

Programmable Controller

MELSEG Q series

QnUCPU User's Manual (Function Explanation, Program Fundamentals)

-Q00UCPU -Q00UJCPU -Q01UCPU -Q02UCPU -Q03UDVCPU -Q03UDCPU -Q03UDECPU -Q04UDVCPU -Q04UDPVCPU -Q04UDHCPU -Q04UDEHCPU -Q06UDVCPU -Q06UDPVCPU -Q06UDHCPU -Q06UDEHCPU -Q10UDHCPU -Q10UDEHCPU -Q13UDVCPU -Q13UDPVCPU -Q13UDHCPU -Q13UDEHCPU -Q20UDHCPU -Q20UDEHCPU -Q26UDVCPU -Q26UDPVCPU

-Q26UDHCPU -Q26UDEHCPU -Q50UDEHCPU -Q100UDEHCPU




SAFETY PRECAUTIONS

(Read these precautions before using this product.)

Before using this product, please read this manual and the relevant manuals carefully and pay full attention to safety to handle the product correctly.

In this manual, the safety precautions are classified into two levels: " / WARNING" and " / CAUTION".

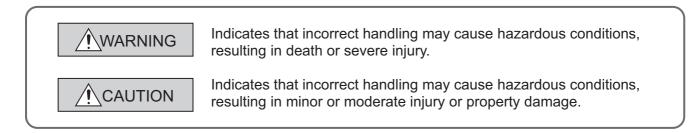

Under some circumstances, failure to observe the precautions given under "A CAUTION" may lead to serious consequences.

Observe the precautions of both levels because they are important for personal and system safety. Make sure that the end users read this manual and then keep the manual in a safe place for future reference.

[Design Precautions]

- Configure safety circuits external to the programmable controller to ensure that the entire system operates safely even when a fault occurs in the external power supply or the programmable controller.
 Failure to do so may result in an accident due to an incorrect output or malfunction.
 - (1) Configure external safety circuits, such as an emergency stop circuit, protection circuit, and protective interlock circuit for forward/reverse operation or upper/lower limit positioning.
 - (2) The programmable controller stops its operation upon detection of the following status, and the output status of the system will be as shown below.

	Q/L series module	AnS/A series module
Overcurrent or overvoltage protection of the power supply module is activated.	All outputs are turned off	All outputs are turned off
The CPU module detects an error such as a watchdog timer error by the self-diagnostic function.	All outputs are held or turned off according to the parameter setting.	All outputs are turned off

All outputs may turn on when an error occurs in the part, such as I/O control part, where the CPU module cannot detect any error. To ensure safety operation in such a case, provide a safety mechanism or a fail-safe circuit external to the programmable controller. For a fail-safe circuit example, refer to General Safety Requirements in the QCPU User's Manual (Hardware Design, Maintenance and Inspection).

(3) Outputs may remain on or off due to a failure of an output module relay or transistor. Configure an external circuit for monitoring output signals that could cause a serious accident.

[Design Precautions]

- In an output module, when a load current exceeding the rated current or an overcurrent caused by a load short-circuit flows for a long time, it may cause smoke and fire. To prevent this, configure an external safety circuit, such as a fuse.
- Configure a circuit so that the programmable controller is turned on first and then the external power supply.

If the external power supply is turned on first, an accident may occur due to an incorrect output or malfunction.

• For the operating status of each station after a communication failure, refer to relevant manuals for the network.

Incorrect output or malfunction due to a communication failure may result in an accident.

When changing data of the running programmable controller from a peripheral connected to the CPU module or from a personal computer connected to an intelligent function module, configure an interlock circuit in the sequence program to ensure that the entire system will always operate safely. For program modification and operating status change, read relevant manuals carefully and ensure the safety before operation.

Especially, when a remote programmable controller is controlled by an external device, immediate action cannot be taken if a problem occurs in the programmable controller due to a communication failure.

To prevent this, configure an interlock circuit in the sequence program, and determine corrective actions to be taken between the external device and CPU module in case of a communication failure.

[Design Precautions]

 Do not install the control lines or communication cables together with the main circuit lines or power cables.

Keep a distance of 100mm or more between them.

Failure to do so may result in malfunction due to noise.

• When a device such as a lamp, heater, or solenoid valve is controlled through an output module, a large current (approximately ten times greater than normal) may flow when the output is turned from off to on.

Take measures such as replacing the module with one having a sufficient current rating.

After the CPU module is powered on or is reset, the time taken to enter the RUN status varies depending on the system configuration, parameter settings, and/or program size. Design circuits so that the entire system will always operate safely, regardless of the time.

[Installation Precautions]

-	-
•	Use the programmable controller in an environment that meets the general specifications in the
	QCPU User's Manual (Hardware Design, Maintenance and Inspection).
	Failure to do so may result in electric shock, fire, malfunction, or damage to or deterioration of the
	product.
•	
	insert the module fixing projection(s) into the hole(s) in the base unit and press the module until it snaps into place.
	Incorrect mounting may cause malfunction, failure, or drop of the module.
	When using the programmable controller in an environment of frequent vibrations, fix the module with a screw.
	Tighten the screw within the specified torque range.
	Undertightening can cause drop of the screw, short circuit, or malfunction.
	Overtightening can damage the screw and/or module, resulting in drop, short circuit, or malfunction.
•	When using an extension cable, connect it to the extension cable connector of the base unit securely.
	Check the connection for looseness.
	Poor contact may cause incorrect input or output.
•	When using a memory card, fully insert it into the memory card slot.
	Check that it is inserted completely.
	Poor contact may cause malfunction.
•	When using an SD memory card, fully insert it into the SD memory card slot.
	Check that it is inserted completely.
	Poor contact may cause malfunction.
•	Securely insert an extended SRAM cassette into the cassette connector of a CPU module.
	After insertion, close the cassette cover to prevent the cassette from coming off.
	Failure to do so may cause malfunction.
•	Shut off the external power supply (all phases) used in the system before mounting or removing a
	module. Failure to do so may result in damage to the product.
	A module can be replaced online (while power is on) on any MELSECNET/H remote I/O station or in
	the system where a CPU module supporting the online module change function is used.
	Note that there are restrictions on the modules that can be replaced online, and each module has its
	predetermined replacement procedure.
	For details, refer to the relevant sections in the QCPU User's Manual (Hardware Design, Maintenance
_	and Inspection) and in the manual for the corresponding module.
•	Do not directly touch any conductive parts and electronic components of the module, memory card,
	SD memory card, or extended SRAM cassette.
	Doing so can cause malfunction or failure of the module.
•	When using a Motion CPU module and modules designed for motion control, check that the
	combinations of these modules are correct before applying power.
	The modules may be damaged if the combination is incorrect.

For details, refer to the user's manual for the Motion CPU module.

[Wiring Precautions]

- Shut off the external power supply (all phases) used in the system before installation and wiring. Failure to do so may result in electric shock or damage to the product.
- After wiring, attach the included terminal cover to the module before turning it on for operation. Failure to do so may result in electric shock.

[Wiring Precautions]

- Individually ground the FG and LG terminals of the programmable controller with a ground resistance of 100Ω or less.
- Failure to do so may result in electric shock or malfunction.
- Use applicable solderless terminals and tighten them within the specified torque range. If any spade solderless terminal is used, it may be disconnected when the terminal screw comes loose, resulting in failure.
- Check the rated voltage and terminal layout before wiring to the module, and connect the cables correctly.

Connecting a power supply with a different voltage rating or incorrect wiring may cause a fire or failure.

- Securely connect the connector to the module. Failure to do so may cause malfunction.
- Connectors for external connection must be crimped or pressed with the tool specified by the manufacturer, or must be correctly soldered.

Incomplete connections could result in short circuit, fire, or malfunction.

• Do not install the control lines or communication cables together with the main circuit lines or power cables.

Keep a distance of 100mm or more between them.

Failure to do so may result in malfunction due to noise.

- Place the cables in a duct or clamp them.
 If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact.
- Check the interface type and correctly connect the cable. Incorrect wiring (connecting the cable to an incorrect interface) may cause failure of the module and external device.
- Tighten the terminal screw within the specified torque range.
 Undertightening can cause short circuit, fire, or malfunction.
 Overtightening can damage the screw and/or module, resulting in drop, short circuit, or malfunction.
- Prevent foreign matter such as dust or wire chips from entering the module. Such foreign matter can cause a fire, failure, or malfunction.
- A protective film is attached to the top of the module to prevent foreign matter, such as wire chips, from entering the module during wiring.
 - Do not remove the film during wiring.

Remove it for heat dissipation before system operation.

[Wiring Precautions]

- When disconnecting the cable from the module, do not pull the cable by the cable part. For the cable with connector, hold the connector part of the cable. For the cable connected to the terminal block, loosen the terminal screw. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.
 Mitsubishi Electric programmable controllers must be installed in control panels.
- Connect the main power supply to the power supply module in the control panel through a relay terminal block.

Wiring and replacement of a power supply module must be performed by maintenance personnel who is familiar with protection against electric shock. For wiring methods, refer to the QCPU User's Manual (Hardware Design, Maintenance and Inspection).

[Startup and Maintenance Precautions]

- Do not touch any terminal while power is on.
 Doing so will cause electric shock or malfunction.
- Correctly connect the battery connector.
 Do not charge, disassemble, heat, short-circuit, solder, or throw the battery into the fire. Also, do not expose it to liquid or strong shock.
 - Doing so will cause the battery to produce heat, explode, ignite, or leak, resulting in injury and fire.
- Shut off the external power supply (all phases) used in the system before cleaning the module or retightening the terminal screws, connector screws, or module fixing screws.
 Failure to do so may result in electric shock or cause the module to fail or malfunction.

[Startup and Maintenance Precautions]

 Before performing online operations (especially, program modification, forced output, and operation status change) for the running CPU module from the peripheral connected, read relevant manuals carefully and ensure the safety.

Improper operation may damage machines or cause accidents.

- Do not disassemble or modify the modules.
 Doing so may cause failure, malfunction, injury, or a fire.
- Use any radio communication device such as a cellular phone or PHS (Personal Handy-phone System) more than 25cm away in all directions from the programmable controller.
 Failure to do so may cause malfunction.

[Startup and Maintenance Precautions]

Shut off the external power supply (all phases) used in the system before mounting or removing a module. Failure to do so may cause the module to fail or malfunction.
 A module can be replaced online (while power is on) on any MELSECNET/H remote I/O station or in the system where a CPU module supporting the online module change function is used.
 Note that there are restrictions on the modules that can be replaced online, and each module has its predetermined replacement procedure.
 For details, refer to the relevant sections in the QCPU User's Manual (Hardware Design, Maintenance and Inspection) and in the manual for the corresponding module.
 After the first use of the product, do not perform each of the following operations more than 50 times

(IEC 61131-2/JIS B 3502 compliant). Exceeding the limit may cause malfunction.

- Mounting/removing the module to/from the base unit
- · Inserting/removing the extended SRAM cassette to/from the CPU module
- Mounting/removing the terminal block to/from the module
- After the first use of the product, do not insert/remove the SD memory card to/from the CPU module more than 500 times. Exceeding the limit may cause malfunction.
- Do not drop or apply shock to the battery to be installed in the module.
 Doing so may damage the battery, causing the battery fluid to leak inside the battery.
 If the battery is dropped or any shock is applied to it, dispose of it without using.
- Before handling the module, touch a grounded metal object to discharge the static electricity from the human body.

Failure to do so may cause the module to fail or malfunction.

[Disposal Precautions]

When disposing of this product, treat it as industrial waste.
 When disposing of batteries, separate them from other wastes according to the local regulations.
 (For details of the battery directive in EU member states, refer to the QCPU User's Manual (Hardware Design, Maintenance and Inspection).)

[Transportation Precautions]

 When transporting lithium batteries, follow the transportation regulations. (For details of the regulated models, refer to the QCPU User's Manual (Hardware Design, Maintenance and Inspection).)

CONDITIONS OF USE FOR THE PRODUCT

(1) MELSEC programmable controller ("the PRODUCT") shall be used in conditions;

i) where any problem, fault or failure occurring in the PRODUCT, if any, shall not lead to any major or serious accident; and

ii) where the backup and fail-safe function are systematically or automatically provided outside of the PRODUCT for the case of any problem, fault or failure occurring in the PRODUCT.

(2) The PRODUCT has been designed and manufactured for the purpose of being used in general industries. MITSUBISHI ELECTRIC SHALL HAVE NO RESPONSIBILITY OR LIABILITY (INCLUDING, BUT NOT LIMITED TO ANY AND ALL RESPONSIBILITY OR LIABILITY BASED ON CONTRACT, WARRANTY, TORT, PRODUCT LIABILITY) FOR ANY INJURY OR DEATH TO PERSONS OR LOSS OR DAMAGE TO PROPERTY CAUSED BY the PRODUCT THAT ARE OPERATED OR USED IN APPLICATION NOT INTENDED OR EXCLUDED BY INSTRUCTIONS, PRECAUTIONS, OR WARNING CONTAINED IN MITSUBISHI ELECTRIC USER'S, INSTRUCTION AND/OR SAFETY MANUALS, TECHNICAL BULLETINS AND GUIDELINES FOR the PRODUCT. ("Prohibited Application")

Prohibited Applications include, but not limited to, the use of the PRODUCT in;

- Nuclear Power Plants and any other power plants operated by Power companies, and/or any other cases in which the public could be affected if any problem or fault occurs in the PRODUCT.
- Railway companies or Public service purposes, and/or any other cases in which establishment of a special quality assurance system is required by the Purchaser or End User.
- Aircraft or Aerospace, Medical applications, Train equipment, transport equipment such as Elevator and Escalator, Incineration and Fuel devices, Vehicles, Manned transportation, Equipment for Recreation and Amusement, and Safety devices, handling of Nuclear or Hazardous Materials or Chemicals, Mining and Drilling, and/or other applications where there is a significant risk of injury to the public or property.

Notwithstanding the above restrictions, Mitsubishi Electric may in its sole discretion, authorize use of the PRODUCT in one or more of the Prohibited Applications, provided that the usage of the PRODUCT is limited only for the specific applications agreed to by Mitsubishi Electric and provided further that no special quality assurance or fail-safe, redundant or other safety features which exceed the general specifications of the PRODUCTs are required. For details, please contact the Mitsubishi Electric representative in your region.

(3) Mitsubishi Electric shall have no responsibility or liability for any problems involving programmable controller trouble and system trouble caused by DoS attacks, unauthorized access, computer viruses, and other cyberattacks.

INTRODUCTION

This manual, "QnUCPU User's Manual (Function Explanation, Program Fundamentals)" describes the memory maps, functions, programs, I/O number assignment, and devices of the Universal model QCPU.

Before using this product, please read this manual and the relevant manuals carefully and develop familiarity with the functions and performance of the Q series programmable controller to handle the product correctly. When applying the program examples introduced in this manual to the actual system, ensure the applicability and confirm that it will not cause system control problems.

Relevant CPU module

CPU module	Model
	Q00U(J)CPU, Q01UCPU, Q02UCPU, Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU,
Universal model QCPU	Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU,
	Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU,
	Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU, Q50UDEHCPU, Q100UDEHCPU

Remark

This manual does not describe the specifications of the power supply modules, base units, extension cables, memory cards, SD memory cards, extended SRAM cassettes, batteries as well as the lists of error codes, special relay, and special register. For details, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

For multiple CPU systems, refer to the following.

QCPU User's Manual (Multiple CPU System)

Memo

SAFETY PRECAUTIONS 1
CONDITIONS OF USE FOR THE PRODUCT
INTRODUCTION
MANUALS
MANUAL PAGE ORGANIZATION
TERMS

PART 1 PROGRAMMING

CHAPTER	1 BAS	SIC PROCEDURE FOR PROGRAMMING	26
1.1	Syst	em Configuration Example	
1.2	Crea	ating a Project	
1.3	Crea	ating a Program	
	1.3.1	Prior knowledge for creating a program	
	1.3.2	How to create a program	
1.4	Con	verting a Program	
1.5	Writi	ing a Project to the CPU Module	
	1.5.1	Formatting a memory	
	1.5.2	Writing to the CPU module	
1.6	Che	cking an Operation of the CPU Module	
1.7	Savi	ng a Project	

35

CHAPTER 2 APPLICATION OF PROGRAMMING

2.1	Mem	ory and Files
	2.1.1	Memory configuration and storable data
	2.1.2	Parameter-valid drive
	2.1.3	Files
2.2	Base	Unit Assignment
	2.2.1	Base mode
	2.2.2	Base unit assignment setting
2.3	I/O N	lumber Assignment
	2.3.1	Concept of I/O number assignment
	2.3.2	Setting I/O numbers
	2.3.3	I/O number setting example
	2.3.4	Checking I/O numbers
2.4	Scan	Time Structure
	2.4.1	Initial Processing
	2.4.2	I/O Refresh (Refresh Processing with Input/Output Modules)
	2.4.3	Program Operation
	2.4.4	END Processing
2.5	Oper	ation Processing in the RUN, STOP, or PAUSE Status
2.6	Oper	ation Processing during Momentary Power Failure
2.7	Data	Clear Processing
2.8	I/O P	rocessing and Response Delay
	2.8.1	Refresh mode

	2.8.2	Direct mode	
2.9	Interr	rupt Program	
2.10	Settir	ngs When Program is Divided	
	2.10.1	Initial execution type program	
	2.10.2	Scan execution type program	
	2.10.3	Stand-by type program	
	2.10.4	Fixed scan execution type program	
	2.10.5	Changing the program execution type	
2.11	Boot	Operation	
2.12	Progr	ramming Language	
2.13	Com	munications with Intelligent Function Modules	
2.14	Acce	ss to the AnS/A Series Special Function Modules	

PART 2 FUNCTIONS

CHAPTER 3 FUNCTIONS

rer 3	3 FUN	ICTIONS	112
3.1	Func	tion List	
3.2	Cons	stant Scan	
3.3	Latch	n Function	
3.4	Outp	ut Mode at Operating Status Change (STOP to RUN)	
3.5	Clock	k Function	
3.6	Remo	ote Operation	131
	3.6.1	Remote RUN/STOP	131
	3.6.2	Remote PAUSE	134
	3.6.3	Remote RESET	136
	3.6.4	Remote latch clear	137
	3.6.5	Relationship between remote operation and RUN/STOP status of the CPU mode	ule 138
3.7	Q Se	ries-compatible Module Input Response Time Selection (I/O Response Time))
3.8	Error	Time Output Mode Setting	
3.9	H/W	Error Time PLC Operation Mode Setting	
3.10	Intelli	igent Function Module Switch Setting.	
3.11	Monit	tor Function	
	3.11.1	Monitor condition setting	146
	3.11.2	Local device monitor/test	151
	3.11.3	External input/output forced on/off	154
	3.11.4	Executional conditioned device test	159
3.12	Writir	ng Programs While CPU Module is in RUN Status	
	3.12.1	Online change (ladder mode)	168
	3.12.2	Online change (files)	171
	3.12.3	Precautions for online change	173
3.13	Exec	cution Time Measurement	
	3.13.1	Program monitor list	
	3.13.2	Interrupt program monitor list	
	3.13.3	Scan time measurement	
3.14	Samp	pling Trace Function	

3.15 Debug from Multiple Programming Tools	
3.15.1 Simultaneous monitoring from multiple programming	tools
3.15.2 Online change from multiple programming tools	
3.16 Watchdog Timer (WDT)	
3.17 Self-diagnostic Function	
3.17.1 LEDs indicating errors	
3.17.2 Clearing errors	
3.18 Error History	
3.19 Security Function	
3.19.1 Password registration.	
3.19.2 File password 32	
3.19.3 File access control by security key	
3.19.4 Remote password	
3.20 LED Indication	
3.20.1 Methods for turning off the LEDs	
3.20.2 LED indication priority	
3.21 High-Speed Interrupt Function	
3.21.1 High-speed interrupt program execution function	
3.21.2 High-speed I/O refresh function and high-speed buffe	
3.21.3 Precautions	
3.22 Interrupt from Intelligent Function Module	
3.23 Serial Communication Function	
3.24 Service Processing.	
3.24 Service Processing	
3.25 Initial Device Value	
3.26 Battery Life-prolonging Function	
3.27 Memory Check Function	
3.28 Program Cache Memory Auto Recovery Function	
3.29 Latch Data Backup to Standard ROM	
3.30 Writing/Reading Device Data to/from Standard ROM	
3.31 CPU Module Change Function with Memory Card	
3.31.1 Data backup for the CPU module change function	
3.31.2 Restoration for the CPU module change function	
3.32 CPU Module Data Backup/restoration Function	
3.32.1 Backup function	
3.32.2 Restoration function	
3.33 Module Model Name Read	
3.34 Module Error Collection	
3.35 Local Device Batch Read Function	
3.36 Send Points Extension Function (CC-Link IE Controller I	Network Module)
3.37 Write-Protect Function for Device Data (from Outside the	e CPU Module)
3.37.1 Setting method	
3.37.2 Target devices	
3.37.3 Operations and functions that cannot be executed for	r devices in write-protected range 309
3.37.4 Precautions	
3.38 Operation History Function	

	3.38.1	Operation history save function	316
	3.38.2	Operation history display	326
	3.38.3	Operation history clear function	326
	3.38.4	Precautions	327
	3.38.5	List of operation codes	328
3.39	iQ Se	nsor Solution Function	334

PART 3 DEVICES, CONSTANTS

CHAPTER 4 DEVICES 336 4.1 .336 Device List 4.2 421 4.2.2 4.2.3 424 4.2.5 4.2.6 4.2.7 4.2.8 4.2.9 4.2.10 4.2.11 4.2.12 4.2.13 4.2.14 4.3 4.3.1 4.3.2 4.3.3 4.4 4.5 4.5.1 4.5.2 4.6 4.6.1 4.6.2 Switching from the scan execution type to the interrupt/fixed scan execution type program 4.6.3 4.7 4.7.1 4.7.2 4.7.3 4.7.4 4.7.5 4.7.6

4.8	Exter	nded Data Register (D) and Extended Link Register (W)	
4.9	Nest	ting (N)	
4.10	Point	er (P)	
	4.10.1	Local pointer	409
	4.10.2	Common pointer	411
4.11	Interr	rupt Pointer(I)	412
	4.11.1	List of interrupt pointer numbers and interrupt factors	413
4.12	Other	r Devices	415
	4.12.1	SFC block device (BL)	415
	4.12.2	Network No. specification device (J)	415
	4.12.3	I/O No. specification device (U)	
	4.12.4	Macro instruction argument device (VD)	416

CHAPTER 5 CONSTANTS 417		417
5.1	Decimal Constant (K)	
5.2	Hexadecimal Constant (H)	
5.3	Real Number (E)	
5.4	Character String (" ")	

CHAPTER 6	CONVENIENT USAGE OF DEVICES	420
6.1	Global Device	
6.2	Local Device	

APPENDICES

Appendix 1 Parameters .	
Appendix 1.1 List of	parameter numbers
Appendix 1.2 PLC p	parameters
Appendix 1.2.1	PLC name
Appendix 1.2.2	PLC system
Appendix 1.2.3	PLC file
Appendix 1.2.4	PLC RAS
Appendix 1.2.5	Boot file
Appendix 1.2.6	Program
Appendix 1.2.7	SFC
Appendix 1.2.8	Device
Appendix 1.2.9	I/O assignment
Appendix 1.2.10	Multiple CPU setting
Appendix 1.2.11	Built-in Ethernet port setting
Appendix 1.2.12	Serial communication
Appendix 1.2.13	Acknowledge XY assignment
Appendix 1.3 Netwo	ork Parameters
Appendix 1.3.1	CC-Link IE Controller Network setting
Appendix 1.3.2	CC-Link IE Field Network setting
Appendix 1.3.3	MELSECNET/H setting
Appendix 1.3.4	Ethernet setting

Appendix 7	1.3.5 CC-Link setting	. 464
Appendix 1.4	Remote Password	. 465
Appendix 2 Functi	tions Added or Changed by Version Upgrade	.467
Appendix 3 CPU N	Module Processing Time	.471
Appendix 3.1	Scan time structure	. 471
Appendix 3.2	Time required for each processing included in scan time	. 472
Appendix 3.3	Factors that increase the scan time	. 483
Appendix 4 Data U	Used in Sequence Programs	.494
Appendix 4.1	BIN (Binary Code)	. 496
Appendix 4.2	HEX (Hexadecimal)	. 497
Appendix 4.3	BCD (Binary-coded Decimal)	. 498
Appendix 4.4	Real number (Floating-point data)	. 499
Appendix 4.5	Character string data	. 503
Appendix 5 Repla	acing Basic Model QCPU or Qn(H)CPU with QnUCPU	.504
Appendix 5.1	Replacement precautions	. 504
Appendix \$	5.1.1 Replacing Basic model QCPU with Universal model QCPU	. 504
Appendix \$	5.1.2 Replacing High Performance model QCPU with Universal model QCPU .	. 508
Appendix 5.2	Applicable devices and software	. 515
Appendix 5.3	Instructions	. 520
Appendix 8	5.3.1 Instructions not supported in the Universal model QCPU and replacing me	ethods
		. 520
Appendix \$		
		. 522
Appendix (5.3.3 Program replacement examples	. 522 . 523
Appendix 5.4	5.3.3 Program replacement examples	. 522 . 523 . 537
Appendix 5 Appendix 5.4 Appendix 5	5.3.3 Program replacement examples Functions	. 522 . 523 . 537
Appendix 5.4	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537
Appendix 5 Appendix 5.4 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 537
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548
Appendix 5 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 544 . 548 . 552 . 554 . 557 . 560 . 564
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564 . 567
Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5 Appendix 5 Appendix 5 Appendix 5	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564 . 567 . 569
Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5 Appendix 5 Appendix 5 Appendix 6	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564 . 567 . 569 . 569
Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5.5 Appendix 5.5 Appendix 5.5 Appendix 5.5 Appendix 6 Appendix 6 Appendix 6.1 Appendix 7 Preca	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564 . 567 . 569 . 569 . 573
Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5 Appendix 5 Appendix 6 Appendix 6.1 Appendix 7 Precat	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 564 . 567 . 569 . 569 . 573 . 573
Appendix 5.4 Appendix 5.4 Appendix 5.4 Appendix 5 Appendix 5 Appendix 5 Appendix 5.5 Appendix 5.5 Appendix 5.5 Appendix 6 Appendix 6 Appendix 6.1 Appendix 7 Precar Appendix 8 Precar Appendix 8 Precar	 5.3.3 Program replacement examples	. 522 . 523 . 537 . 537 . 544 . 548 . 552 . 554 . 557 . 560 . 564 . 567 . 569 . 569 . 573 . 573 . 574

INDEX	577
REVISIONS	581
WARRANTY	585

MANUALS

To understand the main specifications, functions, and usage of the CPU module, refer to the basic manuals. Read other manuals as well when using a different type of CPU module and its functions. Order each manual as needed, referring to the following list.

• :Basic manual, O :Other CPU module manuals/Use them to utilize functions.

(1) CPU module user's manual

Manual name <manual (model="" code)="" number=""></manual>	Description		
QCPU User's Manual (Hardware Design, Maintenance and Inspection) <sh-080483eng (13jr73)=""></sh-080483eng>	Specifications of the hardware (CPU modules, power supply modules, base units, extension cables, memory cards, SD memory cards, extended SRAM cassettes, and batteries), system maintenance and inspection, troubleshooting, and error codes	•	
QCPU User's Manual (Multiple CPU System) <sh-080485eng (13jr75)=""></sh-080485eng>	Information on building multiple CPU systems (system configurations, I/O numbers, communications between CPU modules, and communications with I/O modules and intelligent function modules)	•	
QnUCPU User's Manual (Communication via Built-in Ethernet Port) <sh-080811eng (13jz29)=""></sh-080811eng>	Detailed description of communication via the built-in Ethernet ports of the CPU module	0	
QnUDVCPU/LCPU User's Manual (Data Logging Function) <sh-080893eng (13jz39)=""></sh-080893eng>	Detailed description of the data logging function of the CPU module	0	

(2) Programming manual

Manual name <manual (model="" code)="" number=""></manual>	Description	Manual type
QCPU/LCPU Programming Manual (Common Instruction) <sh-080809eng (13jw10)=""></sh-080809eng>	Detailed description and usage of instructions used in programs	•
MELSEC-Q/L/QnA Programming Manual (SFC) <sh-080041 (13jf60)=""></sh-080041>	System configuration, specifications, functions, programming, and error codes for SFC (MELSAP3) programs	0
MELSEC-Q/L Programming Manual (MELSAP-L) <sh-080076 (13jf61)=""></sh-080076>	System configuration, specifications, functions, programming, and error codes for SFC (MELSAP-L) programs	0
MELSEC-Q/L Programming Manual (Structured Text) <sh-080366e (13jf68)=""></sh-080366e>	System configuration and programming using structured text language	0
MELSEC-Q/L/QnA Programming Manual (PID Control Instructions) <sh-080040 (13jf59)=""></sh-080040>	Dedicated instructions for PID control	0
MELSEC-Q Programming/Structured Programming Manual (Process Control Instructions) <sh-080316e (13jf67)=""></sh-080316e>	Dedicated instructions for process control	0

(3) Operating manual

Manual name <manual (model="" code)="" number=""></manual>	Description		
GX Works2 Version1 Operating Manual (Common) <sh-080779eng (13ju63)=""></sh-080779eng>	System configuration, parameter settings, and online operations of GX Works2, which are common to Simple projects and Structured projects	٠	
GX Developer Version 8 Operating Manual <sh-080373e (13ju41)=""></sh-080373e>	Operating methods of GX Developer, such as programming, printing, monitoring, and debugging	0	

(4) I/O module and intelligent function module manual

Manual name <manual (model="" code)="" number=""></manual>	Description		
MELSEC-Q CC-Link IE Controller Network Reference Manual <sh-080668eng (13jv16)=""></sh-080668eng>	Specifications, procedures and settings before system operation, parameter setting, programming, and troubleshooting of the CC-Link IE Controller Network module	0	
MELSEC-Q CC-Link IE Field Network Master/Local Module User's Manual <sh-080917eng (13jz47)=""></sh-080917eng>	Specifications, procedures and settings before system operation, parameter setting, programming, and troubleshooting of the CC-Link IE Field Network module	0	
Q Corresponding MELSECNET/H Network System Reference Manual (PLC to PLC network) <sh-080049 (13jf92)=""></sh-080049>	Specifications, procedures and settings before system operation, parameter setting, programming, and troubleshooting of a MELSECNET/H network system (PLC to PLC network)	0	
Q Corresponding MELSECNET/H Network System Reference Manual (Remote I/O network) <sh-080124 (13jf96)=""></sh-080124>	Specifications, procedures and settings before system operation, parameter setting, programming, and troubleshooting of a MELSECNET/H network system (remote I/O network)	0	
Q Corresponding Ethernet Interface Module User's Manual (Basic) <sh-080009 (13jl88)=""></sh-080009>	Specifications, procedures for data communication with external devices, line connection (open/close), fixed buffer communication, random access buffer communication, and troubleshooting of the Ethernet module		
MELSEC-Q/L Ethernet Interface Module User's Manual (Application) <sh-080010 (13jl89)=""></sh-080010>	E-mail function, programmable controller CPU status monitoring function, communication via CC-Link IE Field Network, CC-Link IE Controller Network, MELSECNET/H, or MELSECNET/10, communication using the data link instructions, and file transfer function (FTP server) of the Ethernet module	0	
MELSEC-Q CC-Link System Master/Local Module User's Manual <sh-080394e (13jr64)=""></sh-080394e>	System configuration, performance specifications, functions, handling, wiring, and troubleshooting of the QJ61BT11N	0	
Q Corresponding Serial Communication Module User's Manual (Basic) <sh-080006 (13jl86)=""></sh-080006>	Overview, system configuration, specifications, procedures before operation, basic data communication method with external devices, maintenance and inspection, and troubleshooting for using the serial communication module	0	
MELSEC-Q/L Serial Communication Module User's Manual (Application) <sh-080007 (13jl87)=""></sh-080007>	Special functions (specifications, usage, and settings) and data communication method with external devices of the serial communication module	0	

(5) Others

Manual name <manual (model="" code)="" number=""></manual>	Description	Manual type
MELSEC Communication Protocol Reference Manual <sh-080008 (13jf89)=""></sh-080008>	Communication method using the MC protocol, which reads/writes data to/from the CPU module via the serial communication module or Ethernet module	0
iQ Sensor Solution Reference Manual <sh-081133eng (13jv28)=""></sh-081133eng>	Operating methods of iQ Sensor Solution, such as programming and monitoring	0
CC-Link IE Field Network Basic Reference Manual <sh-081684eng (13jx62)=""></sh-081684eng>	Specifications, procedures before operation, system configuration, programming, functions, parameter settings, and troubleshooting of CC-Link IE Field Network Basic	0

MANUAL PAGE ORGANIZATION

In this manual, pages are organized and the symbols are used as shown below. The following page illustration is for explanation purpose only, and is different from the actual pages.

"" is used for screen names and items.	(1) Setting par (a) Operating 1. Open ti Soft	ng method ameters	TER 7 JARIOUS SETTINGS		 The chapter of the current page is shown.
Shows mouse operations. ^{*1} [] is used for items in the menu bar and the project window.		rea form Technological for the plane (the last sectors) the term ter	7		
	Type Model Name Ponts Start XY Joha Starte Jona Market Jona Market	Select the type of the connected module. Select the number of pairs angular base and at Select the number of pairs angular base hald. Sector start 10 number for salah std. Configure the salah start of the tails in I/O or intelligent function modules. Set the following. - Error Time Coget Mode - R/C Operation Mode at HVI Error - 10 Response Time	Page 74, Section 7.1.2 Page 74, Section 7.1.2 Page 74, Section 7.1.4 Page 74, Section 7.1.5 Page 74, Section 7.1.5 Page 74, Section 7.1.7 Page 75, Section 7.1.7 Page 76, Section 7.1.7	Ĺ	The section of the current page is shown.
Ex. shows setting or operating examples. Image: shows reference manuals.	Ex When "10 range of an inpu For details, refe	Y ^{or} enables modification on the start I/O numbers assigned to connected 000 is specified in 'Start X/O'' to the slot where a 16-point module is con it module is changed to X1000 to X100F. If to the following, I, CPU Module User's Manual (Function Explanation, Program Fundam	d modules. Innected, the assignment		
ເ∠ு shows reference pages.	Remark •••	The concected module in Type? Setting a different type metule in SPUUIT LA tert function module, the UG parter must also be the same in addition to the IO a 80, Section 4.2.2) upper termodule is connected, IO assignment can be omitted by selecting connected and in the Project services.	ssignment setting.		 Point Pshows notes that requires attention. Remark shows useful information.
			73		

*1 The mouse operation example is provided below. (For GX Works2)

	MELSUFI Series GX Wor	KSZ (Un:	set Project) - [[PRG] MAIN]
	: <u>P</u> roject <u>E</u> dit <u>F</u> ind/Replace	<u>C</u> ompile	<u>V</u> iew <u>O</u> nline De <u>b</u> ug <u>D</u> iagnos
Menu bar	i 🗅 🖻 💾 🚽 i 🔏 🗈 🖆 🖛	M	🔄 🖙 🖛 👧 👧 🗮 🔜 🗋
Ex. Conline]		_	
Select [Online] on the menu bar,			
and then select [Write to PLC].	Navigation	τ×	🔂 [PRG] MAIN 🔀
A window selected in the view selection area is displayed. Ex.	Project Project Parameter Inteligent Function Module Global Device Comment Program Setting Program Cocal Device Comment Device Memory Device Memory Device Memory Device Mitial Value User Library Connection Destination	×	0
			Unlabeled
			Sindbolod

Icon Universal model QCPU	- Description	
Universal	Icons indicate that specifications described on the page contain some precautions.	

TERMS

Unless otherwise specified, this manual uses the following generic terms and abbreviations.

*□ indicates a part of the model or version.

(Example): Q33B, Q35B, Q38B, Q312B \rightarrow Q3 \Box B

Generic term/abbreviation	Description
CPU module type	
CPU module	Generic term for the Universal model QCPU
High Performance model QCPU	Generic term for the Q02CPU, Q02HCPU, Q06HCPU, Q12HCPU, Q25HCPU
Process CPU	Generic term for the Q02PHCPU, Q06PHCPU, Q12PHCPU, Q25PHCPU
Universal model QCPU	Generic term for the Q00UJCPU, Q00UCPU, Q01UCPU, Q02UCPU, Q03UDCPU, Q03UDVCPU, Q03UDECPU, Q04UDHCPU, Q04UDVCPU, Q04UDPVCPU, Q04UDEHCPU, Q06UDHCPU, Q06UDVCPU, Q06UDEHCPU, Q10UDHCPU, Q10UDEHCPU, Q13UDHCPU, Q13UDHCPU, Q13UDEHCPU, Q20UDEHCPU, Q26UDVCPU, Q26UDVCPU, Q26UDVCPU, Q26UDPVCPU, Q26UDEHCPU, Q50UDEHCPU, and Q100UDEHCPU
Built-in Ethernet port QCPU	Generic term for the Q03UDVCPU, Q03UDECPU, Q04UDVCPU, Q04UDPVCPU, Q04UDEHCPU, Q06UDVCPU, Q06UDPVCPU, Q06UDEHCPU, Q10UDEHCPU, Q13UDVCPU, Q13UDPVCPU, Q13UDEHCPU, Q20UDEHCPU, Q26UDVCPU, Q26UDPVCPU, Q26UDEHCPU, Q50UDEHCPU, and Q100UDEHCPU
High-speed Universal model QCPU	Generic term for the Q03UDVCPU, Q04UDVCPU, Q06UDVCPU, Q13UDVCPU, and Q26UDVCPU
Universal model Process CPU	Generic term for the Q04UDPVCPU, Q06UDPVCPU, Q13UDPVCPU, and Q26UDPVCPU
Motion CPU	Generic term for the Mitsubishi Electric motion controllers: Q172CPUN, Q173CPUN, Q172HCPU, Q173HCPU, Q172CPUN-T, Q173CPUN-T, Q172HCPU-T, Q172DCPU, Q173DCPU, Q172DCPU-S1, Q173DCPU-S1, Q172DSCPU, and Q173DSCP
PC CPU module	Abbreviation for the MELSEC-Q series-compatible PC CPU module manufactured by CONTEC Co., Ltd., PPC-CPU852(MS)-512
C Controller module	Generic term for the C Controller modules: Q06CCPU-V, Q06CCPU-V-B, Q12DCCPU-V, Q24DHCCPU-V, and Q24DHCCPU-LS
CPU module model	
Qn(H)CPU	Generic term for the Q02CPU, Q02HCPU, Q06HCPU, Q12HCPU, Q25HCPU
QnPHCPU	Generic term for the Q02PHCPU, Q06PHCPU, Q12PHCPU, Q25PHCPU
QnU(D)(H)CPU	Generic term for the Q00UJCPU, Q00UCPU, Q01UCPU, Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, and Q26UDHCPU
QnUD(H)CPU	Generic term for the Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, and Q26UDHCPU
QnUDVCPU	Generic term for the Q03UDVCPU, Q04UDVCPU, Q06UDVCPU, Q13UDVCPU, and Q26UDVCPU
QnUDPVCPU	Generic term for the Q04UDPVCPU, Q06UDPVCPU, Q13UDPVCPU, and Q26UDPVCPU
QnUDE(H)CPU	Generic term for the Q03UDECPU, Q04UDEHCPU, Q06UDEHCPU, Q10UDEHCPU, Q13UDEHCPU, Q20UDEHCPU, Q26UDEHCPU, Q50UDEHCPU, and Q100UDEHCPU
QnUD(E)(H)CPU	Generic term for the Q03UDCPU, Q03UDECPU, Q04UDHCPU, Q04UDEHCPU, Q06UDHCPU, Q06UDHCPU, Q10UDHCPU, Q10UDEHCPU, Q13UDHCPU, Q13UDEHCPU, Q20UDHCPU, Q20UDEHCPU, Q26UDHCPU, Q26UDEHCPU, Q50UDEHCPU, and Q100UDEHCPU

Generic term/abbreviation	Description
Base unit type	
Base unit	Generic term for the main base unit, extension base unit, slim type main base unit, redundan power main base unit, redundant power extension base unit, and multiple CPU high speed main base unit
Main base unit	Generic term for the Q3□B, Q3□SB, Q3□RB, and Q3□DB
Extension base unit	Generic term for the Q5⊡B, Q6⊡B, Q6□RB, QA1S5⊡B, QA1S6⊡B, QA1S6⊡B, QA1S6ADP+A1S5⊡B/A1S6⊡B, QA6⊡B, and QA6ADP+A5⊡B/A6⊡B
Slim type main base unit	Another name for the Q3□SB
Redundant power main base unit	Another name for the Q3□RB
Redundant power extension base unit	Another name for the Q6□RB
Multiple CPU high speed main base unit	Another name for the Q3□DB
Base unit model	
Q3□B	Generic term for the Q33B, Q35B, Q38B, and Q312B main base units
Q3⊡SB	Generic term for the Q32SB, Q33SB, and Q35SB slim type main base units
Q3□RB	Another name for the Q38RB main base unit for redundant power supply system
Q3DB	Generic term for the Q35DB , Q38DB and Q312DB multiple CPU high speed main base uni
Q5⊡B	Generic term for the Q52B and Q55B extension base units
Q6□B	Generic term for the Q63B, Q65B, Q68B, and Q612B extension base units
Q6□RB	Another name for the Q68RB extension base unit for redundant power supply system
QA1S5□B	Another name for the QA1S51B extension base unit
QA1S6□B	Generic term for the QA1S65B and QA1S68B extension base units
QA6DB	Generic term for the QA65B and QA68B extension base units
A5□B	Generic term for the A52B, A55B, and A58B extension base units
A6□B	Generic term for the A62B, A65B, and A68B extension base units
QA6ADP+A5□B/A6□B	Abbreviation for A large type extension base unit where the QA6ADP is mounted
QA1S6ADP+A1S5□B/A1S6□B	Abbreviation for A small type extension base unit where the QA1S6ADP is mounted
Power supply module	
Power supply module	Generic term for the Q series power supply module, slim type power supply module, and redundant power supply module
Q series power supply module	Generic term for the Q61P-A1, Q61P-A2, Q61P, Q61P-D, Q62P, Q63P, Q64P, and Q64PN power supply modules
Slim type power supply module	Abbreviation for the Q61SP slim type power supply module
Redundant power supply module	Generic term for the Q63RP and Q64RP power supply modules for redundant power suppl system
Network module	
CC-Link IE module	Generic term for the CC-Link IE Controller Network module and CC-Link IE Field Network module
MELSECNET/H module	Abbreviation for the MELSECNET/H network module
Ethernet module	Abbreviation for the Ethernet interface module
CC-Link module	Abbreviation for the CC-Link system master/local module
Network	· ·
CC-Link IE	Generic term for the CC-Link IE Controller Network and CC-Link IE Field Network
MELSECNET/H	Abbreviation for the MELSECNET/H network system
Memory extension	, ,
Memory card	Generic term for the SRAM card, Flash card, and ATA card
SRAM card	Generic term for the Q2MEM-1MBSN, Q2MEM-1MBS, Q2MEM-2MBSN, Q2MEM-2MBS, Q3MEM-4MBS, and Q3MEM-8MBS SRAM cards

Generic term/abbreviation	Description
Flash card	Generic term for the Q2MEM-2MBF and Q2MEM-4MBF Flash cards
ATA card	Generic term for the Q2MEM-8MBA, Q2MEM-16MBA, and Q2MEM-32MBA ATA cards
SD memory card	Generic term for the NZ1MEM-2GBSD, NZ1MEM-4GBSD, NZ1MEM-8GBSD, NZ1MEM- 16GBSD, L1MEM-2GBSD, and L1MEM-4GBSD Secure Digital memory cards. This is a non-volatile memory card.
Extended SRAM cassette	Generic term for the Q4MCA-1MBS, Q4MCA-2MBS, Q4MCA-4MBS, and Q4MCA-8MBS extended SRAM cassettes
Software package	
Programming tool	Generic term for GX Works2 and GX Developer
GX Works2	Product name for MELSEC programmable controller software package
GX Developer	Product name for MELSEC programmable controller software package
Others	
MC protocol	Abbreviation for the MELSEC communication protocol. The MELSEC communication protocol is a communication method to access from an external device to the CPU module according to the communication procedure for the Q series programmable controller (such as a serial communication module, Ethernet module).
QA6ADP	Abbreviation for the QA6ADP QA conversion adapter module
QA1S6ADP	Generic term for the QA1S6ADP and QA1S6ADP-S1 Q-AnS base unit conversion adapters
Extension cable	Generic term for the QC05B, QC06B, QC12B, QC30B, QC50B, and QC100B extension cables
Battery	Generic term for the Q6BAT, Q7BATN, Q7BAT, and Q8BAT CPU module batteries, Q2MEM- BAT SRAM card battery, and Q3MEM-BAT SRAM card battery
GOT	Generic term for Mitsubishi Electric Graphic Operation Terminal, GOT-A*** series, GOT-F*** series, GOT1000 series, and GOT2000 series


PART 1 PROGRAMMING

In this part, fundamental knowledge of programming is described.

CHAPTER 1 BASIC PROCEDURE FOR PROGRAMMING	26
CHAPTER 2 APPLICATION OF PROGRAMMING	35


CHAPTER 1 BASIC PROCEDURE FOR PROGRAMMING

This chapter describes the basic procedure for programming.

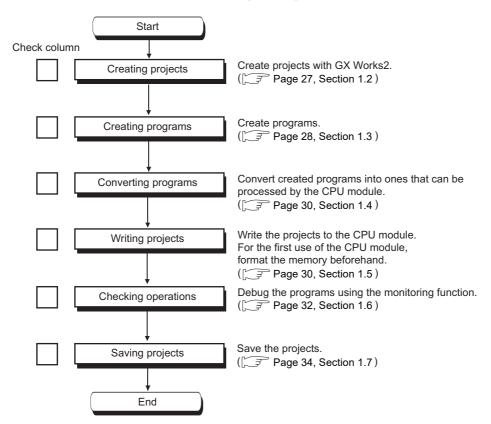

1.1 System Configuration Example

The following system configuration is used for description throughout this chapter.

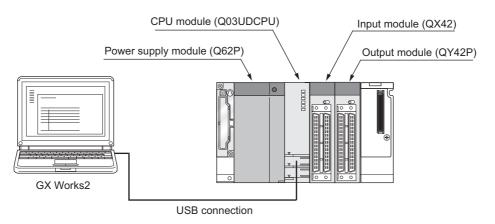

Wiring of the power supply module and I/O modules are omitted in this illustration.

1.2 Creating a Project

A project is a set of information, such as programs and parameters, which is necessary to operate a programmable controller.

The following two projects are available.

- Simple project
- Structured project

Create a new project using GX Works2.

♥ [Project] ⇒ [New...]

New Project	_		
Project Type:			ОК
Simple Project		-	Cancel
	🔲 Use Label		
PLC <u>S</u> eries:			
QCPU (Q mode)		-	
PLC <u>T</u> ype:			
Q03UD		-	
Language:			
Ladder		-	

	ltem	Description
Pro	oject Type	Select a type of project to create. In this chapter, "Simple Project" is selected.
	Use Label	Select this checkbox when using a label for programming. In this chapter, this is not selected.
PL	C Series	Select a series of the CPU module to use in the project. In this chapter, "QCPU (Q mode)" is selected.
PL	С Туре	Select a type of the CPU module (CPU module model) to use in the project. In this chapter, "Q03UD" is selected.
Lar	nguage	Select a language of the program data to use for the new project. In this chapter, "Ladder" is selected.

Point *P*

When perform communication between a programming tool and a CPU module through GOT or a network module, check the PLC type because the modules could be connected with incorrect model names. If the modules are connected with incorrect model names, data may not be written or read properly.


1

1.3.1 Prior knowledge for creating a program

(1) Device and constants

Devices and constants, such as shown below, are used for creating a program.

([Page 336, CHAPTER 4)

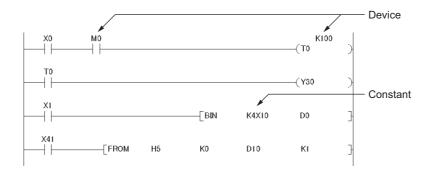

(2) Concept of I/O numbers

I/O numbers are automatically assigned.

Power supply module	CPU module	Input module	Output module	Empty
		64 points	64 points	
		X0000 to X003F	Y0040 to Y007F	

Users can also assign I/O numbers according to their purposes. ([] Page 52, Section 2.2)

(3) Program configuration

A main routine program, subroutine program, (Page 69, Section 2.4.3), and interrupt program (Page 82, Section 2.9) can be included in a program.

1.3.2 How to create a program

\min [PRG] MAIN

0

Enter Symbol

-|/|-+| |+ +|/|+ ▼ ×10

 \downarrow

This section shows how to create the following sample program.



OK Exit

) When X10 is turned on, Y20 turns on.

- **1.** To enter X10, type X10 at the original cursor position and select the contact shown in the left figure.
- **2.** To enter Y20, type Y20 and select the coil shown in the left figure.

🖬 [PRG] 🛚	AIN		
		(Y20)
0		-[END	}

 \downarrow

The program has been created. In the next procedure, convert the program.

1.4 Converting a Program

Operation of a program is defined after converting its ladder.

🏷 [Compile]⇔[Build]

The program has been converted. In the next procedure, write the program to a CPU module.



- To use a label, the program must be compiled.
 GX Works2 Version 1 Operating Manual (Common)
- After modifying a program, it must be compiled.

1.5 Writing a Project to the CPU Module

Write a project to the CPU module. Note that, if the project is new, the memory (Page 35, Section 2.1.1) needs to be formatted first.

1.5.1 Formatting a memory

To format a memory, open the "Format PLC Memory" dialog box. In this chapter, a program memory is formatted so that a program can be written to it.


Format PLC Memory	
Connection Channel List Connection Interface USB Target PLC Network No. D Station No. Host	<> PLC Module PLC Type Q03UD
Target Memory Program Memory]
Format Type	
• Do not create a user setting system area (the required)	uired system area only)
C Create a user setting system area	
High speed monitor area from other station	0 K Steps (015K Steps)
Online change area of multiple blocks	K Steps
	Execute Close

[™] [Online] <> [PLC Memory Operation] <> [Format PLC Memory...]

To check the capacity of the memory after formatting, open the "Online Data Operation" dialog box.

1.5.2 Writing to the CPU module

Open the "Online Data Operation" dialog box. In this chapter, a project is written to the program memory.

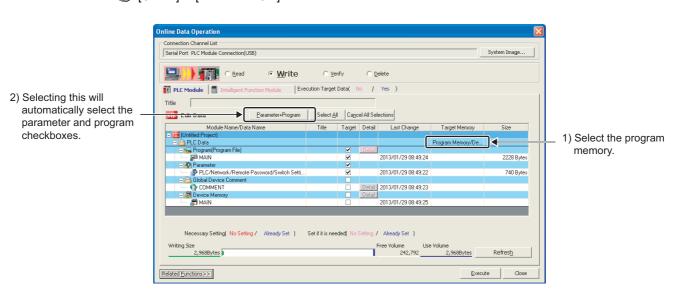

[™] [Online] ⇔ [Write to PLC...]

The project has been written. In the next procedure, execute the program.

Point /

Note that parameter setting is required to operate CPU modules. In this chapter, the procedure for parameter setting is not introduced since default values are used. (Figure 431, Appendix 1)


1

1.6 Checking an Operation of the CPU Module

To check an operation, execute the program written to the CPU module. In this chapter, operation is checked through the monitoring screen of GX Works2.


(1) Executing a program

Before operating the CPU module, data written to the CPU module must be validated. To validate, power off and then on or reset the CPU module.



- **1.** Before resetting the CPU module, check the current LED status.
- 2. Move the switch on the front of the CPU module to the RESET position. (One second or longer)
- **3.** Hold the switch until the ERR. LED turns off after flashing.

In the next procedure, run the CPU module. To run, use the switch on the CPU module.



4. Move the switch to the RUN position.

When the RUN LED is lit green, the program is being executed successfully.

Point *P*

By remote operation, CPU modules can be operated without using switches. ([] Page 131, Section 3.6)

(2) Checking operation

Conductivity and power distribution status of contacts and coils can be checked by switching GX Works2 to the monitor mode.

℃ [Online] ⇒ [Monitor] ⇒ [Start Monitoring]

EPRG] MAIN		
	×1 	(Y10)
3		VYIE
	Monitor Status Monitor Status Image:	Qvif (
6		[END]

When X0 and X1 are turned on, Y10 turns on. (to turn on X0 and X1, place the cursor on them and double-click while holding the Shift key.) While contacts and coils are conducting, they are shown in blue.

Debug can be performed by forcibly turn on or off devices in the "Modify Value" dialog box.

♥♥ [Debug]⇔[Modify Value...]

	Modify Value	\mathbf{X}
Enter a device to be turned on or off.	Device/Label Buffer Memory Device/Label Device/Label Data Type Bit Data Type Bit QN OEF Switch ON/OFF Settable Range Execution Result << Close Execution Result<<	
	Device/Label Data Type Setting Value Reflect to Input Column Delete(C)	

For details on current value changing, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

If a program is edited during debugging, the program can be written to the CPU module even while the CPU module is in the RUN status. (Figure 168, Section 3.12)

1

1.7 Saving a Project

To save a project, open the "Save As" dialog box.

Save Location:		
C:\Program Files		Browse
Workspace/Project List:		
Workspace		
Workspace Name:	Workspace1	
Project Name:	project1	
Title:	program1	
	j	
	Save	Can

ltem	Description
Save Location	Enter the storage destination folder (drive or path) of the workspace. Folders can be browsed for selection by
	clicking the Browse button.
Workspace/Project List	Select a workspace. Double-click "Workspace" to display a project list.
Workspace Name	Enter a name for the workspace.
Project Name	Enter a name for the project.
Title ^{*1}	Enter a title for the project.

*1 Projects can also be saved without titles.

CHAPTER 2 APPLICATION OF PROGRAMMING

2.1 Memory and Files

2.1.1 Memory configuration and storable data

Memory configuration differs depending on the CPU module (refer to the following).

CPU module	Memory configuration
Q00UJCPU	Program memory, standard ROM
Q00UCPU, Q01UCPU	Program memory, standard RAM, standard ROM
Q02UCPU, QnUD(H)CPU, QnUDE(H)CPU	Program memory, standard RAM, standard ROM, memory card (SRAM card, Flash card, or ATA card)
QnUDVCPU, QnUDPVCPU	Program memory, standard RAM, standard ROM, SD memory card

(1) Program memory

This memory stores programs and parameters required in processing of the CPU module.


(a) Processing a program

When a program is executed, data in the program memory are transferred to the program cache memory^{*1} at the following timings.

- Initial processing at power-on
- Initial processing at reset
- *1 The program cache memory is used for program operations.

(b) Writing to the program memory

When a program is written to the program memory, it is temporarily written to the program cache memory, and then automatically transferred back to the program memory.

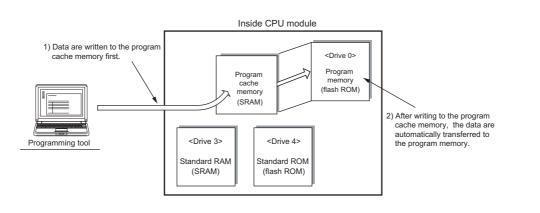

Point /

While the CPU module is in the RUN status, automatic data transfer to the program memory can be disabled by setting. ([] Page 173, Section 3.12.3)

(c) Transfer confirmation to the program memory

Program transfer to the program memory can be checked by the following.

· Checking the status in the progress screen The following figure is the progress screen in a programming tool.



· Checking with the special relay and the special register The status can be checked using SM681 and SD681.

(d) Checking whether data are transferred to the program memory PNote 2.1

Whether data are transferred from the program cache memory to the program memory can be checked using SM165.

(2) Standard RAM

This memory stores file register files, local device files, sampling trace files, and module error history files. For the High-speed Universal model QCPU and Universal model Process CPU, the size of standard RAM is extended by installing an extended SRAM cassette.

(3) Standard ROM

This memory stores data such as device comments and PLC user data.



Note 2.1 Universal

> When checking the data transfer status with the Q02UCPU, Q03UDCPU, Q04UDHCPU, or Q06UDHCPU, check the versions of the CPU module and programming tool used. (Page 467, Appendix 2)

(4) Memory card

This memory is used to extend memory in a CPU module. Three types of memory cards are applicable.

- SRAM card
- Flash card
- ATA card

(a) SRAM card

Data can be read from or written to a file register file stored in an SRAM card by sequence programs. This card is used when:

- the number of file register points is greater than the standard RAM capacity, or
- the sampling trace function is used. (Frage 184, Section 3.14)

When storing file registers to the SRAM card, the file registers can be written or read by the sequence program up to 4086K points.

(b) Flash card

This card is used when changing data is not required. Data are written to the card using a programming tool and read from the card by sequence programs. (Data cannot be written to the card by sequence programs.) Up to 2039K points of file register data can be stored.

(c) ATA card

This card is used for PLC user data (general-purpose data).

With the file access instruction (such as the SP. FWRITE instruction) in the sequence program, access the PLC user data in the ATA card in CSV format/binary format.

(5) SD memory card

This memory stores programs and parameters. To execute programs stored in an SD memory card, perform boot operation. ([] Page 104, Section 2.11) To execute the data logging function, this card must be inserted.

(6) Memory capacities and necessity of formatting

The following tables list the memory capacities and necessity of formatting of each memory. Format a memory that requires formatting using a programming tool before use.

Mem devi		Q00UJCPU	Q00UCPU	Q01UCPU	Q02UCPU	Q03UD/Q03 UDECPU	Q04UDH/Q0 4UDEHCPU	Q06UDH/Q0 6UDEHCPU	Formatting
Program memory		60K bytes (15K steps)	80K bytes (20K steps)	120K bytes (30K steps)	160K bytes (40K steps)	240K bytes (60K steps)	Necessary		
Standard	ROM	256K bytes	512K bytes	512K bytes	512K bytes	1024K bytes	1024K bytes	1024K bytes	Unnecessary
Standard	RAM	-	- 128K bytes 128K bytes		128K bytes	192K bytes	256K bytes	768K bytes	Necessary ^{*1}
Memory	SRAM card	-			Q2MEM-1MBSN, Q2MEM-1MBS: 1M byte Q2MEM-2MBSN, Q2MEM-2MBS: 2M bytes Q3MEM-4MBS: 4M bytes Q3MEM-8MBS: 8M bytes				
card	Flash card	-		Q2MEM-2MBF: 2M bytes Q2MEM-4MBF: 4M bytes					
	ATA card		-			Q2MEM-16M	BA: 8M bytes BA: 16M bytes BA: 32M bytes		Necessary

Memory device		Q10UDH/Q10 UDEHCPU	Q13UDH/Q13 UDEHCPU	Q20UDH/Q20 UDEHCPU	Q26UDH/Q26 UDEHCPU	Q50UDEHCPU	Q100UDEHCPU	Formatting		
Program memory		400K bytes (100K steps)	520K bytes (130K steps)	800K bytes (200K steps)	1040K bytes (260K steps)	2000K bytes (500K steps)	4000K bytes (1000K steps)	Necessary		
Standard	ROM	2048K bytes	2048K bytes	4096K bytes	4096K bytes	8192K bytes	16384K bytes	Unnecessary		
Standard	RAM	1024K bytes	1024K bytes	1280K bytes	1280K bytes	1536K bytes	1792K bytes	Necessary ^{*1}		
Memory	SRAM card		Q2MEM-1MBSN, Q2MEM-1MBS: 1M byte Q2MEM-2MBSN, Q2MEM-2MBS: 2M bytes Q3MEM-4MBS: 4M bytes Q3MEM-8MBS: 8M bytes							
card	Flash card		Q2MEM-2MBF: 2M bytes Q2MEM-4MBF: 4M bytes							
	ATA card		Q2MEM-8MBA: 8M bytes Q2MEM-16MBA: 16M bytes Q2MEM-32MBA: 32M bytes							

Memory device	Q03UDVCPU	Q04UDVCPU/ Q04UDPVCPU	Q06UDVCPU/ Q06UDPVCPU	Q13UDVCPU/ Q13UDPVCPU	Q26UDVCPU/ Q26UDPVCPU	Formatting
Program memory	120K bytes (30K steps)	160K bytes (40K steps)	240K bytes (60K steps)	520K bytes (130K steps)	1040K bytes (260K steps)	Necessary
Standard ROM		1025.5K bytes	•	2051K bytes	4102K bytes	Unnecessary
Standard RAM ^{*2}	192K bytes	256K bytes	768K bytes	1024K bytes	1280K bytes	
With an extended SRAM cassette (1M)	1216K bytes	1280K bytes	1792K bytes	2048K bytes	2304K bytes	
With an extended SRAM cassette (2M)	2240K bytes	2304K bytes	2816K bytes	3072K bytes	3328K bytes	Necessary ^{*1}
With an extended SRAM cassette (4M)	4288K bytes	4352K bytes	4864K bytes	5120K bytes	5376K bytes	
With an extended SRAM cassette (8M)	8384K bytes	8448K bytes	8960K bytes	9216K bytes	9472K bytes	1
SD memory card	SD memory card Capacity of the SD memory card used				•	Necessary

*1 When the memory contents become indefinite in initial status or due to the end of battery life, the memory is automatically formatted after the CPU module is powered off and then on or is reset.

*2 This is the capacity when an extended SRAM cassette is not used.

Point P

- When files are written to each memory, the unit of stored file size depends on the target CPU module and memory area. ([] Page 50, Section 2.1.3 (4))
- In memory capacity calculation, 1 step is equal to 4 bytes.

(7) Memory and data to be stored

The following table lists data that can be stored in each memory.

	CPU mo	dule built-in	memory	Memory card (RAM)	Memor (RC	•	Memory card (SD)		
Item	Program memory	Standard RAM	Standard ROM	SRAM card	Flash card	ATA card	SD memory card	File name and extension	Remarks
	Drive 0 ^{*1} Drive 3 ^{*1} Drive 4 ^{*1} Drive 1 ^{*1} Drive 2 ^{*1}		e 2 ^{*1}	Drive 2 ^{*1}					
Parameter	0	O *14	0	0	0	0	0	PARAM.QPA	1 data/drive
Intelligent function module parameter* ²	0	O ^{*14}	0	0	0	0	0	IPARAM.QPA	1 data/drive
Program	Ø	O ^{*14}	O *3	O *4	O *4	O *4	O *4	***.QPG	-
Device comment	O *5	O ^{*14}	O *6	O ^{*6}	O *6	O *6	O *6	***.QCD	-
Initial device value	0	O ^{*14}	0	0	0	0	0	***.QDI	-
File register	×	O *7*8	×	0	O *9	×	×	***.QDR	-
Local device	×	O *7	×	0	×	×	×	***.QDL	1 data/CPU module
Sampling trace file	×	O *7	×	0	×	×	×	***.QTD	-
Device data storage file	×	×	0	×	×	×	×	DEVSTORE.QST	-
Module error collection file	×	O *7	×	×	×	×	×	IERRLOG.QIE	-
Boot setting file	0	O ^{*14}	0	0	0	0	0	AUTOEXEC.QBT	-
Remote password	0	O ^{*14}	0	0	0	0	0	0000000.QTM	-
Latch data backup file	×	×	0	×	×	×	×	LCHDAT00.QBP	-
Backup data file	×	×	×	0	0	0	0	MEMBKUP0.QBP	-
Data logging setting file	×	×	0	×	×	×	0	LOGCOM.QLG, LOG01.QLG to LOG10.QLG	-
Data logging file	×	×	0 ^{*13}	×	×	×	0	***.CSV	-
PLC user data	×	×	0	×	×	O ^{*10}	O ^{*10}	***.CSV/BIN	-
Symbolic information ^{*11}	0	O ^{*14}	0	0	×	0	0	*12	-
Drive heading	0	O ^{*14}	0	0	0	0	0	QN.DAT	-
System file for the iQ Sensor Solution function (data backup/restoration)	×	×	×	×	×	×	0	SSBRINF.QSI	-
Backup data file for the iQ Sensor Solution function (data backup/restoration)	×	×	x	×	×	×	0	***.QBR ^{*15}	-
Predefined protocol setting file	×	×	0	×	×	×	0	ECPRTCL.QPT	-

◎ :Required, ○ :Storable, × :Not storable

	CPU mo	dule built-in	Memory card (RAM)			Memory card (SD)			
Item	Program memory	Standard RAM	Standard ROM	SRAM card	Flash card	ATA card	SD memory card	File name and extension	Remarks
	Drive 0 ^{*1}	Drive 3 ^{*1}	Drive 4 ^{*1}	Drive 1 ^{*1}	Drive	e 2 ^{*1}	Drive 2 ^{*1}		
System information file for CPU module data backup/restoration	×	×	×	×	x	×	0	BKUPINF.QSL	-
System data file for CPU module data backup/restoration	×	×	×	×	×	×	0	BKUPDAT.QBK	-
Device data file for CPU module data backup/restoration	×	×	×	×	×	×	0	DEVDATA.QDT	-
Operation history file	×	×	0	×	×	×	0	OPERATE.QOL	-

*1 A drive number is used to specify memory where data are written or read by external devices using a sequence program or MC protocol. Since memory names are used to specify memory using a programming tool, drive numbers do not need to be considered.

*2 Store the intelligent function module parameters in the same drive with the parameters. The intelligent function module parameters stored in a different drive are not valid.

*3 A program stored in the standard ROM cannot be executed. Store the program to the program memory before execution.

*4 To execute a program stored in a memory card or SD memory card, make the setting in the Boot file tab of the PLC parameter dialog box.

- *5 The device comments cannot be read by instructions in a sequence program.
- *6 Several scans are required to read device comments using a sequence program.

*7 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU store only one file for each item. The High-speed Universal model QCPU and Universal model Process CPU store more than one file for each item.

- *8 For the number of storable file register points, refer to Page 392, Section 4.7.
- *9 A sequence program allows reading only. No data can be written from the sequence program.

*10 Data can be written or read with the following instructions.
 •SP.FREAD (batch-reads data from the specified file in the memory card.)
 •SP.FWRITE (batch-writes data to the specified file in the memory card.)

*11 This is the data in which the information of label program configuration is stored.

GX Works2 Version 1 Operating Manual (Common)

*12 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: The file name and extension will be SRCINF1M.CAB or SRCINF2M.CAB for Simple projects (with a label), and SRCINF1I.CAB or SRCINF2I.CAB for Structured projects.

High-speed Universal model QCPU and Universal model Process CPU: The file name and extension will be SRCINF1M.C32 or SRCINF2M.C32 for Simple projects (with a label), and SRCINF1I.C32 or SRCINF2I.C32 for Structured projects.

- *13 This file cannot be specified as a data storage file when the data logging function is used. To write data to the file, execute the write PLC user data function.
- *14 Only the High-speed Universal model QCPU and Universal model Process CPU can store these data in the memory.
- *15 This file name depends on the connection type of the iQ Sensor Solution data backup/restoration function. (🛄 iQ Sensor Solution Reference Manual)

Point P

For methods for writing data to each memory (online operation), refer to the following.

2.1.2 Parameter-valid drive

CPU modules operate according to parameter settings. Systems automatically select parameters from those stored in the drives for CPU module operation, according to the following priority order. A user does not have to select them.

(1) Priority of the parameter-valid drives

The CPU module operates according to parameters stored in a higher priority drive.

• Q00U(J)CPU, Q01UCPU

Prio	ority	Drive where parameters are stored
High	1	Drive 0 (program memory)
↑ ↓ Low	2	Drive 4 (standard ROM)

• Q02UCPU, QnUD(H)CPU, QnUDE(H)CPU

Pric	ority	Drive where parameters are stored
High	1	Drive 0 (program memory)
•		Drive 1 (memory card RAM)
\downarrow	3	Drive 2 (memory card ROM)
Low	4	Drive 4 (standard ROM)

• QnUDVCPU, QnUDPVCPU

Pric	ority	Drive where parameters are stored
High	1	Drive 0 (program memory)
• ↑	2	Drive 2 (memory card SD) ^{*1}
\downarrow	3	Drive 3 (standard RAM)
Low	4	Drive 4 (standard ROM)

*1 When the CPU module is locked with a security key and parameters are stored in a memory card (SD) (no parameters stored in the program memory), "MISSING PARA" (error code: 2200) occurs.

Point P

- If a parameter file with a boot setting exists in a memory card or SD memory card, the file will be transferred according to the setting. If the transfer target memory is set to the program memory, the file will be transferred to the program cache memory as well.
- To check the parameter file that the CPU module uses, see "Parameter Valid Drive Information" of "PLC Status Information" on the PLC Diagnostics window. (

Ѷ [Diagnostics]⇔[PLC Diagnostics]

(2) When to determine valid parameters

The CPU module automatically searches for parameters in the following timing and operates by the settings of the parameters stored in the drives:

- · the CPU module is powered off and then on, or
- it is reset.

When storing parameters to a drive by executing the write to PLC function from a programming tool, the timing for validating the parameters differs depending on the drive.

(a) When parameters are stored to the drive different from the one that stores the parameters in operation

The parameters are validated according to the priority set to the drive after the CPU module is powered off and then on or is reset.

(b) When parameters are stored to the drive same as the one that stores the parameters in operation

Only the setting made in the Device tab of the PLC parameter dialog box is validated after "Write to PLC" is performed.

To validate all parameter settings, power off and then on or reset the CPU module.

2.1.3 Files

The files written to the CPU module have information such as a file name, file size, and written date. These information can be checked on the window displayed by selecting [Read from PLC] from the menu of a programming tool.

Online Data Operation						
Connection Channel List						
Serial Port PLC Module Connection(USB)						System Image
Eead C write	⊂ <u>V</u> erify	С	<u>D</u> elete			
PLC Module Intelligent Function Module	Execution Target Data(No	Yes)		
Title			-			
Module Data	ogram Select <u>A</u> ll C	ancel All 9	election	5		
Module Name/Data Name	Title/Project Name	Target	Detail	Last Change	Target Mem	ory Size
					D 14	
		V	Detail		Program Memo	ory/
MAIN		V	Detail	2013/01/29 08:50:06		2228 Bytes
R Parameter				2013/01/23 00:30:00		2220 Dy(65
PLC/Network/Remote Password/Swit		v		2013/01/29 08:50:06		740 Bytes
			Detail			
着 Device Data						
Necessary Setting No Setting / Already Se Writing Size 0Bytes	t) Set if it is needed(1	No Setting	/ Alre Free V	olume Use Volun	ne 2,968Bytes	Refrest
Related Eunctions>>					Ēxe	ecute Close

Ø	[Online]		[Read	from	Ы	C	1
\smile	JOUIIII	5	Reau	IIOIII	ΓL	U	L

ltem	Description
File name	 File name structure and file specification Each file name is composed of a name (up to 8 characters in one byte/4 characters in double bytes) and an extension (3 characters in one byte). Create a file name with upper-case characters only. An extension is automatically appended according to the type set when the file was created. Characters that cannot be used for a file name The following reserved words for Microsoft[®] Windows[®] cannot be used as a file name. COM1 to COM9, PRN, LPT1 to LPT9, NULL, AUX, CLOCK\$, CON How to specify a file name in the sequence program Since the sequence program is not case-sensitive in one-byte characters, the file can be named by both upper-case and lower-case characters. (Both "ABC" and "abc" are treated as "ABC".) In double-byte characters, an upper-case character and lower-case character are distinguished. Name a file by an upper-case character. ("ABC" and "abc" are distinguished.)
Last Change	The date and time when a file was written to the CPU module is shown. The date and time are based on the clock set on the programming tool (personal computer) side.
Size	The size of a file when it was written from a programming tool to the CPU module is shown in units of bytes. To display the latest data, click the <u>Refresh</u> button. At least 64 bytes (136 bytes for a program) are added to the file created by a user except a file register file. (

(1) Precautions for handling files

(a) Power-off or reset during file operation

If the CPU module is powered off or is reset during file operation, files in each memory remain as is. (To hold files in the memory card or SD memory card used, do not remove the card during power-off. Power off and on the CPU module with the card being inserted.)

Point /

When the programmable controller is powered off during an operation in which a file is moved, the data in operation are held in the internal memory of the CPU module. The held data are recovered at power-on. To hold the internal memory data, battery backup is required.

(b) Simultaneous write from multiple programming tools to the same file

While data are being written to a file using a programming tool, another programming tool cannot access to the file until the writing ends. Also, a file is being accessed by a programming tool, another programming tool cannot write data to the file until the access ends. To write data to the same file from multiple programming tools, wait until the current processing ends and perform the processing one at a time.

(c) Simultaneous write from multiple programming tools to different files

Up to 10 programming tools can simultaneously access to different files in a CPU module.

(d) Access to the SD memory card

Accessing the SD memory card by using the SP.FREAD or SP.FWRITE instruction may cause the scan time to increase as the number of files stored in the SD memory card increases.

(2) File size

The size of a file used in the CPU module depends on the file type. When a file is written to the memory area, the unit of the stored file size depends on the CPU module and memory area to be written.

(Page 50, Section 2.1.3 (4)) Calculate the rough size of each file with reference to the following table.

	File type	File size (unit: byte)				
Drive heading		72				
	Default ^{*1}	 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: 464 High-speed Universal model QCPU and Universal model Process CPU: 740 				
	With boot setting ^{*2}	84 + (18 × (number of file	s))			
		72 + (total parameter sizes of each module) + (size of the routing setting) + (size of the data link transfer setting)				
	With CC-Link IE Controller Network	Parameter size of each		(number o	f refresh transfer poir	
	setting	Size of the routing setting	ng	6 + 8 × (nı	umber of routing setting	ngs)
		Size of the data link trar	isfer setting	6 + 12 × (number of transfer settings) + 86 × (number of modules)		ttings) + 86 × (number of
		72 + (total parameter size transfer setting)				g) + (size of the data link
	With CC-Link IE Field Network setting	Parameter size of each module		Up to 13074		
Parameter		Size of the routing setting		6 + 8 × (nı	umber of routing settin	ngs)
		Size of the data link transfer setting 6 + 16 × (number of RX transfer settings) + 16 × (number of RWr transfer settings)				settings) + 16 × (number
	With MELSECNET/H setting	Increase up to 6180/mod	ule			
	With Ethernet setting	Increase up to 922/module				
		Increase up to the values in the following table (The values indicate an increase per module.)				
				Mode setting		
		CC-Link setting	Ver.1 r	node	Ver.2 mode	Ver.2 additional mode
	With CC-Link setting	1st module	550 b	ytes	572 bytes	624 bytes
		2nd to 4th modules	536 b	ytes	558 bytes	610 bytes
		5th module	550 b	ytes	566 bytes	618 bytes
		6th to 8th modules	536 b	ytes	558 bytes	610 bytes
	With remote password setting	92 + (number of target modules × 10), increase up to 172/module				
Sequence program		 CPU modules other that CPU: 148^{*3} + (4 × ((number of the second s	of steps) + (nu nodel QCPU	umber of ste and Univers	ps of reserved area f	PU:

File type	File size (unit: byte)
Device comment	 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: 74 + 8 + (total comment data size of each device) High-speed Universal model QCPU and Universal model Process CPU: 74 + 72 + 8 + (total comment data size of each device)
	Comment data size per device = 10 + 10240 × a + 40 × b • a: Quotient of ((number of device points)/256) • b: Remainder of ((number of device points)/256)
Initial device value	 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: 66 + 44 × n + 2 × m + 8 High-speed Universal model QCPU and Universal model Process CPU: 66 + 44 × n + 2 × m + 72 + 8 m: Total number of device points set to the initial device value n: Number of settings of the initial device value
User setting area	Setting value when formatted (0 to 15K)
File register	2 × (number of file register points)
Sampling trace file	 362 + (number of word device points + number of bit device points) × 12 + (N1 + N2 + N3 + number of word device points × 2 + (number of bit device points/16) × 2) × the number of traces (total number of executions) Apply the following values to N1 to N3 according to the items selected under "Trace additional Information" on the Trace condition settings window. (Page 187, Section 3.14 (8) (b)) N1: When "Time" is selected, apply "4". N2: When "Step no." is set, apply "10". N3: When "Program name" is selected, apply "8".
Device data backup file	Setting value when formatted (2 to 1024K)
Module error collection file	76 + (64 × (value set for the number of storable errors))
Local device ^{*4}	 70 + 6 × (set device type) + (Am + Av + B + Ct + Cst + Cc) × n Am, Av = (((a1 + a2) ÷ 16) - ((a1 + 1) ÷ 16) + 1) × 2 B = b × 2 Ct, Cst, Cc = ((((c1 + c2) × 2) ÷ 16 - ((c1 × 2 + 1) ÷ 16) + 1) × 2 + c2 × 2 Am, Av: Save area sizes of M (internal relay) and V (edge relay), respectively a1: Start device number of M or V a2: Number of points of M or V B: Save area size of D (data register) and Z (index register) b: Total number of points of D and Z Ct, Cst, Cc: Save area sizes of T (timer), ST (retentive timer), and C (counter), respectively c1: Start device number of T, ST, or C a2: Number of programs (only the ones using local devices^{*5})
Data logging setting file	Refer to the following.
System file for the iQ Sensor Solution function (data backup/restoration) Backup data file for the iQ Sensor Solution function (data	Refer to the following.
backup/restoration) Predefined protocol setting file	65532


2.1 Memory and Files 2.1.3 Files

File type	File size (unit: byte)	
	68 + (34 × (N + 1) + 34 × M) + L	
System information file for CPU module data backup/restoration	 N: Number of target drives M: Number of target files L: Total size of file names of target files (including punctuation mark (.) and extension) 	
	64 + (6+ (a × 34)) + (6 + (a × (336 + (12 × b) + (12 × c))) + (6 + (d × 198)) + 22 + 5440 + (6 + e × 6418))	
System data file for CPU module data	 a: Sampling trace registration status b: Number of word device points of sampling trace information 	
backup/restoration	c: Number of bit device points of sampling trace information	
	d: Data logging registration status	
	• e: Module error collection setting status	
	• For the status of a, d, and e, put "1" when they are registered/set and put "0" when they are not registered/set to obtain the above calculation formula.	
	64 + 2 + 4 + 72 + (N × 8) + 11328 + ((a + (b ÷ 16) + (c × 2 ÷ 16)) × 2)	
Device data file for CPU module data	• N: Number of target devices (for the timer, retentive timer, and counter, the contact and coil are counted as one device.	
backup/restoration	• a: Number of word device points	
	• b: Number of bit device points (except for the timer, retentive timer, and counter)	
	 c: Number of bit device points (the timer, retentive timer, and counter) 	
Operation history file	The file size depends on the parameter setting. (1K to 1024K bytes)	
*1 The value will be a becomes multiple of	djusted by the system so that the total number of bytes of PLC parameters and network parameters of four.	
•	djusted by the system so that the total number of bytes becomes multiple of four.	
*3 These are default	values. (Values differ depending on the parameter setting).	
*4 After the decimal p	oint of a value obtained by a division part in the formula is rounded up.	
	, Q03UDCPU, Q04UDHCPU, or Q06UDHCPU whose serial number (first five digits) is "10011" or umber of execution programs.	
Remark ••••••		

For a calculation example of memory capacity, refer to Page 51, Section 2.1.3 (4) (c).

(3) Program file structure

A program file consists of a file header, execution program, and reserved area for online change.

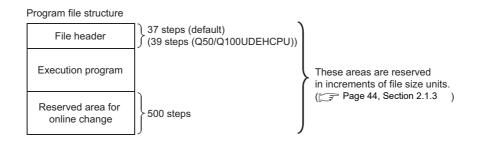

The sizes of the programs stored in the CPU module program memory are the total of above three areas.

Item	Description
File header	This area stores data such as the name, size, and created date of files. The file header size ranges from 25 to 41 steps (100 to 164 bytes) depending on the setting made in the Device tab of the PLC Parameter dialog box.
Execution program	This area stores the created program.
Reserved area for online change	This area is used when the number of steps is increased after writing data in the RUN status. (Default: 500 steps (2000 bytes) The setting value can be changed in the "Program Detail Setting" dialog box. (It can be changed while online change is performed.) After the online change is complete, remaining number of steps for this area is displayed.

(4) Memory capacity

When a file is written to the memory area, the unit of the stored file depends on the CPU module and memory area to be written. This unit is referred to as a file size unit.

(a) File size unit for each memory area

The following table lists the file size unit of the CPU module and memory area to be written.

CDU modulo model	Memory area				
CPU module model	Program memory	Standard RAM	standard ROM	Flash card ^{*1}	
Q00UJCPU		-	64 steps/256 bytes		
Q00UCPU, Q01UCPU			128 steps/512	-	
Q02UCPU, Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU			bytes		
Q10UD(E)HCPU, Q13UD(E)HCPU			256 steps/1024 bytes	128 steps/512 bytes	
Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	1 step/4 bytes	512 bytes	512 steps/2048 bytes		
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU		012 0900	128 steps/ 512 bytes		
Q13UDVCPU, Q13UDPVCPU			256 steps/ 1024 bytes	-	
Q26UDVCPU, Q26UDPVCPU			512 steps/ 2048 bytes		

*1 The file size unit of the Flash card is applied when a file is written to the Flash card by "Export to ROM Format".

(b) File size unit for each memory card or SD memory card

The following table lists the file size unit for each memory card or SD memory card.

	Туре	Model	File size unit (cluster size)
Memory card	SRAM card	Q2MEM-1MBSN, Q2MEM-1MBS	512 bytes
		Q2MEM-2MBSN, Q2MEM-2MBS	1024 bytes
		Q3MEM-4MBS	1024 bytes
		Q3MEM-8MBS	4096 bytes
	Flash card ^{*1}	Q2MEM-2MBF	1024 bytes
		Q2MEM-4MBF	1024 bytes
	ATA card	Q2MEM-8MBA	4096 bytes
		Q2MEM-16MBA	4096 bytes
		Q2MEM-32MBA	2048 bytes
		NZ1MEM-2GBSD	32K bytes
		NZ1MEM-4GBSD	32K bytes
6D ma	manyaard	NZ1MEM-8GBSD	32K bytes
SD me	mory card	NZ1MEM-16GBSD	32K bytes
		L1MEM-2GBSD	32K bytes
		L1MEM-4GBSD	32K bytes

*1 The file size unit of the Flash card is applied when:

• A file is written to the Flash card by Write to PLC (Flash ROM).

• A file is written to the Flash card using a programming tool without accessing the CPU module.

(c) Calculation example of memory capacity

Ex. The following describes a calculation example of memory capacity when parameters and a program are written to the program memory.

Conditions

1) CPU module to be written: Q26UDHCPU

2) Writing file: Table below

File name	File size ^{*1}
PARAM.QPA (parameter file)	464 bytes
MAIN.QPG (sequence program)	525 steps / 2100 bytes

*1 For file size, refer to Page 50, Section 2.1.3 (4) (a).

3) Reserved area for online change: 500 steps/2000 bytes

· Memory capacity calculation

The memory capacity is calculated in units of file sizes of the CPU module to be written. The file size unit of the Q26UDHCPU in this example is 1 step/4 bytes. ([] Page 50, Section 2.1.3 (4) (a))

1. Calculation of parameter file size

Since the parameter file size is 464 bytes, 116 steps/464 bytes is occupied on the program memory.

2. Calculation of program size

The program size is found by: Program size + reserved area for online change. Since a program is stored in units of file sizes (1 step), only the amount equal to the program size is occupied.

3. Result

The calculation results of the memory capacities are as shown below.

File name	File siz	Memory capacity		
PARAM.QPA	464 byt	116 steps (464 bytes)		
	Sequence program size	525 steps		
MAIN.QPG	Reserved area for online change	500 steps	1025 steps (4100 bytes)	
	Total 1025 steps		1	
	1141 steps (4564 bytes)			

2.2 Base Unit Assignment

2.2.1 Base mode

Use this mode when assigning the number of available slots to the main base unit and extension base units. The following two modes are available.

- Auto mode
- Detail mode

(1) Auto mode

Use this mode when assigning the number of slots equal to that on the base unit used.


(2) Detail mode

Use the detail mode when assigning the number of slots for each base unit. Any number of slots can be assigned irrespective of the actual number of slots on the base unit to be used.

(a) Setting the number of slots greater than the actual one

Slots are occupied by the number of slots set. The slots after actually used ones are regarded as empty slots.

Ex. Three slots will be the empty slots when a 5-slot base unit is used and the number of available slots are set to eight.

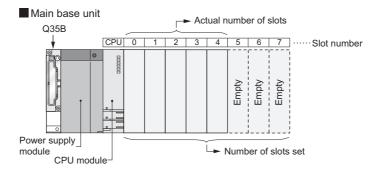


The number of points for the empty slots will be either value set on the PLC system tab, or on the I/O Assignment tab in the PLC parameter dialog box. (The default is 16 points.)

(b) Setting the number of slots smaller than the actual one

Set the smaller number than the actual number of slots when slots with no module mounted need not be recognized.

Ex. Four slots from the right end of the base unit will be the prohibited slots when using a 12-slot base unit and setting the number of available slots to eight. (Mounting a module on a prohibited slot causes "SP.UNIT LAY ERR.".)

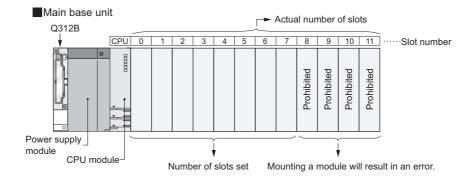

2.2.2 Base unit assignment setting

DLC PLC V 10(*-0) V V 21(*-1) V V 32(*-2) V V 43(*-3) V V 54(*-6) V V 76(*-6) V V	Detailed Setting Select PLC type Select module
3 2 ⁽²⁺²⁾	
4 3(*.3) ▼ ▼ 5 4(*.4) ▼ ▼ 6 5(*.5) ▼ ▼ 7 6(*.6) ▼ ▼ vsigning the I/O address is not necessary as the CPU does it automatically. ▼ ▼	
5 (4*-4) • • • • • • • • • • • • • • • • • • •	Select module
6 (\$(*.5)	
7 (d ⁴⁶ -6) • • • • • • • • • • • • • • • • • • •	
ssigning the I/O address is not necessary as the CPU does it automatically.	
Main Base Model Name Power Model Name Extension Cable Slots	Auto
Base Model Name Power Model Name Extension Cable Slots	Auto
Ext.Base1	C Detail
Ext.Base2	
Ext.Base3	8 Slot Default
Ext.Base4	12 Slot Default
Ext.Base5	12 DIOC Der adic
Ext.Base6	Select
Ext.Base7	module name
	ad PLC Data
(#1)Setting should be set as some when using multiple CD11 Except by CC11 Element Multiple CD11 Except by CC11 Element by CC11	au PLC Data
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	
(*1)Setting should be set as same when using multiple CPU. Export to CSV File Import Multiple CPU Parameter Re	

Set base units on the I/O Assignment tab of the PLC parameter dialog box.

Item		Description	
Base Mode	Auto	Select a mode for base unit assignment either from auto mode or detail mode.	
Dase Mode	Detail		
	Base Model Name	Enter the model names of base units, power supply modules, and extension cables to	
Base Setting	Power Model Name	be used within 16 characters for reference or when printing out parameters. CPU	
base Setting	Extension Cable	modules do not use the entered model names.	
	Slots	When "Detail" is set, select the number of slots on the base unit used.	
8 Slot Default button		When "Detail" is set, select either of these items for batch-setting the base units to the	
12 Slot Default button		specified number of slots	

Point P

- In auto mode, when any extension base unit number is skipped at the setting using the base number setting connector, an empty extension base unit cannot be reserved. To reserve empty extension base units for future extension, select detail mode.
- In detail mode, set the number of slots to all base units used. Failure to do so may result in incorrect I/O assignment setting.

2.3 I/O Number Assignment

The I/O number indicates addresses used for sequence programs in the following cases.


- Input of on/off data to the CPU module
- · Output of on/off data from the CPU module to the external device

(1) Input and output of on/off data

The input (X) is used to input on/off data to the CPU module, and the output (Y) is used to output on/off data from the CPU module.

(2) I/O number representation

The I/O numbers are represented in hexadecimal. When a 16-point I/O module is used, the I/O number for each slot will be 16 point-sequence number from $\Box \Box 0$ to $\Box \Box F$ as shown in the following figure. "X" and "Y" is prefixed to the I/O number of input modules and the I/O number of output modules, respectively.

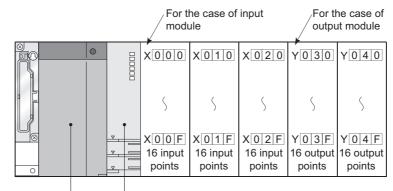

Power supply module


CPU module

2.3.1 Concept of I/O number assignment

The CPU module assigns I/O numbers at power on or reset, according to the I/O assignment setting.

(1) I/O number assignment

The following figure shows an example of I/O number assignment to base units in the system where the CPU module is mounted on the main base unit.

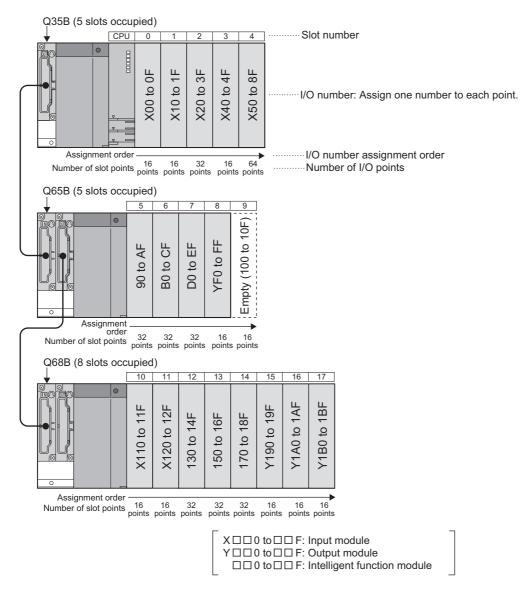

(a) Assignment order

For the main base unit, the I/O numbers are assigned to the modules from left to right in a sequential order, starting from 0_H assigned to the module on the right of the CPU module. For extension base units, the I/O numbers are continued from the last number of the I/O number of the main base unit.


(b) I/O number of each slot

Each slot on the base unit occupies I/O numbers by the number of I/O points of the mounted modules.

(2) I/O assignment on a remote I/O stations

The devices of input (X) and output (Y) in the CPU module can be assigned to I/O modules and intelligent function modules, which allows to control the modules in the remote I/O system such as CC-Link IE Field Network, MELSECNET/H remote I/O network and CC-Link.

Also, the input (X) and output (Y) devices can be used as refresh-target devices for the link I/O (LX, LY) of CC-Link IE Field Network master/local modules and MELSECNET/H modules.

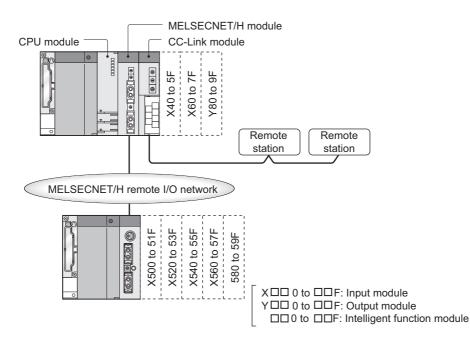

(a) I/O numbers available on remote I/O stations

When the input (X) and output (Y) of the CPU module are used for the I/O numbers in the remote station, assign the I/O numbers later than those used for the I/O modules and intelligent function modules on the CPU module side.


Ex.

When X/Y0 to X/Y3FF (1024 points) are used for the I/O modules and intelligent function modules on the CPU module side, X/Y400 and later can be used in the remote stations.

(b) Precautions for using remote station I/O numbers

Setting for future extension

When the input (X) and output (Y) of the CPU module are used for the I/O numbers on the remote station, consider future extension of I/O modules and/or intelligent function modules on the CPU module side.

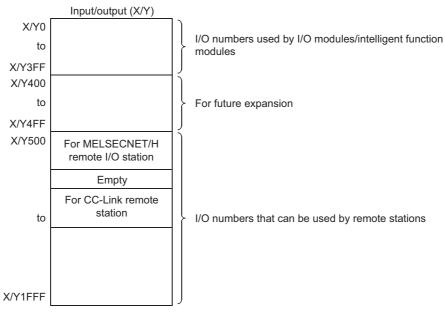

When X/Y0 to 3FF (1024 points) are used by I/O modules and/or intelligent function modules and X/Y400 to 4FF (256 points) are secured for future extension

• When CC-Link IE Field Network, MELSECNET/H, or CC-Link is used

Assign I/O numbers for the refresh-target devices (in the CPU module) of CC-Link IE Field Network or MELSECNET/H so that they do not overlap with those for the CC-Link remote stations.

Point P

- When network parameter setting has not been made in the CC-Link system, X/Y 1000 to 17FF (2048 points) are assigned to the CC-Link system master/local modules of lower numbers.
- There are no restrictions on the I/O number assignment order for the CC-Link IE Field Networks, MELSECNET/H remote I/O networks, CC-Link.
- Free space can be provided in the area for the CC-Link IE Field Network remote station, MELSECNET/H remote I/O station, and CC-Link remote station.

2.3.2 Setting I/O numbers

Set the I/O numbers on the I/O Assignment tab.

(1) Purpose of I/O number assignment

(a) Reserving points for future module changes

The number of points can be flexibly set so that the I/O number modification can be avoided when changing the current module to another in the future.



32 points can be assigned for future use to the slot where an input module with 16 points is currently mounted.

(b) Preventing I/O numbers from changing

The change in the I/O numbers can be prevented when an I/O module or intelligent function module, whose occupied I/O points are other than 16, is removed due to failure.

(c) Changing the I/O numbers to those used in the program

When the I/O numbers used in the actual system differ from those in the designed program, the I/O numbers of each module on the base unit can be changed to the ones in the designed program.

Point P

- If any of the I/O modules whose number of I/O points are other than 16 fails without I/O assignment setting, the I/O numbers assigned following to the failed module may change, leading to a malfunction. For this reason, making the I/O assignment setting is recommended.
- I/O assignment setting allows the following settings as well. (The I/O assignment is required for the input response time and switch settings.)
 - Input response time setting (I/O response time) (
 - Error time output mode setting (Page 141, Section 3.8)
 - CPU module operation setting during a hardware error of intelligent function modules (Page 142, Section 3.9)
 - Switch setting of intelligent function modules and interrupt modules (FP Page 143, Section 3.10)

(2) I/O assignment

The I/O assignment is set on the I/O Assignment tab of the PLC parameter dialog box. On the I/O Assignment tab, the following items can be set for each slot on the base unit.

- "Type" (module type)
- "Points" (I/O points)
- "Start XY" (start I/O number)

Ex. To change the I/O number of the specified slot, setting is allowed only to the number of points. For other items that are not set, settings are completed based on the installation status of the base unit.

	cl. i	-			0.11	Chart VV	Switch Setting
lo. 0 PLC	Slot	PLC Type	•	Model Name	Points	Start XY	Switch Secting
1 0(*-	0)		•		•		Detailed Setting
2 1(*-	1)		•		•		
3 2(*-			•		•		Select PLC type
4 3(*-		_	-		•		Select module
5 4(*- 6 5(*-		-	• •				
7 6(*-			-		•		
Main		basemodername		1 offici Prodorivano	Extension Cable	•	Auto
		Base Model Name		Power Model Name	Extension Cable	Slots	Base Mode
							C Detail
Ext.Base Ext.Base							, Decair
Ext.Base						-	8 Slot Default
Ext.Base	4					-	12 Slot Default
Ext.Base						-	
Ext.Base Ext.Base							Select module name
EXLIDASE	/						
(*1)S	etting should b	e set as same whe	n using multipl	e CPU. Export to CSV File	Import Multiple CPU Par	ameter	Read PLC Data

ltem	Description
Slot	The slot number and location of the slot are displayed. When the base unit is set to auto mode, the base unit number is indicated in "*", and the slot number is counted from slot 0 of the main base unit.
Туре	Select the type of the mounted module from the following: • Empty (empty slot) • Input (input module) • Hi. Input (high-speed input module) • Output (output module) • I/O Mix (I/O combined module) • Intelligent (intelligent function module) • Interrupt (interrupt module) When the type is not specified for a slot, the type of the actually mounted module applies.
Model Name	Enter the model names of mounted modules within 16 characters. CPU modules do not use entered model names. (Use the entered model names for reference.)
Points	 When changing the number of I/O points for each slot, select the points from the following: 0 Point • 16 Points • 32 Points • 48 Points • 64 Points • 128 Points • 256 Points • 512 Points • 1024 Points When the number of points is not specified for a slot, the number of points of the actually mounted module applies. For empty slots, the number of points set on the PLC System tab of the PLC parameter dialog box is assigned (default: 16 Points).
Start XY	When changing the I/O number of each slot, enter a new start I/O number. When this item is not specified for a slot, the I/O number counting from the last number of the current setting is assigned.

(3) Precautions

(a) Type setting

The type set in the I/O Assignment tab must be the same as that of the mounted module. Setting a different type may cause incorrect operation. For an intelligent function module, the number of I/O points must also be the same to the I/O assignment setting. The following table lists the operations when the mounted module type differs from the one set in the I/O Assignment tab.

Mounted module	I/O assignment setting	Result		
Input module, output module, I/O combined module	IntelligentInterrupt	Error (SP.UNIT.LAY.ERR.)		
Intelligent function module	 Input Hi. Input Output I/O Mix 	Error (SP.UNIT.LAY.ERR.)		
Empty slot	 Input Hi. Input Output I/O Mix Intelligent Interrupt 	Empty slot		
All modules	• Empty	Empty slot		
Other combinations	-	Error does not occur but incorrect operation may be caused. Or, error (PARAMETER ERROR (error code: 3000)) is detected.		

(b) I/O points of slots

The number of I/O points set in the I/O Assignment tab takes priority to that of mounted modules.

- When the number of I/O points is set to the number which is less than that of mounted I/O modules The available number of I/O points for the mounted I/O modules will be reduced.
- **Ex.** When the number of I/O points is set to 16 points in the I/O Assignment tab of the PLC parameter dialog box for the slot where a 32-point input module is mounted, the second half 16 points of the module becomes unavailable.
 - When the number of I/O points is set to the number which is exceeding that of mounted I/O modules The exceeded number of points will not be used in the I/O modules.
 - Last I/O number

Set the last I/O number within the maximum number of I/O points. Failure to do so may cause an error ("SP. UNIT LAY ERR."). ("***" is displayed in "I/O Address" on the System Monitor screen.)

· When setting 0 points for empty slots

Setting "Empty" for Type and "0 Point" for Points even occupies one slot. To set slots after the specific slot number unoccupied, set the number of slots in detail mode.

(Page 52, Section 2.2.1)

(c) Start XY setting


When the start XY has not been entered, the CPU module automatically assigns it. For this reason, the start XY setting of each slot may be duplicated with the one assigned by the CPU module in the case of 1) or 2) below.

1. Start XY values are not in the correct order.

2. Slots with and without the start XY setting (automatically assigned slot) are mixed

The following figure shows an example of start XY duplication.

ο.	Slot	Туре		Model Name	Points		Start XY 🧧	<u> </u>	Switch Settin
	PLC	PLC	•			Ŧ			
	0(*-0)	Input	•	Input module	32Points	•	0040		Detailed Setti
	1(*-1)	Input	Ŧ	Input module	32Points	•	0020		
	2(*-2)	Intelligent	•	Inteli. module	32Points	-			Select PLC typ
	3(*-3)		•			•			Select modul
;	4(*-4)		Ŧ			•			Delecembda
	5(*-5)		•			•			
	6(*-6)		Ŧ			•		·	
								_	

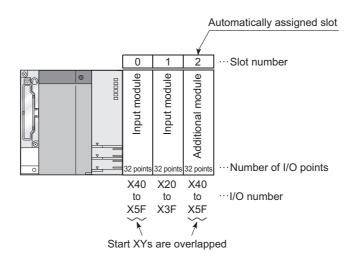

Do not set duplicated start XY for each slot.

Specify start XY in the additional module to prevent the duplication of start XY.

Ex. Input "0060" to "start XY" in slot2.

Duplication of start XY will result in "SP. UNIT LAY ERR." (An error occurs even the module is not mounted.)

(d) When using AnS/A series compatible extension base units

When using the Q5DB/Q6DB in combination with the AnS/A series compatible extension base units, QA1S5DB, QA1S6DB, and QA6DB, take the following precautions.

- Connect the extension base units in the order of the Q5□B/Q6□B, QA1S5□B/QA1S6□B, QA6□B from the closest position to the main base unit.
- The QA1S51B does not have an extension cable connector (OUT) and therefore cannot be used in combination with the QA6□B.
- Batch-assign I/O numbers of the modules mounted on the base units for each series: Q series → A series or Aseries → Q series. Failure to do so will result in "SP.UNITLAY ERR.".

When the QA6ADP+A1S5□B/A1S6□B is used, refer to the following.

QA6ADP QA Conversion Adapter Module User's Manual

When the QA1S6ADP+A1S5DB/A1S6DB is used, refer to the following.


- QA1S6ADP Q-AnS Base Unit Conversion Adapter User's Manual
- QA1S6ADP-S1 Q-AnS Base Unit Conversion Adapter User's Manual

I/O number setting examples are provided as follows.

(1) Changing the number of points of an empty slot from 16 to 32

Reserve 32 points for the currently empty slot (Slot 3) so that the I/O numbers of Slot No. 4 and later do not change when a 32-point input module is mounted there in the future.

(a) System configuration and I/O number assignment before I/O assignment setting

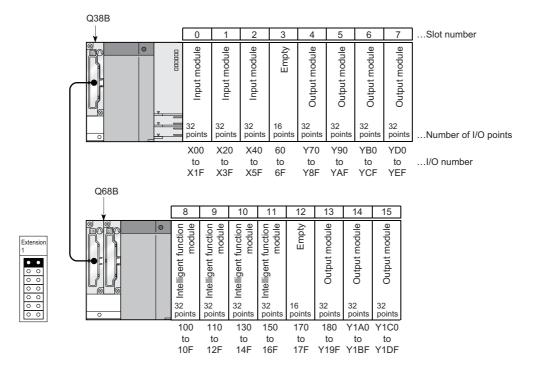


(b) I/O assignment

Select "32 Points" for "Points" of the slot 3 in the I/O Assignment tab of the PLC parameter dialog box. (When "Type" is not specified, the type of the mounted module will be set.)

lo.	Slot	Туре		Model Name	Points		Start XY	*	Switch Settin
0	PLC	PLC	-			-			
1	0(*-0)		-			-			Detailed Settin
2	1(*-1)		-			-			
3	2(*-2)		-			-			Select PLC typ
4	3(*-3)	Empty	-	QX41	32Points	-			Select modul
5	4(*-4)		-			-			Delect modul
6	5(*-5)		-			-			
7	6(*-6)		-			-		-	

Assigning the I/O address is not necessary as the CPU does it auto Leaving this setting blank will not cause an error to occur.

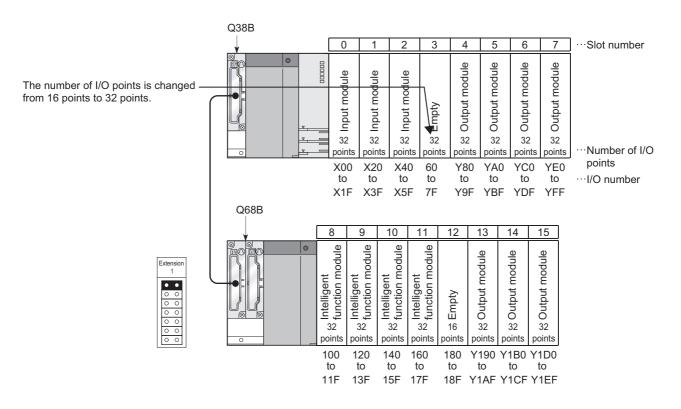


(c) I/O number assignment after the I/O assignment setting

(2) Changing the I/O number of an empty slot

Change the I/O number of the currently empty slot (Slot 3) to X200 through 21F so that the I/O numbers of Slot 4 and later do not change when a 32-point input module is mounted there in the future.

(a) System configuration and I/O number assignment before I/O assignment setting

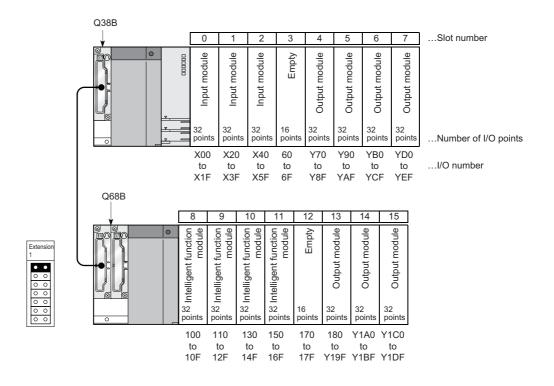


(b) I/O assignment

Set "200" for "Start XY" of the slot 3 and "70" for "Start XY" of the slot 4 in the I/O Assignment tab of the PLC parameter dialog box. (When the start I/O number is not set, the I/O number following the slot 3 will be set.)

No.	Slot	Туре	Model Name	Points	Start XY 🔺	Switch Setting		
0	PLC	PLC .		-				
1	0(*-0)			-		Detailed Setting		
2	1(*-1)			-				
3	2(*-2)					Select PLC type		
4	3(*-3)			+	0200	Select module		
5	4(*-4)			-	0070			
6	5(*-5)							
7	6(*-6)			-	•			
Assigning the I/O address is not necessary as the CPU does it automatically. Leaving this setting blank will not cause an error to occur.								

(c) I/O number assignment after the I/O assignment setting

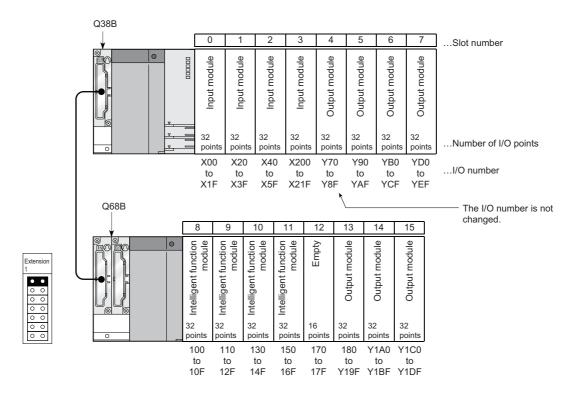


2.3.4 Checking I/O numbers

Information on mounted modules and their I/O numbers can be checked on the System Monitor screen in a programming tool.

2.4 Scan Time Structure

A CPU module sequentially performs the following processing in the RUN status. Scan time is the time required for all processing and executions to be performed.

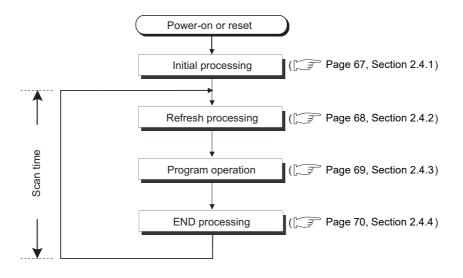

2.4.1 Initial Processing

*1


The CPU module performs pre-processing required for program operations. The processing is performed only once when any of the operations described in the following table is performed. When initial processing is completed, the CPU module will enter the status set using the RUN/STOP/RESET switch. (

			O : Performed, × : Not performed			
		CPU module status				
Initial processing item	Powered-on	Reset	Changed from STOP to RUN ^{*1}			
The I/O module initialization	0	0	×			
Boot from a memory card or SD memory card	0	0	×			
PLC parameter check	0	0	0			
Multiple CPU system parameter consistency check	0	0	0			
Initialization of devices outside the latch range (bit device: off, word device: 0)	0	0	×			
Automatic I/O number assignment of mounted modules	0	0	0			
CC-Link IE and MELSECNET/H information setting	0	0	×			
Intelligent function module switch setting	0	0	×			
CC-Link information setting	0	0	×			
Ethernet information setting	0	0	×			
Initial device value setting	0	0	0			
Serial communication function setting	0	0	×			

The operation indicates that the status is changed back to RUN without resetting the module after any parameter or program was changed in the STOP status. (The RUN/STOP/RESET switch is set from STOP to RUN (the RUN LED will flash), then back to STOP and to RUN again.) Note that the PLS, $\Box P$ instruction (instruction for pulse conversion) may not be executed properly with the above operation. This is because the previous information may not be inherited depending on the program changes.



If any parameter or program is changed in the STOP status, reset the CPU module using the RUN/STOP/RESET switch.



2.4.2 I/O Refresh (Refresh Processing with Input/Output Modules)


The CPU module performs the following before sequence program operations.

- · On/off data input from the input module or intelligent function module to the CPU module
- On/off data output from the CPU module to the output module or intelligent function module


When the constant scan time is set, I/O refresh is performed after the constant scan waiting time has elapsed. (I/O refresh is performed at each constant scan cycle.)

2.4.3 Program Operation

The CPU module repeatedly executes the program stored in the module from step 0 to the END or FEND instruction. This program is referred to as a main routine program. This program is executed from step 0 in every scan.

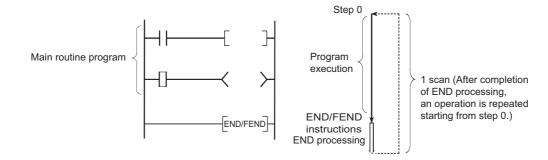

A main routine program can be divided into subroutine programs. A subroutine program is from a pointer (P^{II}) to the RET instruction, and is created between the FEND and END instructions. This program is executed only when called by an instruction, such as CALL(P) and FCALL(P), from a main routine program.

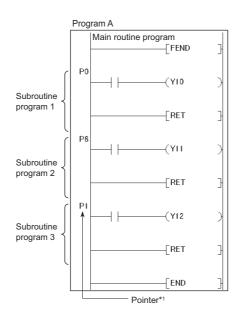

2

*1 Pointer numbers do not need to be specified in ascending order.

Use a subroutine program for purposes such as the following:

- To organize a program executed several times in one scan as a subroutine program so that the entire number of steps can be reduced
- To organize programs executed under the specific condition as a subroutine program so that the scan time can be reduced

Point *P*

- Subroutine programs can be managed as one separate program (standby type program). (
- Subroutine programs can be configured with the nesting. (Page 407, Section 4.9)
- Using an interrupt pointer in a subroutine program changes the program to an interrupt program. (

2.4.4 END Processing

The CPU module performs refresh processing with network modules and communication with external devices. END processing includes the following.

- · Refresh with network modules
- Refresh with CC-Link IE Field Network Basic
- · Auto refresh with intelligent function module
- · Intelligent function module dedicated instruction processing
- Device data latch processing
- · Service processing
- · Watchdog timer reset
- Auto refresh between multiple CPU modules
- Device data collection using the sampling trace function (only when trace point is set to every scan (after END instruction execution))
- · Self-diagnostics processing
- Special relay/special register value setting (only for those that should be set during END processing)

Point *P*

When the constant scan function (Page 119, Section 3.2) is used, the results of processing performed in END processing are held for the period between after END processing is completed and until the next scan starts.

2.5 Operation Processing in the RUN, STOP, or PAUSE Status

There are three types of operating status of the CPU module.

- RUN status
- STOP status
- PAUSE status

This section describes program operation processing in the CPU module based on its operating status.

(1) Operation processing in the RUN status

RUN status is a status where sequence program operations are repeatedly performed in a loop between the step 0 and the END (FEND) instruction.

(a) Output status when entering the RUN status

The CPU module outputs either of the following according to the output mode parameter setting when its status

is changed to RUN. (Frage 125, Section 3.4)

- Output (Y) status saved in the STOP status
- · Result of operations performed after one scan

(b) Processing time required before operations

The processing time required for the CPU module to start sequence program operations after its operating status is changed from STOP to RUN varies depending on the system configuration and/or parameter settings. (It takes one to three seconds normally.)

(2) Operation processing in the STOP status

STOP status is a status where sequence program operations are stopped by the RUN/STOP/RESET switch or the remote STOP function.

The CPU module status will be changed to STOP when a stop error occurs.

(a) Output status when entering the STOP status

When entering the STOP status, the CPU module saves data in the output (Y) and turns off all outputs. The device memory other than that of the output (Y) will be held.

(3) Operation processing in the PAUSE status

PAUSE status is a status where sequence program operations are stopped by the remote PAUSE function after operations are performed for one scan, holding the output and device memory status.

(4) Operation processing when operating status of the CPU module changed

	CPU module operation processing								
RUN/STOP	Sequence		Device me	mory					
status	program operation processing	External output	M, L, S, T, C, D	Y					
$RUN \to STOP$	The CPU module executes the program until the END instruction and stops.	The CPU module saves the output (Y) status immediately before its status is changed to STOP and turns off all the outputs.	The CPU module holds the device memory status immediately before its status is changed to STOP.	The CPU module saves the output (Y) status immediately before its status is changed to STOP and turns off all the outputs.					
$STOP\toRUN$	The CPU module executes the program from the step 0.	The CPU module outputs data according to the output mode parameter setting. $(\underbrace{\neg \overrightarrow{}}$ Page 125, Section 3.4)	The CPU module holds the device memory status immediately before its status is changed to STOP. Note that the CPU module uses initial device values if those values are preset. Local device data are cleared.	The CPU module outputs data according to the output mode parameter setting. $(\underbrace{\neg \overrightarrow{}}$ Page 125, Section 3.4)					

Point P

The CPU module performs the following in any of the RUN, STOP, or PAUSE status.

- Refresh processing with I/O modules
- · Refresh processing with network modules
- Refresh processing with CC-Link IE Field Network Basic
- Auto refresh processing with intelligent function modules
- Self-diagnostics processing
- Service processing
- · Intelligent function module dedicated instruction processing (completion processing only)
- Operation processing of Multiple CPU high speed transmission function
- Setting values for special relay/special register (only for those that should be set during END processing)

Even if the CPU module is in the STOP or PAUSE status, the following operations can be executed.

- I/O monitor or test operation from a programming tool or a GOT
- Read/Write data from/to external devices using the MC protocol
- · Communication with other stations using CC-Link IE or MELSECNET/H
- · Communication with CC-Link remote stations

2.6 **Operation Processing during Momentary Power Failure**

When the input voltage supplied to the power supply module drops below the specified range, the CPU module detects a momentary power failure and performs the following operation.

(1) When a momentary power failure occurs for a period shorter than the allowable power failure time

The CPU module registers error data and suspends the operation processing. The CPU module, however, continues measurement in the timer device and holds the output status.

(a) When resume start is specified for the SFC program

Data in the system is saved.


(b) When power is recovered after a momentary power failure

The CPU module restarts its operation processing.

(c) Watchdog timer (WDT) measurement during a momentary power failure

Even if operation processing is suspended due to a momentary power failure, the CPU module continues the measurement of the watchdog timer (WDT).

Ex. When the WDT setting of PLC parameter is 200ms and the scan time is 190ms, if a momentary power failure occurs for 15ms, "WDT ERROR" occurs.



(2) When a momentary power failure occurs for a period longer than the allowable power failure

The CPU module starts its operations initially.

Operation processing will be the same as that when any of the following is performed.

- · Programmable controller is powered on.
- · The CPU module is reset by the RUN/STOP/RESET switch.
- The CPU module is reset by a programming tool (the remote reset operation).

Point /

- In a redundant power supply system, the CPU module does not suspend its operations if a momentary power failure occurs in either of the power supply modules. However, if a momentary power failure occurs under the condition where the power is supplied to only one of the power supply modules, operations are suspended.
- Information of a momentary power failure occurred in a redundant power supply system will be stored in SM1782 to SM1783 and SD1782 to SD1783. On the other hand, information of a momentary power failure occurred in a single power supply system will be stored in SM53 and SD53.

2.7 Data Clear Processing

This section describes how to clear data in the CPU module and settings required for clearing latch data.

(1) Clearing data

Data in the CPU module are cleared when the reset operation (using the RUN/STOP/RESET switch or by powering off and on the module) is performed. However, the following data cannot be cleared by these operations:

- Data in the program memory
- Data in the standard ROM
- · Data in a memory card or SD memory card
- Data in latch-specified devices (Page 75, Section 2.7 (4))

(2) Clearing data that cannot be cleared by the reset operation

(a) Data in the program memory

Clear the data by:

- · Selecting the "Clear Program Memory" checkbox in the Boot File tab of the PLC parameter dialog box.
- Configuring settings on the screen opened by selecting [Online] → [Delete PLC Data] in a programming tool.

(b) Data in the standard ROM

Data stored on the standard ROM are automatically cleared when new data is written on it.

(c) Data in a memory card or SD memory card

Clear the data by configuring settings on the screen opened by selecting [Online] \rightarrow [Delete PLC Data] in a programming tool.

(d) Data in latch-specified devices

Refer to Page 75, Section 2.7 (4).

(3) Device latch specification

Set a latch range for each latch-target device in the Device tab of the PLC parameter dialog box.

(Page 123, Section 3.3 (4))

(a) Latch range setting

Two different types of latch ranges can be set using a programming tool:

• Latch clear operation enable range (Latch (1) Start/End)

- This is a range within which data can be cleared by a latch clear operation.
- Latch clear operation disable range (Latch (2) Start/End) This is a range within which data cannot be cleared by a latch clear operation.

(4) Clearing latch data

(a) Data in the latch clear operation enable range (Latch (1) Start/End)

Perform either of the following.

Remote latch clear

Perform the operation using a programming tool. (FP Page 137, Section 3.6.4)

- Latch clear by using the special relay and special register areas PNote 2.2
 - 1. Change the operating status of the CPU module to STOP.
 - **2.** Set "5A01_H" in SD339.
 - **3.** Turn on SM339.
- (b) Data in the latch clear operation disable range (Latch (2) Start/End) and in the file register

Perform any of the following.

- Reset data by using the RST instruction.
- Transfer K0 by using the MOV or FMOV instruction. (MELSEC-Q/L Programming Manual (Common Instruction))
- Set parameters ("Clear Device's whole Memory" or "Clear all File Registers").
 - ℃ [Online] ⇔ [PLC Memory Operation] ⇔ [Clear PLC Memory] ⇔ "Clear Device's whole Memory"/"Clear all File Registers"

Connection Channel List Connection Interface	<> PLC Module
Target PLC Network No.	Station No. Host PLC Type Q06UDV
Device Memory Clear Device's whole Memory Include Latch	[Point] Program local device selected in monitor status "local device monitor target select column" will be cleared when executing device memory all clear during local device monitor.
File Register	Tarret Marray RAM
Clear all <u>Fi</u> le Registers	Target Memory Standard RAM
C Specific File MAIN	~

Point P

Latching device data increases the scan time. When latching device data, consider the increase in scan time. ([] Page 479, Appendix 3.2 (6))



2 Universal

Only the High-speed Universal model QCPU and Universal model Process CPU support latch clear operation by using the special relay and special register areas. Before executing the function, check the version of the CPU module used. ([] Page 467, Appendix 2)

2.8 I/O Processing and Response Delay

The CPU module performs I/O processing in the refresh mode.

Using the direct access input/output in a sequence program, however, allows the CPU module to perform I/O

processing in the direct mode at the time of each instruction execution.

This section describes these I/O processing modes of the CPU module and response delays.

(a) Refresh mode (P Page 77, Section 2.8.1)

Refresh mode is a mode for the CPU module to access input/output modules and perform I/O processing collectively before the start of sequence program operations.

(b) Direct mode (Page 80, Section 2.8.2)

Direct mode is a mode for the CPU module to access input/output modules and perform I/O processing at the timing when each instruction is executed in a sequence program.

To access input/output modules in the direct mode, use the direct access input or direct access output in a sequence program.

(1) Differences between refresh mode and direct mode


The direct mode directly accesses I/O modules at execution of an instruction. Therefore, data is input faster than when it is input in refresh mode. Processing time required for each instruction, however, takes longer. The following table lists the availability of the refresh mode and the direct mode for each input and output.

Item	Refresh mode	direct mode	
Input/output modules		Available	
Input/output of intelligent function modules	Available		
Input/output of MELSEC-I/O LINK Remote I/O System Master	Available	Available	
Module (AJ51T64/A1SJ51T64) ^{*1}			
Remote input/output in CC-Link IE, CC-Link IE Field Network Basic, MELSECNET/H, or CC-Link	Available	Not available	

*1 The module must be mounted on the AnS/A series compatible extension base unit (QA1S5□B, QA1S6□B, QA6□B, QA6DP+A5□B/A6□B, or QA1S6ADP+A1S5□B/A1S6□B). (The CPU module whose serial number (first five digits) is "13102" or later must be used. However, the QnUDPV cannot be used.)


2.8.1 Refresh mode

In a refresh mode, the CPU module batch-performs I/O processing before the start of sequence program operations.

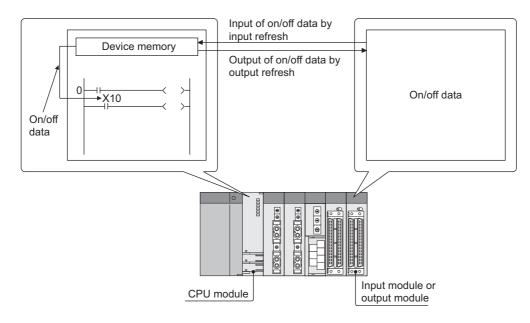

(1) Outline of the processing

The following describes the details of the refresh processing.

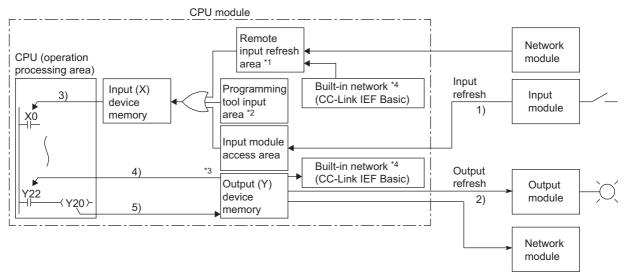

- *1 The remote input refresh area indicates the area to be used when auto refresh is set to the input (X) in the CC-Link IE, CC-Link IE Field Network Basic, MELSECNET/H, or CC-Link. Data in the remote input refresh area will be refreshed automatically during END processing.
- *2 Data in the programming tool input area can be turned on or off by the following:
 - •Test operation of a programming tool
 - •Writing data from the network module
 - •Writing data from an external device using the MC protocol
 - Writing data using the simple PLC communication function
- *3 Data in the output (Y) device memory can be turned on or off by the following:
 - •Test operation of a programming tool
 - •Writing data from an external device using the MC protocol
 - •Writing data from the network module
 - Writing data using the simple PLC communication function
- *4 This applies only to the QnUDVCPU and QnUDPVCPU.

ltem	Description
Input refresh	Before program operation, input data are collectively read out from the input modules (1), the OR processing with the programming tool input area and remote input refresh area is executed, and then the data are stored in the input (X) device memory.
Output refresh	Before program operation, data in the output (Y) device memory (2) are collectively output to the output module.
Execution of an input contact instruction	Input data in the input (X) device memory (3) are read out and the program is executed.
Execution of an output contact instruction	Output data in the output (Y) device memory (4) are read out and the program is executed.
Execution of the OUT instruction The operation result of the program (5) are stored to the output (Y) device memory.	

(a) Input

On/off data of an input module are batch-input to the area for communication with the input module in the CPU module before the start of sequence program operations.

The CPU module performs sequence program operations using the on/off data stored in the input (X) device memory.

(b) Output

The operation results of the sequence program is output to the output (Y) device memory in the CPU module every time program operation is performed. Then, the CPU module batch-outputs the on/off data in the output (Y) device memory to an output module before the start of sequence program operations.


(2) Response delay

An output response which corresponds to the status change in the input module delays for two scans (maximum) depending on the on timing of an external contact.


[Example]



· Y5E turns on the earliest

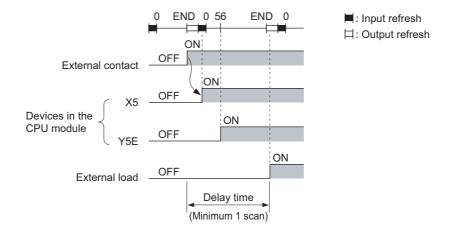


· Y5E turns on the latest

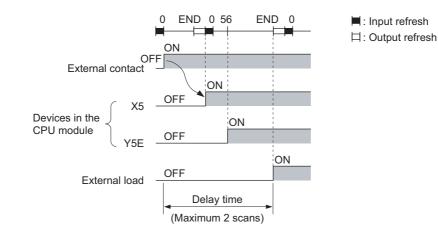

2.8.2 Direct mode


In a direct mode, the CPU module performs I/O processing when each instruction is executed in a sequence program.

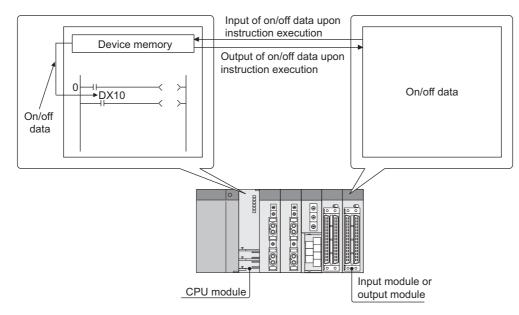

With this mode, the CPU module uses the direct access input (DX) and direct access output (DY) to perform I/O processing.

(1) Outline of the processing

The following describes the details of the Direct processing.

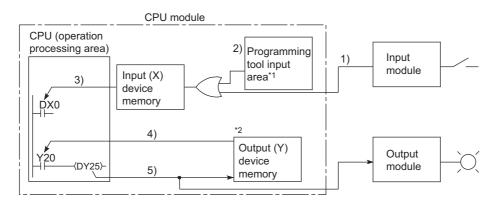

- *1 Data in the programming tool input area can be turned on or off by the following:
 - •Test operation of a programming tool
 - •Writing data from the network module
 - •Writing data from an external device using the MC protocol
 - Writing data using the simple PLC communication function
- *2 Data in the output (Y) device memory can be turned on or off by the following:
 - Test operation of a programming tool
 - •Writing data from an external device using the MC protocol
 - •Writing data from the network module
 - Writing data using the simple PLC communication function

Item	Description
Execution of an input contact instruction	The OR processing is performed with the input information of the input module (1)) and the input data of the programming tool input area (2)) or remote input refresh area. The result is stored in the input (X) device memory and is used as input data (3)) to execute the program.
Execution of an output contact instruction	Output data in the output (Y) device memory (4)) are read out and the program is executed.
Execution of the OUT instruction	The operation result of the program (5)) are output to the output module, and stored in the output (Y) device memory.


(2) Response delay

An output response which corresponds to the status change in the input module delays for one scans (maximum) depending on the on timing of an external contact.


[Example]




· DY5E turns on the earliest

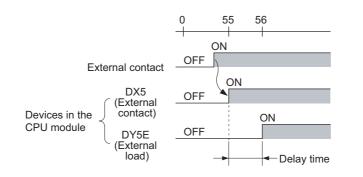

· DY5E turns on the latest

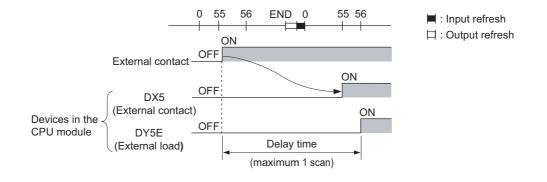


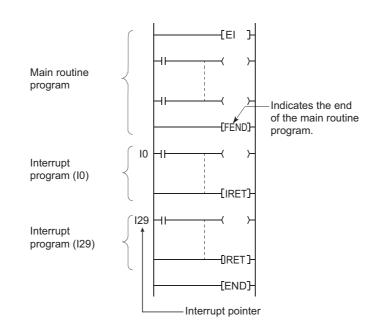

An interrupt program is from an interrupt pointer (I \Box) to the IRET instruction.


The interrupt pointer (I□) number varies depending on the interrupt factor. (Page 412, Section 4.11)

When an interrupt factor occurs, the interrupt program of the interrupt pointer number corresponding to that factor is executed. (Interrupt programs are executed only when the interrupt factor occurs.

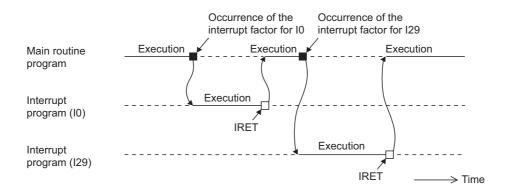


Point P

Only one interrupt program can be created with one interrupt pointer number.



(1) Programming of interrupt programs

Create interrupt programs between the FEND and END instructions in the main routine program.

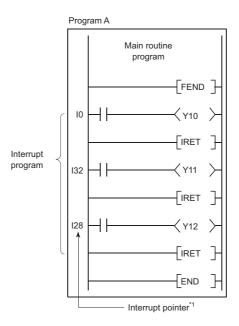

*1 The pointer numbers do not need to be specified in ascending order.

Point P

Interrupt programs can be managed as one separate program (stand-by type program). (FF Page 95, Section 2.10.3)

(a) Before executing an interrupt program


Before executing the interrupt programs of the interrupt pointers I0 to I15, I28 to I31, I45, I49, and I50 to I255, enable interrupts with the EI instruction. For details on the EI instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

(b) Restrictions on programming

PLS and PLF instructions

The PLS and PLF instructions perform off processing in the next scan after the instruction is executed. Therefore, the device which is turned on by the instruction remains on until the same instruction is reexecuted.

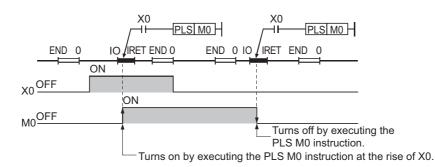

· EI and DI instructions

During execution of an interrupt program, interrupts are disabled (DI) so that any other interrupt processing will not be executed. Do not execute the EI or DI instruction during interrupt program execution.

• Timer (T) and counter (C)

Do not use the timer (T) and counter (C) in interrupt programs. If more than one interrupts occur in one scan, the timer (T) and counter (C) in the interrupt program cannot measure the time correctly. The OUT

C instruction status causes the counter (C) measure the number of interrupts incorrectly.

Instructions not available in interrupt programs

Refer to sections corresponding to each instruction in the following.

MELSEC-Q/L Programming Manual (Common Instruction)


(2) Operation when an interrupt factor occurs

There are restrictions on interrupt programs depending on the interrupt factor occurrence timing.

(a) When an interrupt factor occurs before the interrupt program execution status is enabled

The CPU module stores the interrupt factor occurred.

As soon as the interrupt program execution status is enabled, the CPU module executes the interrupt program corresponding to the stored interrupt factor.

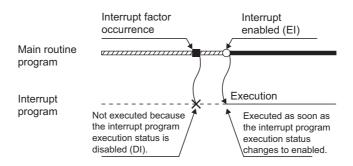


When the same interrupt factor occurs more than one time before the interrupt program execution status is enabled, the interrupt factors of I0 to I15, I28 to I31, I45, I50 to I255 and fixed scan execution type programs are stored only once. For details on the IMASK instruction, refer to the following.

However, the factors occurred by IMASK instruction at mask status are all discarded.

MELSEC-Q/L Programming Manual (Common Instruction)

(b) When an interrupt factor occurs in the STOP or PAUSE status

The CPU module executes the interrupt program as soon as the interrupt program execution status is enabled after the CPU module status is changed to RUN.

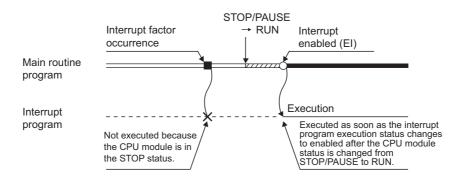


(c) When multiple interrupt factors occur simultaneously in the interrupt program execution enabled status

The interrupt programs are executed in the order of interrupt pointers (I□) with high priority.

(Page 413, Section 4.11.1)

Other interrupt programs have to wait until processing of the interrupt program being executed is completed.

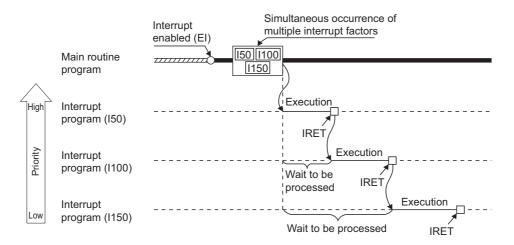

(d) When the same interrupt factor as that of the interrupt program being executed occurs


When the same interrupt factor as that of the interrupt program being executed occurs more than one time before completion of interrupt program processing, the interrupt factors of I0 to I15, I45, and I50 to I255 are stored only once, and then the interrupt program corresponding to each stored interrupt factor is executed after completion of current interrupt program execution.

The interrupt factors of I28 to I31 and fixed scan execution type programs are all stored, and then all the interrupt programs corresponding to interrupt factors are executed after completion of current interrupt program execution.

(e) When an interrupt factor occurs during link refresh

The link refresh is suspended and an interrupt program is executed.

Even if the Block data assurance per station setting is enabled in the CC-Link IE or MELSECNET/H network, this setting does not work when a device set as a refresh target is used in the interrupt program. In the interrupt program, do not use any refresh target device.

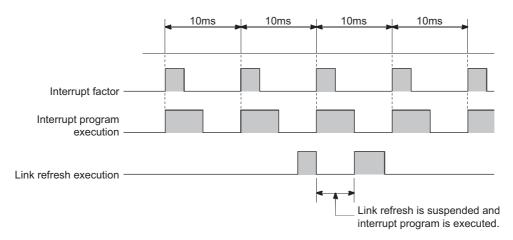

For the Block data assurance per station setting, refer to the following.

Manual for each network module

(f) Interrupt during END processing

When the constant scan function is used and an interrupt factor occurs during the waiting time in END processing, an interrupt program corresponding to the interrupt factor is executed.

(g) When an interrupt factor occurs during access to another module

When an interrupt factor occurs during access to another module (during service processing or instruction processing), the interrupt program becomes standby status until the service processing or the instruction in execution is completed.

To shorten the wait time of the interrupt, reduce the amount of data that access to other modules.

(3) Processing at program execution type change

When the program execution type is changed from the scan execution type to the interrupt, the CPU module saves and restores the following data. (FFP Page 390, Section 4.6.3)

- Data in the index register
- · File register block number

Whether to save and restore the data above can be set in the PLC parameter dialog box.

If the data is not saved or restored, the overhead time of the corresponding interrupt program can be shortened.

(Page 473, Appendix 3.2 (3))

(4) Precautions

(a) When the same device is used

During execution of an instruction in a main routine program, an interrupt program may be executed, suspending the processing of the instruction being executed.

If the same device is used for the main routine program and interrupt program, device data may become inconsistent. In this case, take the following measures to prevent device data inconsistency.

- Moving device data to another device Do not directly specify the device where the data is written by the interrupt program in the main routine program. Use the data in another device by moving the data with the transfer instruction.
- · Disabling interrupts with the DI instruction


Disable interrupts with the DI instruction if instructions that may cause inconvenience for the main routine program are used. However, interrupts do not occur during access to the device of the corresponding argument of the instruction. For this reason, data inconsistency will not occur in units of arguments.

2.10 Settings When Program is Divided

When one sequence program is divided into multiple programs, execution conditions, such as executing a program only once at start-up or executing a program at fixed intervals, can be set for each program.


(1) Control by multiple programs dividing one program

The CPU module can store multiple programs divided on the basis of each control unit. This enables programming of one sequence program by two or more designers.

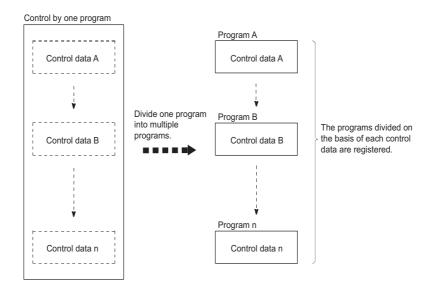

(2) Settings required for execution of multiple programs

To execute multiple programs, names (file names) and execution conditions of the programs must be set. Set them in the Program tab of the PLC parameter dialog box.

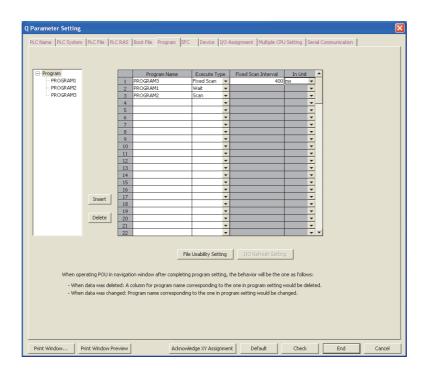

Item	Description				
Program Name	Enter the name (file name) of the program to be executed in the CPU module. The programs are executed according to the setting order.				
Execute Type	Select an execution type of the program set under "Program Name". The CPU module executes programs whose execute type has been set here according to the setting order.				
Initial execution type ("Initial")	This program is executed only once when the CPU module is powered on or its status is switched from STOP to RUN. ([] Page 92, Section 2.10.1)				
Scan execution type ("Scan")	This program is executed once in every scan, starting in the scan following the scan in which an initial execution type program is executed. (
Standby type ("Wait")	This program is executed only when its execution is requested. (127 Page 95, Section 2.10.3)				
Fixed scan execution type ("F Scan")	 This program is executed at the intervals specified under "Fixed Scan Interval" and "In Unit". () Page 98, Section 2.10.4) Fixed Scan Interval Enter the execution interval of fixed scan execution type program. The setting range depends on the setting unit. When the unit is "ms" : 0.5 to 999.5ms (in increments of 0.5ms) When the unit is "s" : 1 to 60s (in increments of 1s) In Unit Select the unit ("ms" or "s") of the fixed scan interval. 				

(a) File usability setting PNote 2.3

For each program, determine whether to use the file specified for the local device in the PLC file tab of the PLC parameter dialog box.

	Program Name	Execute	File Register		Device Initial Value		Comment		Local Device	
1	PROGRAM3	Fixed Scan	Use PLC File Setting	-	Use PLC File Setting	•	Use PLC File Setting	-	Use PLC File Setting	
2	PROGRAM1	Wait	Use PLC File Setting	-	Use PLC File Setting	-	Use PLC File Setting	-	Use PLC File Setting	
3	PROGRAM2	Scan	Use PLC File Setting	-	Use PLC File Setting	•	Use PLC File Setting	-	Not Used	
4				•		•		Ŧ		-
5				-		•		Ŧ		Ŧ
6				-		•		-		-
7				•		•		Ŧ		-
8				-		•		Ŧ		Ŧ
9				-		•		Ŧ		-
10				•		•		Ŧ		•
11				•		•		•		-
12				•		•		•		-
13				•		•		•		•
14				•		•		•		•
15				-		•		•		-

The default is set to "Use PLC File Setting".

When "Not Used" is selected, data in the local device is not saved or restored when the program execution type is changed.




Note 2.3 Universal

The Q00UJCPU does not support the file usability setting. When using the setting for the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming

tool used. (Page 467, Appendix 2)

(3) Program sequence in the CPU module

The following figure shows the program sequence after the CPU module is powered on or its status is changed from STOP to RUN.

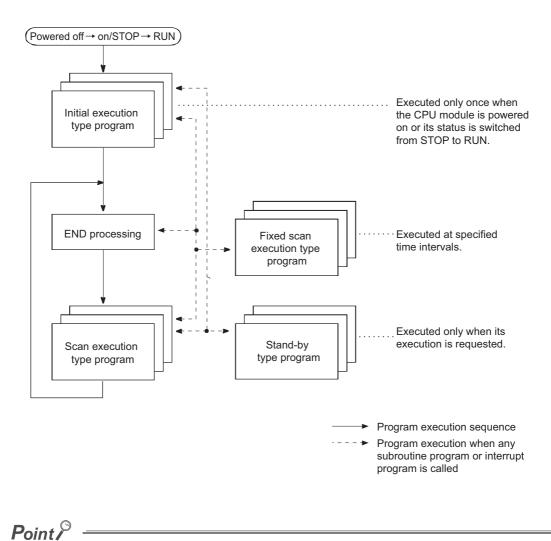


Use initial execution type program, stand-by type program, and fixed scan execution type program as required.

2.10 Settings When Program is Divided

2.10.1 Initial execution type program


Initial execution type program is executed only once when the CPU module is powered on or its operating status is changed from STOP to RUN. This type of program can be used as a program that need not be executed from the next scan and later once it is executed, like initial processing to an intelligent function module.

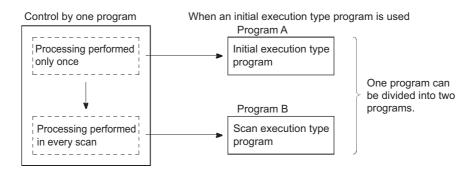

(1) Processing

(a) Execution order

After completion of all the initial execution type program execution, END processing is performed. In the next scan and later, scan execution type programs are executed.

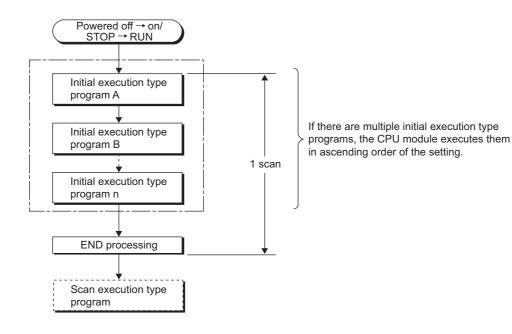

(b) Initial scan time

Initial scan time is the sum of the execution time of initial execution type program and the END processing time. When multiple programs are executed, the initial scan time will be the sum of the time required for completing all the initial execution type program execution and the END processing time.

· Initial scan time storage location

The CPU module measures the initial scan time and stores it into the special register (SD522 and SD523). The initial scan time can be checked by monitoring SD522 and SD523.



If the stored values in SD522 and SD523 are 3 and 400 respectively, the initial scan time is 3.4ms. Ex.

- · Accuracy and measurement of the initial scan time Accuracy of the initial scan time stored in the special register is ±0.1ms. Even if the WDT instruction (instruction that resets the watchdog timer) is executed in the sequence program, the measurement of the initial scan time continues.
- · Execution of an interrupt program or fixed scan execution type program When an interrupt program or fixed scan execution type program is executed before completion of the initial execution type program execution, the execution time of the executed program will be added to the initial scan time.

(2) Precautions on programming

Initial execution type programs do not support the instructions that require several scans (instructions with completion device).



Ex. SEND, RECV, and similar instructions

(3) Initial execution monitoring time setting

Initial execution monitoring time is a timer for monitoring initial scan time. Set a time value in the PLC RAS tab of the PLC parameter dialog box. The setting range is 10 to 2000ms (in increments of 10ms). No default value is set.

WDT(Watchdog Timer)Set	WDT(Watchdog Timer)Setting								
WDT Setting	200	ms (10ms2000ms)							
Initial Execution Monitoring Time	30	ms (10ms2000ms							
Low Speed Execution Monitoring Time		ms (10ms2000ms)							

(a) When the initial scan time exceeds the preset initial execution monitoring time

"WDT ERROR" occurs and the CPU module stops program operations.


Set a time value so that the initial execution monitoring time becomes longer than actual initial scan time.

Point *P*

An error of the measurement value is 10ms for the initial execution monitoring time setting. If the initial execution monitoring time (t) parameter is set to 10ms, "WDT ERROR" occurs when actual initial scan time is within the range of 10ms < t < 20ms.

2.10.2 Scan execution type program

Scan execution type program is executed once in every scan, starting in the next scan of which the initial execution type program is executed and later.

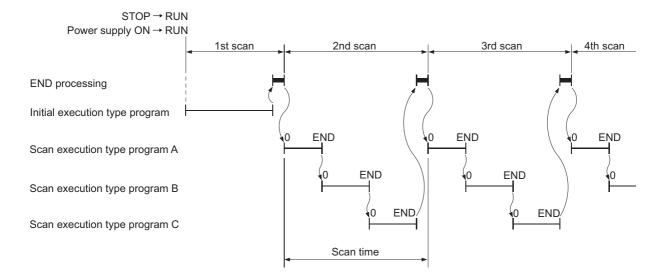

When multiple scan execution type programs are executed, the scan time will be the time required for completing all the scan execution type program execution. If an interrupt program or fixed scan execution type program is executed, execution time of the executed program will be added to the scan time.

2.10.3 Stand-by type program


Stand-by type program is executed only when its execution is requested. This type of program can be changed to any desired execution type by a sequence program instruction.

(1) Application

(a) Program library

Stand-by type program is used as a program library, a collection of subroutine programs and/or interrupt programs, and managed separately from a main routine program.

Multiple subroutine programs and/or interrupt programs can be created and managed in a single stand-by type program.

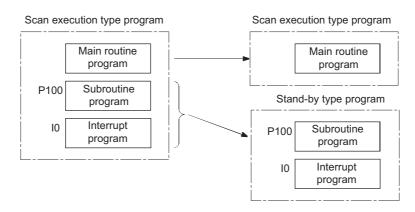

(b) Program type change

Stand-by type program is used to create and store programs available in all systems. Only required programs will be executed. For example, a program preset as a stand-by ("Wait") type program in the PLC parameter dialog box can be changed to a scan execution type program and executed in the sequence program.


(2) Execution method

Execute stand-by type programs in either of the following methods.


- Create subroutine and/or interrupt programs in a stand-by type program and call them using a pointer or when an interrupt occurs.
- Change a stand-by type program to any other execution type using instructions.

(a) Creating subroutine and/or interrupt programs in a single stand-by type program

When creating subroutine and/or interrupt programs in a single stand-by type program, start the program from the step 0. The FEND instruction used in creation of a subroutine or interrupt program is not required after a main routine program.

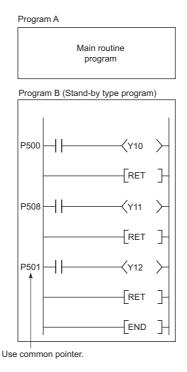

After execution of the standby type program, the CPU module re-executes the program that called a program in the standby type program. The following figure shows the operation when the subroutine and interrupt programs in the standby type program are executed.

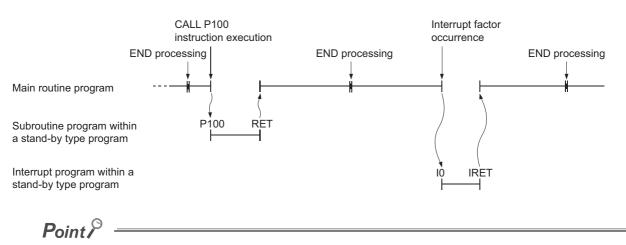

- For restrictions on programming of subroutine and interrupt programs, refer to the following.
 - Subroutine program: Page 69, Section 2.4.3
 - Interrupt program: Page 82, Section 2.9
- Use common pointers. (Page 411, Section 4.10.2) If local pointers are used, subroutine programs in a stand-by type program cannot be executed from any other program.


(b) Changing the program execution type using instructions

Use the PSCAN, PSTOP, or POFF instruction to change a program execution type. (FF Page 102, Section 2.10.5)

- **Ex.** The PSCAN instruction changes the program "DEF" to a scan execution type program.
 - The PSTOP instruction changes the program "ABC" to a standby type program.



The program execution type is changed in END processing. Therefore, the execution type will not be changed in the middle of program execution. If different types are set to the same program in the same scan, the program will be changed to the type specified by the last instruction executed.

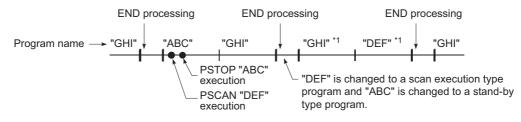

*1 The programs "GHI" and "DEF" are executed in the order set in the Program tab of the PLC parameter dialog box.

(3) Precautions on programming

(a) Unavailable devices


Unavailable devices depend on the program type (subroutine program or interrupt program) or the execution type changed by an instruction.

(b) Use of local devices

For execution of a subroutine program using a local device, refer to Page 422, Section 6.2.

2.10.4 Fixed scan execution type program

Fixed scan execution type program is a program executed at specified time intervals. This type of programs, unlike interrupt programs, can be interrupted in units of files without interrupt pointers or the IRET instruction. For the restrictions on programming, refer to Page 84, Section 2.9 (1) (b). (The restrictions on programming are the same as those for interrupt programs.)

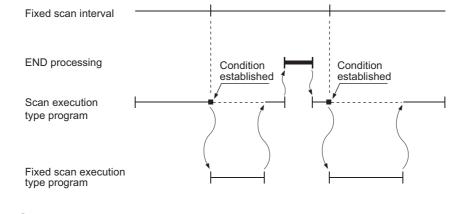

Point P

To execute a fixed scan execution type program, execute the EI instruction in the initial execution type program or scan execution type program to enable interrupts.

(1) Processing

(a) When two or more fixed scan execution type programs exist

Each fixed scan execution type program is executed at specified time intervals. If two or more fixed scan execution type programs reach the specified time at the same timing, programs will be executed in ascending order of the numbers set in the Program tab of the PLC parameter dialog box.

(b) When both fixed scan execution type program and interrupt program exist


When a fixed scan execution type program and an interrupt program (I28 to I31) reach the specified time at the same timing, the interrupt program will be given priority.

(c) When the execution condition is established during link refresh

The link refresh is suspended and a fixed scan execution type program is executed.

Even if the Block data assurance per station setting is enabled in the CC-Link IE or MELSECNET/H network, this setting does not work when a device set as a refresh target is used in the fixed scan execution type program.

In the fixed scan execution type program, do not use any refresh target device.

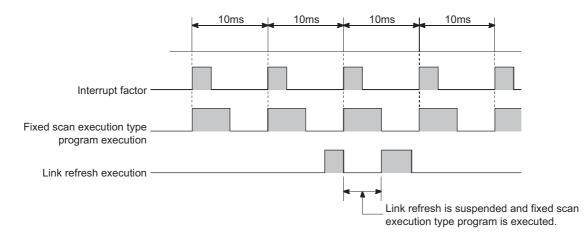


For the Block data assurance per station setting, refer to the following.

Manual for each network module

(d) When the execution condition is established during END processing

When the execution condition is established during the constant scan execution or the waiting time of the END instruction, a fixed scan execution type program is executed.

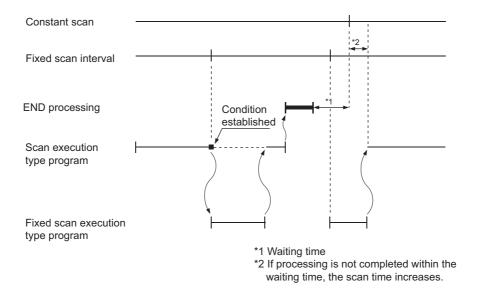

(2) Processing at program execution type change

For how to save and restore data in the index register when the program execution type is changed, refer to Page 87, Section 2.9 (3). (The method is the same as that for interrupt programs.)

(3) Precautions

(a) Execution interval of a fixed scan execution type program

Execution interval of a fixed scan execution type program may increase from the preset interval depending on the time set for disabling interrupts by the DI instruction (interrupt disabled time).

If the interrupt disabled time by the DI instruction becomes too long, use an interrupt program by fixed scan interrupt (I28 to I31) instead of a fixed scan execution type program.

Highest common factor of fixed scan execution interval*1 < Interrupt disabled time ••• Condition 1)</th>*1This is the highest common factor of execution interval set to multiple fixed scan execution type programs

When the condition 1) is satisfied, the actual execution interval of a fixed scan execution type program may increase from the preset interval by the time shown in the expression below.

Interrupt disabled time Highest common factor of fixed scan execution interval

Fixed scan execution interval set to the corresponding program


The following shows an example of the increase in execution time of a fixed scan execution type program.

Ex. • Fixed scan execution interval ••• 10ms, 5ms, 1ms, 0.5ms

• Highest common factor of fixed scan execution interval ••• 0.5ms

• Interrupt disabled time (DI) ••• 5ms (Interrupt enabled time (EI) ••• less than 0.5ms)

With the settings above, the condition 1) will be 0.5ms < 5ms.

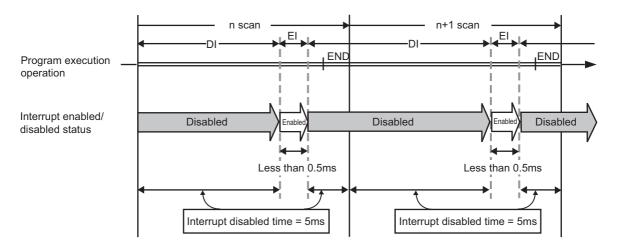


The execution time of a fixed scan execution type program whose execution interval is set to 10ms increases 100ms ($5 \div 0.5 \times 10 = 100$) at the most.

2.10.5 Changing the program execution type

(1) Changing the execution type using instructions

(a) Instructions used to change the execution type

The execution type of sequence programs can be changed using instructions even during execution. Use the PSCAN, PSTOP, or POFF instruction to change the execution type.

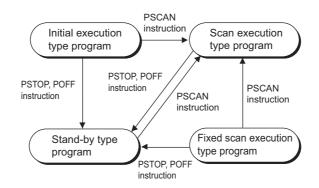

Execution type before	Instruction						
change	PSCAN PSTOP		POFF				
Scan execution type	Remains unchanged.	Changes to the stand-by type.	Turns off outputs in the next scan. Changes to the stand-by type in two scans later.				
Initial execution type	Changes to the scan execution type.	Changes to the stand-by type.	Turns off outputs in the next scan. Changes to the stand-by type in two scans later.				
Stand-by type	Changes to the scan execution type.	Remains unchanged.	No processing				
Fixed scan execution type	Changes to the scan execution type.	Changes to the stand-by type.	Turns off outputs in the next scan. Changes to the stand-by type in two scans later.				

Point P


Once the fixed scan execution type program is changed to another execution type, the type cannot be returned to the fixed scan execution type.

(b) Execution type change example

In a control program, a standby type program matching the preset condition is changed to a scan execution type program in the course of program execution.

An unused scan execution type program can also be changed to a standby type program.

The following figure shows an example where the execution type of the standby type programs "ABC", "DEF", "GHI", and "JKL" are changed in the control program.

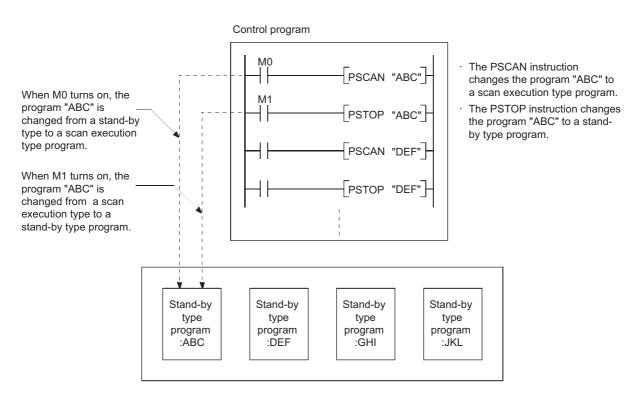

2.11 Boot Operation PNote 2.4


This section describes methods for executing the program stored in a memory card or SD memory card.

(1) Executing the program in a memory card or SD memory card

To execute the program in a memory card or SD memory card, boot the program into the program memory. To execute the boot operation, set the boot target program in the Boot file tab of the PLC parameter dialog box.

(Page 105, Section 2.11 (3))

The program set in parameter is booted into the program memory when the CPU module is powered off and then on or is reset.




(2) Bootable files, transfer source, and transfer destination

The following table lists combinations of bootable file, transfer source, and transfer destination.

		O : Bo	otable, × : Cannot be booted.		
File type	Transfer source	Transfer destination			
i ne type		Program memory	Standard ROM		
Parameter ^{*1}		0	0		
Sequence program	Normania and	0	×		
Device comment	Memory card, SD memory card ^{*2}	0	0		
Initial device value		0	0		
Label program		0	0		

*1 The intelligent function module parameter is included.

*2 If the boot operation is performed while the CPU module is locked with a security key, "BOOT ERROR" (error code: 2214) occurs.



The Q00UJCPU, Q00UCPU, and Q01UCPU do not support the boot operation.

(3) Procedure before boot operation

The following is the procedure to store files to be booted in a memory card or SD memory card before the boot operation.

1. Create a program.

2. Configure the setting for a boot operation.

Set the names of files to be booted to the program memory in the Boot File tab of the PLC parameter dialog box.

Boot File Setting						
🖃 Program		Туре		Data Name	Transfer From	Transfer To 📃 📥
MAIN	1	Sequence 🗸 🗸	-	MAIN2	Memory Card (RAM) (Drive 1) 🔻	
- MAIN1	2	Sequence 🗸 🗸	-	MAIN1	Memory Card (RAM) (Drive 1) 🔻	Program Memory (Drive 0 💌
MAIN2	3	Parameter 🗸 🗸	-	PARAM	Memory Card (RAM) (Drive 1) 🔻	
🖃 Global Comment	4	Sequence 🗸 🗸	-	MAIN	Memory Card (RAM) (Drive 1) 💌	Program Memory (Drive 0 💌
COMMENT	5	•	-		-	-
Local Comment	6	•	-			
Parameter	7	-	-		-	
PARAM	8	-	-		-	-
Device Initial Value	9	•	-			
	10	•	-			•
	11	-	-		-	
	12	•	-		-	
	13		-		-	<u> </u>
	14	•	-			•
	15	•	-		-	•
	16	-	-		•	• •
Insert Delete						

- 3. Insert a memory card or SD memory cart into the CPU module.
- 4. Write the parameter file and other files set in parameter to the memory card or SD memory card.
- **5.** Execute the program.

Power on or reset the CPU module. The BOOT LED turns on after a boot operation from the specified memory is completed.

6. Check that the boot operation has completed successfully.

The following status indicates normal completion of boot operation.

- The BOOT LED turns on.
- The special relay (SM660) turns on.
- The data written in the transfer source memory and the one in the program memory are compared and confirmed their match by "Verify with PLC".

(4) Stopping the boot operation

To stop boot operation and operate the CPU module by the parameters and program files written to the program memory, perform the following operations.

- **1.** Remove the memory card or SD memory card, and write parameters without boot file setting to the program memory.
- 2. Power off and then on the programmable controller or rest the CPU module.

(5) Precautions

(a) Storage location of parameters

- Store the parameter file set in the Boot file tab of the PLC parameter dialog box to the memory card or SD memory card. If it is stored in the program memory or standard ROM, the CPU module ignores the settings. (Figure Page 42, Section 2.1.2)
- The CPU module operates using the parameters in the program memory, not those in the memory card or SD memory card, if the following conditions are both met.
 - 1) A parameter file exists in the program memory.
 - 2) The parameter file in a memory card or SD memory card is not set for boot target in parameter.

(b) Online change during boot operation

If the program in the program memory is overwritten online while the boot operation is being performed, the change is not reflected to the program in the memory card or SD memory card. Write the same program file to the memory card or SD memory card.

(c) Maximum number of settable boot files

Set the maximum number of settable boot files in the Boot file tab of the PLC parameter dialog box so that it may be the same with the number of files storable to the program memory.

However, the number of boot files decreases by one when:

- The parameter file (with boot settings) stored in the memory card or SD memory card is booted.
- A heading is set.

(d) Boot operation when the ATA card is used

When data are booted from the ATA card, the processing time of maximum 200ms may be required per 1K step (4K bytes).

(e) When data in the program memory are changed after the CPU module is powered off and then on or is reset

If the program memory data are changed after the sequence program is written to the program memory and the CPU module is powered off and then on or is reset, a boot operation may be active.

While the BOOT LED on the front of the CPU module is on, the boot operation is active. Refer to Page 105, Section 2.11 (4) and stop the boot operation.

(f) File size before and after the boot operation

The size unit of a file stored in each memory differs. ($\square Page 50$, Section 2.1.3 (4)) Note that files transferred from the memory card or SD memory card to the program memory differ in size before and after the transfer.

(g) Program written to the memory card or SD memory card

Set the programmable controller type (model name of the CPU module) for the program written to the memory card (program set in the Boot file tab) and the model name of the CPU module to be booted to the same. Set the type (model) of the CPU module that actually performs the boot operation to the program (with boot settings) written to the memory card or SD memory card.


2.12 Programming Language

Programming tools support the following programming languages.

- Ladder
- Structured text
- SFC
- · Structured ladder

(1) Ladder

A graphical programming language used for contacts and coils. For a project with a label, the inline ST function can be used in the ladder editor which allows a user to edit structured text programs.

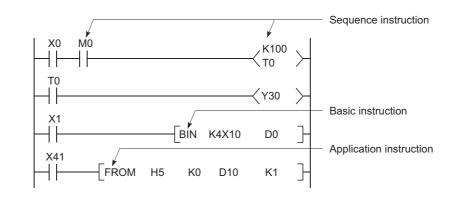

Point P

Data indicating the execution status of an operation in a sequence program step is referred to as "signal flow".

(2) Structured text

A text language such as C language, and is preferred by computing engineers.

(3) SFC

A graphical programming language where the execution order and conditions are clearly defined for the program.

(4) Structured ladder

A graphical programming language that is used contacts and coils.

.

Remark •

For the projects that support these programming languages, refer to the following.

2.12 Programming Language

2.13 Communications with Intelligent Function Modules

The intelligent function module allows the CPU module to process analog quantity and high-speed pulses that cannot be processed by the I/O modules. The following is some of the intelligent function modules.

- Serial communication module
- · Analog module

The intelligent function module is equipped with a memory (buffer memory) to store the data taken in from or output to external devices. The CPU module writes or reads data to or from the buffer memory of the intelligent function module.

(1) Setting method of intelligent function module parameters

Open the "New Module" dialog box.

9	Duele studie device N	Flore the Hill of the second of the second s	and a sheet of a 1 N	Distant all als	N FN1 N4	.1. 1
$\langle \rangle$	Project window <>	[Intelligent function	modulei 5>	Right-Click		uleI
\sim		[

New Module	le la
Module Selection	
Module Type	Analog Module
Module Name	Q64AD
Mount Position	Mounted Slot No. Image: Comparison of the state of th
Title Setting	
L	OK Cancel

	ltem	Description
Module Selection	Module Type	Select a type of the CPU module.
	Module Name	Select a model name of the CPU module.
	Base No.	Select a base No. where the CPU module is connected.
	Mounted Slot No.	Select a slot No. where the CPU module is connected.
Mount Position	Acknowledge I/O Assignment	The I/O assignment settings in the PLC Parameter dialog box can be checked.
	Specify start X/Y address	Enter the start I/O number.
Title Setting	Title	Enter a title.

Upon completion of the setting above, parameters for the intelligent function module appear in the "Project" window.



To set the intelligent function module parameters, refer to the following.

(2) Communications with the FROM and TO instructions

The FROM instruction stores data read from the buffer memory of the intelligent function module to the specified device.

The TO instruction writes data stored in the specified device to the buffer memory of the intelligent function module.

For details on the FROM and TO instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

(3) Communications using the intelligent function module device

The intelligent function module device represents the buffer memory of the intelligent function module as one of the CPU module devices. (FP Page 384, Section 4.5.1)


The difference from the FROM and TO instructions is that, with this device, both reading and writing data from and to the intelligent function module can be processed with one instruction.



(4) Communications using the intelligent function module dedicated instruction

This instruction enables easy programming for the use of functions of the intelligent function module.

Ex. Serial communication module dedicated instruction (OUTPUT instruction) The OUTPUT instruction allows communications with external device by nonprocedural protocol regardless of the buffer memory address of the serial communication module.

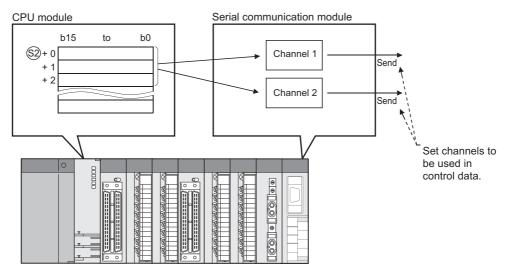

(a) Processing of the intelligent function module dedicated instruction

When using multiple intelligent function module dedicated instructions to one intelligent function module, execute the dedicated instructions one by one after the completion device turns on. This completion device turns on for one scan when an instruction is completed. If the CPU module status is changed from RUN to STOP before the completion device turns on, the completion device does not turn on until one scan after the next RUN of CPU module.

For details on the intelligent function module dedicated instructions and the completion device, refer to the following.

Manual for the intelligent function module used

2.14 Access to the AnS/A Series Special Function

Modules 9 Note 2.5

(1) Effect of high-speed access to the special function module

Processing time in the Q series CPU module has been speeded up so that the scan time is shortened. If the FROM or TO instruction is frequently executed to a special function module in short scan, processing in the special function module may not be completed correctly.

(2) Measures for high-speed access to the special function module

- Adjust execution intervals of the FROM and TO instructions to the processing time and conversion time using the timer and constant scan of the CPU module.
- Adjust execution intervals of the FROM and TO instructions using SM415 (2n (ms) clock) or SD415 (2nms clock setting).

If SM415 is used as an interlock for the FROM or TO instruction, the instruction is executed every 120ms since the initial value of SD415 has been set to "30".



Point P

When changing the SM415 clock, store the changed value in SD415. For details of SM415 and SD415, refer to the following.

GPU User's Manual (Hardware Design, Maintenance and Inspection)



Universal

Before using the AnS/A series-compatible special function modules, check the version of the CPU module used. () Page 467, Appendix 2)

PART 2 FUNCTIONS

In this part, functions of the CPU module are described.

CHAPTER 3 FUNCTIONS	11	12

CHAPTER 3 FUNCTIONS

This chapter describes the functions of the Universal model QCPU.

3.1 Function List

The following table lists the functions of the Universal model QCPU.

\bigcirc : Supported, \triangle : Partly supported, \times : No					Not supported			
Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference
Boot operation	Transfers data stored in a memory card or SD memory card to the program memory or the standard ROM at power-on or reset.	×	×	0	0	0	0	Page 104, Section 2.11
Constant scan	Executes a program in a set time interval regardless of its scan time.	0	0	0	0	0	0	Page 119, Section 3.2
Latch function	Holds the device data even when the CPU module is powered off and on or reset.	0	0	0	0	0	0	Page 122, Section 3.3
Output status selection when the status changed from STOP to RUN	Selects the output (Y) status (outputting the same status prior to STOP or clearing the status) when the operating status of the CPU module is switched from STOP to RUN.	0	0	0	0	0	0	Page 125, Section 3.4
Clock function	Reads the internal clock data of the CPU module to use it for time management.	0	0	0	0	0	0	Page 127, Section 3.5
Remote RUN/STOP	Runs or stops the program operations in the CPU module externally.	0	0	0	0	0	0	Page 131, Section 3.6.1
Remote PAUSE	Stops the program operations in the CPU module externally, holding the status of outputs (Y).	0	0	0	0	0	0	Page 134, Section 3.6.2
Remote RESET	Resets the CPU module externally when the CPU module is in the STOP status.	0	0	0	0	0	0	Page 136, Section 3.6.3
Remote latch clear	Clears the latch data in the CPU module when the CPU module is in the STOP status.	0	0	0	0	0	0	Page 137, Section 3.6.4
Input response time selection	Selects input response time values for the Q series-compatible input modules, I/O combined modules, high-speed input modules, and interrupt modules.	0	0	0	0	0	0	Page 139, Section 3.7
Error time output mode setting	Sets whether to clear or retain the output to the Q series-compatible output modules, I/O combined modules, intelligent function modules, and interrupt modules at the time of a stop error of the CPU module.	0	0	0	0	0	0	Page 141, Section 3.8

 $\mathsf{O} \ : \textbf{Supported}, \ \ \bigtriangleup \ : \textbf{Partly supported}, \ \textbf{\times} \ : \textbf{Not supported}$

Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference
H/W error time PLC operation mode setting	Sets whether to stop or continue operations in the CPU module when a hardware error has occurred in an intelligent function module or interrupt module.	0	0	0	0	0	0	Page 142, Section 3.9
Intelligent function module switch setting	Makes settings for the intelligent function modules and interrupt modules. (Refer to manuals of intelligent function modules and interrupt modules for setting details.)	0	0	0	0	0	0	Page 143, Section 3.10
Monitor function	Reads the status of programs and devices in the CPU module using a programming tool.	0	0	0	0	0	0	Page 145, Section 3.11
Monitor condition setting	Specifies the monitoring timing of the CPU module with device condition or step number.	×	×	∆*1	∆*1	0	0	Page 146, Section 3.11.1
Local device monitor/test	Monitors and/or tests the local devices of the specified program using a programming tool.	×	0	0	۵ ^{*1}	0	0	Page 151, Section 3.11.2
External input/output forced on/off	Forcibly turns on/off the external input/output of the CPU module using a programming tool.	0	0	∆*1	∆* ¹	0	0	Page 154, Section 3.11.3
Executional conditioned device test	Changes a device value within the specified step of a sequence program.	0	0	∆*1	۵ ^{*1}	0	0	Page 159, Section 3.11.4
Online change	Writes programs when the CPU module is in the RUN status.	0	0	0	0	0	0	Page 168, Section 3.12
Program monitor list	Displays the scan time and execution status of the program being executed.	0	0	0	0	0	0	Page 180, Section 3.13.1
Interrupt program monitor list	Displays the number of executions of interrupt programs.	0	0	0	0	0	0	Page 180, Section 3.13.2
Scan time measurement	Measures the execution time of the area specified by the steps in a program.	0	0	∆*1	∆*1	0	0	Page 181, Section 3.13.3
Sampling trace function	Continuously samples the specified device data at a preset timing.	×	0	0	0	0	0	Page 184, Section 3.14
Debug function from multiple programming tools	Enables simultaneous debugging by multiple programming tools.	0	0	0	0	0	0	Page 189, Section 3.15
Watchdog timer	Monitors operational delays caused by hardware failure or program error of the CPU module.	0	0	0	0	0	0	Page 193, Section 3.16
Self-diagnostic function	Self-diagnoses the CPU module to see whether an error exists or not.	0	0	0	0	0	0	Page 195, Section 3.17
Error history	Stores the result of self- diagnostics to the memory as error history data.	0	0	0	0	0	0	Page 206, Section 3.18

Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference
Security function	Protects data in the CPU module against tampering and theft by unauthorized persons.	0	0	0	0	0	0	Page 207, Section 3.19
Password registration	Prohibits writing/reading data to/from each file in the CPU module using a programming tool.	0	0	0	0	0	×	Page 207, Section 3.19.1
File password 32	Prohibits writing/reading data to/from each file in the CPU module using a programming tool. Sets a read password and write password for each file.	×	×	×	×	×	0	Page 209, Section 3.19.2
File access control by security key	Prevents unauthorized access to the files in the CPU module by writing a security key to the module. (The CPU module is locked with a security key.)	×	×	×	×	×	0	Page 214, Section 3.19.3
Remote password	Prevents unauthorized access from external devices.	0	0	0	0	0	0	Page 219, Section 3.19.4
Block password	Prevents access to program contents by setting a block password for each POU.	0	0	0	0	0	0	GX Works2 Version 1 Operating Manual (Common)
LED indication	Displays the operating status of the CPU module with LEDs on the front of the module.	0	0	0	0	0	0	Page 222, Section 3.20
LED indication priority	Sets whether to indicate an error with LED according to the priority of each error.	0	0	0	0	0	0	Page 223, Section 3.20.2
High-speed interrupt function	Executes an interrupt program at fixed intervals of 0.1 to 1.0ms using the high-speed interrupt pointer (I49).	×	x	×	×	×	0	Page 225, Section 3.21
Interrupt from intelligent function module	Executes an interrupt program at the time of interrupt request from the intelligent function module.	0	0	0	0	0	0	Page 232, Section 3.22
Serial communication function	Communicates data using the MC protocol by connecting the RS- 232 interface of the CPU module and a personal computer or HMI from other companies using an RS-232 cable.	0	0	۵ ^{*1}	۵ ^{*1}	×	0	Page 233, Section 3.23
Service processing setting	Specifies the service processing count or time to be executed in END processing.	0	0	0	0	0	0	Page 241, Section 3.24.1
Initial device value	Registers data used in a program to the device of the CPU module or the buffer memory of the intelligent function module and special function module without a program.	0	0	0	0	0	0	Page 247, Section 3.25
Battery life-prolonging function	Extends the life of a battery by holding only clock data using the battery.	0	0	0	0	0	0	Page 250, Section 3.26
Memory check function	Checks whether data in the memories of the CPU module are not changed due to excessive electric noise.	0	0	0	0	0	0	Page 251, Section 3.27

Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference
Program cache memory auto recovery function	Restores the error location automatically by using data in the program memory, which are stored in the flash ROM, when the memory check function detects an error in the program cache memory.	∆ ^{*1}	۵*۱	∆*1	∆*1	Δ*1	0	Page 252, Section 3.28
Latch data backup to standard ROM	Backs up latch data such as device data and error history to the standard ROM without using a battery.	0	0	0	0	0	0	Page 254, Section 3.29
Writing/reading device data to/from standard ROM	Writes/reads device data to/from the standard ROM.	0	0	0	0	0	0	Page 259, Section 3.30
CPU module change function with memory card	Backs up all the data (only the file register files and latch-target device data) in a CPU module to a memory card or SD memory card. The data backed up can be restored to a replaced CPU module. ^{*2}	x	x	∆*1	∆*1	∆*1	0	Page 260, Section 3.31
CPU module data backup/restoration function	Backs up data such as program files, a parameter file, and device data including file registers in a CPU module to an SD memory card. The data backed up can be restored as necessary. ^{*2}	×	x	x	×	x	۵*۱	Page 276, Section 3.32
Module model name read	Reads the model name of a module on a base unit.	∆*1	Δ*1	∆*1	△*1	∆*1	0	Page 297, Section 3.33
Module error collection	Collects errors occurred in the connected intelligent function modules in the CPU module.	∆ ^{*1}	∆ ^{*1}	∆*1	∆*1	Δ^{*1}	0	Page 298, Section 3.34
Local device batch read function	Batch-reads local device data in the CPU module and stores them in a CSV file.	×	۵ ^{*1}	∆*1	۵ ^{*1}	۵ ^{*1}	0	Page 302, Section 3.35
Send points extension function (CC-Link IE Controller Network module)	Extends the maximum number of link points per CC-Link IE Controller Network module.	۵ ^{*1}	۵ ^{*1}	∆*1	۵ ^{*1}	۵ ^{*1}	0	Page 304, Section 3.36
Write-protect function for device data (from outside the CPU module)	Disables device data writing (including the file register) from outside the CPU module such as the programming tool, GOT, SLMP/MC protocol, and FTP to the write-protected range set in the parameter.	×	×	×	×	×	۵*۱	Page 306, Section 3.37
Operation history function	Saves the operation information of device data writing/writing of files from outside the CPU module such as the programming tool, GOT, SLMP/MC protocol, and FTP into the CPU module as an operation history file, and displays it in the programming tool.	x	x	×	×	x	۵ ^{*1}	Page 314, Section 3.38

Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference
Built-in Ethernet function	Enables MC protocol communications and the following functions by using built-in Ethernet ports.	×	×	×	×	0	0	
File transfer function (FTP)	Enables the use of FTP (File Transfer Protocol) server function, which transfers files between the CPU module and external devices. External devices with a FTP client function can directly access to the files in the CPU module.	×	x	x	x	0	0	
Predefined protocol function	Sends and receives packets predefined by using GX Works2, enabling easy communications with external devices (such as measuring instruments and bar code readers)	×	×	×	×	×	∆*1	
Socket communication function	Communicates data (using TCP/UDP) with external devices connected on the Ethernet network. The function is executed by dedicated instructions.	x	×	×	×	۵ ^{*1}	0	
Simple PLC communication function ^{*1*2}	Allows data communications between specified devices at the specified timing just by doing simple settings from a programming tool.	×	×	×	×	×	۵*۱	QnUCPU
IP address change function	Changes an IP address of a built- in Ethernet port by storing it in the special relay and special register, not in the built-in Ethernet port setting parameter.	×	x	×	×	۵*۱	0	User's Manual (Communica- tion via Built- in Ethernet
IP packet transfer function	Communicates with the following devices that correspond to IP address specified via a CC-Link IE Controller Network module or CC-Link IE Field Network module, using a protocol such as the FTP or HTTP via a built-in Ethernet port from an Ethernet device such as a personal computer. • External devices on the CC- Link IE Controller Network or CC-Link IE Field Network • External devices on the Ethernet network, which are connected through the built-in Ethernet ports	×	x	x	x	∆*1	0	in Ethernet Port)
Reading/writing device data from/to the CPU module on another station by specifying an IP address	Reads/writes device data from/to the CPU module on another station by using the dedicated instructions.	x	×	×	×	×	۵ ^{*1}	
SLMP frame send instruction	Sends MC protocol messages (QnA-compatible 3E frame and 4E frame) from the CPU module to external devices connected on the Ethernet network.	×	×	×	×	×	∆*1	
Disable using port setting	Sets the Ethernet port used for communications or functions.	×	×	×	×	×	∆*1	

Function	Description	Q00U JCPU	Q00UCPU, Q01UCPU	Q02U CPU	QnUD(H) CPU	QnUDE(H) CPU	QnUDV CPU, QnUDP VCPU	Reference							
Writing/reading data to/from refresh devices with the specified station number	Writes/reads data by specifying the station number of the target station, without considering the assignment of refresh devices.	×	×	×	∆*1	۵ ^{*1}	۵*۱	MELSEC- Q/L Programming Manual (Common Instruction)							
Data logging function	Collects data from the specified device of a CPU module at a specified timing. The data logging file can be transferred from a CPU module to the FTP server using the data logging file transfer function.	×	x	x	×	x	0	QnUDVCPU/ LCPU User's Manual (Data Logging Function)							
iQ Sensor Solution function	The functions can be used in the iQ Sensor Solution.														
Automatic detection of connected device	Detects devices supporting iQ Sensor Solution connected to the CPU module, and automatically displays them on "List of devices" and "Device map area" using a programming tool.														
System configuration check	Compares the system configuration information displayed on a programming tool with the actual system configuration, and checks if they match.	x	×	×	×										
Communication setting reflection	Reflects the communication settings (such as IP addresses) of devices supporting iQ Sensor Solution on "Device map area" to the devices connected over Ethernet in the system.					×	×	×	x	∆*1	Page 334, Section 3.39, iQ Sensor Solution Reference				
Sensor parameter read/write	Reads/writes parameters from/to devices supporting iQ Sensor Solution.														
Monitoring	Monitors the current values (such as measurement values and input/output values), status (error existence), and error information of devices supporting iQ Sensor Solution graphically using a programming tool.														
Data backup/restoration	Backs up setting data (such as parameters) in a device supporting iQ Sensor Solution to an SD memory card. The data backed up can be restored as necessary. ^{*2}														
CC-Link IE Field Network Basic function	A set of functions that can be used in CC-Link IE Field Network Basic	×	×	x	×	×	∆*1	CC-Link IE Field Network Basic Reference Manual							

*1 Availability depends on the version of the CPU module. (

*2 For details, refer to $\overrightarrow{\ \ }$ Page 574, Appendix 9.

Remark
For details on the special relay (SM) and special register (SD) used for each function, refer to the following.
QCPU User's Manual (Hardware Design, Maintenance and Inspection)

3.2 Constant Scan


Scan time differs depending on the execution status of instructions used in sequence programs. This function repeatedly executes sequence programs keeping their scan time constant.

(1) Application


I/O refresh is performed before every sequence program execution.

This function is used to maintain I/O refresh intervals constant even if the execution time of each sequence program differs.


· Scan time without constant scan setting



· Scan time with constant scan setting (7ms)

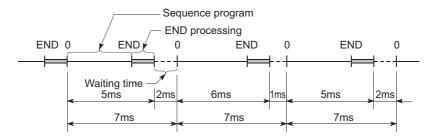


· Scan time for multiple programs with constant scan setting (10ms)

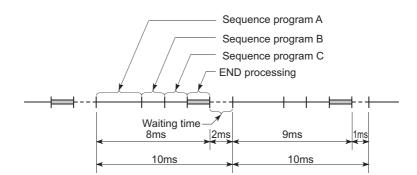

(2) Constant scan time setting

Set a constant scan time value in the PLC RAS tab of the PLC parameter dialog box. (FF Page 442, Appendix 1.2.4)

When not executing the constant scan function, leave the constant scan time setting box blank.




(a) Condition

The constant scan time needs to satisfy the following relational expression.

(WDT setting time) > (Constant scan setting time) > (Sequence program maximum scan time)

If the sequence program scan time is longer than the constant scan setting time, the CPU module detects "PRG. TIME OVER" (error code: 5010).

In this case, the constant scan setting will be ignored and the sequence program scan time will be applied.

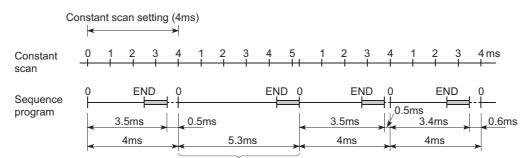

Scan where the constant scan setting is not applied

If the sequence program scan time is longer than the WDT setting time, the CPU module detects "WDT ERROR".

In this case, the program execution will be stopped.

(3) Waiting time from when END processing is executed until next scan starts

Sequence program processing is stopped during the waiting time from when END processing of a sequence program is executed until next scan starts.

(a) When an interrupt factor occurs during waiting time

Either of the following programs is executed.

- Interrupt program
- Fixed scan execution type program

(b) When a service processing parameter is set

The communication service processing with peripherals (such as programming tools) and intelligent function modules is enabled during the waiting time by setting a service processing parameter. (FFP Page 241, Section 3.24.1)

(4) Constant scan accuracy

The constant scan accuracy is 0.01ms. However, the constant scan time may increase in the following cases.

(a) When interrupt program or fixed scan execution type program is executed

Interrupts are disabled while an interrupt program or fixed scan execution type program is executed. Even if the constant scan time runs out during execution of an interrupt program or fixed scan execution type program, the constant scan cannot be finished.

In this case, the constant scan time may exceed the time set and increase by the time of the program executed.

(b) When service processing is performed just before the end of constant scan

The constant scan time may exceed the time set and increase.

3.3 Latch Function

This function holds data in each device of the CPU module when:

- the CPU module is powered off and then on,
- the CPU module is reset, or
- power failure occurs exceeding the allowable momentary power failure time.

Data in devices of the CPU module are cleared and set back to their default (bit device: off, word device: 0) if the latch function is not used.

(1) Application

This function is used to hold the data managed by sequential control and continue control operation especially when the CPU module is powered off and then on.

(2) Program operation when the latch function is used

Program operation is the same, regardless of the latch status.

(3) Devices that can be latched

The following devices can be latched. (By default, only the latch relay is latched.)

- · Latch relay (L)
- · Link relay (B)
- Annunciator (F)
- Edge relay (V)
- Timer (T)
- Retentive timer (ST)
- Counter (C)
- Data register (D)
- Link register (W)

The following devices also can be latched when the file register is set to be used in parameter (PLC file tab).

- File register (R, ZR)
- Extended data register (D)
- Extended link register (W)

Point *P*

When the battery life-prolonging function (Page 250, Section 3.26) is set, the latch relay cannot be latched.

(4) Latch interval setting

Data are latched at each scan or at set intervals. Latch timing is set in parameter.

(a) Each scan

Latch data processing is performed during END processing of each scan. Since device data is latched every scan, the CPU module holds the latest device data at all times.

(b) Time setting PNote 3.1

Latch data processing starts during the first END processing after a preset time has elapsed. Since the latch data processing is performed asynchronous to the sequence program, an increase in scan time is reduced.

Point P

If the latch interval is shorter than a scan time, the latch timing occurs more than once within one scan. However, the latch processing is performed only once during the END processing.


(5) Latch setting

To latch data, a latch range and timing need to be set.

(a) Latch range setting

Latch-target devices and ranges are set. There are two range settings: the latch clear operation enable range setting (Latch (1)) and the latch clear operation disable range setting (Latch (2)).

C Project window ⇔ [Parameter] ⇔ [PLC Parameter] ⇔ "Device" tab

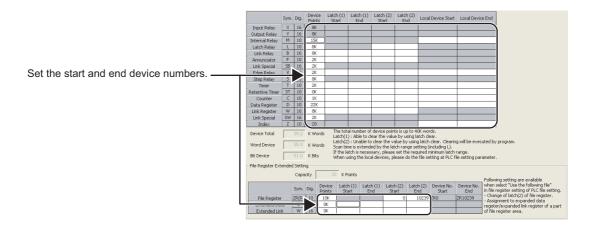

Point /

- If "Use the same file name as the program" is selected in the PLC File tab of the PLC parameter dialog box, latch ranges
 of the file register (ZR), extended data register (D), and extended link register (W) cannot be set. (All data in the file
 register (ZR) will be held.) The data outside the latch range will be cleared when the CPU module is powered off and on
 or is reset.
- When the file register file used is switched with the QDRSET instruction, the latch range setting of the file register will be disabled. After switching, regardless of the latch range setting, all data in the file register will be held.



3.1 Universal

Only the High-speed Universal model QCPU and Universal model Process CPU can select "Time Setting" in parameter. The latch interval setting is fixed to "Each Scan" for other CPU modules.

(b) Latch interval setting (High-speed Universal model QCPU and Universal model Process CPU only)

A latch timing is set. (F Page 447, Appendix 1.2.8)

🏷 Project window ⇔ [Parameter] ⇔ [PLC Parameter] ⇔ "Device" tab

ì	Label Televisel Catting	
	Latch Interval Setting	
	 Time Setting 	When time setting is selected, latch by END processing after the specified time
	10 ms (1 to 2000ms)	
	C Per Scan	

(6) Device data latch method and influence on the scan time

Data latch processing is performed during END processing. For this reason, the scan time increases.

Consider an influence on the scan time when latching devices. ([] Page 479, Appendix 3.2 (6))

Point

To minimize the scan time increase due to $atch^{1}$, reduce the number of atch points (atch (1) setting, atch (2) setting, and atch relay) as much as possible by performing the following.

- Move latch-target data to the file register.
- Store device data that is less frequently updated in the standard ROM using the SP.DEVST instruction. (The data stored in the standard ROM can be read using the S(P).DEVLD instruction.) (Page 259, Section 3.30)
- Set the latch interval parameter to "Time Setting". (Page 124, Section 3.3 (5) (b))
- *1 With the file register (including the extended data register (D) and extended link register (W)), the scan time is not increased due to latch.

(7) Device data latch clear

The following table lists the status of device data when the latch clear operation is performed.

Latch setting	Status of data
Device data without latch setting	Cleared
Device data in the "Latch (1)" range	Cleared
Device data in the "Latch (2)" range	Held ^{*1}

*1 For the clearing method, refer to Page 75, Section 2.7 (4).

(8) Precautions

(a) When a local device or initial device value is specified

Even data of the latch-specified devices cannot be latched.

(b) Use of battery

Device data in the latch range are held with the battery installed to the CPU module.

- Even for the boot operation, the battery is required to latch device data.
- Note that if the battery connector is disconnected from the connector of the CPU module while the power supply for the programmable controller is off, device data in the latch range will not be held and will become undefined.

3.4 Output Mode at Operating Status Change (STOP to RUN)

When the operating status is switched from RUN to STOP, the CPU module internally stores the outputs (Y) in the RUN status and turns off all the outputs (Y). The status of the outputs (Y) when the CPU module is changed from STOP to RUN can be selected from the following two options in the parameter setting.


- Output the output (Y) status prior to STOP. ("Previous state")
- Clear the output (Y) status. ("Recalculate (output is 1 scan later)")

(1) Application

This function is used to determine the status of outputs (whether to resume the outputs from the previous status or not) when the operating status is changed from STOP to RUN in the holding circuit.



· When outputting the output (Y) status prior to STOP

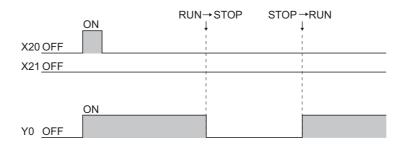

• When clearing the output (Y) status



3.4 Output Mode at Operating Status Change (STOP to RUN)

(2) Operation when the operating status is changed from STOP to RUN


(a) Previous state (Default)

The CPU module outputs the output (Y) status immediately before changed to the STOP status and then performs sequence program operations.

(b) Recalculate (output is 1 scan later)

All outputs are turned off.

The CPU module outputs the output (Y) status after sequence program operations are completed. For the operation of the CPU module when the output (Y) status is forcibly turned on in the STOP status, refer to Page 126, Section 3.4 (4).

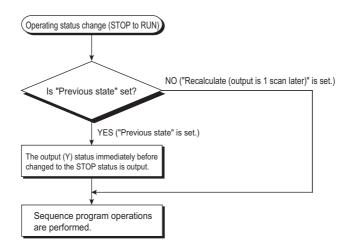

(3) Setting the output mode when the operating status is changed from STOP to RUN

Set the output mode when the operating status is changed from STOP to RUN in the PLC system tab of the PLC parameter dialog box.



(4) Precautions

The following tables shows the output status of the CPU module when the operating status is changed from STOP to RUN after the outputs (Y) are forcibly turned on in the STOP status.

Output mode ("Output Mode at STOP to RUN") selected	Output status
Previous State	The output status prior to STOP is output. The on status is not held if the output status prior to STOP was off.
Recalculate (Output is 1 scan later)	The on status is held and output.

3.5 Clock Function

This function reads the internal clock data of the CPU module by a sequence program and uses it for time management. The clock data is used for time management required for some functions in the system, such as storing date into the error history.

Remark
The Built-in Ethernet port QCPU can set the time in the CPU module automatically by using the time setting function (SNTP client).

QnUCPU User's Manual (Communication via Built-in Ethernet Port)

(1) Clock operation at power off and momentary power failure

.

Clock operation continues by the internal battery of the CPU module even when the programmable controller is powered off or power failure occurs exceeding the allowable momentary power failure time.

(2) Clock data

The following table lists the details of clock data in the CPU module.

Data name	Desc	ription			
Year	Four digits ^{*1} (fro	om 1980 to 2079)			
Month	1 te	o 12			
Day	1 to 31 (Automatic leap year detect	leap year detection)			
Hour	0 to 23 (24 hours)				
Minute	0 te	o 59			
Second	0 te	o 59			
	0	Sunday			
	1	Monday			
	2	Tuesday			
Day of the week	3	Wednesday			
	4	Thursday			
	5	Friday			
	6	Saturday			
1/1000 seconds ^{*2}	0 to	999			

*1 Storing in SD213 for the first two digits and SD210 for the last two digits of the year

*2 Can be read using Expansion clock data read (S(P).DATERD) instruction.

MELSEC-Q/L Programming Manual (Common Instruction)

(3) Changing and reading clock data

(a) Changing clock data

Clock data can be changed using either a programming tool or a program.


• Changing clock data by programming tool Open the "Set Clock" dialog box.

[™] [Online] ⇔ [Set Clock...]

Connection Channel List Connection Interface USB Target PLC Network No. 0		> PLC Module
April, 2012 Image: Constraint of the state	9	Get Time from PC Specify Execution Target Currently Specified Station Specify Module No. Specify Network No. 1 Specify Group No.
4/ 4/2012 * 6:33:19	M ·	1 Execute Close

· Changing clock data by a program

Use the DATEWR instruction (instruction for writing clock data) to change the clock data. The following shows a program example that writes clock data set D0 to D6.

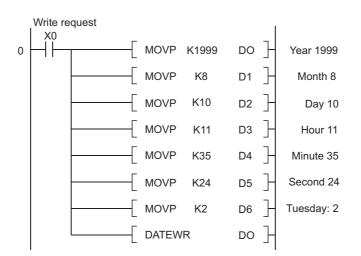

For details of the DATEWR instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

Point P

- When clock data is changed, the clock of 1/1000 seconds is reset to 0.
- Year data settable by programming tool is up to 2037.

(b) Reading clock data


To read clock data to the data register, use either of the following instructions in the program.

- DATERD (instruction for reading clock data)
- S(P).DATERD (instruction for reading extended clock data)

The following figure shows a program for storing clock data that are read using the DATERD instruction to D10 to D16.



*1 The following figure shows the clock data stored in D10 to D16.

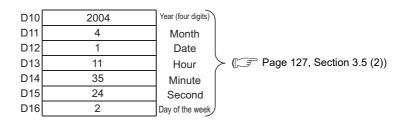

For details of the DATERD and S(P).DATERD instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

Point P

Clock data can also be written or read by the special relay (SM210 to SM213) and special register (SD210 to SD213). For details of the special relay and special register, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection).

(4) Precautions

(a) Initial clock data setting

No clock data is set at the factory.

Clock data is required for some functions of the CPU module used in the system, such as error history data storage, or for intelligent function modules.

Before using the CPU module for the first time, set the time correctly.

(b) Clock data correction

If clock data is corrected, rewrite all clock data to the CPU module.

(c) Clock data setting range

When changing clock data, write data within the range given in Page 127, Section 3.5 (2). If data outside of clock range is written to the CPU module, the clock function does not operate normally. However, the CPU module does not detect an error if the clock data is within the range.

	Write operation to the CPU module	CPU module operation
February 30	Executed	An error is not detected.
32th of month 13	Not executed	 When the DATEWR instruction is executed, "OPERATION ERROR" (error code: 4100) is detected. When SM210 is on, SM211 turns on.

(d) Use for clock data of 1/1000 sec.

• Function that clock data of 1/1000 sec. can be used

Only the following instructions can use the clock data of 1/1000 sec. Other instructions cannot use data of 1/1000 sec. (such as data read using SM/SD, data indicating error occurrence time stored as error history data, data read using a programming tool, and data read using dedicated instructions for other modules.)

- S(P).DATERD
- S(P).DATE+
- S(P).DATE-
- When clock data is changed

When clock data is changed using a programming tool or instructions (including dedicated instructions for other modules), the clock data of 1/1000 sec. is reset to 0.

(5) Clock data accuracy

Accuracy of the clock data varies depending on the ambient temperature as shown below.

Ambient temperature (°C)	Accuracy (Day difference, S)
0	-2.96 to +3.74 (TYP.+1.42)
+ 25	-3.18 to +3.74 (TYP.+1.50)
+ 55	-13.20 to +2.12 (TYP3.54)

(6) Clock data comparison

To compare clock data in a sequence program, read the clock data with the DATERD instruction (instruction for reading clock data).

Since the DATERD instruction reads the year data in four digits, the data can be compared by the comparison instruction without any modifications.

3.6 Remote Operation

The remote operation can change the operating status of the CPU module externally (using a programming tool, external devices in the MC protocol, link dedicated instructions for a CC-Link IE module or a MELSECNET/H module, or remote contacts). Four types of remote operations are available:

- Remote RUN/STOP (Page 131, Section 3.6.1)
- Remote PAUSE (F Page 134, Section 3.6.2)
- Remote RESET (Page 136, Section 3.6.3)
- Remote latch clear (Page 137, Section 3.6.4)

3.6.1 Remote RUN/STOP

This operation changes the operating status of the CPU module externally to RUN or STOP, keeping the RUN/STOP/RESET switch of the CPU module in the RUN position.

(1) Application

This operation is useful to run or stop the CPU module remotely when:

- the CPU module is inaccessible, or
- the CPU module is in a control panel.

(2) Program operation

The program operation will be as follows when the remote RUN/STOP operation is performed.

(a) Remote STOP

The CPU module executes a program until the END instruction and changes its operating status to STOP.

(b) Remote RUN

The CPU module changes its operating status to RUN and executes a program from the step 0.


(3) Executing method

(a) Using a RUN contact

Set a RUN contact in the PLC system tab of the PLC parameter dialog box. The settable device range is X0 to 1FFF.

The remote RUN/STOP operation can be performed by turning on/off the set RUN contact.

- When the RUN contact is turned off, the CPU module status changes to RUN.
- When the RUN contact is turned on, the CPU module status changes to STOP.

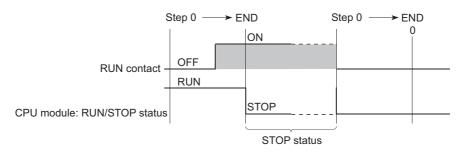


(b) Using a programming tool

Select [Online] \rightarrow [Remote Operation] \rightarrow "RUN" or "STOP".

(c) Using an external device in the MC protocol

Use MC protocol commands. For commands, refer to the following.

MELSEC Communication Protocol Reference Manual

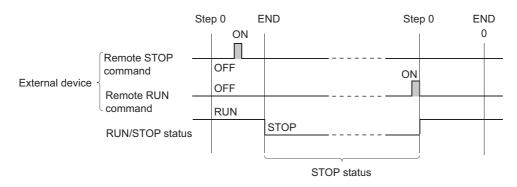

(d) With link dedicated instructions of the CC-Link IE module or MELSECNET/H module

The remote RUN/STOP operation by link dedicated instructions of the CC-Link IE module or MELSECNET/H module can change the RUN/STOP status of the CPU module.

For details, refer to the following.

Manual for each network module

(4) Precautions

Pay attention to the following since the STOP status is given priority over other status.

(a) Timing of changing to the STOP status

The operating status of the CPU module is changed to STOP when the remote STOP operation is performed from any one of the following: RUN contact, programming tool, or an external device using the MC protocol.

(b) When changing the status back to RUN

To change the operating status back to RUN after the CPU module status was changed to STOP by the remote STOP operation, perform the remote RUN operation in the same order for the remote STOP operation.

Point *P*

- The definitions of the RUN/STOP status are described below.
 - RUN status: Status where program operations are repeatedly performed in a loop between the step 0 and the END or FEND instruction.
 - STOP status: Status where program operations are stopped. All outputs (Y) turn off.
- After the CPU module is reset, the operating status of the CPU module becomes the one set using the RUN/STOP/RESET switch.

3.6.2 Remote PAUSE

This operation changes the operating status of the CPU module externally to PAUSE, keeping the RUN/STOP/RESET switch of the CPU module in the RUN position. PAUSE status is status where sequence program operations in the CPU module are stopped, holding the status (on or off) of all outputs (Y).

(1) Application

This operation is useful, especially during the process control, to hold the on status of outputs (Y) even after the operating status of the CPU module is switched from RUN to STOP.

(2) Executing method


(a) Using a PAUSE contact

Set a PAUSE contact in the PLC system tab of the PLC parameter dialog box. The settable device range is X0 to 1FFF.

• The PAUSE contact (SM204) turns on during END processing of the scan where both the PAUSE contact and PAUSE enable coil (SM206) turn on.

The CPU module executes one more scan until the END instruction after the scan where the PAUSE contact turns on, and then changes its operating status to PAUSE. In the PAUSE status, the program operations are stopped.

• When the PAUSE contact or SM206 is turned off, the PAUSE status will be canceled and the CPU module will restart the sequence program operation from the step 0.

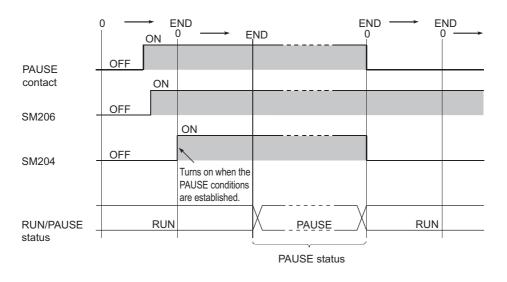

Point P

Setting of only a PAUSE contact is not allowed. (When setting a PAUSE contact, set a RUN contact as well.)

(b) Using a programming tool

Select [Online] \rightarrow [Remote Operation] \rightarrow "PAUSE".

(c) Using an external device in the MC protocol


Use MC protocol commands. For commands, refer to the following.

MELSEC Communication Protocol Reference Manual

• The PAUSE contact (SM204) turns on during END processing of the scan where the remote PAUSE command is executed.

The CPU module executes one more scan until the END instruction after the scan where the PAUSE contact turns on, and then changes its operating status to PAUSE. In the PAUSE status, the program operations are stopped.


• Upon execution of the remote RUN command, the CPU module will restart the sequence program operations from the step 0.

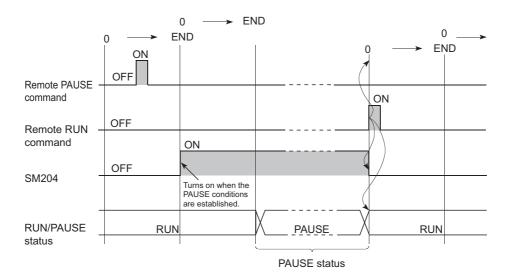

(3) Precautions

(a) When forcibly keeping output status (on or off)

To forcibly keep the output status (on or off) in the PAUSE status, provide an interlock with the PAUSE contact (SM204).

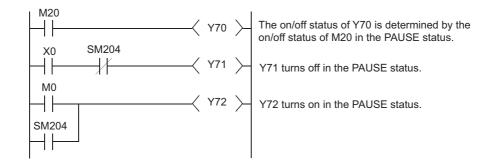

3.6.3 Remote RESET

This operation resets the CPU module externally when the CPU module is in the STOP status. Even if the RUN/STOP/RESET switch is in the RUN position, this operation can be performed when the module is stopped due to an error detected by the self-diagnostics function.

(1) Application

This operation is useful to reset the CPU module remotely when an error occurs in the CPU module placed in an inaccessible location.

(2) Executing method

(a) Using a programming tool

Select [Online] \rightarrow [Remote Operation] \rightarrow "RESET".

(b) Using an external device in the MC protocol

Use the MC protocol command. For the commands, refer to the following.

MELSEC Communication Protocol Reference Manual

Point P

Before performing the remote RESET operation, select the "Allow" checkbox for the remote RESET operation in the PLC System tab of the PLC parameter dialog box, and write the parameter setting to the CPU module. Without the preset parameter setting, the operation cannot be performed.

(3) Precautions

(a) Remote RESET in the RUN status

When the CPU module is in the RUN status, the remote RESET operation cannot be performed. To perform the operation, change the operating status of the CPU module to STOP by the remote STOP.

(b) Status after reset processing

After reset processing of the remote RESET operation is completed, the CPU module will be placed in the operating status set by the RUN/STOP/RESET switch.

If the RUN/STOP/RESET switch is set to STOP, the CPU module will be in the STOP status. If the switch is set to RUN, the CPU module will be in the RUN status.

Point P

- If the remote RESET operation is performed to the CPU module which is stopped due to an error, note that the CPU module will be placed in the operating status set by the RUN/STOP/RESET switch after reset processing is completed.
- If the CPU module cannot be reset by the remote RESET operation from a programming tool, check if the remote RESET operation is set to "Allow" under the PLC System tab in the PLC parameter dialog box.
 If the "Allow" checkbox is not selected, the CPU module cannot be reset even after the remote RESET processing from a programming tool is completed.

(c) When an error occurs due to noise

Note that the CPU module may not be reset by the remote RESET operation. In this case, reset the CPU module using the RUN/STOP/RESET switch or power off and then on the CPU module.

3.6.4 Remote latch clear

This function resets the latched device data from a programming tool when the CPU module is in the STOP status.

(1) Application

This function is useful in the following cases if used together with the remote RUN/STOP operation.

- When the CPU module is inaccessible
- · To clear latched device data in the CPU module in a control panel externally

(2) Executing method

(a) Using a programming tool

 $Select \ [Online] \rightarrow [Remote \ Operation] \rightarrow "Latch \ clear".$

(b) Using an external device in the MC protocol

Use the MC protocol command. For the commands, refer to the following.

MELSEC Communication Protocol Reference Manual

To perform the remote latch clear operation, follow the following steps.

- 1. Change the operating status of the CPU module to STOP by the remote STOP operation.
- 2. Clear the latched device data in the CPU module by the remote latch clear operation.
- **3.** After remote latch clear processing is completed, perform the remote RUN operation to return the operating status to RUN.

(3) Precautions

(a) Latch clear in the RUN status

The latch clear operation cannot be performed when the CPU module is in the RUN status.

(b) Latch clear enabled range

There are two kinds of latch range can be set in the Device tab of the PLC parameter dialog box: latch clear operation enable and disable range.

Remote latch clear operation resets only the data set in the "Latch (1)" (latch clear operation enable range). For the method for resetting the device data in the latch clear operation disable range, refer to Page 75, Section 2.7 (4) (b).

(c) Devices that are reset by the remote latch clear operation

Devices that are not latched are also reset when the remote latch clear operation is performed.

3.6.5 Relationship between remote operation and RUN/STOP status of the CPU module

(1) Relationship between remote operation and RUN/STOP status of the CPU module

The following table lists the operating status of the CPU module according to the combination of remote operation and RUN/STOP status of the CPU module.

RUN/STOP	RUN/STOP Remote operation					
status	RUN ^{*1}	STOP	PAUSE ^{*2}	RESET ^{*3}	Latch clear	
RUN	RUN	STOP	PAUSE	Operation disabled ^{*4}	Operation disabled ^{*4}	
STOP	STOP	STOP	STOP	RESET ^{*5}	Latch clear	

*1 When performing the operation using a RUN contact, "RUN-PAUSE contact" must be set in the PLC system tab of the PLC parameter dialog box.

*2 When performing the operation using a PAUSE contact, "RUN-PAUSE contact" must be set in the PLC system tab of the PLC parameter dialog box.

In addition, the PAUSE enable coil (SM206) must be turned on.

*3 The "Allow" checkbox for the remote RESET operation must be selected in the PLC system tab of the PLC parameter dialog box.

*4 The remote RESET and remote latch clear operations are enabled if the CPU module status is changed to STOP by the remote STOP operation.

*5 The status includes a case where the CPU module is stopped due to an error.

(2) Remote operations from a single programming tool

When remote operations are performed from a single programming tool, the operating status of the CPU module will be the status of the last remote operation performed.

(3) Remote operations from multiple programming tools

Any remote operation from other programming tools via other stations cannot be performed to the CPU module where remote operations are being performed from a programming tool connected. To perform any remote operations from other programming tools, cancel the remote operation by performing the remote RUN operation from the same programming tool that is performing the current remote operation.


For example, even if the remote STOP or RUN operation is performed from the other programming tool to the CPU module where the remote PAUSE operation has been performed by the programming tool connected, the CPU module remains in the PAUSE status. Once after the remote operation is canceled by performing the remote RUN operation from the same programming tool that is performing the remote PAUSE operation, remote operations from the other programming tool will be enabled.

3.7 Q Series-compatible Module Input Response Time Selection (I/O Response Time)

This function is used to change the input response time for each Q series-compatible module. The following table lists the modules available for input response time change and selectable time settings.

Module name	Туре	Settable time
Input module	"Input"	1ms, 5ms, 10ms, 20ms, 70ms (Default: 10ms)
I/O combined module	"I/O Mix"	This, sins, tonis, zonis, ronis (Delaut. tonis)
High-speed input module	"Hi Input"	0.1ms, 0.2ms, 0.4ms, 0.6ms, 1ms (Default: 0.2ms)
Interrupt module	"Interrupt"	0.1115, 0.2115, 0.4115, 0.0115, 1115 (Delaut. 0.2115)

The Q series-compatible modules in the table above take in external inputs within the set input response time.

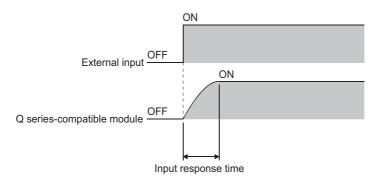

(1) Input response time setting

Set input response time values in the I/O Assignment tab of the PLC parameter dialog box.

No.	Slot	Туре	_	Model Name	Points	Start X	<u>ہ</u>	Switch Settin
	PLC 0(*-0)	PLC Input	*		16Points T			Detailed Setti
	1(*-1)	Input	*		16Moints -		- 1	Decared Jetts
	2(*-2)		-				_	Select PLC tw
	3(*-3)		-		-		_	
	4(*-4)		*				_	Select modul
	5(*-S)		+				_	
	6(*-6)		*				-	
	.Base2						*	
	Main Base1		_					Auto Detal
	:Base2 Base3						*	8 Slot Defaul
	Base3		_				Ť	
	.Base5						*	12 Slot Defau
Ext	.Base6						-	Select
Ext	.Base7						٣	module name
	(*1)Setting sho	ald be set as same when usin	ig multiple CPU.	Export to CSV File	Import Multiple CP	U Parameter	R	ead PLC Data

	Slot	Туре	Model Name	Error Time Output Mode	PLC Operation Mode at H/W Error	I/O Response Time	Control PLC(*1)
		PLC		-	-	-	
	0(*-0)	Input		-	*	10ms 💌	
	1(*-1)				*	1ms	
	2(*-2)					Sms 10ms	
	3(*-3)			-	-	20ms	-
	4(*-4)			-	*	70ms	
	5(*-5)				*	-	
	6(*-6)			-			-
	7(*-7)			-		-	
	8(*-8)				×	*	
)	9(*-9)			-	*	*	
	10(*-10)			-			-
2	11(*-11)			-		*	
3	12(*-12)				*	*	
	13(*-13)					*	
5	14(*-14)			-			-
	Vertice should be	set as same when using n	hi li stan				

1. Set I/O assignment.

2. Click the Detailed Setting button.

3. Select an input response time.

(2) Precautions

(a) When input response time is shortened

The shorter the input response time is, the more the CPU module is susceptible to noise. Consider the operating environment when setting input response time values.

(b) When an AnS/A series-compatible module is used

The input response time cannot be changed.

Even if the input response time is set to the slot of the input module or interrupt module (AnS/A seriescompatible), the setting is not valid.

(c) Enabling the setting

The input response time setting will be enabled when:

• the CPU module is powered off and then on, or

• the CPU module is reset.

3.8 Error Time Output Mode Setting

This function determines the output mode (clear or hold) from the CPU module to the Q series-compatible output modules, I/O combined modules, intelligent function modules, and/or interrupt module when a stop error occurs in the CPU module.

(1) Error time output mode setting

Set the error time output mode in the I/O Assignment tab of the PLC parameter dialog box.

No. Slot	t Type		Nodel Name	Points		Start XY 🔺	Switch Setting
0 PLC	PLC	*			-		
1 0(*-0)	Output	-		16Points	-		Detailed Setting
2 1(*-1)	I/O Mix	*		16Points	*		
3 2(*-2)	Intelligent	*		16Points	*		Select PLC type
4 3(*-3)	Interrupt	-		32Points	-		Select module
5 4(*-4)		*			*		Jelett Hoode
6 5(*-5)		*			-		
7 6(*-6)		*			+	-	
Ext.Base1						*	C Detail
Sase Setting(*1)	Base Model Name		er Model Name	Extension		Slots	Base Mode
Main	00001100000			Children (Martin		-	@ Auto
		_				-	C Detail
Ext.Base2							
Ext.Base3						*	8 Slot Default
Ext.Base4						*	12 Slot Default
Ext.Base5						*	12 Slot Derauk
Ext.Base6						-	Select
Ext.Base7						*	module name
(*1)Setting s	hould be set as same when usi	ng multiple CPU.	Export to CSY Pi	a Import Mult	ple CPU F	oraneter	Read PLC Data

Slot	Туре	Model Name		Error Time Output Mode		PLC Operation Mode at H/W Error		I/O Response Time		
PLC	PLC			Ŧ		Ŧ		*		1
0(*-0)	Output		Clear	-		+		-		4
1(*-1)	I/O Mix		Clear	-		-	10ms	+		4
2(*-2)	Intelligent		Clear		Stop	*		-		4
3(*-3)	Interrupt		Clear		Stop	*	0.2ms	+		1
4(*-4)			Clear			-		-	-	
5(*-5)			Hold	_		-		-		1
6(*-6)				Ŧ		-		-		1
7(*-7)				Ŧ		Ŧ		-		1
8(*-8)				Ŧ		Ŧ		-		1
9(*-9)				-		-		-	-	1
10(*-10)				Ŧ		-		-		1
11(*-11)				¥		Ŧ		Ψ.		1
12(*-12)				Ŧ		Ŧ		-		1
13(*-13)				-		Ŧ		-		1
14(*-14)				-		-		-		-

1. Set I/O assignment.

2. Click the Detailed Setting button.

3. Select "Clear" or "Hold" for the slot where the error time output mode is set. (Default: "Clear")

(2) Precautions

The error time output setting will be enabled when:

- the CPU module is powered off and then on, or
- the CPU module is reset.

This setting determines whether to stop or continue the CPU module operation when a hardware error (CPU module detects SP.UNIT DOWN) occurs in the intelligent function module or the interrupt module.

(1) H/W error time PLC operation mode setting

Set the H/W error time PLC operation mode in the I/O Assignment tab of the PLC parameter dialog box.

				Model Name	Points	Start XY 🔺	Switch Setting
No.	Slot	PLC	*	PAUGETRENE		1000.01	
	0(*-0)		-		-		Detailed Setting
			*		-		
	2(*-2)	Intelligent	*		32Points 💌		Select PLC type
4			-		*		Select module
	4(*-4)		*		v		Jelett IIttude
			*		*		
7 1	6(*-6)		*		*	*	
Ext.E	Base2					*	
	ain Basel					-	C Detail
						*	
	Sase3					•	8 Slot Default
	3ase4						12 Slot Default
	Base5						
	Sase7						Select module pame
LOAN	/09//						1100000110110
(-	1)36010 5100	d be set as same when	using indicate C	PU. Export to CSV Fi	e Import Multiple CPU	Parameter	ead PLC Data

Slot	Туре	Model Name	Error Ti Output M		PLC Operation Mode at H/W Error	I/O Response Time	Control PLC(*1)
	PLC			Ŧ	-		-
0(*-0)				-	-	*	
1(*-1)				-	•	*	
2(*-2)	Intelligent		Clear	¥	Stop 👻	*	
3(*-3)				Ŧ	Stop	*	
4(*-4)				Ŧ	Continue	-	-
5(*-5)				-	-	-	
6(*-6)				¥	¥	*	
7(*-7)				Ŧ		*	
8(*-8)				Ŧ	-	*	-
9(*-9)				-		-	-
10(*-10)				Ŧ	•	*	
11(*-11)				¥	¥	*	
12(*-12)				Ŧ	-	*	
13(*-13)				Ŧ	-	-	-
14(*-14)				-	-	*	
 ······································	set as same when using m	the le contra					

1. Set I/O assignment.

2. Click the Detailed Setting button.

 Select "Stop" or "Continue" for the slot where the H/W error time PLC operation mode is set. (Default: "Stop")

(2) Precautions

The H/W error time PLC operation setting will be enabled when:

- · the CPU module is powered off and then on, or
- the CPU module is reset.


3.10 Intelligent Function Module Switch Setting

Switches of a Q series-compatible intelligent function module or an interrupt module can be set in a programming tool.

(1) Writing the switch settings

The switch settings will be written from the CPU module to each intelligent function module and interrupt module when:

- the CPU module is powered off and then on, or
- the CPU module is reset.

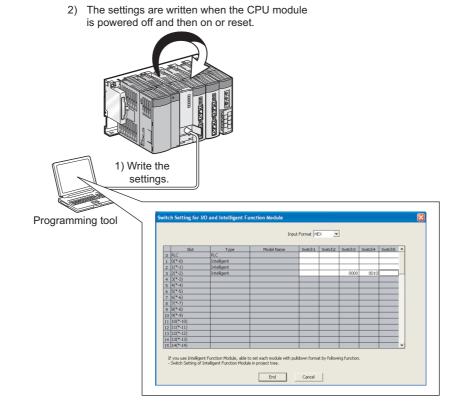

(2) Switch setting for an intelligent function module or an interrupt module

Set the switch details in the I/O Assignment tab of the PLC parameter dialog box.

1 2 3 4	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3)		Type PLC		Model Name						Switch S	Setting
1 2 3 4	0(*-0) 1(*-1) 2(*-2) 3(*-3)			*	1 20201 120100		Poin	•	Start XY			
2 3 4	1(*-1) 2(*-2) 3(*-3)		Intelligent	-			32Points	-		_	Detailed	Setting
4	3(*-3)		Intelligent	¥			32Points	¥			Select PL	
5	3(13)		Intelligent	*			32Points	*		- 1		
	4(*-4)			-				-		- 1	Select m	nodule
6	4(*-4) 5(*-5) 6(*-6)			*				*				
Assign Leavin	ing the I	ting blank wi	not necessary as ti I not cause an error		ioes it automatically. r.							
Dase :	econgl.		se Model Name		Power Model Name		Extension	Cable	9	sts	Base Mo	
	lain				1.0100 1.700 1.000		1.1.(E) (94/4			*	@ Aut	
	Base1				-			_		*	C Det	;al
Ext.	Base2 Base3					-			_	*	8 Slot De	de k
	Base4			-		-			-	-		
Ext.	Base5									*	12 Slot D	
Ext.	Base6 Base7			_						*	Selec module r	t.
int Wi	ndow	Print We	ndow Preview		Admovindge XY Assignme	ent	Default	Che	*	End		Cance
				ent Fu	nction Module			Che	3 k [End		Cance
		ing for I/	O and Intellig	ent Fu	inction Module	Format HE	x					Cance
Swite	ch Sett		O and Intellig	ent Fu	inction Module	Format HE	x		* Switch+	End	5 4	Cance
Swite	ch Sett	ing for I/	O and Intellig	ent Fu	inction Module	Format HE	x				5	Cance
Swite	ch Sett	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch	5	Cance
Swite 0 1 2 3	PLC 0(*-0) 1(*-1) 2(*-2)	ing for I/	O and Intellig Type PLC Inteligent	ent Fu	inction Module	Format HE	x		Switch4	Switch	5	Cance
Swite	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3)	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Canco
Swite	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 4(*-4)	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swit/	ch Sett PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 4(*-4) 5(*-5)	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swit:	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 4(*-6) 5(*-6) 6(*-6)	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 5 6 6 7 7	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 4(*-4) 5(*-5) 6(*-6) 7(*-7) 8(*-8)	ing for I/	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 4 5 6 6 7 7 8 9 9	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 6(*-6) 6(*-6) 7(*-7) 8(*-8) 8(*-8) 8(*-8) 8(*-8)	ing for 1/ Slot	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 4 5 6 6 7 7 8 9 9 10	PLC 0(*-0) 2(*-1) 2(*-2) 2(*-3) 4(*-4) 5(*-5) 5(*-5) 8(*-8) 7(*-7) 8(*-8) 9(*-9	Slot	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 5 6 6 7 7 8 9 1 11 112	PLC PLC Q(*-0) I(*-1) Q(*-2) Q(*-2) Q(*-3) Q(*-3) Q(*-3) Q(*-3) Q(*-3) I(*-1) I(*-	ing for 1/ Slot	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 4 5 6 7 8 9 10 11 11 11	PLC 0(*-0) 1(*-1) 2(*-2) 3(*-3) 4(*-4) 5(*-5) 6(*-6) 9(*-9) 10(*-1) 11(*-1)(*-1)(*-1)(*-1)(*-1)(*-1)(*-1)(*-	ing for 1/ Slot	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Cance
Swite 0 1 2 3 4 4 5 6 6 7 7 8 9 9 10 11 12 13 14	PLC PLC Q(*-0) I(*-1) Q(*-2) Q(*-2) Q(*-3) Q(*-3) Q(*-3) Q(*-3) Q(*-3) I(*-1) I(*-	ing for 1/ slot	0 and Intellig Type PLC Inteligent Inteligent	ent Fu	inction Module	Format HE	x	Switch3	Switch4	Switch		Canco

1. Set I/O assignment.

2. Click the Switch Setting button.

3. Set the switch details for an intelligent function module or an interrupt module.

(3) Precautions

(a) When an AnS/A series-compatible module is used

Do not set the switch details for AnS/A series-compatible special function modules. Even if values are input, the setting is ignored.

(b) Switch setting details of each module

For the switch setting details of each intelligent function module or interrupt module, refer to the manual for the intelligent function module or interrupt module used.

(c) Enabling the setting

The switch settings of each intelligent function module or interrupt module will be enabled when:

- the CPU module is powered off and then on, or
- the CPU module is reset.

O : Available. \triangle : Available with restrictions. × : Not available

3.11 Monitor Function

Programs and device data of the CPU module, and intelligent function module status can be read from a programming tool using this function.

				,		,
Monitor function	Q00UJ CPU	Q00UCPU, Q01UCPU	Q02UCPU	QnUD(H) CPU	Built-in Ethernet port QCPU	Reference
Monitor ^{*1}	0	0	0	0	0	Operating manual for the programming tool used
Monitor condition setting	×	×	∆ ^{*2}	△*2	0	Page 146, Section 3.11.1
Local device monitor/test	×	0	0	0	0	Page 151, Section 3.11.2
External input/output forced on/off	0	0	∆*2	∆*2	0	Page 154, Section 3.11.3
Executional conditioned device test	0	0	∆*2	△*2	0	Page 159, Section 3.11.4

*1 This includes a ladder monitor, device batch monitor, entry data monitor, entry ladder monitor and local device monitor.

*2 Availability depends on the version of the CPU module. (F Page 467, Appendix 2)

(1) Monitor request timing and displayed data

The CPU module processes monitor requests from a programming tool during END processing. For this reason, the data in the CPU module at the time of END processing will be displayed in the programming tool.

(2) Monitor with monitor condition settings

By setting a monitor condition in a programming tool during debugging, the program operation status in the CPU module can be monitored under the specified condition. Also, by setting a monitoring stop condition, a monitoring status can be held under the specified condition.

(3) Local device monitor

If multiple programs are executed and local devices are used, data in local devices of each program can also be monitored.

3.11.1 Monitor condition setting PNote 3.2

This setting is used to monitor data in the CPU module under a specified condition.

(1) Setting method

There are two kinds of monitor condition setting.

- · Monitor execution condition setting
- · Monitor stop condition setting

For the setting method, refer to the following.

Operating manual for the programming tool used



Note 3.2 Universal

The Q00UJCPU, Q00UCPU, and Q01UCPU do not support this function. Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used. (

(a) When only a step number is specified

Monitor data is collected when the status immediately before execution of the specified step becomes the specified status.

The following status can be specified.

- When the operation of the specified step changes from the non-execution status to the execution status:
 <^>
- · Always only when the operation of the specified step is in execution: <ON>
- · Always only when the operation of the specified step is in non-execution: <OFF>
- · Always regardless of the status of the operation of the specified step: <Always>

Point

• If a step between the AND/OR blocks is specified as a monitor condition, monitor data is collected when the status previous to execution of the specified step is specified by the LD instruction. The monitor timing depends on the ladder of step specified as a monitor condition. The following shows examples of monitoring when the step 2 is on (Step No. [2] = <ON>).

Condition	Condition Description					
	The monitor execution condition is established when both X0 and X1 are on.					
When the step 2 is connected by the AND instruction	Ladder mode \searrow Step 2 $0 \qquad X1 \qquad X2 \qquad (Y20)$	List mode 0 LD X0 1 AND X1 2 AND X2 3 OUT Y20				
	The monitor execution condition is established when on/off status of X0 does not affect the establishment execution condition.)	•				
When the step 2 is connected in the middle of the AND/OR block	Ladder mode \searrow Step 2 0 1 221 2 21 21 2 21 21 2 2 21 2 2 2 2 2 2 2 2 2 2	List mode 0 LD X0 1 LD X1 2 AND X2 3 OR X3 4 ANB 5 OUT Y20				
When the start of a ladder block other than the	Monitor data is collected when the execution status or right before execution becomes the specified status. <on>) is specified in the following ladder, monitor da when OUT Y10 turns on.</on>	lf (Step No. [2] = ta is collected				
step 0 is specified for the step number as a detailed condition	Ladder mode	List mode 0 LD X0 1 OUT Y10 2 LD X1 3 OUT Y11				

- When "0" is specified as the step No., set the condition to "Always".
- With the High-speed Universal model QCPU and Universal model Process CPU, only the first data which satisfies the specified conditions is collected if the step between the FOR and NEXT instructions is specified.

(b) When only a device is specified

Either word device or bit device can be specified.

· When a word device is specified

Monitor data is collected when the current value of the specified word device becomes the specified value. Enter the current value (in decimal or hexadecimal).

• When a bit device is specified

Monitor data is collected when the execution status of the specified bit device becomes the specified status. Select the execution condition (on the rising edge or falling edge).

(c) When a step number and device are specified


Monitor data is collected when the status previous to execution of the specified status or the status (current value) of the specified bit device (word device) becomes the specified value.

Point Point

When "Step No.[100]=<^>, Word device [D1]=[K5]" is specified as an execution condition, a monitor execution condition is established on the rising edge of the step 100 and also D1=5.



The monitor interval of a programming tool depends on the processing speed of the programming tool. For the monitor execution conditions established at the interval shorter than the monitor interval of the programming tool, monitor is executed only when the monitor execution condition is established at the monitor timing of the programming tool.

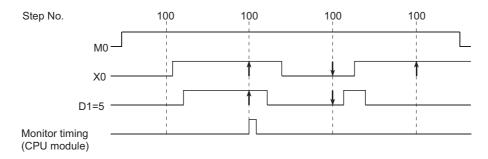

• With the High-speed Universal model QCPU and Universal model Process CPU, only the first data which satisfies the specified conditions is collected if the step between the FOR and NEXT instructions is specified.

(2) Precautions

(a) Files to be monitored

When monitor conditions are set, a programming tool monitors the file displayed on the screen. Select [Online] \rightarrow [Read from PLC] in the programming tool and read data from the CPU module so that the file name in the CPU module to be monitored matches the file name displayed on the screen of the programming tool.

(b) No file register setting

If the file register is monitored when there is no file register used, "FFFF_H" is displayed.

(c) Device assignment

For a monitor operation, the device assignment in the CPU module and the programming tool must be the same.

(d) Monitoring the buffer memory of an intelligent function module

When monitoring the buffer memory of an intelligent function module, the scan time increases for the same reason for execution of the FROM/TO instructions.

(e) Monitoring by multiple users

When multiple users are performing monitoring at the same time, pay attention to the following.

- High speed monitor can be performed by increasing 1K step per monitor file of other stations in the system area when formatting the program memory or setting a parameter in the Boot file tab of the PLC parameter dialog box. Up to 15 stations can be set as the station monitor file, but the program space will be reduced.
- If the monitor condition or monitor stop condition is set, only one user can perform monitoring.

(f) Setting a monitor stop condition

A monitor stop condition can be set only in the ladder monitor.

(g) Specifying the same device as a condition

When specifying the same device as a monitor condition or monitor stop condition, set the on/off status as well.

(h) Specifying a step number as a monitor condition

If an instruction in the specified step is not executed in such cases described below, the monitor condition will not be established.

- The specified step is skipped with the CJ, SCJ, or JMP instruction.
- The specified step is the END instruction and never be executed because the FEND instruction also exists in the program.

(i) During monitor condition registration

Do not reset the CPU module while monitoring conditions are being registered.

(j) Monitor operation with monitor condition setting

When monitor operation with monitor condition setting is performed, other applications on the same personal computer cannot execute any online function using the same route for the monitor operation. The following applications must be noted.

- Programming tool
- Application using MX Component
- MX Sheet

If any online function is executed by other applications using the same route for the monitor operation, the following situations may occur.

- No response is returned from the CPU module for the online function executed. (An online communication function time-out occurs.)
- The CPU module detects an error (error code: 4109) for the online function executed.
- Even when the monitor condition is established in the CPU module, monitoring results cannot be updated for the monitor operation with monitor condition setting.

3.11.2 Local device monitor/test PNote 3.3

This operation is useful for debugging a program, monitoring local devices (Page 422, Section 6.2) in the program monitored by a programming tool.

(1) Monitoring a local device


The following table lists the monitor operation when the CPU module executes three programs "A", "B", and "C" and D0 to D99 are set as a local device.

(Three programs are to be executed in the order of $A \rightarrow B \rightarrow C \rightarrow (END \text{ processing}) \rightarrow A \rightarrow B....)$

Setting	Monitored device				
Setting	D0 (Local device)	D100 (Global device)			
l and device mention is not	The D0 value in the specified program (local	The D100 value after execution of the			
Local device monitor is set	device for a program) is monitored. ^{*1}	specified program is monitored. ^{*2}			
Local device monitor is not set	The D0 value after execution of the program	The D100 value after execution of the			
Local device monitor is not set	"C" is monitored.	program "C" is monitored.			


*1 When "Not Used" is set for "Local device" in File Usability Setting of the Program tab, the D0 value after execution of the specified program is monitored.

*2 When local devices are monitored using the built-in Ethernet ports of the QnUDE(H)CPU whose serial number (first five digits) is "11013" to "12051", the value in D100 after execution of the program "C" is monitored.




The Q00UJCPU does not support the use of local devices.

Ex. When local devices are set to be monitored and the program "B" is displayed for monitoring, the local device(s) used in the program "B" can be monitored.

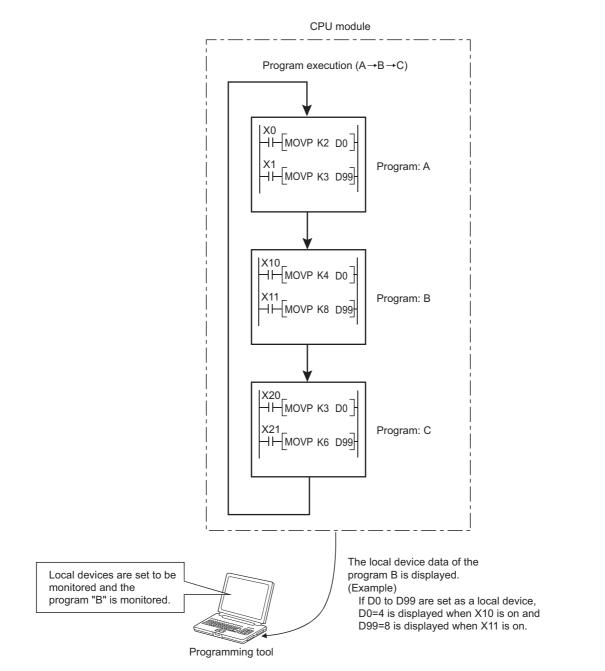

(2) Monitoring procedure

The following shows the local device monitoring procedure.

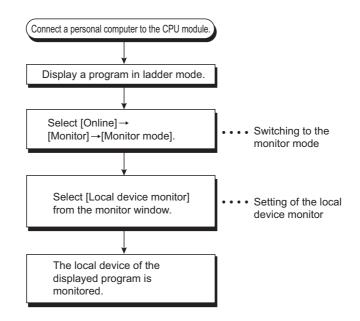

(3) Precautions

(a) Local devices that can be monitored/tested by a single programming tool

One programming tool can monitor or test local devices in one program at a time. Local devices in multiple programs cannot be monitored or tested simultaneously.

(b) Number of programs that can be monitored/tested

Local devices in 16 programs can be monitored or tested simultaneously from multiple programming tools connected to the RS-232 interface of the CPU module or the serial communication module.

(c) Monitoring local devices in a stand-by type program

When local devices in a stand-by type program are monitored, data in local devices are saved and restored. For this reason, the scan time increases. ([] Page 422, Section 6.2)

(d) Monitoring local devices in a fixed scan execution type program

When local devices in a fixed scan execution type program are monitored, data in local devices cannot be acquired and "0" is displayed.


(e) Clearing the PLC memory during local device monitoring

Local devices of monitoring programs are the target for the PLC memory clear operation during local device monitoring.

The external input/output can forcibly be turned on/off using a programming tool. The information registered for forced on/off can be cancelled by an operation from a programming tool.

(1) Input/output operation when a forced on/off operation is performed

There are three kinds of forced on/off operations: forced on ("Set forced ON"), forced off ("Set forced OFF"), and forced on/off cancellation ("Cancel it"). The following table lists the CPU module operation of when a forced on/off operation is performed.

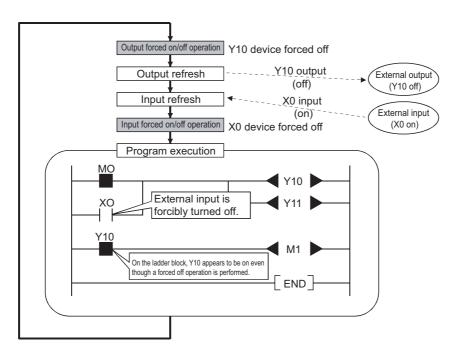

Operation	Input (X) operation	Output (Y) operation
Forced on/off cancellation (no operation)	The CPU module performs sequence program operations using external inputs.	The CPU module outputs the results of sequence program operations externally.
Forced on	The CPU module performs sequence program operations using inputs forcibly turned on.	The CPU module outputs "on" externally regardless of the results of sequence program operations.
Forced off	The CPU module performs sequence program operations using inputs forcibly turned off.	The CPU module outputs "off" externally regardless of the results of sequence program operations.



3.4 Universal

Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used.

(Page 467, Appendix 2)

(2) Specifications

(a) CPU module status where input/output can forcibly be turned on/off

Forced on/off can be registered regardless of the operating status (RUN/STOP) of the CPU module. Note, however, that only input can be forcibly turned on/off during a stop error. The CPU module outputs on/off data only to Y device.

(b) Devices that can be registered

Forced on/of can be registered as many as the number of I/O device points in the CPU module.

(c) Target input/output

The following input/output are targeted for a forced on/off operation.

- Input (X) and output (Y) of modules mounted on the base unit
- Input (X) and output (Y) of the CPU module to be refreshed from LX/LY of a CC-Link IE Controller Network
 module or MELSECNET/H module
- Input (X) and output (Y) of the CPU module to be refreshed from RX/RY of a CC-Link IE Field Network
 master/local module or CC-Link module
- Input (X) and output (Y) of the CPU module to be refreshed from RX/RY of CC-Link IE Field Network Basic

When forcibly turning on/off the devices outside the above refresh ranges (for example, empty slots), only input/output in the CPU module device memory are turned on/off and the results are not output externally.

Point /

In multiple CPU systems, inputs and outputs of control modules can forcibly turned on/off. Even when inputs and outputs of non-control modules are registered for forced on/off, the input/output devices in other CPU modules and inputs and outputs of modules controlled by other CPU modules cannot be forcibly turned on/off. (The input/output devices in the own CPU module can forcibly turned on/off.)

(d) External input/output forced on/off timing

The following table lists the external input/output forced on/off timing.

Refresh area	Input	Output
Input and output of modules mounted on the base unit	 During END processing (input refresh) At execution of the COM instruction (input refresh) At execution of an instruction using direct access input (DX) (LD, LDI, AND, ANI, OR, ORI, LDP, LDF, ANDP, ANDF, ORP, ORF) At execution of the RFS or MTR instruction At execution of an instruction used for a system interrupt (UDCNT1, UDCNT2, SPD) 	 During END processing (output refresh) At execution of the COM instruction (output refresh) At execution of an instruction using direct access input (DX) (OUT, SET, DELTA, RST, PLS, PLF, FF, MC, SFT) At execution of the RFS or MTR instruction At execution of an instruction used for a system interrupt (PLSY, PWM)
Input and output of the CPU module to be refreshed from LX/LY of a CC-Link IE Controller Network module or MELSECNET/H module	 During END processing (refresh via CC-Link IE Con At execution of the COM instruction At execution of the ZCOM instruction 	troller Network or MELSECNET/H)
Input and output of the CPU module to be refreshed from RX/RY of a CC-Link IE Field Network master/local module or CC-Link module	 During END processing (auto refresh) At execution of the COM instruction (auto refresh) At execution of the ZCOM instruction (auto refresh) 	
Input and output of the CPU module to be refreshed from RX/RY of CC-Link IE Field Network Basic	 During END processing (auto refresh) At execution of the COM instruction (auto refresh) 	

(e) Cancelling on/off registration data

The registered forced ON/OFF data can be canceled by a programming tool. Once the registered data is canceled, the status of the forced on/off registered devices will be as follows.

	Forced on/off registered device	Sequence program operations (on/off) performed Sequence program operations (on/off) not performed				
	Input from modules mounted on the base unit	Uses the on/off status input from modules.				
	Input of the CPU module to be refreshed from LX of a CC-Link IE Controller Network module or MELSECNET/H module	Used the on/off status refreshed via CC-Link IE Controller Network module or MELSECNET/H module.				
Input	Input of the CPU module to be refreshed from RX of a CC-Link IE Field Network master/local module or CC-Link module	Uses the on/off status refreshed via CC-Link IE Field Network master/local module or CC-Link module.				
	Input of the CPU module to be refreshed from RX of CC-Link IE Field Network Basic	Uses the on/off status refreshed from the CPU module (when CC-Link IE Field Network Basic is used)				
_	Input other than above (outside of the refresh range)	Uses the results of sequence program operations.	Holds the forced on/off status.			
	Output from modules mounted on the base unit					
	Output of the CPU module to be refreshed from LY of a CC-Link IE Controller Network module or MELSECNET/H module	Outputs the results of sequence program operations.	Holds the registered on/off status.			
Output	Output of the CPU module to be refreshed from RY of a CC-Link IE Field Network master/local module or CC-Link module					
	Output of the CPU module to be refreshed from RY of CC-Link IE Field Network Basic	Outputs the results of sequence program operations. ^{*1}				
	Output other than above (outside of the refresh range)	Outputs the results of sequence program operations. (The results are not output externally.)	Holds the forced on/off status.			

*1 The result is output for one scan in accordance with the registered on/off state even after forced on/off registration data are canceled.

Forced on/off setting can be cleared by:

- powering off and then on the CPU module,
- · resetting the CPU module by the RUN/STOP/RESET switch, or
- resetting the CPU module by the remote RESET operation.

(f) Number of devices that can be registered

Forced on/off can be registered for 32 devices in total.

(g) When output Y contact is used in a sequence program

On/off operations in a sequence program are given priority.

(h) Checking forced on/off execution status

The execution status can be checked by:

- reading the forced on/off registration status of a programming tool.
- flashing of the MODE LED (green), (The MODE LED flashes in green when at least one forced on/off is registered.) or
- the on status of the 1st bit in SD840 (Debug function usage).

Point P

- The MODE LED also flashes in green when the executional conditioned device test function is used. To check the registration status using the MODE LED, check the status of the executional conditioned device test function as well.
 () Page 160, Section 3.11.4 (3))
- When using SD840 to check the registration or cancellation status, remind that SD840 is used to check the status of the executional conditioned device test function as well.

(i) Forcibly turning input or output on/off from multiple programming tools

Forced on/off can be registered to a single CPU module from multiple programming tools connected via network. If forced on/off is registered to the same device, the last registration will be enabled. Therefore, the forced on/off status different from the actual status in the CPU module may be displayed on the programming tool that registered forced on/off earlier. When the forced on/off registration is performed from multiple programming tools, click the "Update status" button to update the registered data and execute the function.

(3) Operating procedure

For the operating procedure of forced input output registration/cancellation, refer to the following.

Derating manual for the programming tool used

3.11.4 Executional conditioned device test PNote 3.5

This function changes a device value within the specified step of a program.


This enables debugging of the specified ladder block without modifying the program.*1

*1 The executional conditioned device test is not available for the SFC program.

(1) Operation of the executional conditioned device test


A device value will be changed based on the registration data once after the executional conditioned device test setting is registered.


The changed device value becomes enabled in the ladder blocks of the specified step number and later.

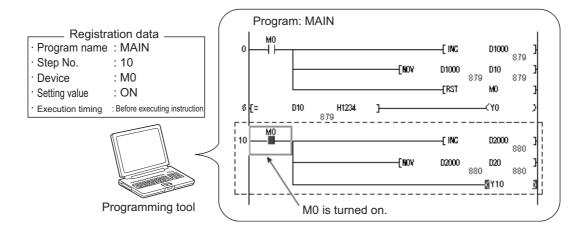

Note that a device value is changed within the specified step regardless of an execution status of the instruction in the specified step.

<Operation>



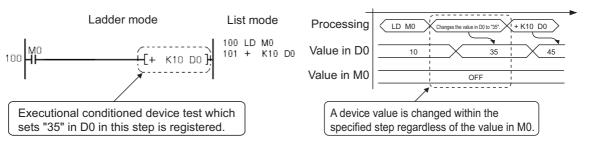

Note 3.5
 Universal

Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used.

(Page 467, Appendix 2)

(2) Available devices and number of settable devices

Туре	Available device	Number of settable devices
Bit device	X, Y, M, L, B, F, SB, V, SM, T (contact), ST (contact), C (contact), $J^{\Box}X$, $J^{\Box}Y$,	
	J⊡\B, J⊡\SB, FX, FY, DX, and DY	
	T (current value), ST (current value), C (current value), D ^{*1} , SD, W ^{*2} , SW, R, ZR,	
	Z, UƏ\GƏ, U3EƏ\GƏ, JƏ\WƏ, JƏ\SWƏ, and FD	Up to 32 (in total)
Word device	Digit-specified bit device:	
	X, Y, M, L, F, SM, V, B, SB, J \Box \X, J \Box \Y, J \Box \B, and J \Box \SB	
	Indirect specification (@D0): D, SD, W, SW, R, and ZR (devices specified with @)	

The following table lists available devices and the number of settable devices.

*1 The extended data register (D) is included.

*2 The extended link register (W) is included.

Note, when the write-protect function for device data (from outside the CPU module) is enabled, that indirect specified/index-modified devices cannot be set for the test. When the write-protected range is set to the file register (ZR (R)), the file register (R) cannot be set, too.

(3) How to check the execution status

The execution status of registered executional conditioned device test can be checked in three different ways:

- By the display on the screen for checking the registration status in a programming tool
- By the flash of the MODE LED in green
- By the on status of the first bit of SD840 (Debug function usage)

Point P

- The MODE LED also flashes in green when the external input/output forced on/off function is used. To check the execution status using the MODE LED, check the status of the external input/output forced on/off function as well.
 () Page 158, Section 3.11.3 (2) (h))
- When using SD840 to check the execution status, remind that SD840 is used to check the status of the external input/output forced on/off function as well.


(4) Registering executional conditioned device test settings

For how to register executional conditioned device test settings, refer to the following manual.

C Operating manual for the programming tool used

(a) Multiple executional conditioned device test registrations for the same step number

Multiple executional conditioned device test settings can be registered for one step number.



However, if multiple executional conditioned device test settings with same device name and same execution timing are registered for the same step number, the registration data will be overwritten. (Even though the same device is specified, if the execution timing differs, two settings can be registered for one step.)

Point P

- When setting a word device with a different data type, a device is regarded as the same device.
 - **Ex.** When a word device is set in the order of "D100 (16 bit integer)" and then "D100 (Real number (single precision))", "D100 (Real number (single precision))" is registered.
- When setting a device with a different modification method (such as a bit-specified word device, digit-specified bit device, or index-modified device), a device is regarded as a different device.

Ex. When a word device is set in the order of "D100.F" and then "D100Z0 (Real number (single precision)), both devices are registered.

(b) Step to be specified for executional conditioned device test registration


Any step number (0 to step number for the END instruction) in a sequence program can be specified.

Point P

Be sure to specify the start step of each instruction.

(c) Execution timing

Timing to change a device value can be specified. A device value can be changed either before or after an instruction of the specified step is executed. The following figure shows the module operation based on the execution timing.

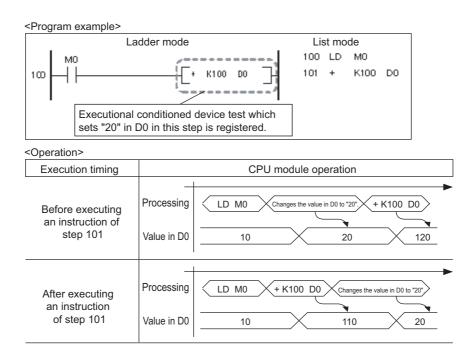

Note that there may be a case where a device value will not be changed depending on the execution timing even though the specified step is executed. The following instructions need to be noted when registering executional conditioned device test settings.

Instructions that do not change device values^{*1}

A device value will not be changed by executing the executional conditioned device test when the execution timing has been set to "After executing instruction", specifying the step for instructions that do not execute the next step, such as branch instructions.

*1 If the execution condition of an instruction is not satisfied, a device value will be changed based on the registration data.

The following table lists the instructions that do not change device values.

No.	Classification	Instruction	Operation
1	Stop	STOP	
2		CJ	
3	Jump	SCJ	 When the execution condition for an instruction is satisfied.
4		GOEND	A device value will not be changed even when the
5	Repeat (Loop)	BREAK(P)	specified step is executed.
6		CALL(P)	When execution condition for an instruction is not
7		FCALL(P)	satisfied.
8	Subroutine program call	ECALL(P)	A device value will be changed after the specified step is executed.
9		EFCALL(P)	
10		XCALL	
11	End	FEND	
12	Jump	JMP	A device value will not be changed even when the specified
13	Return from subroutine program	RET	step is executed.
14	Return from interrupt program	IRET	

• FOR/NEXT instructions

When the executional conditioned device test setting is registered specifying the step for the FOR or NEXT instruction, timing of device value change is different from the timing when steps for other instructions are specified. The following table lists the device value change timing based on the execution timing.

Instruction of the	Execution timing				
specified step	Before executing instruction	After executing instruction			
FOR	Executed once before the start of loop processing.	Executed once after the start of loop processing. (Device values are changed before the execution of the program between the FOR and NEXT instructions.)			
NEXT	 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: Executed in every loop processing. (Device values are changed after the execution of the program between the FOR and NEXT instructions.) High-speed Universal model QCPU and Universal model Process CPU: Executed once after the start of loop processing. (Device values are changed after the execution of the program between the FOR and NEXT instructions.) 	Executed once after the start of loop processing.			

END instruction

When the executional conditioned device test setting is registered specifying the step for the END instruction, the execution timing is restricted to "Before executing instruction" only. If "After executing instruction" is set, the CPU module sends a registration error to the programming tool.

(d) Number of settings that can be registered simultaneously in one scan

Eight executional conditioned device test settings can be registered into the CPU module simultaneously in one scan. When nine or more executional conditioned device test settings are to be registered simultaneously, they will be registered over multiple scans.

(5) Checking/disabling executional conditioned device test settings

For how to check/disable executional conditioned device test settings, refer to the following.

Derating manual for the programming tool used

(a) Usage of the executional conditioned device test

Usage of the executional conditioned device test can be checked in the special register (SD840).

(b) Number of settings that can be disabled simultaneously in one scan

Eight executional conditioned device test settings can be disabled simultaneously in one scan. When nine or more executional conditioned device test settings are to be disabled simultaneously, they will be disabled over multiple scans.

(6) Batch-disabling executional conditioned device test settings

For how to batch-disable executional conditioned device test settings, refer to the following.

(7) Cases where executional conditioned device test settings cannot be registered or disabled

In the following cases, executional conditioned device test setting cannot be registered or disabled. When multiple settings are to be registered, no setting can be registered if any of the settings applies to the cases below.

(a) Executional conditioned device test settings cannot be registered

- · Specified program does not exist.
- Specified step does not exist.
- Specified device does not exist.
- The number of registered executional conditioned device test settings exceeds 32.

(b) Executional conditioned device test settings cannot be disabled

- · Specified program does not exist.
- Specified step does not exist.
- · Specified device does not exist.
- · No executional conditioned device test setting has been registered.

(8) Precautions

(a) Operations from multiple programming tools

Executional conditioned device test settings can be registered in the same CPU module from multiple programming tools connected via network. Note, however, that if multiple executional conditioned device test settings are registered with the same device name in the same step, the registration data will be overwritten. When registering executional conditioned device data settings from multiple programming tools, update the data first by clicking the Read File... button, and register the settings.

(b) Priority

If any of the following functions is set in the same step number that is specified by the executional conditioned device test setting, the executional conditioned device test is given the priority to other functions.

- · Monitor condition setting
- · Sampling trace function (trace point)
- Sampling trace function (trigger point)
- Scan time measurement (start step)
- Scan time measurement (end step)

(c) Disabling executional conditioned device test settings

Executional conditioned device test setting can be disabled by any of the following operations, in addition to the operation of a programming tool.

- · Powering off and then on the CPU module
- · Resetting the CPU module
- · Writing program files to the program memory while the CPU module is in the STOP status
- · Clearing the program memory data while the CPU module is in the STOP status
- Formatting the program memory while the CPU module is in the STOP status

(d) Writing data while the CPU module is in the RUN status

The CPU module operation will be as follows if the executional conditioned device test and the online change function are executed simultaneously.

 When the executional conditioned device test is executed during execution of the online change function The online change function completes normally. However, the executional conditioned device test cannot be executed. The following message box will appear. Execute the executional conditioned device test again after the online change has completed.

MELS	OFT application
(j)	It is not possible to execute it, because, the online change function is executing now. Please execute it again after completed online change function.
	<es:010a410a></es:010a410a>
	ОК


 When the online change function is executed during execution of the executional conditioned device test The online change function completes normally. If any executional conditioned device test setting has been registered in the program to be changed online, the corresponding setting will be disabled.
 () Page 166, Section 3.11.4 (8) (e))

(e) Online change of the CPU module with executional conditioned device test registration


• Online change (ladder mode)

If any executional conditioned device test setting has been registered in the ladder block to be changed online, the CPU module disables the corresponding setting.

 Example 1)
 Step numbers of registrations 1 to 3 are specified in the executional conditioned device test settings. When the ladder block including the registration 2 is changed online, the registration 2 is disabled during execution of the online change function. Since the registrations 1 and 3 are not included in the change target program, they are not disabled.

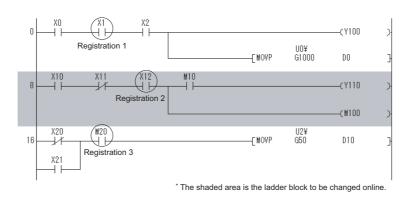


Example 2) When multiple ladder blocks are changed online, ladder blocks between the change target ladder blocks will be included in the change target. For this reason, if the online change function is executed as follows, all registrations 1 to 3 are disabled.

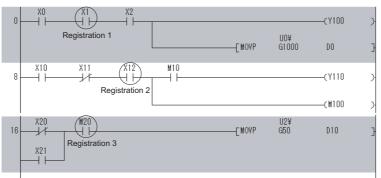

* The shaded area is the ladder block to be changed online.

Example 3) When a ladder block is added online, the executional conditioned device test setting included in the ladder block followed after the added ladder block will be disabled. For this reason, if the online change function is executed as follows, the registration 2 is disabled.

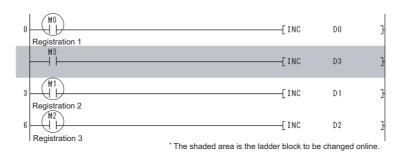

· Online change (files)

All executional conditioned device test settings registered to the program in the online change target file are disabled.

(f) Precautions for specifying an index-modified device

If an index-modified device name is specified to register the executional conditioned device test setting, the CPU module does not check whether the specified device is within the setting range.

If the index-modified device is out of the device range or on the boundary of devices, a device value will not be changed within the specified step.

(g) Precautions for specifying an indirectly-specified device

If indirectly-specified device name is specified to register the executional conditioned device test setting, the CPU module does not check whether the specified device is within the setting range.

If the indirectly-specified device is out of the device range or on the boundary of devices, a device value will not be changed within the specified step.

(h) Precautions for specifying the file register

If the file register is specified to register the executional conditioned device test setting, the CPU module does not check the file register file assignment and the file register number range.

A file register value will not be changed within the specified step in the following cases.

- The file register file is not assigned.
- The specified file register number is out of the file register range.

3.12 Writing Programs While CPU Module is in RUN Status


There are two ways of writing programs in the RUN status.

- Online change (ladder mode) : F Page 168, Section 3.12.1
- Online change (files) : Page 171, Section 3.12.2

Data can also be written in the RUN status using a pointer. (Free Page 192, Section 3.15.2)


3.12.1 Online change (ladder mode)

This function writes programs to the CPU module in the RUN status. This function enables the program in ladder mode to be changed without stopping the program operation in the CPU module.

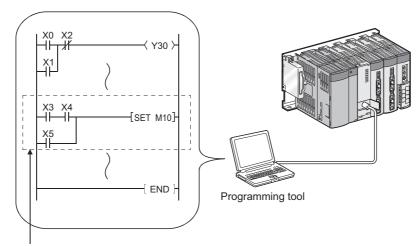

Change a program with programming tool and write it to the CPU module in the RUN status.

Also, programs can be written in the RUN status from a programming tool connected to another station on the network.

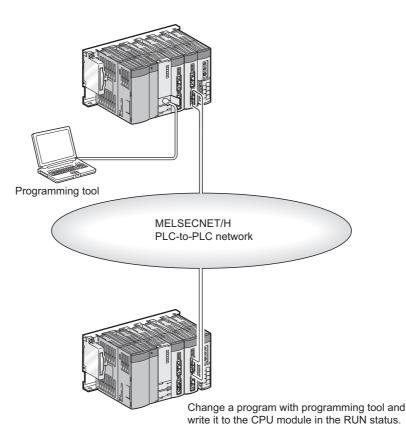

(1) Memory for online change

A program cache memory (program memory) is available.

(2) Number of steps that can be batch-written by online change

Up to 512 steps can be batch-written.

(3) Changing the reserved area for online change

A program file has an area designated as reserved area for online change to support the online change that changes program file size.

The following provides precautions when the size of reserved area for online change is changed.

(a) Size of a program file

The size of a program file is addition of created program size and reserved area for online change.

(b) When program file size is increased from the secured capacity

If the size secured for the program file (size including reserved area for online change) is exceeded after a program is written in the RUN status, the reserved area for online change can be reset before the writing if the user memory area has space.

(c) Increase in the scan time

The scan time is increased when reserved area for online change is reset when programs are written in the RUN status.

For increase in the scan time, refer to Page 488, Appendix 3.3 (7).

- (4) Operations prohibited when programs are written to the CPU module in the RUN status, TC setting value is changed, or data are transferred from a program cache memory to a program memory Refer to Page 173, Section 3.12.3 (2).
- (5) Instructions that do not operate normally when programs are written to the CPU module in the RUN status


Refer to Page 174, Section 3.12.3 (3).

3.12.2 Online change (files)

This function batch-writes files listed in the following table to the CPU module in the RUN status by online operation from a programming tool.

File name	CPU module built-in memory			Memory card (RAM)	Memory card (ROM)		Memory card (SD)
File fiame	Program memory	Standard RAM	Standard ROM	SRAM card	Flash card	ATA card	SD memory card
Parameter	×	×	×	×	×	×	×
Intelligent function module parameter	×	×	×	×	×	×	×
Program	0	×	0	0	×	0	0
Device comment	0	×	Δ	Δ	×	Δ	Δ
Initial device value	×	×	×	×	×	×	×
File register	×	Δ	×	\bigtriangleup	×	×	×
Local device	×	×	×	×	×	×	×
Sampling trace file	×	0	×	0	×	×	×
Programmable controller user data	×	×	0	×	×	0	0

O : Can be written, \bigtriangleup : Cannot be written while being accessed, × : Cannot be written

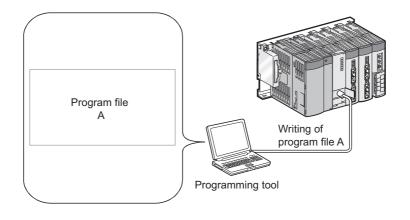

(1) Availability

(a) For the Q00UJCPU, Q00UCPU, and Q01UCPU

The function cannot be performed in the following cases.

- A program memory does not have enough area for storing a program file to be written.
- A program memory stores the maximum number of files that can be stored.

(b) For the Q02UCPU, QnUD(H)CPU, and Built-in Ethernet port QCPU

Files can be written in the RUN status, regardless of free space in the program memory and the number of files to be stored.

(2) Increase in the scan time

The scan time increases when a program file is written to the CPU module in the RUN status. For increase in the scan time, refer to Page 488, Appendix 3.3 (7).

(3) Online change (files) from multiple locations

Do not simultaneously write files to one CPU module in the RUN status from multiple locations. Doing so may delete program files.

(4) Online change (files) of SFC programs

SFC programs cannot be written in units of files to the CPU module in the RUN status.

(5) Operations prohibited when programs are written to the CPU module in the RUN status, TC setting value is changed, or data are transferred from a program cache memory to a program memory

Refer to Page 173, Section 3.12.3 (2).

(6) Instructions that do not operate normally when files are written to the CPU module in the RUN status

Refer to Page 174, Section 3.12.3 (3).

3.12.3 Precautions for online change

The following shows precautions for online change.

(1) Online change during boot operation

When data are written to the CPU module in the RUN status during boot operation, the status of boot source program is not changed.

(2) Operations prohibited when programs are written to the CPU module in the RUN status, TC setting value is changed, or data are transferred from a program cache memory to a program memory

Do not perform the following operations.

(a) Power-off or reset

The following operations are not normally completed if they are performed during online change, TC setting value change, or data transfer from the program cache memory to the program memory. If performed, write the data to the CPU module again.

- Power-off
- Reset

(b) Operations from a programming tool

The following operations cannot be performed during online change, TC setting value change, or data transfer from the program cache memory to the program memory. If performed, an error is displayed on the programming tool. Perform the following operations after online change.

Online change (ladder mode), online change (files)

- TC setting value change
- Data transfer to the program memory
 PNote 3.6
- Write to PLC (Flash ROM)

3

P Note 3.6

3.6 Universal

With the Universal model QCPU whose serial number (first five digits) is "12012" or later, this function can be executed while data are being transferred from the program cache memory to the program memory.


(3) Instructions that do not operate normally during online change

When data are written to the CPU module in the RUN status, the following instructions do not operate normally.

- Rise instruction
- SCJ instruction
- STMR instruction

(a) Rise instruction


The rise instruction is not executed when the instruction is in the data written to the CPU module in the RUN status, even if the execution condition (off \rightarrow on) is met.

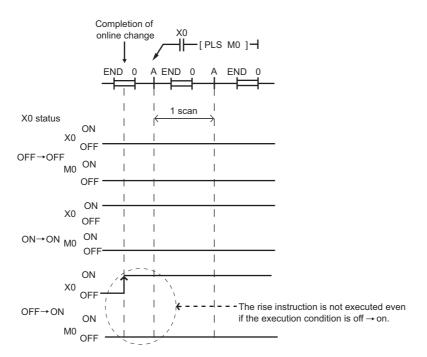

The corresponding rise instructions are PLS and $\Box P$.


(b) SCJ instruction

When the SCJ instruction is in the data written to the CPU module in the RUN status and the execution condition is on at completion of the writing, a jump to the specified pointer is made without a wait of one scan.

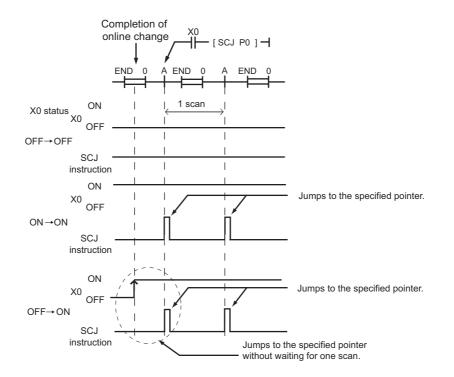

(c) STMR instruction

Note that the STMR instruction operates when the instruction is used within the range written data by the online program change.

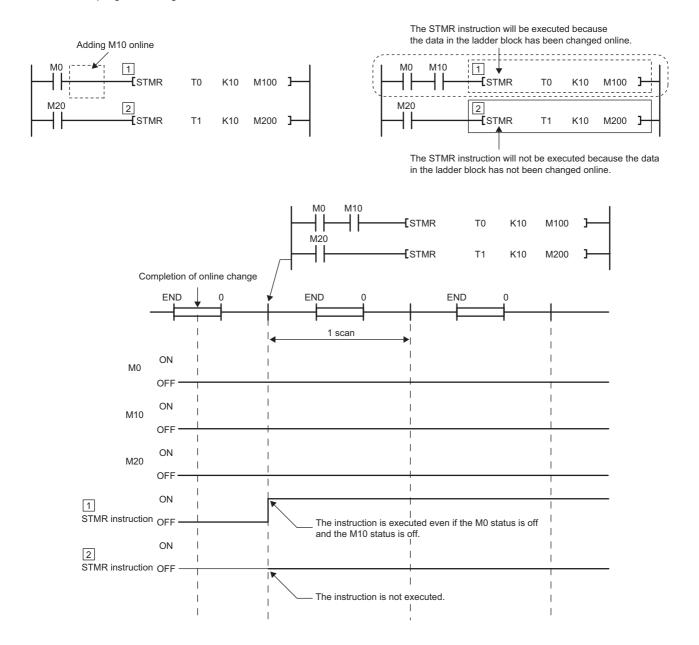


Point P

When "Execute fall instruction" is checked in the "Options" window of a programming tool, the fall instruction is executed when the instruction is in the data written to the CPU module in the RUN status, even if the execution condition (on \rightarrow off) is not met. (Same operation as the High Performance model QCPU)

Options - (Untitled Project)		×
Project Common Setting Automatic Save Change History Program Editor Device Comment Editor Parameter Monitor PLC Read/Write Online Change Intelligent Function Module iQ Works Interaction	Operational Setting Execute fall instruction * Only applies to the QCPU and LCPU Transfer program cache memory to program memory * Only applies to the QCPU and LCPU Execute online change based on relative steg No. * Ladder Only * Only applies to the QCPU and LCPU Execute online change by Compile * Enabled when 'Switch the Ladder Edit Mode' is set Explanation Select whether to execute fall instruction (LDF, LDFI, ANDF, ANDFI, ORF, ORFI, MEF, PLF, FCALLP, EFCALLP) at online change.	
Back to System Default Back to User Default Set as User Default OK Cancel		

The corresponding fall instructions are LDF, ANDF, ORF, MEF, PLF, FCALLP, and EFCALLP. The following describes the operation with and without "Execute fall instruction" selected.

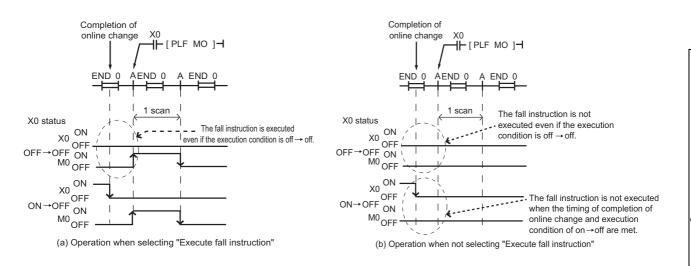

(4) Writing to the program memory during online change and TC setting value change


Due to automatic data transfer to the program memory, the time takes to write data to the CPU module during the RUN status and to change TC setting value extends by the time shown in the following table.

	Ts: Scan time (s)
CPU module	Transfer time
Q00UJCPU, Q00UCPU, Q01UCPU, Q02UCPU	Ts × 320 + 4.8 (s)
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU	Ts × 260 + 4.7 (s)
Q10UD(E)HCPU	Ts × 439 + 6.2 (s)
Q13UD(E)HCPU	Ts × 600 + 8.0 (s)
Q20UD(E)HCPU	Ts × 839 + 11.4 (s)
Q26UD(E)HCPU	Ts × 1100 + 15.0 (s)
Q50UDEHCPU	Ts × 2450 + 17.0 (s)
Q100UDEHCPU	Ts × 4550 + 9.0 (s)
Q03UDVCPU	Ts × 5 + 0.65 (s)
Q04UDVCPU, Q04UDPVCPU	Ts × 5 + 0.85 (s)
Q06UDVCPU, Q06UDPVCPU	Ts × 5 + 1.25 (s)
Q13UDVCPU, Q13UDPVCPU	Ts × 5 + 1.85 (s)
Q26UDVCPU, Q26UDPVCPU	Ts × 5 + 3.7 (s)

Since the number of writes to the program memory (Flash ROM) is limited (up to 100,000 times), set the automatic transfer to the program memory to be disabled when data are written to the CPU module in the RUN status and changing TC setting value frequently.

Point P

Automatic data transfer to the program memory can be disabled in the "Options" window of the programming tool.

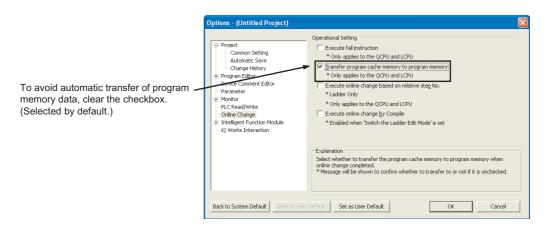

When the automatic data transfer is disabled, the following message appears after online change.

MELSOF	T Series GX Works2
	Online change completed. Do you want to transfer data in the program cache memory to the program memory?
	Caution - It might take a few seconds to transfer. - Do not turn OFF the PLC or reset until the transfer completes. - Please execute the program memory batch transfer later if you don't transfer the data now.
	<u>⊻es</u> <u>N</u> o

Selecting "Yes" transfers data to the program memory. When selecting "No", execute "Program Memory Batch Download" from the programming tool.

Program transfer status can be checked in the special relay (SM165). Program transfer status can be checked in the special relay (SM165).

When SM165 is on, the program memory batch transfer has not completed. When SM165 is off, the program memory batch transfer has completed.



Universal

When checking the transfer status with the Q02UCPU, Q03UDCPU, Q04UDHCPU, or Q06UDHCPU, check the versions of the CPU module and programming tool used. (

3.13 Execution Time Measurement

This function displays the processing time of the program being executed.

(1) Applications and types

This function can be used to know the effect of processing time of each program on the total scan time when the system is adjusted.

There are following three types.

- Program monitor list : F Page 180, Section 3.13.1
- Interrupt program list monitor : F Page 180, Section 3.13.2
- Scan time measurement : F Page 181, Section 3.13.3

3.13.1 Program monitor list

The scan time, number of execution times, and processing time by item can be displayed for each program.

(1) Execution

For how to execute the program monitor list, refer to the following.

Derating manual for the programming tool used

(2) Precaution

(a) When the POFF instruction is in the program

When the POFF instruction is executed, a non-execution processing is performed for one scan. The number of executions includes the executions of non-execution processing. For details of the POFF instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

3.13.2 Interrupt program monitor list

This function displays the number of interrupt program executions. This function is used to check the execution status of an interrupt program.

(1) Execution

For how to execute the interrupt program monitor list, refer to the following.

Derating manual for the programming tool used

3.13.3 Scan time measurement PNote 3.8

This function displays the processing time of set program section during ladder monitoring. The time required for the subroutine and interrupt programs can be measured.


(1) Range specification of scan time measurement

There are following two types for specifying a scan time measurement range.

- Setting on the ladder monitor screen
- · Setting on the scan time measurement screen

(2) When the subroutine program call instruction is in the measurement range

When the subroutine program call instruction (CALL) is in the range of scan time measurement, the scan time includes the time required for processing a subroutine program.



(3) When interrupt programs/fixed scan execution type programs are executed in the scan time measurement range

The execution time of interrupt programs and fixed scan execution type programs are added.

(4) Execution

For how to execute the scan time measurement, refer to the following.

C Operating manual for the programming tool used

3



Universal

Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used. (

(5) Precautions

(a) Measurement range setting

Set the measurement range so that "Start step < End step" is satisfied.

(b) Minimum unit of measurement time


The minimum unit of measurement time is 0.01ms. If the measurement time is less than 0.01ms, 0.000ms is displayed.

(c) When steps are specified between the FOR and NEXT instructions

Scan time required to execute the program between the specified steps is measured.

(d) When only the start step is specified between the FOR and NEXT instructions

· CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU Since the start step is executed repeatedly, scan time cannot be measured. (Time values are not updated on the Scan Time Measurement window of a programming tool.)

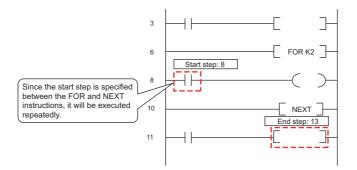

· High-speed Universal model QCPU and Universal model Process CPU The High-speed Universal model QCPU and Universal model Process CPU recognize only the first start step and ignores the second and later start steps. Scan time required to execute the program between the first start step and the end step is measured.

(e) When scan time cannot be measured


Scan time cannot be measured for scans executed across multiple program files.

Scan time is not updated on the Scan Time Measurement screen in the following case.

· When the branch instruction is specified to the end step




Ex. The JMP instruction is specified to the end step.




· When only the start step is executed

Ex. The specified end step is not executed by the JMP instruction.

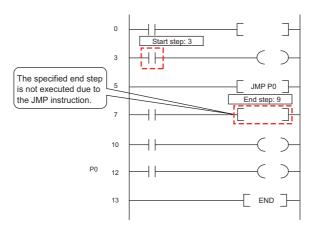


· When the end step is executed before the start step

Ex. The start step is specified as the next step of the CALL instruction and the end step is specified in a subroutine program executed by the CALL instruction.

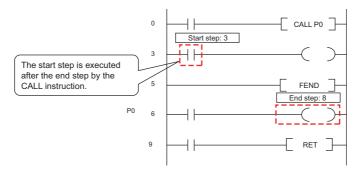

- · When the IRET instruction, FEND instruction, BREAK instruction, or RET instruction is specified for the end step

Ex. In an interrupt program by I31, the IRET instruction is specified for the end step.

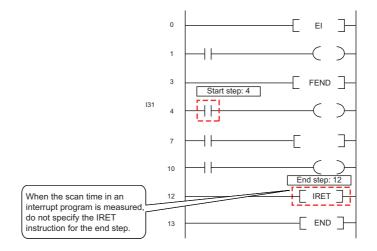

This function samples the data of the specified device at a preset timing and at a preset interval (sampling cycle), and then stores the trace results in the sampling trace file.

(1) Application

The change in the device data used in the program during debugging can be checked at a specified timing. Also, this function is used to read the device data at trigger condition establishment.

(2) Sampling trace file


This file stores the trace setting necessary for executing the function and trace results. A sampling trace file is stored in the following memory.

CPU module	Memory
Q00UCPU, Q01UCPU, QnUDVCPU, QnUDPVCPU	Standard RAM
Q02UCPU, QnUD(H)CPU, QnUDE(H)CPU	Standard RAM or SRAM card

(3) Sampling trace operation

(a) Operation of the CPU module

When a sampling trace trigger is issued by a programming tool, the CPU module executes traces for the preset number of times. The number of traces will be a value of which the number of bytes for the sampling trace area divided by the number of bytes of the specified device (N1 + N2 + N3 + word device points × 2 + (bit device points/16) × 2).^{*1 *2}

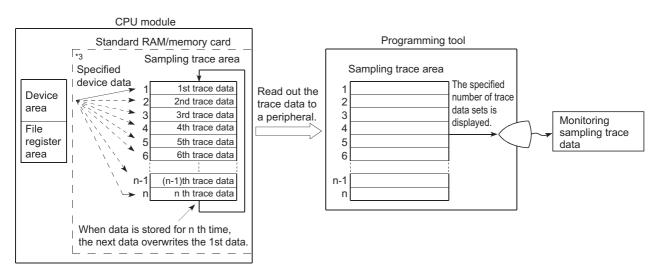

*1 Round up the result of "bit device points/16" in the expression to the right of the decimal point.

- *2 Add the following values to N1 to N3 according to the items selected under the trace additional information of the trace condition setting.
 - N1: When "Time(sec)" is selected, add "4".
 - N2: When "Step no." is selected, add "10".
 - N3: When "Program name" is selected, add "8".
- *3 When the trigger is issued, the CPU module samples data for the preset number of times and latches the data in the sampling trace area.

Note 3.9 Universal

The Q00UJCPU does not support this function.


(b) Operation of the special relay

When the sampling trace is executed normally

The execution status of the sampling trace can be checked in the special relays below.


Number	Name	Description
SM800	Trace preparation	Turns on when the trace setting in a programming tool is written to the CPU module. The relay is used to check whether the sampling trace execution is enabled or not.
SM801	Trace start	Turns on when the sampling trace is started.
SM802	Trace execution in progress	Turns on during sampling trace execution. The relay is used to check the sampling trace execution status.
SM803	Trace trigger	A trigger turns on upon the status change of the relay (off \rightarrow on).
SM804	After trace trigger	 Turns on when any of the following conditions is met. The relay is used to check the status of trigger condition. A trigger is issued by a programming tool The TRACE instruction is executed. SM803 turns on. Detailed setting (Device and Step No.)
SM805	Trace completed	Turns on when the sampling trace is completed.
SM826	Trace error	Turns on when an error occurs during sampling trace execution.

The following figure shows the operation flow of the special relays for sampling trace execution.

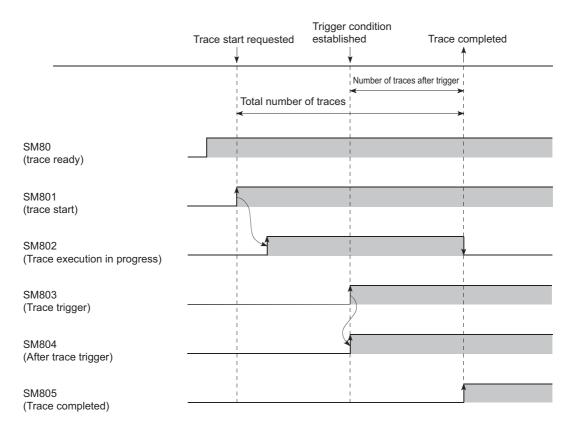

· When the sampling trace is interrupted

If SM801 (Trace start) is turned off during sampling trace, execution of the sampling trace will be suspended. When the sampling trace is suspended, the trace count is cleared. The sampling trace restarts by turning on SM801.

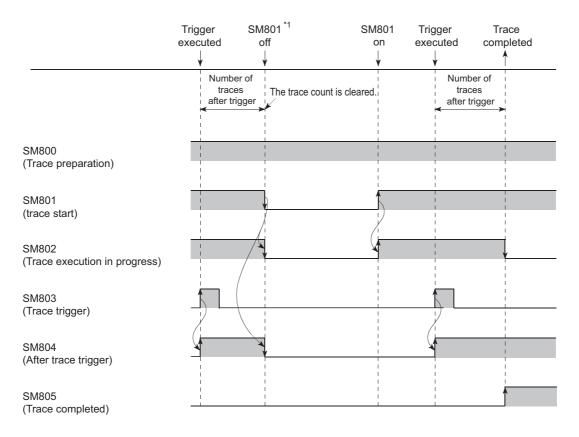

*1 SM800 also turns off when the sampling trace is suspended by programming tool.

(4) Device/label that can be set with the sampling trace

For the device/label that can be set with the sampling trace, refer to the following.

(5) Setting method

For how to execute the trace and set the storage location of trace data, refer to the following.

(6) Execution method

For how to execute the sampling trace, refer to the following.

Operating manual for the programming tool used

(7) Storage method of trace data

The settings and results of trace can be stored in the CSV file format in a personal computer. For how to store the trace data, refer to the following.

C Operating manual for the programming tool used

(8) Precautions

(a) Areas where sampling trace can be performed

The sampling trace can be performed from other stations on the network or serial communication module. However, it cannot be performed from multiple devices simultaneously. It can be performed from one device to the CPU module.

(b) Holding and clearing the trace setting

The trace setting (sampling trace file) registered with the CPU module is latched.

Even if the CPU module is powered off and then on or is reset, the sampling trace can be performed again with the trace setting at registration.

However, the previous trace result cannot be read.

Also in the following cases of 1) to 4), even when the trigger condition of the sampling trace is established, the latched trace setting will be cleared since the condition is not recognized as the trigger condition (SM800 (Trace preparation) turns off).

Register the trace setting again through a programming tool.

- When selecting "Standard RAM" in "Target memory", configuring the setting that changes the local device size in the standard RAM^{*1}, writing parameters to the CPU module, and then performing any of the following operations
 - The CPU module is powered off and then on.
 - The CPU module is reset.
 - The CPU module is set from STOP to RUN.
- *1 The operation includes when a local device is created.
 - 2) When selecting "Standard RAM" in "Target memory" and the sampling trace file is corrupt, either of the following operations were performed.
 - The CPU module is powered off and then on.
 - The CPU module is reset.
 - 3) When selecting "Memory card (RAM)" in "Target memory" while the SRAM card where the sampling trace file has been registered is not mounted, either of the following operations were performed.
 - The CPU module is powered off and then on.
 - The CPU module is reset.
 - 4) When selecting "Memory card (RAM)" in "Target memory" and the sampling trace file is corrupt, either of the following operations were performed.
 - The CPU module is powered off and then on.
 - The CPU module is reset.

(c) Clearing trace execution status

The trace execution status can be cleared by either of the following operations.

- Remote latch clear (Page 137, Section 3.6.4)
- Latch clear by using the special relay and special register areas(Page 75, Section 2.7 (4) (a))

(d) Reading trace result in the STOP status

The trace result cannot be read while the CPU module is in the STOP status. Read the trace result while the CPU module is in the RUN status.

(e) Sampling trace registration while the trigger condition is met

Even if a trigger condition is met, the sampling trace setting can be registered by the following procedure.

- 1. Turn on SM829 (Forced registration specification of trace setting).
- **2.** Enable the forced execution registration.

C [Debug] 🗇 [Sampling Trace] 🗢 [Forced Execution Registration Effective]

For the above case, start the trace in the status where the trigger condition is not met. If the trigger condition is met, the trigger may not be normally executed.

(f) When a file register is selected

When a file register is selected as a specified device for a trace setting, do not change the file register file and the block number of file register after trace registration. If doing so, trace data may not be normally collected.

(g) Data acquisition timing setting

When the data acquisition timing setting is set to "Specified Interval" or "Each Multiple CPU High Speed Transfer Cycle", pay attention to the sampling interval and sampling processing time for one sampling because the sampling trace is performed as interrupt processing. If the processing time for one sampling is long, "WDT ERROR" may occur.

(h) Performing sampling trace during execution of another sampling trace

The first sampling trace is performed normally. The second sampling trace cannot be performed.

(i) Executing online change

When sampling trace and online change are performed simultaneously, they operate as follows.

- Performing sampling trace during online change
 - When the trace point or trigger point is specified by the step number:
 - The online change is completed normally but the sampling trace is not performed.
 - When the trace point and trigger point are specified by setting other than the step number: Both the online change and sampling trace can be performed.
- · Performing online change during execution of sampling trace
 - When the trace point or trigger point is specified by the step number: The sampling trace is suspended but the online change is normally performed.
 - When the trace point and trigger point are specified by setting other than the step number: Both the online change and sampling trace can be performed.
- (j) Latch clear by using the special relay and special register areas during execution of sampling trace

The latch clear operation is performed normally. However, the sampling trace will be stopped.

3.15 Debug from Multiple Programming Tools

This function allows simultaneous debugging from multiple programming tools connected to modules (such as a CPU module and serial communication module). This function is useful when debugging multiple files divided according to processes or functions.

(1) Description

The following table lists the combinations of functions that can be executed simultaneously using this function.

O · Can be simultaneousl	v performed ∧ · Partia	ly restricted × Canno	t be simultaneously performed
	y periornica, Δ . I artic	ly looulotou, ~ . Oullio	t be simulationally performed

		Function executed later										
Function in execution	Monitor *1	Monitor monitor condition		Monitor condition setting	Online change	Scan time measure ment	Sampling trace	Executional conditioned device test				
monitor ^{*1}	0 0		0	0	0	0 0		0				
Program monitor list	0	×	0	o o o o o		0	0					
Interrupt program monitor list	0	0	×	0	0	0	0	0				
Monitor condition setup	0	0	0	×	△*2	0	0	0				
Online change	0	0	0	×	×	×	×	×				
Scan time measurement	0	0	0	0	×	×	0	0				
Sampling trace	ing trace O O O		0	0	∆*3	0	×	0				
Executional conditioned device test	0	0	0	0	\triangle^{*4}	0	0	0				

*1 This includes a ladder monitor, device batch monitor, entry data monitor, entry ladder monitor, and local device monitor.
 *2 Cannot be performed simultaneously when the step number, or the step number and device number, are set in the

monitor condition.

*3 Cannot be performed simultaneously unless the step number is set to the trace point or the trigger point.


*4 Cannot be performed simultaneously in the following cases.

The data to be changed online includes the registration of an executional conditioned device test.
When adding a ladder block by online change, registration of an executional conditioned device test is included in the ladder block immediately after the one where the ladder block is to be added.

•The program to be changed online includes registration of an executional conditioned device test.

3.15.1 Simultaneous monitoring from multiple programming tools

This function allows simultaneous monitoring from multiple programming tools connected to modules (such as a CPU module and serial communication module). Creating a user setting system area allows high-speed monitoring from multiple programming tools. (Setting a monitoring file for the host station is not required.)

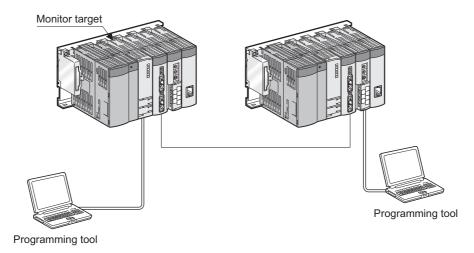

(1) Setting for simultaneous monitoring from multiple programming tools

Create a user setting system area by the following procedure.

1. Open the "Format PLC Memory" screen.

♡ [Online] ⇔ [PLC Memory Operation] ⇔	[Format PLC Memory]
---------------------------------------	---------------------

Format PLC Memory	×
Connection Channel List	
Connection Interface USB	<> PLC Module
Target PLC Network No. D Station No. Host	PLC Type Q03UD
Target Memory Program Memory]
Format Type	
O Do not create a user setting system area (the requ	uired system area only)
Create a user setting system area	
High speed monitor area from other station	0 K Steps (015K Steps)
Online change area of multiple blocks	K Steps
	Execute Close

- 2. Select "Program Memory" for "Target Memory".
- 3. Select "Create a user setting system area" in "Format Type".
- **4.** Set the number of steps for the system area (in increments of 1K step) within the following range. Only 1K step is available for each monitoring file from another station.

Maximum size of settable step	System area for monitoring from another station					
Maximum 15K steps	Maximum 15					

(2) Precautions

(a) Monitoring condition setting

The monitoring conditions can be set from one programming tool.

(b) Necessity of system area setting

A programming tool connected to another station can simultaneously monitor a CPU module without a user setting system area. However, the monitor speed will be slow. Since the system area is set in the program memory, the area for storing programs in the memory decreases by the size of the system area.

(c) Number of programming tools for which high-speed monitoring can be set

The number of programming tools that can simultaneously monitor a CPU module at high-speed is "the number of user setting system areas (the number of K steps) + 1".

Ex. When a user setting system area is created for 15K steps, maximum 16 programming tools can simultaneously monitor a CPU module at high-speed.

3.15.2 Online change from multiple programming tools

This function allows online change from multiple programming tools.

(1) Operating procedure

Select [Tool] \rightarrow [Options] \rightarrow "Online Change" in the programming tool, and check the "Execute online change based on relative step No." checkbox. Set a pointer for online change in advance.

Options - (Untitled Project)		×
Project Common Setting Automatic Save Change History Program Editor Device Comment Editor Parameter Monitor PLC Read/Write Online Change Intelligent Function Module iQ Works Interaction	Operational Setting Execute fall instruction * Only applies to the QCPU and LCPU Image: Transfer program cache memory to program memory * Only applies to the QCPU and LCPU Execute online change based on relative step No. * Ladder Only * Only applies to the QCPU and LCPU Execute online change based on relative step No. * Enabled when 'Switch the Ladder Edit Mode' is set Explanation Select whether to execute online change based on relative step No. from pointer. Even if real step No. is different, online change is available as long as relative step No. from the pointer is corresponding.	-
Back to System Default Back to User	Default Set as User Default OK Cancel	

Display the ladder including the specified pointer and write the changed ladder to the CPU module during RUN.

(2) Precautions

Precautions for online change from multiple programming tools are the same as those for standard online change. (

3.16 Watchdog Timer (WDT)

This function serves as a CPU module internal timer to detect errors of CPU module hardware and sequence programs.

(1) Setting and resetting

(a) Setting

The watchdog timer setting can be changed in the PLC RAS setting of PLC parameter. The default is set to 200ms.

The setting range is 10 to 2000ms (in increments of 10ms).

(b) Reset

The CPU module resets the watchdog timer during END processing.

- The watchdog timer does not time up when the CPU module operates normally and the END/FEND instruction is executed within the setting value of watchdog timer.
- The watchdog timer times up when the scan time of the sequence program is extended and the END/FEND instruction could not be executed within the setting value of watchdog timer due to the hardware failure of the CPU module or execution of an interrupt program/fixed scan execution type program.

(2) When the watchdog timer times up

"WDT ERROR" is detected and the following status occurs:

- The CPU module turns off all outputs.
- The RUN LED on the front of the CPU module turns off and the ERR. LED starts flashing.
- SM1 turns on and the error code 5000 or 5001 is stored in SD0.


(3) Precautions

(a) Watchdog timer error

An error is observed within the range of 0 to 10ms. Set a watchdog timer while considering such an error.


(b) Resetting a watchdog timer when a program is repeatedly executed between the FOR and NEXT instructions

The watchdog timer can be reset by executing the WDT instruction in the sequence program. To avoid the time up of watchdog timer while a program is repeatedly executed between the FOR and NEXT instructions, reset the watchdog timer by the WDT instruction.

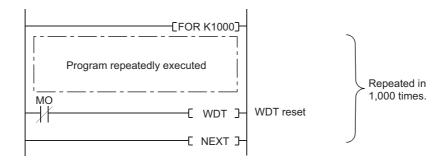

(c) Scan time when using the WDT instruction

The scan time value is not reset even if the watchdog timer is reset in the sequence program. The scan time is measured up to the END instruction.

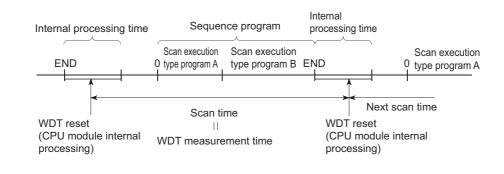

Point P

- A scan time is time required for the CPU module to operate the sequence program from step 0 and return to the step 0 in the sequence program with the same file name.
 - The scan time depends on the execution status of the following:
 - · Instructions used in the program
 - Interrupt program and fixed scan execution type program
- To execute the same scan time in every scan, use the constant scan function. (FF Page 119, Section 3.2)

3.17 Self-diagnostic Function

This function allows the CPU module to diagnose itself to check for errors. This function aims to preventive measures and prevention of malfunction of the CPU module.

(1) Self-diagnostic timing

When an error occurs at power-on or during the RUN or STOP status of the CPU module, the error is detected and displayed by the self-diagnostic function, and the CPU module stops an operation. Note that errors cannot be detected by the function depending on error status or an instruction executed. When the operation is not stopped by the function, configure a safety circuit external to the programmable controller so that the entire system operates safely.

(2) Checking errors

(a) LED status

When the CPU module detects an error, the ERR. LED turns on.

(b) Storage location of error information and error check

When the CPU module detects an error, the special relays (SM0, SM1) turn on and the error information (error code) is stored in the special register (SD0).

When several errors are detected, the latest error code is stored in SD0.

Use the special relays and special register in a program as an interlock for the programmable controller and mechanical system.

(3) Checking error history

The latest error code can be checked under "Error History" on the "PLC Diagnostics" screen.

♡ [Diagnostics] ⇔ [PLC Diagnostics]

The error history data is backed up using a battery even after the programmable controller is powered off.

(4) CPU module operation at error detection

(a) Mode at error detection

When an error is detected by the self-diagnostic function, the CPU module enters either of the following modes.

· Mode that stops CPU module operation

When an error is detected, the CPU module stops an operation and turns off all external outputs of the module set to "Clear" in "Error Time Output Mode" in "Detailed setting" of the I/O Assignment tab of the PLC parameter dialog box (Outputs (Y) in the device memory are held). Note that the external outputs of the module set to "Hold" in "Error time output mode" are held (Outputs (Y) in the device memory are held).

Mode that continues CPU module operation
 When an error is detected, the CPU module operates programs other than the one (instruction) where an error occurred.

(b) Errors whether to continue or stop an operation can be selected

Whether to continue or stop an operation can be selected in the following errors.

- Errors whether to continue or stop an operation can be selected in the PLC RAS tab of the PLC parameter dialog box
 - Computation error (including SFC program)
 - Expanded command error (setting for future extension)
 - Fuse blown
 - Module verify error
 - Intelligent module program execution error
 - File access error
 - Memory card operation error
 - External power supply OFF (setting for future extension)

Ex. When "Module verify error" is set to "Continue", an operation is continued from the I/O number before an error. For details of errors, refer to "Self-diagnostics list". (FFP Page 197, Section 3.17 (6))

• Error whether to continue or stop an operation can be selected in "Detailed setting" in the I/O Assignment tab of the PLC parameter dialog box.

Intelligent function module error

(5) Error check options

Whether to check the following errors or not can be selected in the PLC RAS tab of the PLC parameter dialog box (All the options are selected (executed) by default).

- Carry Out Battery Check
- Carry Out Fuse Blown Check
- Verify Module
- Check Device Range at Indexing
- Diagnose Redundant Power Supply System PNote 3.10

Note 3.10 Universal

Before setting the diagnostic function of the redundant power supply system for the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming

tool used. (

(6) Self-diagnostics list

The following table lists the self-diagnostics performed by the CPU module. The error messages in the "Error message" column can be checked on the screen displayed by selecting [Diagnostics] \rightarrow [PLC Diagnostics] in the programming tool.

Diagnostics				CPU	LED	status		Q00U		QnUD	QnUDV
		Error message	Diagnostic timing	module status	RUN	ERR.	Q00UJ CPU	CPU, Q01U CPU	Q02U CPU	(E)(H) CPU	CPU, QnUDP VCPU
	CPU error	MAIN CPU DOWN	• Always	Stop	Off	Flashing	0	0	0	0	0
	END instruction not executed	END NOT EXECUTE	Execution of the END instruction	Stop	Off	Flashing	0	0	0	0	0
	SFC program execution error	SFCP. END ERROR	 Execution of a SFC program 	Stop	Off	Flashing	0	0	0	0	0
	RAM check	RAM ERROR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
	Operation circuit check	OPE.CIRCUIT ERR.	 Power-on/reset Execution of the END instruction 	Stop	Off	Flashing	0	0	0	0	0
	Fuse blown*1*2	FUSE BREAK OFF	• Always	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	I/O interrupt error	I/O INT. ERROR	 Occurrence of an interrupt 	Stop	Off	Flashing	0	0	0	0	0
	LAN controller failure	LAN CTRL. DOWN	Power-on/reset	Stop	Off	Flashing	×	×	×	O *4	0
Hardware failure	Intelligent function module error ^{*1}	SP.UNIT DOWN	 Power-on/reset Execution of the FROM/TO instructions Execution of the intelligent function module dedicated instruction Execution of the END instruction 	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	Control bus error	CONTROL- BUS ERR.	Power-on Execution of END processing Execution of the FROM/TO instructions Execution of the intelligent function module dedicated instruction Always	Stop	Off	Flashing	0	0	0	0	0
	Momentary power failure	AC/DC DOWN	• Always	Continue	On	Off	0	0	0	0	0
	Multiple CPU high speed bus error	MULTI-C.BUS ERR.	Power-on/reset	Stop	Off	Flashing	×	×	×	0	0

O: Self-diagnostics is performed. ×: Self-diagnostics is not performed.

				CPU	LED status			Q00U		QnUD	QnUDV
Dia	agnostics	Error message	Diagnostic timing	module status	RUN	ERR.	Q00UJ CPU	CPU, Q01U CPU	Q02U CPU	(E)(H) CPU	CPU, QnUDP VCPU
	Voltage drop of power supply for redundant base unit	SINGLE PS. DOWN	• Always	Continue	On	On	×	0	0	0	0
Hardware failure	Redundant power supply module failure	SINGLE PS. ERROR	• Always	Continue	On	On	×	0	O *5	O ^{*5}	0
	Flash ROM error	FLASH ROM ERROR	Writing to ROM	Continue	On	On	0	0	0	0	0
	Module verification ^{*1*2}	UNIT VERIFY ERR.	Execution of the END instruction	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	Base assignment error	BASE LAY ERROR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
	Intelligent function module assignment error	SP.UNIT LAY ERR.	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0
	Intelligent program execution error ^{*1}	SP.UNIT ERROR	Execution of the FROM/TO instructions	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	Intelligent function module version error	SP.UNIT VER.ERR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
	No parameter	MISSING PARA.	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0
Handling error	Boot error	BOOT ERROR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
	Backup error	RESTORE ERROR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
	Memory card operation error ^{*1}	ICM.OPE. ERROR	 Mounting/ removal of the memory card 	Stop/ continue	Off/on	Flashing /on	×	×	0	0	0
	Memory card access error	MEM.ACCESS ERROR	• Always	Continue	On	On	×	×	×	×	0
	File setting error	FILE SET ERROR	 Power-on/reset Writing to programmable controller 	Stop	Off	Flashing	0	0	0	0	0
	File access error ^{*1}	FILE OPE. ERROR	 Execution of an instruction 	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	Instruction execution disabled	CAN'T EXE.PRG.	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0

				CPU	LED status			Q00U		QnUD	QnUDV
Dia	Diagnostics		Diagnostic timing	module status	RUN	ERR.	Q00UJ CPU	CPU, Q01U CPU	Q02U CPU	(E)(H) CPU	CPU, QnUDP VCPU
	Parameter setting check	PARAMETER ERROR	 Power-on/reset Switching from STOP to RUN Writing to programmable controller 	Stop	Off	Flashing	0	0	0	0	0
Parameter error	Link parameter error	LINK PARA.ERROR	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0
enor	SFC parameter error	SFC PARA. ERROR	 Switching from STOP to RUN Writing to programmable controller 	Stop	Off	Flashing	0	0	0	0	0
	Intelligent function module parameter error	SP.PARA. ERROR	Power-on/reset	Stop	Off	Flashing	0	0	0	0	0
Password e	rror	REMOTE PASS.ERR	 Power-on/reset Switching from STOP to RU 	Stop	Off	Flashing	0	0	0	0	0
Instruction code check		INSTRUCT. CODE ERR	 Power-on/reset Switching from STOP to RUN Execution of an instruction 	Stop	Off	Flashing	0	0	0	0	0
No END instruction		MISSING END INS.	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0
Pointer setting error		CAN'T SET(P)	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0
		CAN'T SET(I)	 Power-on/reset Switching from STOP to RUN 	Stop	Off	Flashing	0	0	0	0	0


				CPU	LED	status		Q00U		QnUD	QnUDV
Dia	agnostics	Error message	Diagnostic timing	module status	RUN	ERR.	Q00UJ CPU	CPU, Q01U CPU	Q02U CPU	(E)(H) CPU	CPU, QnUDP VCPU
	Operation error ^{*1*3}	OPERATION ERROR	• Execution of an instruction	Stop/ continue	Off/on	Flashing /on	0	0	0	0	0
	FOR to NEXT instructions structure error	FOR NEXT ERROR	• Execution of an instruction	Stop	Off	Flashing	0	0	0	0	0
	CALL to RET instructions structure error	CAN'T EXECUTE(P)	• Execution of an instruction	Stop	Off	Flashing	0	0	0	0	0
	Interrupt program error	CAN'T EXECUTE(I)	• Execution of an instruction	Stop	Off	Flashing	0	0	0	0	0
	Instruction execution disabled	INST. FORMAT ERR.	• Execution of an instruction	Stop	Off	Flashing	0	0	0	0	0
Program error	Dedicated instruction of multiple CPU high speed bus error	MULTI COM.ERROR	• Execution of an instruction	Stop	Off	Flashing	×	×	×	0	0
	SFC block configuration error	CAN' SET(BL)	Switching from STOP to RUN	Stop	Off	Flashing	0	0	0	0	0
	SFC step configuration error	CAN'SET(S)	Switching from STOP to RUN	Stop	Off	Flashing	0	0	0	0	0
	SFC execution error	SFC EXE. ERROR	Switching from STOP to RUN	Stop	Off	Flashing	0	0	0	0	0
	SFC syntax error	SFCP. FORMAT ERR.	Switching from STOP to RUN	Stop	Off	Flashing	0	0	0	0	0
	SFC block execution error	BLOCK EXE.ERROR	• Execution of an instruction	Stop	Off	Flashing	0	0	0	0	0
	SFC step execution error	STEP EXE.ERROR	 Execution of an instruction 	Stop	Off	Flashing	0	0	0	0	0
CPU error	Watchdog error supervision	WDT ERROR	• Always	Stop	Off	Flashing	0	0	0	0	0
CF U en u	Program time-out	PRG.TIME OVER	• Always	Continue	On	On	0	0	0	0	0
	Another CPU major error	MULTI CPU DOWN	 Always Power-on/reset	Stop	Off	Flashing	×	0	0	0	0
Multiple CPU	Multiple CPU systems execution error	MULTI EXE.ERROR	Power-on/reset	Stop	Off	Flashing	×	0	0	0	0
systems error	Multiple CPU systems consistency error	CPU LAY. ERROR	Power-on/reset	Stop	Off	Flashing	×	0	0	0	0
	Another CPU minor error	MULTI CPU ERROR	• Always	Continue	On	On	×	0	0	0	0
File diagnos	stic check	INCORRECT FILE	 Power-on/reset Switching from STOP to RUN Writing to programmable controller 	Stop	Off	Off	0	0	0	0	0
Annunciato	r check	F***	• Execution of an instruction	Continue	On	USER LED turns on.	0	0	0	0	0

- *1 The operating status can be set to "Continue" in parameter. (Default: "Stop")
- *2 The check status can be selected in parameter. (Default: Checkbox selected)
- *3 The error includes an operation error when a device range is checked at index modification.
- *4 Only the Built-in Ethernet port QCPU supports this self-diagnostic item.

When an error occurs, the LEDs on the front of the CPU module turns on/flashes. (F Page 222, Section 3.20)

3.17.2 Clearing errors

Continuation errors can be cleared. The High-speed Universal model QCPU and Universal model Process CPU can clear those errors by types.

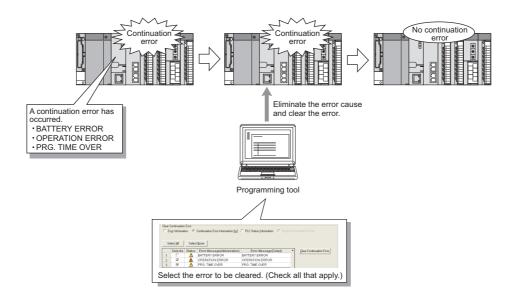

AC/DC DOWN

MEM.ACCESS ERROR

FILE OPE.ERROR

FUSE BREAK OFF

• UNIT VERIFY ERR.

OPERATION ERROR

(1) Errors that can be cleared

The following errors can be cleared.

- SP.UNIT DOWN
- FLASH ROM ERROR
- ICM.OPE.ERROR
- SNTP OPE.ERROR
- F*** (Annunciator)
- SINGLE PS.ERROR
- PID ERROR

(2) Clearing method

Errors are cleared in two ways.

- Using a programming tool PNote 3.11
- Using the special relay (SM) and special register (SD)

- BATTERY ERROR
- SP.UNIT ERROR
- REMOTE PASS.FAIL
- PRG.TIME OVER
- SINGLE PS.DOWN
- MULTI CPU ERROR

Note 3.11 Universal

Only the High-speed Universal model QCPU and Universal model Process CPU can clear errors using a programming tool.

(a) Clearing errors using a programming tool (High-speed Universal model QCPU and Universal model Process CPU only)


Perform the following procedure.

				Connection Channel List						
	Joona	Port PL	C Module Connection(USB)				System Image			
		Model Na	me Operation Status	Switch						
	QOGUDV	CPU		UN						
e function menu is										
ended from the PLC										
age.		formation								
Q05UDVCPU			ation C Continuation Error Inf							
NODE	Current				Change the window si					
ERR.	PLC	Status					Error Jump			
USER BAT.	2		1600 BATTERY ERROR	BATTERY ERROR	2000-04-17	22:55:12	Error Clear			
800T	3						Error Help			
SD CAFD 🛄	4						Clini Ueb			
	Error H	istoru(PI	.C No.1 1 Occurrence Or	der Display Descending 💌						
		No.			Year/Month/Day	Time 🔺	Error History			
		1600	BATTERY ERROR	BATTERY ERROR	2000-04-17	22:55:12				
▼ PULL		4100	OPERATION ERROR	OPERATION ERROR	2000-04-17	22:54:18	Clear History			
	1	5010	PRG. TIME OVER	PRG. TIME OVER	2000-04-17	22:52:21	Error Jymp			
							Error Help			
							Ellorrigp			
▲ PULL USB							- Status Icon Legend			
A PULL USB										
•~~							Major Error			
•							Major Error			
•							Major Error Moderate Error			
•							Major Error			

1. Check the continuation errors detected on the PLC Diagnostics window.

- 2. Eliminate the error causes of the detected errors.
- 3. Select the "Continuation Error Information" radio button and check the checkboxes of errors to be cleared. Then, click the Clear Continuation Error button.

3

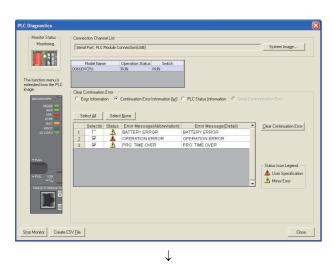

L

MELSOF	T Series GX Works2		
	Selected continuation errors will be cleared. Do you want to continue?		
	Yes <u>N</u> o		

- **4.** Click the <u>Yes</u> button to clear the errors.
- **5.** Check that the specified errors are no longer displayed on the PLC Diagnostics window.^{*1}

*1 The specified errors are not deleted from error history data.

(b) Clearing errors using the special relay (SM) and special register (SD)

Perform the following procedure.

- CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU
 - **1.** Eliminate the error cause.
 - 2. Store the error code corresponding to the error to be cleared in SD50.
 - **3.** Turn off and then on SM50.
 - **4.** The error is cleared.

Point P

When the latest error (the error stored in SD0) is cleared, error information (stored in SM0, SM1, SM5, SM16, SD0 to SD26) are cleared. If more than one error has been detected, information on other errors are also cleared and no longer obtained. To clear other errors, obtain the past error data from the error history.

- High-speed Universal model QCPU and Universal model Process CPU
 - **1.** Check the continuation error(s) detected in SD81 and SD82. (For the bit pattern, refer to the QCPU User's Manual (Hardware Design, Maintenance and Inspection).)
 - **2.** Eliminate the error cause(s).
 - **3.** Specify the error(s) to be cleared in SD84 and SD85.
 - 4. Turn off and then on SM84.
 - 5. Check the bit(s) corresponding to the cleared error(s) in SD81 and SD82 is off.

Point P

The High-speed Universal model QCPU and Universal model Process CPU can also clear errors by storing an error code in SD50 and turning off and on SM50. In this case, however, error types cannot be specified.

(3) Status after error clear

When the CPU module is recovered from errors, the related special relay, special register, and LEDs return to the status before the errors occurred. If the same error occurs after clearing an error, it is registered in the error history again.

(4) Precautions

- Since errors with the same message are batch-cleared regardless of their error codes, error codes not intended may also be cleared.
- To clear more than one annunciator, perform the same number of error clear operations as that of annunciators that are on.

Point P

- When the clear-target error code is stored in the special register, the units digit of the code is ignored.
 Ex. When the error codes 2410, 2411, and 2412 occur and 2412 is stored in SD50 to clear, other two error codes 2410 and 2411 are also cleared.
- Only errors occurred in a CPU module can be cleared.

Ex. Since "SP. UNIT DOWN" is an error occurred in the Q bus, the error cause will not be eliminated with the error clear methods explained in this section. To eliminate the error cause, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

3.18 Error History

This function stores an error detected by the self-diagnostic function and the detection time as error history data in a memory. The error history data can be checked on the screen displayed by selecting [Diagnostics] \rightarrow [PLC Diagnostics] in the programming tool.

Point P

The detection time is based on the clock in the CPU module. Make sure to set the correct time before the first use of the CPU module. (

(1) Storage area

All stored logs are saved to the storage memory for error history of the CPU module.

Storage area	Number of storable logs
System memory in CPU module ^{*1}	Up to 100 ^{*2}

*1 The memory is managed inside the system.

*2 When the number of storable logs are exceeded, the latest error log is stored by deletion of the oldest error log.

(2) How to clear error history

To clear the error history data stored in the memory and error history file, select [Diagnostics] \rightarrow [PLC

Diagnostics] in the programming tool and click the clear History button. When the button is clicked, all the error history data stored in the storage memory of the CPU module and the error history file in a memory card are cleared.

3.19 Security Function

This function protects data in the CPU module against tampering and theft by unauthorized persons. There are four security functions available. Use those functions according to your applications and needs.

Function	Purpose	Reference
Password registration ^{*1}	To limit access to each file in the CPU module	Page 207, Section 3.19.1
File password 32 ^{*2}		Page 209, Section 3.19.2
File access control by security key ^{*2}	To limit devices that can access to files in the CPU module	Page 214, Section 3.19.3
Remote password	To limit access to the CPU module from external devices	Page 219, Section 3.19.4
Block password	To limit access to each POU	GX Works2 Version 1 Operating Manual (Common)

*1 The High-speed Universal model QCPU and Universal model Process CPU do not support this function.

*2 Only the High-speed Universal model QCPU and Universal model Process CPU support these functions.

3.19.1 Password registration PNote 3.12

This function disables reading and writing data, such as programs and device comments, in the CPU module using a programming tool.

(1) Password target files

A password can be set to the following files.

- Program
- Device comment
- · Initial device value

(2) Operations that are controlled and the number of characters

A password can be set to the following operations. The number of characters in the password should be four (one-byte).

- · Reading files
- Writing files

_	
- 48	
	Remark

For characters allowed in passwords, refer to "Explanation of Registration Conditions" on the Input Password window.

3

The High-speed Universal model QCPU and Universal model Process CPU do not support this function.

(3) Online operations that require authentication

Authentication is required to execute the following operations to password-protected files. For the authentication method, refer to Page 211, Section 3.19.2.

- Write to PLC (data writing)
- Read from PLC (data reading)
- Online change (data writing)
- Change TC setting value (data writing)
- Verify with PLC (data reading)
- Create/Change or Delete of a password (data reading and writing)
- Write to PLC (flash ROM)
- Delete PLC data (data writing)

(4) Operating procedure

For the password registration procedure, refer to the following.

Derating manual for the programming tool used

Remark

To change, delete, or unlock the password, refer to the following.

(5) Precautions

(a) Password management

A password registered with a file cannot be read from the file. Forgetting the registered password disables the following operations.

- Program memory or memory card: Format PLC memory
- · Standard ROM: Batch write

Record the registered password on paper and securely store the paper.


(b) Operations that overwrite files

The following operations overwrite files in the target drives (program memory and standard ROM) regardless of the password registration setting.

- · Boot operation from a memory card
- CPU module change function with memory card (Backup data restoration)

3.19.2 File password 32 PNote 3.13

This function sets a read password and write password for each file stored in the CPU module so that files are protected against tampering and theft by unauthorized persons.

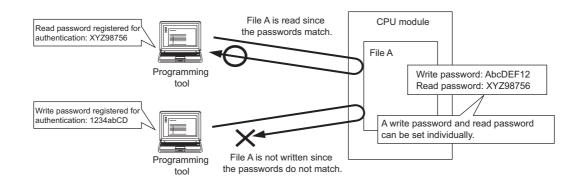

(1) File protection timing

File protection is enabled immediately after the passwords are registered, and it is disabled immediately after the passwords are deleted.

(2) Password target files

A password can be set to the following files.

- Program
- Device comment
- · Initial device value
- Parameter
- · Symbolic information

(3) Operations that are controlled and the number of characters

A password can be set to the following operations. The minimum number of characters in the password should be 4, and the maximum number should be 32.

- Reading files
- Writing files
- · Reading/writing files

Remark For characters allowed in passwords, refer to "Explanation of Registration Conditions" on the Input Password window. 3

Only the High-speed Universal model QCPU and Universal model Process CPU support this function.

(4) Online operations that require authentication

Authentication is required to execute the following operations to password-protected files. (Section 3.19.2)

- Write to PLC (data writing)
- Read from PLC (data reading)
- Online change (data writing)
- Change TC setting value (data writing)
- Verify with PLC (data reading)
- · Create/Change or Delete of a password (data reading and writing)
- · Delete PLC data (data writing)

(5) Operating procedure

For the password setting procedure, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

Remark

.

To change, delete, or unlock the password, refer to the following. GX Works2 Version 1 Operating Manual (Common)

(6) Precautions

(a) Boot from an SD memory card

The following table shows the relationship between the boot operation availability and file password 32 setting.

Transfer source file		Transfer destination file		Password status	Boot operation	
File	Password	File	Password		Bool operation	
			Set	Matched	Enabled	
	Set	Exist	Sei	Not matched	Disabled	
			Not set	-	Disabled	
Exist		Not exist	-	-	Enabled	
	Not set	Exist	Set	-	Disabled	
			Not set	-	Enabled	
		Not exist	-	-	Enabled	
Not exist	-	-	-	-	-	

-: No combination available

If boot file settings are configured to more than one file, the files can be transferred only when all the passwords match. If all the passwords do not match, data in the SD memory card are not transferred and "BOOT ERROR" (error code: 2213) occurs.

(b) When "Clear Program Memory" is selected in parameter (Boot File tab)

Even though a password is registered, files will be formatted.

(7) Authentication method

Passwords are authenticated in three ways.

- By a programming tool
- By the FTP server
- · By the MC protocol

(a) Authentication by a programming tool

isable Password					
able passwords for data					
Target Memory	Program Memor	y/Device Memory	<u>_</u>		
Data Type Program	MAIN	Registered			
Parameter	PARAM	জন Registered			
		Setting	OK Cancel		
		\downarrow			

Input Disable Password	\mathbf{X}
Disable password for the selected file.	
Disable Condition Write Protection	-
L Disable Password (<u>R</u> ead Protection)	
Disable Password (<u>Write Protection</u>)	_
Explanation of Registration Conditions [Registration Conditions] Read protection, Write protection, Read protection/Write protection	
OK Cancel	

Point P

The entered password is valid until the project is closed.

1. Whenever an online operation requiring password authentication is executed, the "Disable Password" window appears.

Select an authentication target file, and click the "Setting" button.

2. Enter a password in the "Input Disable Password" window.

(b) Authentication by the FTP server

To access a password-protected file from external devices using the FTP server function, password authentication is required for each file. Authentication is required whenever files are accessed.

	-	1 /		
Operation	FTP command	Password authentication		
Operation	FTF command	Data write	Date read	
Deleting a file in a CPU module	delete	0	-	
Reading a file from a CPU module	get	-	0	
Deleting a file in a CPU module	mdelete	0	-	
Reading a file from a CPU module	mget	-	0	
Changing the name of a file in a CPU module	rename	0	-	
Changing or displaying the attribute of a file in a CPU module	change	0	-	

O: Authentication required, -: Authentication not required

To authenticate a password, use FTP commands for password authentication. Once the password is authenticated, it is valid until the accessed external device logs out from the FTP server or the network line is disconnected. (A password does not need to be authenticated every time the authentication target FTP commands are executed.)

FTP command for password authentication	Operation
quote passwd-rd <password></password>	Setting, displaying, and clearing a read password (file password 32) in a CPU module
quote passwd-wr <password></password>	Setting, displaying, and clearing a write password (file password 32) in a CPU module
quote keyword-set <password></password>	Setting, displaying, and clearing a file access password in a CPU module

The executability of FTP commands for password authentication differs depending on the access path to the CPU module.

O: Executable, ×: N	Not executable
---------------------	----------------

FTP command for password authentication	Access path		
	Via Ethernet module supporting the file password 32 function	Via Ethernet module not supporting the file password 32 function	
quote passwd-rd <password></password>	0	×	
quote passwd-wr <password></password>	0	×	
quote keyword-set <password></password>	×	0	

Point P -

If the Ethernet module that does not support the file password 32 function is used, observe the following points.
 Set the same password for a read password and writ password.
 The number of characters in the password must be four.

- The number of characters in the password must be four
- For details of FTP commands, refer to the following.
 QnUCPU User's Manual (Communication via Built-in Ethernet Port)

(c) Authentication by the MC protocol

To access a password-protected file from external devices using the MC protocol, the request message format of the MC protocol needs to be changed and a command for the file password 32 must be specified.

- 1. Add "Keyword" at the end of a request message, and set a password in the added area.
- **2.** Authenticate the password using the one set in the added area.
- **3.** For the commands requiring password authentication, specify 0004 (for file password 32) in the "Subcommand" area of a request message.

Function	Command (subcommand)	
Deleting a file	1822 (0004)	
Copying a file	1824 (0004)	
Changing the attribute of a file	1825 (0004)	
Opening a file	1827 (0004)	

The executability of commands for password authentication differs depending on the access path to the CPU module.

O: Executable, ×: Not executable (Command is not supported.)

		Access path		
Function	Command	Via serial communication module supporting the file password 32 function	Via serial communication module not supporting the file password 32 function	
Deleting a file	1822 (0000)	O *1	O*1	
	1822 (0004)	×	0	
Copying a file	1824 (0000)	O *1	O*1	
	1824 (0004)	×	0	
Changing the attribute of a file	1825 (0000)	O *1	O*1	
	1825 (0004)	×	0	
Opening a file	1827 (0000)	O *1	O*1	
	1827 (0004)	×	0	


*1 The commands are executable only when no password is registered with the access-target file or the number of characters in the registered password is four.

Point P

- If the serial communication module that does not support the file password 32 function is used, observe the following points.
 - Set the same password for a read password and writ password.
 - The number of characters in the password must be four.
- For details of commands, refer to the following.
 MELSEC Communication Protocol Reference Manual

3.19.3 File access control by security key PNote 3.14

This function protects unauthorized access to the files in the CPU module by writing a security key^{*1} to the module. The CPU module is locked with a security key and the files in the module can only be accessed from a programming tool where the same security key is registered.

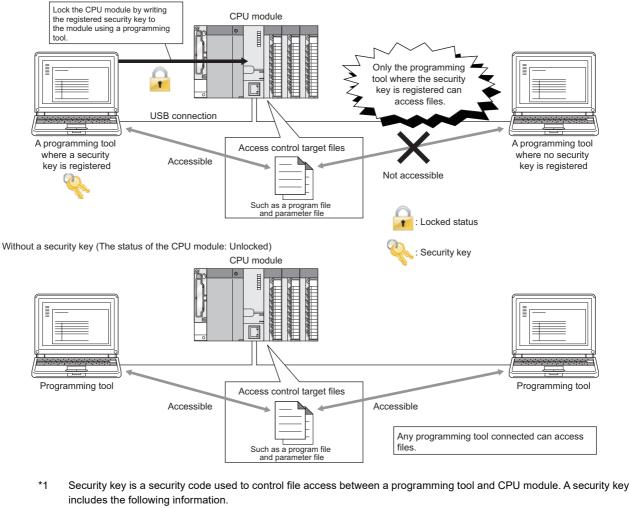

With a security key (The status of the CPU module: Locked)

- Name: A name of the security key. The number of characters used is 1 to 128.
- Date and time: Date and time when a security key is generated. The display format is [yyyy/mm/dd hh:mm].

If the security key used to lock a project or CPU module cannot be imported from a personal computer to a programming tool, the security key cannot be unlocked and the project data cannot be accessed permanently. When using a security key, note that we take no responsibility for any loss caused to the user, individual, or company resulting from lost data.

Note 3.14 Universal

Remark

Only the High-speed Universal model QCPU and Universal model Process CPU support this function.

(1) Access control target files

With a security key, access to the following files is controlled.

- Program
- Device comment
- Parameter
- Symbolic information

(2) Access control target drives

With a security key, access to the following drives is controlled.

O: Available, ×: Not available

Drive	Read/write availability
Program memory (drive 0)	0
SD memory card (drive 2)	×
Standard RAM (including an extended SRAM cassette) (drive 3)	0
Standard ROM (drive 4)	0

Point P

- Do not execute the Write to PLC, Read from PLC, or Verify with PLC function to the access control target files in the SD memory card. If executed, an error is displayed on the programming tool.
- If the CPU module is locked, device comments cannot be written to the SD memory card. Do not specify the SD memory card as a device comment storage location in the QCDSET instruction or in parameter (PLC file setting).


(3) Online operations that require authentication

Authentication is required to execute the following operations to access control target files. (Page 217, Section 3.19.3 (5))

- Write to PLC
- Read from PLC
- Verify with PLC
- Delete PLC data
- · Create/Change or Delete a password
- · Online change
- · Change TC setting

(4) Procedure

To control file access, register a security key in the programming tool. Then, using the registered security key, lock the CPU module.

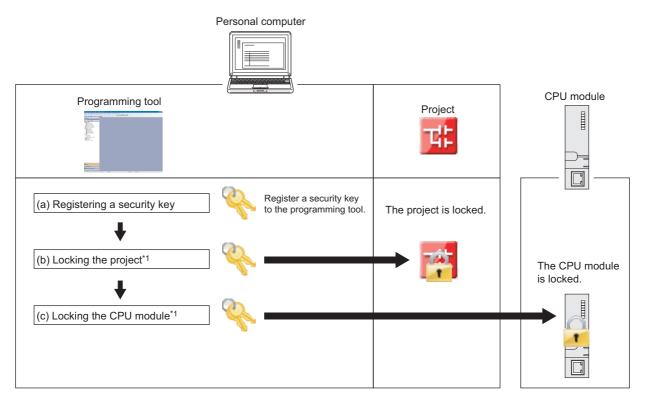

*1 The steps (b) and (c) do not need to be proceeded in particular order.

 Remark

 For setting details, refer to the following.

 Image: Image

(a) Registering a security key

Register a security key in the programming tool.

(b) Locking the project

Lock the project using the registered security key.

(c) Locking the CPU module

Lock the CPU module using the registered security key. The CPU module can be locked while it is in the STOP or PAUSE status. The locked status is kept even during power failure and cannot be unlocked even when the PLC memory format or PLC memory clear function is executed.

Point *P*

To lock the CPU module, use a USB device is recommended to avoid communications being intercepted.

(d) Checking the security key information

The information (name, date, and time) of the security key can be checked using a programming tool.

(e) Unlocking the CPU module

To unlock the CPU module, use the security key set with the project. Even if the security keys set with the CPU module and the project do not match, the CPU module can be unlocked. In this case, the system formats the drives (access control target drives) in the CPU module. The CPU module can be unlocked while it is in the STOP or PAUSE status.

(5) Authentication method

To read/write files from/to the locked CPU module, a security key needs to be authenticated between the CPU module and the programming tool.

(a) Writing files

To write files to the locked CPU module, the security keys set with the CPU module and the project need to match.

(b) Reading files

- To read files from the locked CPU module and create a new project, the same security key used to lock the CPU module needs to be registered in the programming tool.
- To read files from the locked CPU module to an existing project, the security keys set with the CPU module and the project need to match.

(6) Precautions

(a) Functions with restrictions

Some restrictions apply to the following functions when the CPU module is locked.

Fu	inction	Restrictions	Reference	
CPU module change function with memory card		The function cannot be used.	Page 260, Section 3.31	
Boot operation		The function cannot be used.	Page 104, Section 2.11	
Parameter-valid drive		Parameters stored in a memory card (SD) are not valid.	Page 42, Section 2.1.2	
Data logging funct	on	Device comments are not output to the data logging file.	QnUDVCPU/LCPU User's Manual (Data Logging Function)	
Accessing files from an external	File transfer function (FTP)		QnUCPU User's Manual (Communication via Built-in Ethernet Port)	
device other than MC protocol a programming GOT, EZSocket		Access control target files are not accessed.	-	
			-	

(b) Power-off or reset of the CPU module

Do not power off or reset the CPU module during the lock or unlock processing.

(c) Operations from multiple programming tools

If the lock or unlock processing is performed simultaneously from multiple programming tools, the first operation is executed, and the second and later operations are ignored.

(d) Online operations from a different programming tool

Even if an online operation is performed from a different programming tool where the security key is registered during the lock or unlock processing, the operation is not executed.

(e) During the execution of the CPU module change function with memory card

The CPU module cannot be locked.

(f) Number of connectable programming tools

The number of programming tools that can read/write files from/to the CPU module simultaneously while the module is locked is 32.

(g) Files that are not targeted for access control

If an operation is performed from a programming tool to the initial device value and device memory files, which are not targeted for access control, while the CPU module is locked, the security key needs to be authenticated.

(h) Writing a drive heading to the program memory

A drive heading is not written to the program memory if the security key in the programming tool and the CPU module does not match.

3.19.4 Remote password

This function prevents unauthorized remote access to the CPU module.

If a remote password has been set and the CPU module is remotely accessed, entering a remote password is required.

(1) Settable modules and the number of settable modules

The following table lists the modules for which the remote password can be set and the number of settable modules.

Settable module	Number of settable modules
Built-in Ethernet port QCPU	1
Ethernet module	4
Serial communication module	8

Point P


• The number of settable modules in the above table indicates the number of modules for which the remote password can be set, not the number of mountable modules in the system including a CPU module. For the number of mountable modules in the system, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

• For details of the remote password set for intelligent function modules, refer to the manuals for each module used.


(2) Function overview

Set a remote password in parameter (Page 465, Appendix 1.4), and write it to the CPU module. The remote password is transferred to the target module (Page 219, Section 3.19.4 (1)) when the CPU module is powered off and then on or is reset.

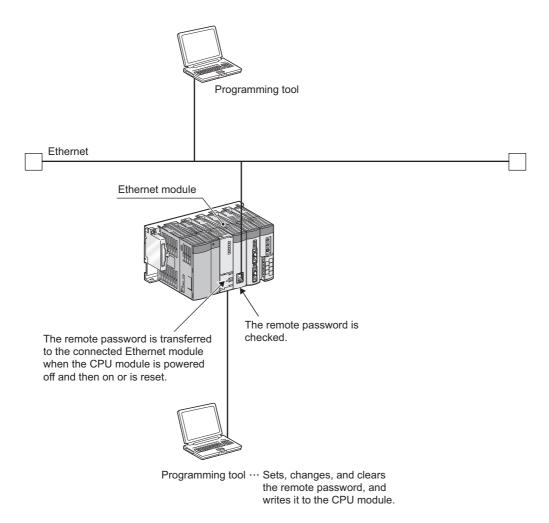

(3) Locking/unlocking the remote password

Unlock the remote password of a serial communication module or the password of an Ethernet module over Ethernet. When the entered password matches the registered password, the module is allowed to access the CPU module.

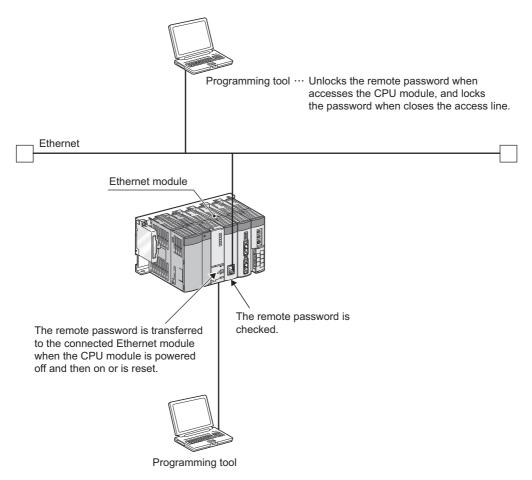

(4) Setting/changing/clearing a remote password

(a) Setting a remote password

Set a password in the Remote Password Setting window. (FP Page 465, Appendix 1.4)

♥ Project window ⇔ [Parameter] ⇔ [Remote Password]

Write the remote password setting to the CPU module. In a multiple CPU system, write the setting to the control CPU of the target module.

(b) Changing a remote password

Change the password in the Remote Password Setting window, and write the new remote password setting to the CPU module.


(c) Clearing a remote password

Click the <u>Clear</u> button in the Remote Password Setting window, and write the remote password setting to the CPU module.

3.20 LED Indication

Operating status of the CPU module can be checked by the LEDs on the front of the CPU module. For details of LED indications, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)



3.20.1 Methods for turning off the LEDs

The LEDs can be turned off by the following operations (except for reset operation).

O : Enabled, × : Disabled

		-	,	
Mothod for turning off the LED	Relevant LED			
Method for turning off the LED	ERR.	USER	BAT.	BOOT
Execute the LEDR instruction after resolving the error.	0	0	0	×
After resolving the error, clear the error by the special relay SM50 and special register SD50 ^{*1} (operation continuation error only).	0	0	0	×
Turn off the LED by the special relay SM202 and special register SD202. ^{*1}	×	0	×	0


*1 Description of special relays and special registers

• SM50 : Clears an error of the error code stored in SD50 when the CPU module is powered off and then on.

 SD50 : Stores a code of a error to be cleared. For details of error codes, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

- SM202 : Turns off the LED corresponding to each bit of SD202 when the CPU module is powered off and then on.
- SD202 : Set an LED to be turned off.



Configure setting to turn off each LED as follows:

- Turning off both the BOOT LED and USER LED: SD202 = 110_{H}
- Turning off only the BOOT LED: SD202 = 100_{H}
- Turning off only the USER LED: SD202 = 10_{H}

There is a priority in indications of the ERR.LED, USER LED, and BAT.LED.

When a cause number of an LED is deleted in the priority, the LED will not turn on even if an error with the cause number occurs. (FP Page 223, Section 3.20.2)

3.20.2 LED indication priority

This section describes a priority for error messages stored in the LED display data (SD220 to SD227) in case of an error.

(1) Displayed error messages and their priorities

In case of multiple errors, the error messages are displayed with the following conditions.

- A stop error is always set to the LED display data (SD220 to SD227).
- An operation continuation error is displayed according to the priority cause number described in this section.
 Whether to indicate an error according to its priority using LED can be selected. (Set the priority using special registers, SD207 to SD209.)
- When errors having the same priority occur simultaneously, the error detected first is displayed.

Default value of factor number 0 bits 15 12 11 to 8 7 to 4 3 to 0 bits 15 to to SD207 Priority 3 Priority 4 Priority 2 Priority 1 SD207 4 2 3 1 Factor number setting area SD208 Priority 8 Priority 7 Priority 6 Priority 5 SD208 8 7 6 5 Factor number setting area SD209 Priority 10 ➡ SD209 0 9 Priority 9 0 A Factor number setting area Ignored

The priority is determined with the special registers SD207 to SD209 as follows.

(2) Priorities and cause numbers

The following table lists the description and priority of the cause numbers set to the special registers SD207 to SD209.

Priority	Cause number (hexadecimal)	Displayed error message	Remarks
1	1	AC/DC DOWN	• Power-off
2	2	• UNIT VERIFY ERR. • FUSE BREAK OFF • SP.UNIT ERROR • SP.UNIT DOWN	 I/O module verification error Fuse blown Intelligent function module verification error
3	3	OPERATION ERROR SFCP OPE.ERROR SFCP EXE.ERROR	 Operation error SFC instruction operation error SFC program execution error
4	4	ICM.OPE.ERROR ^{*1} FILE OPE.ERROR FLASH ROM ERROR	Memory card operation error File access error Flash ROM access count over error
		PRG.TIME OVER	Constant scan setting time-out error
5	5	• MULTI CPU ERROR ^{*2}	Another CPU error in multiple CPU systems
6	6	PID ERROR	PID control instruction error
7	7	Annunciator	-
8	8	-	-
9	9	BATTERY ERROR	-
10	A	-	-

*1 The Q00UJCPU, Q00UCPU, and Q01UCPU cannot display the error message.

*2 The Q00UJCPU cannot display the error message.

Point P

• To remain the LED off even in case of an error, set the cause number setting area (each 4 bits) of SD207 to SD209 that stores the corresponding cause number to "0".

Ex. To remain the ERR. LED off even when a fuse blown error is detected, set the cause number setting area where the cause number "2" is stored to "0".


	•	- SE	020 -		<	- SD	020 -		<	- SE	020 -		
l	0	0	А	9	8	7	6	5	4	3	0	1	

Because the cause number "2" is not set, the ERR.LED remains off even if a fuse blown is detected. In this case, even if another error with the cause number "2" (I/O module verification error or intelligent function module verification error) is detected, the ERR.LED remains off.

• If "0" is set to the cause number setting area (setting that does not turn on the LED), SM0 (Diagnostic errors) and SM1 (Self-diagnostic error) turn on, and the error code is stored to SD0 (Diagnostic errors).

3.21 High-Speed Interrupt Function PNote 3.15

This function executes an interrupt program at fixed intervals of 0.1 to 1.0ms using the high-speed interrupt pointer (I49). Also, the I/O response improves because the I/O signal data set in parameters and the data in the buffer memory of each intelligent function module are refreshed before and after these high-speed interrupt programs are executed. This enables high-accuracy control such as precise position detection.

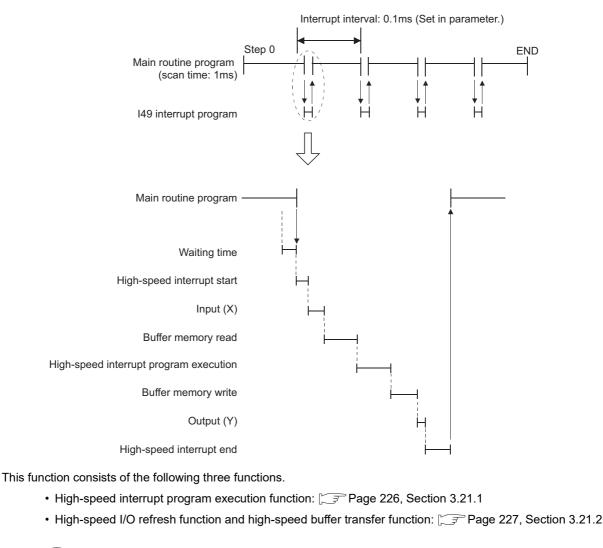

Remark For the processing time of the high-speed interrupt function, refer to [_____ Page 492, Appendix 3 (15).

Note 3.15 Universal

Only the High-speed Universal model QCPU and Universal model Process CPU support this function. (Page 467, Appendix 2)

3.21.1 High-speed interrupt program execution function

This function executes interrupt programs according to the high-speed interrupt pointer (I49).

(1) Setting method

Open the High Speed Interrupt Settings window and set a value to "I49 Fixed Scan Interval" within the range of 0.1 to 1.0ms.

℃ Project window <> [Parameter] <> [PLC Parameter] <> "PLC System" tab <> "System Interrupt Settings", "High Speed Interrupt Settings" button

	eed Interrupt ed Scan Interval	ms	(0.1ms to 1.0ms)	₊		Set a value within the range of 0.1
		,		1		1.0ms.
High S	ipeed I/O Refresh	Setting				
			Assi	gnment Method	1	
			0	Points/Start		
			(*	Start/End		
					-	
	Туре	Points(DEC)	Start(HEX)	End(HEX)		
	X Input	16	0000	000F		
	X Input					
	X Input					
	X Input					
	X Input					
	X Input					
	Y Output					
	Y Output					
	Y Output Y Output				-	
	Y Output					
	Y Output				1	
		II	I		-	

(2) Precautions

(a) High-speed interrupts while interrupts are disabled

High-speed interrupt programs are not executed while interrupts are disabled. To execute the programs, the interrupt enable condition needs to be established.

For the functions that disable interrupts and delay the startup of a high-speed interrupt, refer to Page 231, Section 3.21.3 (3).

(b) High-speed interrupts that are ignored

If interrupts are disabled for the period longer than the set interrupt interval, there is a case that high-speed interrupts are ignored. If a high-speed interrupt occurs twice during an interrupt disabled period, the second interrupt is ignored.

(c) Executability of this function

This function is executed when all of the following conditions are met.

- The EI instruction is being executed.
- The CPU module is running.
- The high-speed interrupt pointer (I49) is not masked by the IMASK instruction. (Default: Not masked)

For the IMASK and El instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

3.21.2 High-speed I/O refresh function and high-speed buffer transfer function

The high-speed I/O refresh function refreshes I/O signal data between I/O modules or intelligent function modules and the CPU module at the specified interrupt intervals.

The high-speed buffer transfer function refreshes data between the buffer memory in intelligent function modules and the devices in the CPU module at the specified interrupt intervals.

(1) Setting method

(a) High-speed I/O refresh function

Open the High Speed Interrupt Settings window and set the refresh ranges for X/Y.

♥ Project window ⇔ [Parameter] ⇔ [PLC Parameter] ⇔ "PLC System" tab ⇔ "System Interrupt Settings", "High Speed Interrupt Settings" button

I49 Fix	ed Scan Interval	0.1 ms	(0.1ms to 1.0ms)		
High S	5peed I/O Refres	h Setting				
			As	signment Method	1	
			0	Points/Start		Set the refresh ranges of X
				Start/End		Set the remestivalities of A
				Startpena		
	Туре	Points(DEC)	Start(HEX)	End(HEX)	1	
	X Input			1	1	
	X Input			Î		
	X Input					
	X Input					
	X Input					
	X Input					
	Y Output					
	Y Output					
	Y Output				- 1	
	Y Output					
	Y Output				- 1	
	Y Output					

Item	Description	Restrictions	Number of settings
Assignment Method	Select an assignment method (Points/Start or Start/End).	-	-
Points(DEC)	The number of bits transferred (16 to 4096)		
Start(HEX)	Start device number (X0 to 0FF0 or Y0 to 0FF0)	 I/O modules and intelligent function modules only 	Up to six settings for X input and Y
End(HEX)	End device number (X000F to 0FFF or Y000F to 0FFF)	• Numbers in the multiples of 16 only ^{*1}	output, respectively

*1 This applies to both the start device number and the number of bits transferred.

(b) High-speed buffer transfer function

Open the High Speed Buffer Transfer Setting window and set the transfer ranges.

♥ Project window ⇒ [Parameter] ⇒ [PLC Parameter] ⇒ "PLC System" tab ⇒ "System Interrupt Settings", "High Speed Interrupt Settings" button ⇒ "High Speed Buffer Transfer Setting" button

High Speed B Assignment N O Points/S O Start/En	Method Bul	fer Setting ffer Memory (© DEC () HEX					٤
	Start I/O No.	Points	Buffer Memory	Buffer Memory		PLC Side Device	PLC Side Device
Туре	(HEX)	(DEC)	Start	End		Start	End
Buffer Read					•		
Buffer Read					•		
Buffer Read					\rightarrow		
Buffer Read					\rightarrow		
Buffer Read					\bullet		
Buffer Read					•		
Buffer Write					•		
Buffer Write					•		
Buffer Write					\rightarrow		
Buffer Write					•		
Buffer Write					•		
Buffer Write							
	Default		Check	End		Cancel	

Item	Description	Restrictions	Number of settings	
Assignment Method	Select an assignment method (Points/Start or Start/End).			
Buffer Memory Address	Select an buffer memory address input system (DEC. or HEX.).	-	-	
Start I/O No. (HEX)	Start I/O number ÷ 10 _H (0 to FF _H)	Intelligent function modules only		
Points (DEC)	Number of words transferred (1, 2 to FFE_H)	Intelligent function modules only	-	
Buffer Memory Start	Start address (0 _H to FFF _H)	 Even addresses and even words 	Up to six settings for read and write, respectively	
Buffer Memory End	End address (0 _H to FFFF _H)	only ^{*1}		
PLC Side Device Start	Start device number	D, W, D (extended data register), W		
PLC Side Device End	End device number	(extended link register), R, and ZR		

*1 An odd address is allowed when the number of words transferred is set to 1.

Point P

Mount the target modules of this function on a main base unit. (Access time to modules mounted on a main base unit is shorter than that to modules on an extension base unit.)

(2) Precautions

(a) Executability of this function

This function is executed when all of the following conditions are met.

- The EI instruction is being executed.
- The CPU module is running.
- The high-speed interrupt pointer (I49) is not masked by the IMASK instruction. (Default: Not masked)

For the IMASK and EI instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

3.21.3 Precautions

This section describes precautions for executing the high-speed interrupt function.

(1) Functions that delay the startup of high-speed interrupts

When any of the functions in the table below is being executed, high-speed interrupts cannot be executed at preset intervals.

Item	Operation when executed
Multiple CPU system configuration	The startup of a high-speed interrupt delays for about 15µs.
Connection of the QA1S5□B, QA1S6□B, and QA6□B	The startup of a high-speed interrupt delays for about 18µs for the first level and delays for about 30µs for the second and later levels.
Interrupt program (I0 to I48, I50 to I255), fixed scan execution type program	Only one interrupt is executed at a time. A high-speed interrupt starts after the execution of an interrupt program or fixed scan execution type program ends.
Operation when a continuation error occurs	The startup of a high-speed interrupt delays for the time required to detect a continuation error (instruction execution time + continuation error notification time (20µs)).
Execution of an instruction	Interrupts are disabled while an instruction is being executed. A high-speed interrupt starts after the execution of the instruction is completed.
Link direct device, instruction that accesses to module access device, MC protocol, and device test	The startup of a high-speed interrupt delays for more than 15µs.
I/O refresh, link refresh, auto refresh (intelligent function module), and multiple CPU auto refresh	 The startup of a high-speed interrupt delays for the following period of time. When I/O refresh is performed on the module mounted on the main base unit: 24µs maximum on the extension base unit: 40µs maximum When link refresh or auto refresh is performed on the module mounted on the main base unit: 30µs maximum on the extension base unit: 70µs maximum When multiple CPU auto refresh is performed on the module mounted on the main base unit: 250µs maximum
Interlink transfer	The startup of a high-speed interrupt delays for the following period of time. • Interlink transfer on the main base unit: 15µs maximum • Interlink transfer on the extension base unit: 30µs maximum
Ladder monitor, device batch monitor, and entry data monitor	The startup of a high-speed interrupt delays for the monitoring time ($0.121\mu s x$ number of device points + $9\mu s$). If self-monitoring and monitoring via any intelligent function module are requested at the same time, the startup of a high-speed interrupt delays for about 70 μs .
Local device monitor	The startup of a high-speed interrupt delays for the monitoring time (340μ s + performance when the local devices are used).
Buffer memory batch monitor	The startup of a high-speed interrupt delays for about 820µs. (The number of points to be monitored: 55)
Monitor condition setting	The startup of a high-speed interrupt delays for the following period of time. • When step is specified: 30µs • When internal user device is specified: 15µs
Read from PLC (during RUN)	The startup of a high-speed interrupt delays for the following period of time. • Reading data from the device memory (59K words): 250µs • Reading data from other memory: 15µs
Write to PLC (during RUN), file transfer function (FTP)	 The startup of a high-speed interrupt delays for the following period of time. Writing data to the comment file in the program memory or standard RAM: 60µs or longer Writing data to the file register in the standard RAM: 60µs or longer Writing data to other memory: 15µs
Forced disablement of SD memory card	The startup of a high-speed interrupt delays for about 20µs.
Program memory batch download	The startup of a high-speed interrupt delays for about 15µs.
Executional conditioned device test	 The startup of a high-speed interrupt delays for the following period of time. When registered/disabled: 50μs maximum During execution: Tested using the same program name and step No. Internal user device: 12μs × (number of device points) + 25μs I/O device: 28μs × (number of device points) + 25μs

Item	Operation when executed
Scan time measurement	The startup of a high-speed interrupt delays for the following period of time. • When registered: 100μs • During measurement: 15μs
Sampling trace	 The startup of a high-speed interrupt delays for the following period of time. At startup: 110μs During execution: 11μs Internal user device (word: 50 points, bit: 50 points)
Data logging function	 The startup of a high-speed interrupt delays for the following period of time. Logging type: Continuous logging (one setting, no CSV output) Each scanning cycle (Device data match.), internal user device (128 points): 15µs Step No. specification, internal user device (128 points): 45µs
Data logging by a high speed data logger module	The startup of a high-speed interrupt delays for the following period of time. • General data sampling: Link direct device (256 points): 1ms • High-speed data sampling: File register (256 points): 40µs
Online change	The startup of a high-speed interrupt delays for the following period of time. • Online change (ladder mode): 40μs maximum • Online change (files): 15μs maximum
Diagnostic function (such as PC diagnostics, system monitor)	The startup of a high-speed interrupt delays for about 1ms (maximum) in the multiple CPU system or if any diagnostic target module is mounted on the base unit.
Error clear	The startup of a high-speed interrupt delays for the following period of time. • Annunciator error: about 30μs • Battery error: about 25μs
IP packet transfer function	The startup of a high-speed interrupt delays for about 30µs.
Access command issuance from intelligent function modules, such as the QJ71C24 and QJ71E71, to the CPU module	 The startup of a high-speed interrupt delays for the following period of time. Read/write command: (0.060 × (number of device points) + 12) μs Batch write command: (0.10 × (number of device points)) μs Batch read command: (0.13 × (number of device points)) μs
Clock setting using a programming tool	The startup of a high-speed interrupt delays for about 30µs.

Item	Operation when used		
External input/output forced on/off	This function is not executed and ignored in high-speed interrupt programs. (No error occurs.)		
Index register	High-speed interrupt programs do not save nor restore data in the index register. If data in the index register are changed in a high-speed interrupt program, the data are overwritten.		
Local device	High-speed interrupt programs do not save nor restore data in local devices. If data in local devices are changed in a high-speed interrupt program, the data are overwritten in the program that was being executed before the interrupt.		
File register having the same name as a program	High-speed interrupt programs do not automatically change the file register name to the same name as a program. If data in the file register are changed in a high-speed interrupt program, the data are overwritten in the program that was being executed before the interrupt.		
Device comment having the same name as a program	High-speed interrupt programs do not automatically change the device comment file name to the same name as a program. The following data are not updated in a high- speed interrupt program. • Comment use (SM650) • Comment drive (SD650) • Comment file name (SD651 to SD656) • Memory card in-use flag (SM604) • Memory card use conditions (SD604) • Drive 3/4 in-use flag (SM624) • Drive 3/4 use conditions (SD624)		

(2) Items disabled when the high-speed interrupt function is used

(3) Time required for one interrupt program

If exceeded, "WDT ERROR" may occur and the operation of the high-speed interrupt program is not guaranteed.

(4) "Interrupt Program/Fixed Scan Program Setting" in PLC parameter

For high-speed interrupts, the "High Speed Execution" parameter setting is ignored even when selected.

(5) High-speed I/O refresh function and high-speed buffer transfer function

- · Mount the target modules of these functions on the main base unit.
- When the high-speed buffer transfer function is executed, an error does not occur even when the file register is used exceeding the setting range. Data out of the setting range, however, are not transferred. (There is no impact on other device data.)

(6) Programming precautions

Refer to the programming precautions for interrupt programs. (FP Page 82, Section 2.9)

(7) Occurrence of the same interrupt


If the same interrupt factor occurs while a high-speed interrupt program (I49) is being executed, the second interrupt will be ignored.

3.22 Interrupt from Intelligent Function Module

The CPU module can execute an interrupt program (I \Box) by the interrupt request from the intelligent function module. For example, the serial communication module can receive data by an interrupt program when the following data communication functions are executed.

- · Data reception during communication by nonprocedural protocol
- · Data reception during communication by bidirectional protocol

Using an interrupt program enables a CPU module to receive data quickly.

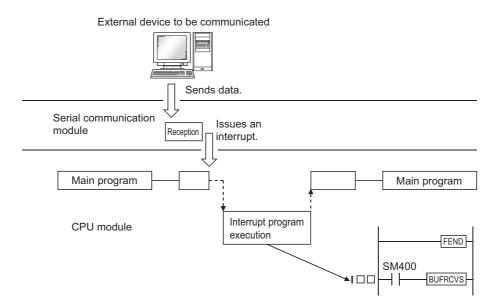

To execute an interrupt program by an interrupt from the intelligent function module, select "Intelligent Function Module Interrupt Pointer Setting" in "Intelligent Function Module Setting" of the PLC system tab in the PLC parameter dialog box.

℃ [PLC Parameter] ⇔ [PLC System] ⇔ [Intelligent Function Module Setting] ⇔ [Interrupt Pointer Setting] button

To configure "Intelligent Function Module Parameter" at the intelligent function module is also required. For execution of an interrupt program by an interrupt from the intelligent function module, refer to the following.


Manual for the intelligent function module used

Remark
For the numbers of interrupt pointers available for an interrupt from the intelligent function module, refer to Page 412, Section 4.11.

. . . .

3.23 Serial Communication Function PNote 3.16

This function communicates data using the MC protocol by connecting the RS-232 interface of the CPU module and a personal computer or HMI from other companies with an RS-232 cable. This section describes the specifications, functions, and settings of the function.

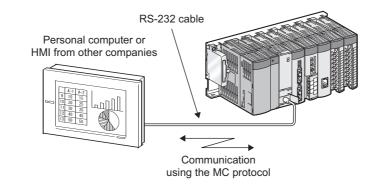

Point P

- A personal computer or HMI from other companies can communicate only with a CPU module connected to it. It cannot communicate with stations connected over CC-Link IE, MELSECNET/H, Ethernet, or CC-Link.
- This function is not used to connect a programming tool or GOT to a CPU module.
- To execute this function with the Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, or Q26UDHCPU, use GX Works2. (GX Developer does not support this function.)

3.23

3



Note 3.16 Universal

Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used.

(Page 467, Appendix 2)

The Built-in Ethernet port QCPU does not support this function.

(1) Specifications

(a) Transmission specifications

The following is the transmission specifications of RS-232 used for this function. Check that the specifications of the personal computer or HMI from other companies match those in the following table.

Item	Setting range	Default
Communication method	-	Full-duplex communication
Synchronization method	-	Asynchronous method
Transmission speed ^{*1}	9.6kbps, 19.2kbps, 38.4kbps, 57.6kbps, 115.2kbps	19.2kbps
Data format	-	 Start bit: 1 Data bit: 8 Parity bit: Odd Stop bit: 1
MC protocol format ^{*2} (automatic detection)	-	Format 4 (ASCII) Format 5 (binary)
Frame ^{*2}	-	QnA-compatible 3C frame QnA-compatible 4C frame
Transmission control	-	DTR/DSR control
Sum check ^{*1}	Checked/not checked	Checked
Transmission wait time ^{*1}	No waiting time, 10ms to 150ms (in increments of 10ms)	No waiting time
RUN write setting ^{*1}	Permit (selected), prohibited (deselected)	Prohibited (deselected)
Overall cable distance	-	15m

*1 The item is set in the PLC parameter of the programming tool. (Page 457, Appendix 1.2.12)

*2 Relationship between the MC protocol formats and frames is shown below.

O : Available, × : Unavailable

		÷ .	· · · · · · · · · · · · · · · · · · ·
Fur	ction	Format 4	Format 5
Communication in ASCII code	QnA-compatible 3C frame	0	×
	QnA-compatible 4C frame	0	×
Communication in binary code	QnA-compatible 4C frame	×	0

(b) RS-232 connector specifications

The following is the specifications of the RS-232 connector of a CPU module.

Appearance	Pin number	Signal	Signal name
	1	RD (RXD)	Receive data
$(\bullet_5 \bullet^3 \bullet_1)$	2	SD (TXD)	Send data
Mini-DIN 6 pins (female)	3	SG	Signal ground
	4	-	-
	5	DR (DSR)	Data setting ready
	6	ER (DTR)	Data terminal ready

(c) RS-232 cable


Use either of the following RS-232 cables between a personal computer or HMI from other companies and a CPU module.

- QC30R2 (cable length: 3m)
- CH-M096234-*** (manufactured by CHUGAI Co., Ltd.)

Effective length

Cable with a Mini-DIN connector on one side and without connector on the other side *** indicates a cable length, which can be lengthened up to 15m in increments of 0.1m.






CH-M096234-*** connector

Pin number	1	2	3	4	5	6	Metal shell
Signal	RD	SD	SG	-	DR	ER	wetar shen
Wire core	Red	Black	Green/white	-	Yellow	Brown	Shield

Point *P*

To fix the RS-232 cable to the CPU module, the use of the RS-232 connector disconnection prevention holder (Q6HLD-R2) is recommended. For the Q6HLD-R2, refer to the following.

Q6HLD-R2 Type RS-232 Connector Disconnection Prevention Holder User's Manual



(2) Commands

The following table lists the MC protocol commands that can be executed.

	Function		Command	Processing	Number of processing points
	In un bits		0401(00 🗆 1)	Reads bit devices in units of 1 point.	ASCII: 3584 points BIN: 7168 points
	Batch read	In units of	0401(00 🗆 0)	Reads bit devices in units of 16 points.	480 words (7680 points)
		words	0401(00 🗆 0)	Reads word devices in units of 1 point.	480 points
	- *1	In units of bits	1401(00 🗆 1)	Writes bit devices in units of 1 point.	ASCII: 3584 points BIN: 7168 points
	Batch write ^{*1}	In units of	1401(00 🗆 0)	Writes bit devices in units of 16 points.	480 words (7680 points)
		words	1401(00 🗆 0)	Writes word devices in units of 1 point.	480 points
	Random read In units of words Device memory In units of bits Test*1 (random write) In units of words*2		0403(00 □ 0)	Reads bit devices in units of 16 points or 32 points by specifying the device or device number at random. Reads word devices in units of 1 point or 2 points by	96 points
				specifying the device or device number at random.	
memory			1402(00 🗆 1)	Sets/resets bit devices in units of 1 point by specifying the device or device number at random.	94 points
		1/	1402/00 🗖 0)	Sets/resets bit devices in units of 16 points or 32 points by specifying the device or device number at random.	*5
				Writes word devices in units of 1 point or 2 points by specifying the device or device number at random.	
	Monitor registration	In units of		Registers bit devices to be monitored in units of 16 points or 32 points.	96 points
	*2 *3 *4		0801(00 🗆 0)	Registers word devices to be monitored in units of 1 point or 2 points.	96 points
	Monitor	In units of words	0802(00 □ 0)	Monitors devices registered for monitoring.	Number of monitor registration points

*1 To perform online change, check the "Permit" checkbox under "RUN write setting".

*2 Devices such as TS, TC, SS, SC, CS, and CC cannot be specified in units of words. For the monitor registration, an error (4032_H) occurs during the monitor operation.

*3 The monitor condition specification cannot be used for these commands.

*4 Do not execute monitor registration from multiple external devices. If executed, the last monitor registration becomes valid.

*5 Set the number of processing points within the range of the following calculation formula.

(number of word access points) × 12 + (number of double word access points) × 14 \leq 960

• One point of a bit device corresponds to 16 bits for word access or to 32 bits for double word access.

• One point of a word device corresponds to one word for word access or to two words for double word access.

(3) Accessible devices

The following table lists the accessible devices by the serial communication function.

Category E		Device co		code ^{*1}	Device number range	number range	
oategory		201100		Binary	Device number range		
	Function input	Function input				Hexadecimal	
	Function output				(Cannot be accessed)	Hexadecimal	
Internal system device	Function regist	ter				Decimal	
	Special relay		SM	91 _H		Decimal	
	Special registe	er	SD	A9 _H		Decimal	
	Input		X *	9C _H		Hexadecimal	
	Output		Y *	9D _H		Hexadecimal	
	Internal relay		M *	90 _H		Decimal	
	Latch relay		L*	92 _H		Decimal	
	Annunciator		F*	93 _H	1	Decimal	
	Edge relay		V *	94 _H		Decimal	
	Link relay		В*	A0 _H		Hexadecimal	
	Data register		D *	A8 _H		Decimal	
Link register Timer		W *	B4 _H		Hexadecimal		
		Contact	TS	C1 _H	Within the device number range of the CPU module accessed. Note, however, that local devices cannot be accessed.		
	Timer	Coil	тс	C0 _H		Decimal	
Internal user		Current value	TN	C2 _H			
device		Contact	SS	C7 _H			
	Retentive	Coil	SC	C6 _H	_	Decimal	
	timer	Current value	SN	C8 _H			
		Contact	CS	C4 _H			
	Counter	Coil	СС	C3 _H	-	Decimal	
		Current value	CN	C5 _H			
	Link special re	l lay	SB	A1 _H	-	Hexadecimal	
	Link special re	-	SW	B5 _H		Hexadecimal	
	Step relay	0	S *	98 _H	-	Decimal	
	Direct input ^{*2}		DX	A2 _H	-	Hexadecimal	
	Direct output ^{*2}		DY	A3 _H	-	Hexadecimal	
Index register	Index register		Z *	CC _H		Decimal	
	index regioner		 R*	AF _H	Within the device number range of the CPU module	Decimal	
File register*3	File register	File register		B0 _H	accessed	Hexadecimal	
Extended data register ^{*3}	Extended data	register	ZR D*	A8 _H	Binary: Within the device number range of the CPU module accessed ASCII: 000000 to 999999 (up to 976.6K points)	Decimal	
Extended link register ^{*3}	Extended link	register	W *	B4 _H	Within the device number range of the CPU module accessed	Hexadecimal	

1 This is a code specified in MC protocol messages. When communicating data in ASCII code, specify the code in two characters. If the code consists of only one character, add "" (ASCII code: 2A_H) or a space (ASCII code: 20_H) after the character.

*2 Devices of DX/DY1000 or later are not available. Use X/Y devices to access devices of X/Y1000 or later.

*3 The Q00UJCPU does not support these devices.

(4) Setting transmission specifications

Set a transmission speed, sum check status, transmission wait time, and online change status for this function in the Serial Communication tab of the PLC parameter dialog box. (

- Select "Use Serial Communication" to communicate with a personal computer or HMI from other companies using this function.
- Set a transmission speed, sum check status, transmission wait time, and online change status.

	Q Parameter Setting
Click here to use the serial communication function.	PLC Name PLC PLC System PLC
	Deta format value is flood as below. Seat Okti Party U-Codd Deta biti 3 Stop bit 1
	Print Window Print Window Preview Acknowledge XY Assignment Default Check End Cancel

(5) Precautions

(a) Switching a connection from an HMI from other companies to a programming tool

A connection device can be switched from a personal computer or HMI from other companies to a programming tool during communication. However, this operation causes a communication error in the personal computer or HMI. For a startup method of the personal computer or HMI after it is reconnected to the CPU module, refer to the manual for the device used.

(b) Transmission speed set in the Transfer Setup screen

When "Use Serial Communication" is selected, the transmission speed set in the Transfer setup screen of the programming tool is ignored.

(c) Communication error

If any of the following conditions is met, no response is returned (a communication error occurs). Take a corrective action.

- The serial communication function is set not to be used.
- · Communication is made at different transmission speed and data format.
- A frame to be sent has no correct starting end or terminal.
 - 3C frame format 4: ENQ/CR + LF
 - 4C frame format 4: ENQ/CR + LF
 - 4C frame format 5^{*1}: DLE+STX/DLE + ETX
- *1 When the "Sum Check" checkbox is selected, the sumcheck code is included.
 - The frame identification number of a frame to be sent is incorrect.
 - The number of transmission bytes is under the header part size.

(6) Error codes during communication with the serial communication function

The following table lists the error codes (together with their descriptions and corrective actions) sent from the CPU module to the external device when an error occurs during communication using the serial communication function.

Error code (hexadecimal)	Error item	Description	Corrective action
4000 _H to 4FFF _H	-	Error detected by the CPU module (error occurred by other than the serial communication function)	Refer to the following manual and take corrective action. QCPU User's Manual (Hardware Design, Maintenance and Inspection)
7155 _H	Unregistered monitor error	A monitor request was given before monitor registration.	Give a monitor request after registering a device to be monitored.
7157 _H	Request target specification error	A CPU module that does not support the serial communication function is specified as a request target module or is in the specified route.	Check that the transmission message is addressed to the CPU module that supports the serial communication function. If not, correct the address and restart communication.
7164 _H	Request data error	The requested data or device specification method is incorrect.	Check the sent message/requested data of the external device, correct it, and restart communication.
7167 _H	Disabled during RUN	A write command was specified while online change is disabled.	 Enable the online change and restart communication. Set the CPU module to STOP and restart communication.
7E40 _H	Command error	A subcommand or a command that does not exist is specified.	Check and correct the sent message of the external device and restart communication.
7E41 _H	Data length error	The number of points specified for random write/read exceeds the number of points enabled for communication.	Check and correct the sent message of the external device and restart communication.
7E42 _H	Data count error	The requested number of points exceeds the range of the command.	Check and correct the sent message of the external device and restart communication.
7E43 _H	Device error	The device specified does not exist. The device specified cannot be specified by the corresponding command.	Check and correct the sent message of the external device and restart communication.
7E47 _H	Continuous request error	The next request was received before the response message was returned.	Do not give continuous requests from the external device. Match the monitoring time of timer 1 with the time-out time of the external device.
7F21 _H	Receive header section error	The command (frame) section specified is in error. The ASCII code received cannot be converted into binary.	Check and correct the sent message of the external device and restart communication.
7F22 _H	Command error	The command or device specified does not exist.	Check and correct the sent message of the external device and restart communication.
7F23 _H	MC protocol message error	The data (such as ETX, CR+LF) specified after the character part does not exist or in error.	Check and correct the sent message of the external device and restart communication.
7F24 _H	Sumcheck error	The calculated sumcheck does not match the received sumcheck.	Review the sumcheck of external device.

Error code (hexadecimal)	Error item	Description	Corrective action	
7F67 _H	Overrun error	The next data was received before the CPU module completed receive processing.	Reduce the communication speed and restart communication. Check the CPU module for momentary power failure. (For the CPU module, use the special register SD53 to check.) When an momentary power failure occurs, remove its cause.	
7F68 _H	Framing error	 The stop bit setting does not match. Communication line became unstable by powering on/off the target device. Noise is generated on the communication line. 	 Match the setting of the CPU module with that of the external device. Take noise reduction measures. 	
7F69 _H	Parity error	 The parity bit setting does not match. Communication line became unstable by powering on/off the target device. Noise is generated on the communication line. 	 Match the setting of the CPU module with that of the external device. Take noise reduction measures. 	

3.24 Service Processing

3.24.1 Service processing setting

This function allows to set the time and the number of times of service processing performed at END processing by parameters.

Processing for requests from peripherals to the CPU module are performed with this function. The processing speed for the communication response to the requests varies depending on the scan time and communication load. Set the parameter of the service processing time as follows to achieve an optimal service processing environment for the system used.

- Setting a longer time can improve the processing speed for the communication response.
- Setting a shorter time can avoid a prolonged scan time caused by the service processing.

Communications from multiple peripherals to the CPU module may slow down the processing speed for the communication response. Adjust the settings for the system by specifying a longer service processing time or modifying the parameter settings of the peripherals to set longer timeout times taking the processing speed for the communication response and increases in scan times into consideration.

Point /


The service processing refers to the following:

- Communications via intelligent function modules (A link refresh from network modules is not included.)
 Communications via USB cables, RS-232 cables, and the built-in Ethernet port (Communications with
- programming tool and GOT)

Using the COM instruction enables service processing during program execution of same performance with service processing at END processing. Therefore, the high-speed service processing response can be performed even if the scan time is long.

(1) Parameter setting

Set the parameters in the PLC system tab of the PLC parameter dialog box.

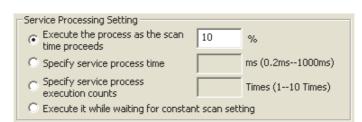

To perform the service processing, select any of the parameter items in the following table. The setting value of deselected parameter cannot be entered. (Default: Execute the process as the scan time proceeds. = 10%)

Item	Description	Setting range	Remarks
Execute the process as the scan time proceeds.	Set the percentage of service processing for one scan.	• Range: 1 to 99% • Unit: 1%	Default when selected =10%
Specify service process time.	Set the time of service processing for one scan.	• Range: 0.2ms to 1000ms • Unit: 0.1ms	Default when selected =0.2ms
Specify service process execution counts.	Set the number of service processing for one scan.	• Range: 1 to 10 times • Unit: 1 time	Default when selected =1 time


ltem	Description	Setting range	Remarks
Execute it while waiting for constant scan setting.			Even when the waiting time is
	Set whether to perform service		0.2ms or less, the service
	processing during waiting time for	-	processing time (0.2ms) will be
	constant scan setting.		added to the scan time at service
			processing execution.

(2) Operations for service processing setting

Operations for each service processing setting is described below.

(a) Operation when "Execute the process as the scan time proceeds." is selected

· Operation when 10% is set

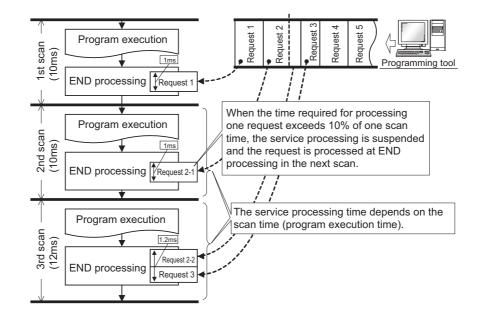


Point /

If no request data for service processing exists, END processing speeds up by the request processing time. (The CPU module does not wait for requests.)

· Operation for constant scan setting

The calculation of the service processing time is a calculation of the percentage of the time excluding the waiting time of the constant scan from the scan time, not a calculation of the percentage of the scan time.

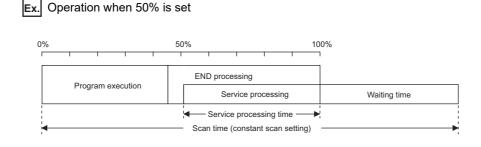


Point P


When setting the constant scan, selecting "Execute it while waiting for constant scan setting." can perform the service processing efficiently. () Page 245, Section 3.24.1 (2) (d))



Operation when 0.5ms is set

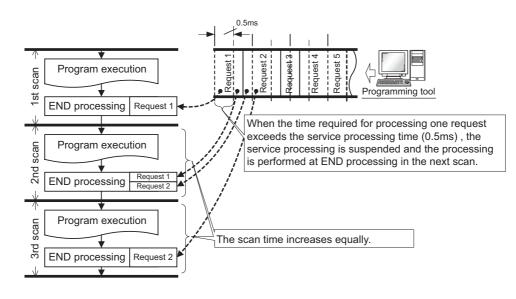

· Operation when 1ms is set

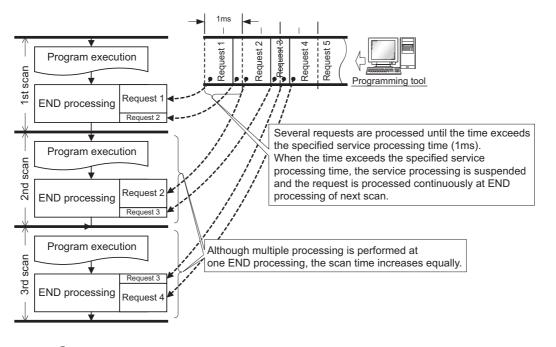


Point P


If no request data exists when setting the service processing time, END processing speeds up by the request processing time. (The CPU module does not wait for requests.)

(c) Operation when "Specify service process execution counts." is selected

• Operation when 1 time is set

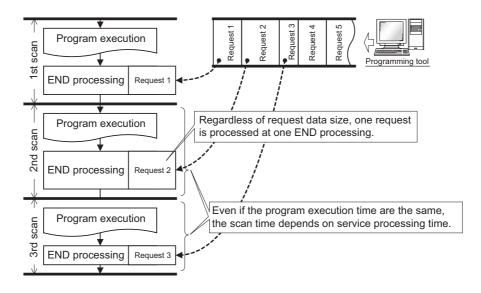


· Operation when 2 times is set

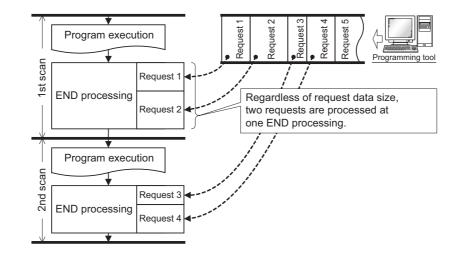

Point P


- When several devices are connected to one CPU module, each device requests service processing. When the CPU module receives requests from several devices simultaneously, a single END processing can accept several requests simultaneously if the service processing count is set to the number of connected devices. This improves response performance. (Note that the scan time increases by the service processing time.)
- If no request data exists when setting the service processing count, END processing speeds up by the request processing time. (The CPU module does not wait for requests.)

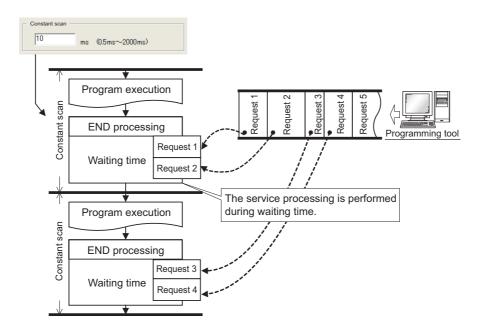

(d) Operation when "Execute it while waiting for constant scan setting." is selected

Point P

- When setting the constant scan, selecting "Execute it while waiting for constant scan setting." can perform the service processing efficiently.
 - When "Execute it while waiting for constant scan setting." is selected

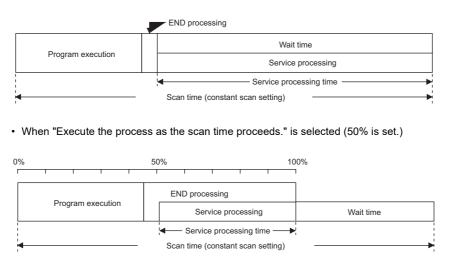

 Even when there is no waiting time, the service processing (0.2ms) is performed. Therefore, when the waiting time is less than 0.2ms, the constant scan time may be exceeded.

(3) Precautions

The following describes precautions when the service processing setting is configured.


- · For the following functions, scan time will be increased longer than the specified time during service
 - processing even if the service processing time specification is set.
 - Online change
 - Change TC setting
 - Local device monitor
 - Program memory backup
 - Writing/reading data to/from a file register (The scan time will be increased when the write or read size is large.)
 - Writing to/reading from the buffer memory of the intelligent function module (The scan time will be increased when the write or read size is large.)
 - Access to a network module
 - a) Diagnostic functions (CC IE Control diagnostics, CC IE Field diagnostics, MELSECNET diagnostics, Ethernet diagnostics, CC-Link/ CC-Link/LT diagnostics)
 - b) Monitor function (Module access device, Link direct device)
- Note that the scan time will be increased much longer if the CPU module receives multiple requests simultaneously while the service processing count specification is set many.
- The response performance of service processing significantly decreases in the following cases. Set service processing time considering the time-out time of the peripheral.
 - Service processing time is set much shorter than the scan time.
 - Setting "Execute it while waiting for constant scan setting" results in increase in the scan time and decrease in the service processing time.
- An error of -20µs to +30µs occurs between the actual processing time and the set service processing time.
- When "Specify service process execution counts." is selected and Ethernet communication is performed, the scan time increases by the service processing time (approx. 500ms). To keep the time increase 500ms or less, select an item other than "Specify service process execution counts.". (Example: Select "Specify service process time." and set a desired time value.)
- If communications in the MC protocol are performed with an item other than "Specify service process execution counts" selected, data inconsistency may occur. To prevent data inconsistency, select "Specify service process execution counts".
- In the service processing, processing for the requests from each receive port (each intelligent function module, USB, the RS-232, and built-in Ethernet) is performed one by one. If multiple requests are sent from a single receive port, the service processing for those requests may not performed in the same scan regardless of whether or not the service processing time is left. Therefore, when communications are performed between multiple peripherals via built-in Ethernet port, response time to each peripheral cannot be shortened even though a longer service processing time is set. In this case, connect peripherals not only to the built-in Ethernet of the CPU module but also to the Ethernet module to shorten the response time.
- Since the processing for a request including accesses to files takes time, responding to the request
 necessarily takes time. The processing for request data is performed one by one in the service processing,
 and therefore responses to succeeding request data delays when the CPU module receives a request
 including accesses to files. For this reason, set a longer timeout time for peripherals when using a system
 that regularly send these requests.

3.25 Initial Device Value

This function registers data used in a program to the device of the CPU module or the buffer memory of the intelligent function module without a program.


(1) Application

Use of this function can omit device data setting program by initial processing program.

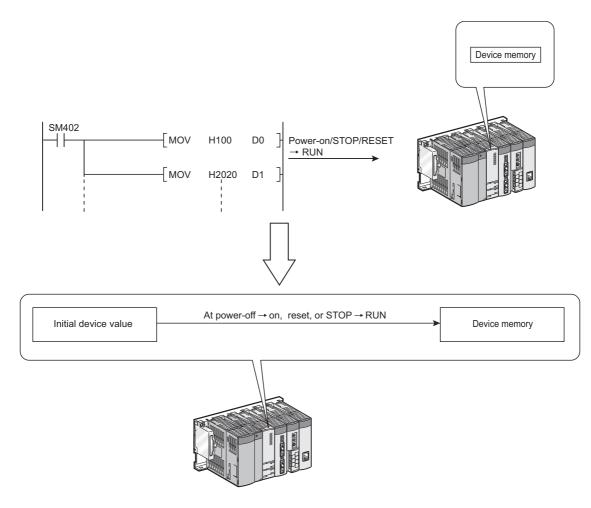

(2) Timing when initial device values are written to the specified device

The CPU module writes data in the specified initial device value file to the specified device or the buffer memory of the intelligent function module when the CPU module is powered off and then on, is reset, or is set to the STOP status and then the RUN status.

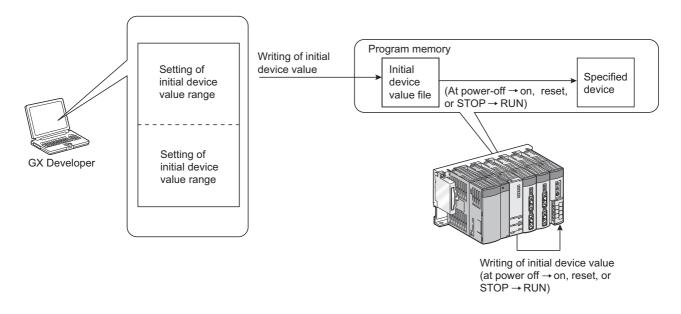

(3) Applicable devices

For devices applicable for this function, refer to the following.

(4) Setting procedures

For setting procedures of initial device values, refer to the following.

(5) Precautions

(a) When initial device value and latch range are overlapped

In that case, the initial device value data takes priority. Therefore, the latch range data will be overwritten to the initial device value data after the CPU module is powered off and then on.

(b) Area disabling the initial device value setting when the CPU module is set from STOP to RUN

The initial device values are also reflected when the CPU module is set from STOP to RUN.

For an area where the initial device values should not be set when the CPU module is set from STOP to RUN (data that are set when the CPU module is powered off and then on and changed by a program), this function cannot be used.

Use an instruction such as the MOV instruction in the main routine program so that the initial device values will be set to the specified devices.

Use the TO instruction to write data to the buffer memory of the intelligent function module.

(c) Devices that require module synchronization setting

To set the following devices for the initial device value setting range, set "Module Synchronization" in the PLC system tab of the PLC parameter dialog box.

If the setting is not configured, the initial device values may not be set to the target module properly.

- Intelligent function module device (U□\G□)
- Link direct device (J□\W□, J□\SW□)

This function extends the life of battery installed in the CPU module by restricting data to be held by the battery to clock data only. This function initializes all data other than the clock data when the CPU module is powered off or is reset.

Data held by a battery		Description				
Error history		The number of error history data is initialized to zero.				
Latch device (L)		Cleared to zero.				
Device in the latch range		Cleared to zero.				
Standard RAM		Formatted (cleared to zero).				
File register assigned to	Set "Use the same file name as the program."	A file is deleted.				
the standard RAM	Set "Use the following file".	A file is deleted (A file is recreated at power-on or reset (Data is cleared to zero.))				

(1) Setting

Set the function in the I/O Assignment tab of the PLC parameter dialog box.


- 1. Configure the I/O assignment setting.
- 2. Click the Switch Setting button.
- **3.** Enter 0001_{H} to the switch 3 of the slot where the CPU module is mounted. (When entering the value to a slot in another station, the value is ignored.)

		Input Format HEX							
	Slot	Туре	Model Name	Switch1	Switch2	Switch3	Switch4	Switch5	
) PLC		PLC				0001			
ι O(*-O))								
2 1(*-1	.)								
3 2(*-2	2)								
4 3(*-3									
5 4(*-4									
5 5(*-5	5)								
7 6(*-6	5)								
3 7(*-7									
9 8(*-8									
0 9(*-9									
1 10(*-									
2 11(*-	-11)								
3 12(*-									
4 13(*-									
5 14(*-	-14)								-

(2) Battery life

For the life of battery installed in the CPU module when the battery life-prolonging function is used, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)



The High-speed Universal model QCPU and Universal model Process CPU do not support this function.

3.27 Memory Check Function

This function checks whether data in the memories of the CPU module are not changed due to such as excessive electric noise.

Since the CPU module automatically checks a memory, setting for enabling this function is unnecessary. This function does not require processing time.

(1) Data to be checked

(a) Program

The program during execution is compared with the user program written to the program memory. If they do not match, a stop error, "RAM ERROR" (error code: 1160) is detected.

(b) Parameter

The parameters are compared with the ones written to the parameter-valid drive.

(c) Device memory

If the CPU module detects the change of data in the device memory, a stop error, "RAM ERROR" (error code: 1161) occurs. For the Universal model QCPU whose serial number (first five digits) is "13022" or later, the device information, which contains data change information, can be checked in SD927 and SD928. For details on the special register, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

(2) Execution timing

- Program: At program execution
- Parameter:
 - · When the CPU module is powered off and then on
 - When the CPU module is reset
 - When the CPU module is set from STOP to RUN after data are written to it
- · Device memory: When device data are read

3.28 Program Cache Memory Auto Recovery Function PNote 3.18

This function is to restore the error location automatically by using data in the program memory, which are stored in the flash ROM, when the memory check function ($\square \square$ Page 251, Section 3.27) detects an error in the program cache memory. This function enables the CPU module to continue its operation even if an error such as change of data in the program cache memory occurs due to noise.

(1) Execution condition

The function is executed when the following conditions are all met.

- The CPU module is in RUN status.
- · Data in the program memory match those in the program cache memory.

Note that the function is not executed in the following conditions even though the above conditions are met, and "RAM ERROR" (error code: 1160) occurs.

- The change of data in the program cache memory was detected while the following operations were being performed with the CPU module during RUN.
 - O: The auto recovery processing is performed and no error occurs. \triangle : An error occurs depending on the condition. ×: An error occurs.

Operation item	Universal model QCPU with a serial number (first five digits) of "12121" or earlier	Universal model QCPU with a serial number (first five digits) of "12122" or later
Online change (ladder mode)	×	\triangle^{*1}
Password registration (program files)	×	0
Program memory batch download	×	۵ ^{*1}
Export to ROM format	×	0
Write to PLC (device comments)	×	<u>م</u> *۱

*1 If the change of data is detected while data in the program cache memory are being transferred to the program memory (while the following window is being displayed on the programming tool), the auto recovery processing is not performed and an error occurs.



- The change of data in the program cache memory was detected by SFC program.^{*2}
- The change of data in the program cache memory was detected by the dedicated instruction such as the S(P). instruction.^{*2}
- The change of data in the program cache memory was detected by the rise instruction or the fall instruction.^{*2}
- The data in the program cache memory was not restored due to the failure of the memory.
- *2 The High-speed Universal model QCPU and Universal model Process CPU execute the function when the change of data in the program cache memory is detected by the corresponding factors above. (Data are automatically recovered and no error occurs.)

Note 3.18 Universal

Before executing the function, check the version of the CPU module used.

```
( Page 467, Appendix 2)
```

Point P

To match the data in the program memory and those in the program cache memory, configure the setting to transfer the data of the program cache memory to the program memory from "Options" screen.^{*2} (Page 178, Section 3.12.3 (4))

♥♥ [Tool] I (Options]

*2 The transferring of the data in the program cache memory to the program memory is set by default.

Other than the above, you can also use "Program Memory Batch Download" to match the data in the program memory and those in the program cache memory.

(2) Execution timing

The execution timing of this function is described below.

- · When the program is executed
- When data are verified or data are read from the programmable controller
- When any one of the write operations listed under (1) in this section is performed^{*3}
- *3 To perform the auto recovery processing when any one of the write operations listed under (1) in this section is
 - performed, check the version of the CPU module and use the programming tool with the following version or later. • GX Works2: 1.80J or later
 - GX Developer: 8.102G or later

3.29 Latch Data Backup to Standard ROM

This function holds (backs up) latch data, such as device data and error history, to the standard ROM without using a battery when the system is stopped for a long period. This function helps to extend battery life.

Remark When a CPU module other than the High-speed Universal model QCPU and Universal model Process CPU executes this function, the battery life-prolonging function is enabled regardless of its parameter setting. The function is disabled after

backup data are restored. The status of the function can be checked in SD119 (Battery life-prolonging factor). For details of the battery life-prolonging function, refer to Page 250, Section 3.26.

For details of the battery life-prolonging function, refer to Page 250, Section 3.20

(1) Backup target data and file size

The following table lists backup target data and sizes of files where data are stored.

Backup target data		File size (byte)			
 File register (R, ZR)^{*1} Extended data register (D)^{*1} Extended link register (W)^{*1} 		64 + 2 × Number of file register points			
	 Internal user device (M, L, B, F, V, T, ST, C, D, W) Index register (Z)/standard device register (Z) 	File sizes differ depending on the CPU module used.*7			
		CPU module	Serial No. (first 5 digits)	File size (byte)	
Error history		Q00UJCPU, Q00UCPU,	11042 or earlier	87210	
		Q01UCPU	11043 or later	89790	
		000110011	11042 or earlier	87210	
Module error of	collection file (stored in the system memory) *3	Q02UCPU	11043 or later	93630	
		QnUD(H)CPU,	11042 or earlier	110890	
		QnUDE(H)CPU	11043 or later	117310	
File transfer e	rror history		17011 or earlier	124952	
		Q03UDVCPU	17012 to 17102	132582	
			17103 or later	132608	
SFC program	continuation start information		18052 or later	132634	
		Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU,	17011 or earlier	144152	
Sampling trace information			17012 to 17102	151782	
			17103 or later	151808	
		Q06UDPVCPU	18052 or later	151834	
		Q13UDVCPU,	17011 or earlier	184728	
		Q13UDPVCPU,	17012 to 17102	192358	
Scan time me	asurement information	Q26UDVCPU,	17103 or later	192384	
		Q26UDPVCPU	18052 or later	192410	
Standard RAM	∕l system data ^{*4, *5}	4			
Standard RAM	/l directory data ^{*4, *5}	14212			
Trace setting	(Sampling trace file) ^{*6}	16 + Sampling trace file size			
Module error of	collection file (stored in the standard RAM)	92 + 64 × Maximum number of module errors			

Backup target data	File size (byte)
Parameter ^{*5}	
Intelligent function module parameter ^{*5}	
Program ^{*5}	
Device comment ^{*5}	16 + File size
Initial device value ^{*5}	10 + File Size
Drive heading ^{*5}	
Boot setting file ^{*5}	
Remote password ^{*5}	

- *1 The data are backed up only when the file register in the standard RAM is used and the following parameter is set.
 CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU: Check the
 - "Transfer to Standard ROM at Latch data backup operation" checkbox on the PLC file tab. (
 - High-speed Universal model QCPU and Universal model Process CPU: Check the "Backup all files in the internal of standard RAM" checkbox on the PLC system tab. (
- *2 The data are backed up only when the Universal model QCPU whose serial number (first five digits) is "10042" or later is used.
- *3 The data are backed up regardless of the setting status of the module error collection function.
- *4 The data are backed up regardless of the existence of files in the standard RAM if the "Backup all files in the internal of standard RAM" checkbox is checked on the PLC system tab.
- *5 Only the High-speed Universal model QCPU and Universal model Process CPU back up these data.
- *6 A storage file is created only when the trace registration has been made. The data are not backed up in the following cases.
 - Trace settings are stored in a memory card.
 - Trace settings are not written to the CPU module.
- *7 These are sizes when the device assignment is default. Sizes differ depending on parameter settings.

(2) Execution using a contact

(a) Setting method

Check the "Execute by contact" checkbox and set a contact for the latch data backup operation in the PLC system tab of the PLC parameter dialog box. (Devices X, M, or B can be selected.)

Check this checkbox ———— and set a contact.	Latch Data Backup Function Execute by Contact Device Name
	Backup all files in standard RAM

(b) Execution method

Backup starts at the rise of a contact (off \rightarrow on).

After the backup operation is completed, the BAT.LED of the CPU module flashes (green). The module is in the standby status and is ready to be powered off.

(c) Precautions

- Backup data are the data when the contact is on (END processing). To run the CPU module again after the backup operation, power on or reset the CPU module.
- Since the status of the contact is checked during execution of the END instruction, data are not backed up even if the contact is turned on → off → on, or off → on → off within one scan.
- In the following cases, data are not backed up unless the contact is turned off and then on.
 - The device X is set as a contact, the backup operation is performed by turning off and then on the contact, and the CPU module is powered off and then on or is reset without turning off the contact.
 - The device M or B is set as a contact and the backup operation is performed by turning off and then on the contact.

(3) Execution by remote operation

(a) Execution method

Open a dialog box to execute a remote operation.

♡ [Online]⇔[Latch Data Backup]⇔[Backup]

MELSOFT Series GX	Works2
Caution - The data to All file of stan PLC paramete - Device mem are required. - When the PI	to backup the data to standard ROM in order to execute latch data backup operation? be backed up includes device memory, error history, trace information and SFC program start information. idard RAM will become backup target according to "PLC System Setting" "Latch Data Backup Function" setting of er. ory includes all devices (M,L,B,F,V,T,ST,C,D,W,Z) are targets, and when back up file register simultaneously, parameter settings LC is turned on or reset, operation will start based on the backup contents. : in RUN status, it will be changed to STOP. Yes

After the backup operation is completed, the BAT. LED of the CPU module flashes (green). The module is in the standby status and is ready to be powered off. Backup data are the data at the execution of remote operation. For details, refer to the following.

(4) Restoring backup data

The backup data are automatically restored when:

- · the CPU module is powered off and then on, or
- the CPU module is reset.

Whether to restore data once after backup or per above operation is set by SM676 (Specification of restore repeated execution).

Status of SM676 at backup operation	Restoration operation
SM676 is off.	Data are restored once when the CPU module is powered off and then on or is reset after backup.
SM676 is on.	Data are restored whenever the CPU module is powered off and then on or is reset after backup. Data are repeatedly restored until the backup data are deleted or the latch data are backed up next time.

After backup data are restored, the BAT.LED on the CPU module turns on (green) for five seconds.

Point

If the number of device points configured in the parameter setting and the number of device points at the time of backup are different, "RESTORE ERROR" (error code: 2220) is detected when the backup data are restored, and data restoration is not normally completed.

(Data will be restored again when the CPU module is powered off and then on or is reset in the next time.) Perform any of the following operations to normally complete restoring data.


- Return the status of data when the parameters are backed up.
- Delete the backup data.
- Backup data again.

(5) Deleting backup data

The backup data can be deleted in the following screen. (Stop the CPU module before deleting the backup data. This operation cannot be performed when the CPU module is in the RUN status.)

♥♥ [Online]⇔[Latch Data Backup]⇔[Delete Backup Data]

Also, information of special registers (SD671 to SD675) can be initialized (cleared to 0) by deleting the backup data.

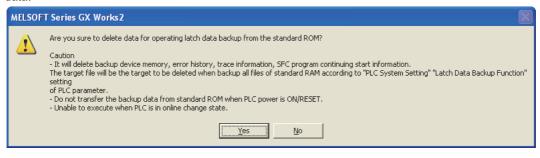

(6) Checking the status in the special relay and special register

The execution status of the function and the restoration operation status can be checked in SM671, SM676, and SD671 to SD679. For details, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

(7) Precautions

The following provides precautions for backing up latch data.

- Do not power off or reset the CPU module during backup of latch data. If performed, "RESTORE ERROR" (error code: 2221) occurs, and the backup data is not restored. (The backup data will be deleted.)
- Even if the backup data exists, the initial device value has a priority over the backup data when the initial device value is set. Therefore, the device where the initial device value setting is configured is overwritten by the device data of the initial device value after reflecting the backup data.
- Even if the latch device or latch range setting is used, backup data has a priority. Therefore, even when data of latch device and latch range setting are changed after backup, it is overwritten by data backed up when the CPU module is powered off and then on or is reset.
- Devices where local device range setting is configured are not backed up. They are initialized (cleared to 0) when the CPU module is powered off and then on or is reset.
- When the number of writes to the standard ROM exceeds 100,000 times ("FLASH ROM ERROR" (error code: 1610) is detected), data may not be normally backed up.
- Backup data cannot be deleted unless the data are deleted or the storage location memory (standard ROM) for the backup data is formatted.
- The following operations cannot be performed during latch data backup. Perform them after the backup operation. If performed, an error is displayed on the programming tool.
 - Format PLC memory (standard ROM only)
 - Latch data backup by remote operation
 - Online change (ladder mode, files, function block)
 - Program Memory Batch Download
 - Write to PLC (Flash ROM)
 - · CPU module change function with memory card
 - CPU module data backup/restoration function
- When the High-speed Universal model QCPU and Universal model Process CPU are used and the "Backup all files in the internal of standard RAM" checkbox is checked in parameter, "RESTORE ERROR" (error code: 2228) occurs if the size of the standard RAM is smaller than the backup data.

3.30 Writing/Reading Device Data to/from Standard ROM

This function writes device data to the standard ROM. Writing the fixed values for operation and operation results to the standard ROM can prevent losing data due to low battery. Also, timing of writing to the standard ROM can be set by an instruction.

(1) Execution method

Device data are written to the standard ROM by the SP.DEVST instruction. The device data written to the standard ROM is read to the specified device by the S(P).DEVLD instruction.

(2) Devices that can be written to the standard ROM

The following table lists the devices whose data can be written to the standard ROM.


Device	Storage location
X, Y, M, L, B, F, V, T, ST, C, D^{*1} , W^{*2} , SM, SD, SB, SW, R, ZR	Standard ROM (device data storage location)

*1 The extended data register (D) is included.

*2 The extended link register (W) is included.

(3) Setting method

The area for storing the device data is set in the standard ROM by the PLC file tab of the PLC parameter dialog box.



(a) File size setting

Remark

The capacity that can be set varies depending on the CPU module.

CPU module	Setting range	
Q00UJCPU, Q00UCPU, Q01UCPU	1K Points (fixed)	
Q02UCPU	1 to 16K Points	
QnUD(H)CPU, Built-in Ethernet port QCPU	1 to 512K Points	

.


.

For details of the instructions, refer to the following

MELSEC-Q/L Programming Manual (Common Instruction)


3.31 CPU Module Change Function with Memory Card PNote 3.19

This function backs up all the data (only the file register files and latch-target device data) in a CPU module to a memory card or SD memory card. The data backed up can be restored to a replaced CPU module.

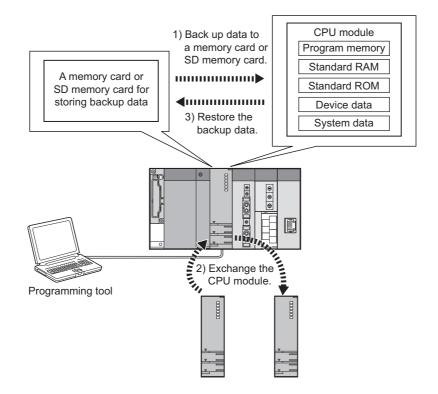

This function consists of the following two functions.

- Data backup for the CPU module change function: Page 263, Section 3.31.1
- Restoration for the CPU module change function: F Page 272, Section 3.31.2



The Q00UJCPU, Q00UCPU, and Q01UCPU do not support this function. Before executing the function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, Q26UDHCPU, or QnUDE(H)CPU, check the versions of the CPU module and programming tool used.

(Page 467, Appendix 2)

(1) Backup data file

After data are backed up, a backup data file "MEMBKUP0.QBP" is created in a memory card or SD memory card. Only one backup data file can be stored to each card. If a backup data file has existed in the card, the data in the

file are overwritten whenever the backup operation is performed. $^{\ast1^{\ast2}}$

- *1 If there is no parameter file in the CPU module where the backup data are restored, and there is a parameter file in the memory card or SD memory card, the CPU module operates using the parameter settings in the card.
- *2 When data are backed up to a Flash card, only a backup data file is stored. (Other files cannot be stored.)

To delete a backup data file, perform the following operation using a programming tool.

🏷 [Online] 🗇 [Delete PLC Data]

(2) Backup data details

(a) Backup target data

The following table lists the backup target data.

Backup data (drive) Description		Backup selection by the user	
Program memory (drive 0)	All data in the program memory $(drive 0)^{*1}$	Selectable	
Standard RAM (drive 3) ^{*3}	All data in the standard RAM (drive 3)		
Standard ROM (drive 4)	All data in the standard ROM (drive 4)		
Device data ^{*2} Internal user device (L, B, F, V, T, ST, C, D, W)		Not selectable (Data are automatically backed up by the	
System data	Data managed by the system (such as error history)	system.)	

*1 Data in the program cache memory are backed up.

*2 Only data in the latch relay (L) and devices to which the latch range can be set are backed up.

*3 When an extended SRAM cassette is used, data in the cassette are also backed up.

(b) Data size

The following table lists the maximum size of data to be backed up.

					(Unit: K byte)
Backup target data (drive)	Q02UCPU	Q03UD/ Q03UDECPU	Q04UDH/ Q04UDEHCPU	Q06UDH/ Q06UDEHCPU	Q10UDH/ Q10UDEHCPU
Program memory (drive 0)	82	124	164	244	408
Standard RAM (drive 3)	130	194	258	770	1026
Standard ROM (drive 4)	516	1032	1032	1032	2056
Device data	128	128	128	128	128
System data	41	64	64	64	64
Total (maximum)	897	1542	1646	2238	3682
Backup target data (drive)	Q13UDH/ Q13UDEHCPU	Q20UDH/ Q20UDEHCPU	Q26UDH/ Q26UDEHCPU	Q50UDEHCPU	Q100UDEHCPU
Program memory (drive 0)	528	808	1048	2008	4008
Standard RAM (drive 3)	1026	1282	1282	1538	1794
Standard ROM (drive 4)	2056	4104	4104	8200	16392
Device data	128	128	128	128	128
System data	64	64	64	64	64
Total (maximum)	3802	6386	6626	11938	22386
Backup target data (drive)	Q03UDVCPU	Q04UDVCPU/ Q04UDPVCPU	Q06UDVCPU/ Q06UDPVCPU	Q13UDVCPU/ Q13UDPVCPU	Q26UDVCPU/ Q26UDPVCPU
Program memory (drive 0)	124	164	244	528	1048
Standard RAM (drive 3) (without an extended SRAM cassette)	204	268	780	1036	1292
With an extended SRAM cassette (1M)	1228	1292	1804	2060	2316
With an extended SRAM cassette (2M)	2252	2316	2828	3084	3340
With an extended SRAM cassette (4M)	4300	4364	4876	5132	5388
With an extended SRAM cassette (8M)	8396	8460	8972	9228	9484
Standard ROM (drive 4)	1034	1034	1034	2059	4110
Device data	130	170	170	250	250
System data	70	70	70	70	70
Total (maximum) (without an extended SRAM cassette)	1562	1706	2298	3943	6770

The backup data size can be checked by the following methods.

• On the window of a programming tool

In SD698 and SD699^{*1}

*1 The data size is checked after the backup operation starts.

3.31.1 Data backup for the CPU module change function

This function backs up all the data (only the file register files and latch-target device data) in a CPU module to a memory card or SD memory card. If a memory card or SD memory card is used in a running system, users can stop its operation, change the card, and back up data to another card.

(1) Data backup using contacts

(a) Setting method

To back up data using contacts, turn on the devices set in the PLC Module Change Setting window, opened by clicking the button on the PLC system tab of the PLC parameter dialog box.

PLC Module Change Se	etting 🛛 🗙		
Backup Setting for Memor	y Card by Contact		
Backup Start Setup Cont	act Device Name		
Backup Start Contact	Device Name		
Backup Target Data	Options		
Program memory	Format memory card before backup		
Standard RAM	Auto restore at turn OFF->ON or reset		
Standard ROM	C Restore for the first time only (valid for ATA /SRAM card only) (Restore at first turn OFF->ON or first reset only)		
	C Restore every time (Restore at every turn OFF->ON or reset)		
Title Setting			
When no setting is spe	cified, the time when the backup was executed is set.		
	get data for backup, options and title. ata is selected, only the device data and system data are backed up.		
Default	Check End Cancel		

Item	Description	Setting range	Default
Backup Start Setup Contact ^{*1}	At the rise of the selected device among the items shown in the right column, backup is ready to start.	Available devices ^{*2} • X (0 to 1FFF)	
Backup Start Contact	At the rise of the selected device among the items shown in the right column, backup enters execution status.	 M (0 to 8191)^{*3} B (0 to 1FFF)^{*3} 	-
Backup Target Data	Select data to be backed up stored in any of memories shown in right column.*4	 Program memory (drive 0) Standard RAM (drive 3) Standard ROM (drive 4) 	All drives are backed up.
Format memory card before backup	Select whether to format a memory card before backup.	Formatted Selected/deselected	Deselected
Title Setting ^{*5}	Set a title for a backup data file stored in a memory card or SD memory card.	32 characters (16 in two-byte characters)	A title based on the time of backup is set. (Example) If data are backed up at 12 p.m. on October 1, 2008, "200810011200" is set.


be turned on in the sequence program.*2 Set different devices for the backup start setup contact and backup start contact.

*3 These are the setting range for the default number of points. The setting range will be M (0 to 61439) and B (0 to 0EFFF) when the number of internal user device points is set to the maximum, 60K points.

- *4 If no backup target data is selected, only device data and system data are backed up.
- *5 A title is used to identify backup data. The title of the backup data stored in a memory card or SD memory card can be checked on the window opened by selecting [Delete PLC Data] from the menu using a programming tool.

(b) Operating procedure


Turn on the backup start setup contact first, and then the backup start contact. Data are not backed up when only the backup start contact is on.

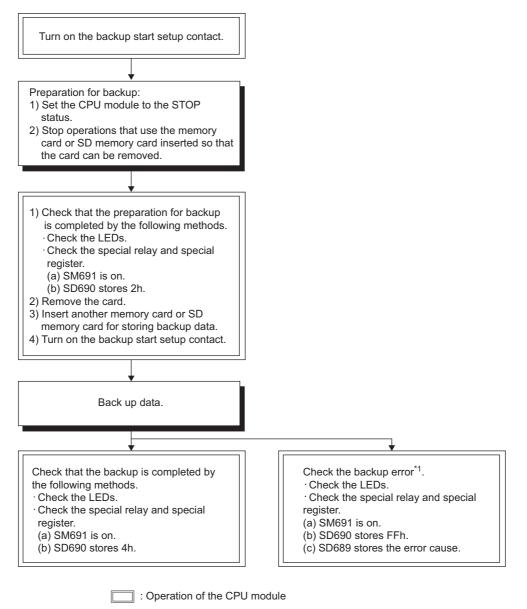

- : Operation by a user
- *1 Since the SM691 (Backup start preparation status flag) is on, data can be backed up again by turning off and then on the backup start contact.

(c) Operation of data backup using contacts

The following figure shows the operations of the backup start setup contact, backup start contact, SM691 (Backup start preparation status flag), and SD690 (Backup status).

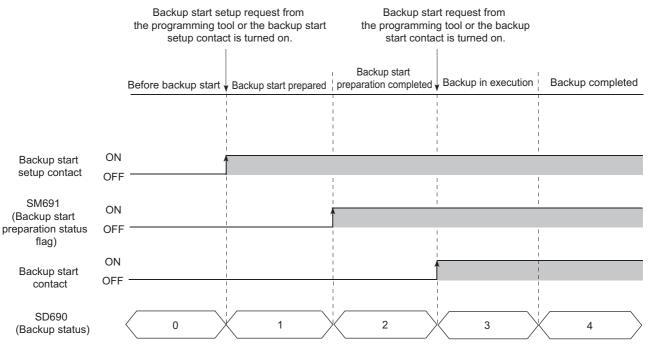

If the backup start contact is turned on while the value in SD690 is 0_H (Before backup start) or 1_H (Backup start prepared), data are not backed up.

If the backup start contact is on before the value in SD690 becomes 2_{H} (Backup start preparation completed), turning off and then on the backup start contact again while the value in SD690 is 2_{H} (Backup start preparation completed) starts backup.

(2) Data backup using a programming tool

Data backup using a programming tool can be performed on the "Create Backup Data for PLC Module Change" window.

🏷 [Online] 🗇 [PLC Module Change] 🖒 [Create Backup Data]

For details, refer to the following.

Derating manual for the programming tool used

(3) Data backup operation details


(a) Changing a memory card or SD memory card

If a memory card or SD memory card is being used in a running system, the card can be changed to another card after the status of the data backup function shifts into the ready status. (SM609 (Memory card remove/insert enable flag) does not need to be turned on.) Upon the status change, the CPU module turns off SM604 (Memory card in-use flag).

(b) Data backup operation status


The following table lists the backup operation status.

Status	Description	Value in SD690
Before backup start	p start Data backup processing has not been started.	
Backup start prepared	A memory card or SD memory card can be changed (removed and inserted).	1 _H
Backup start preparation completed	Backup target data are set.	2 _H
Backup in execution	Data are being backed up.	3 _H
Backup completed	Data have been backed up normally	4 _H
Backup error	Data backup has failed and an error has occurred.	FF _H

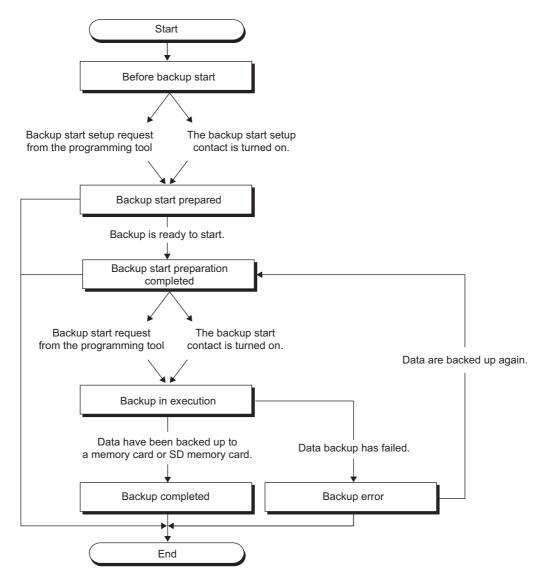

(c) Operations of the special relay and special register^{*1}


The following figure shows the operations of SM609 (Memory card remove/insert enable flag), SM691 (Backup start preparation status flag), and SD690 (Backup status).

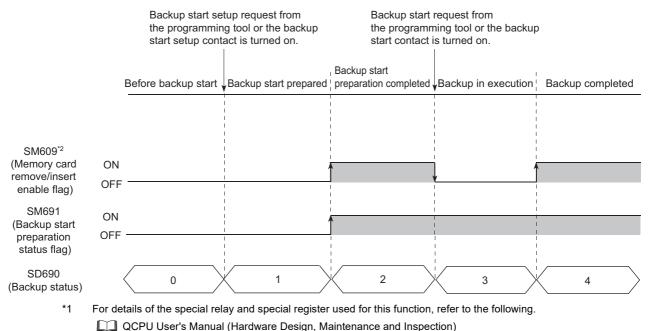

*2 This special relay is turned on/off by the system.

(d) Operating status of the CPU module

After END processing where the backup start setup request is accepted, the CPU module changes its operating status to STOP. Data can be backed up regardless of the operating status. After the data backup processing ends, power off and then on or reset the CPU module. (If only the RESET/STOP/RUN switch is moved to RUN without power-on or reset, the operating status of the CPU module remains in STOP.)

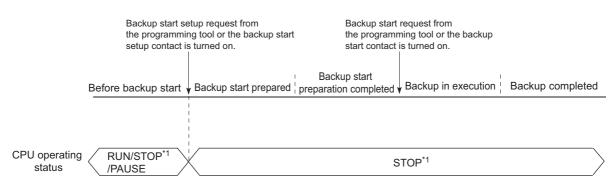



(4) LED indication

The LEDs on the front of the CPU module indicate backup status.

Value stored in SD690	Backup status	LED indication
2 _H	Backup start preparation completed	MODE: Flash (green), BAT.: Flash (green)
3 _H	Backup in execution	 Indication status changes as follows at 800ms intervals. 1) MODE: Flash (green), BAT.: On (green) ↓ 2) MODE: Flash (green), BAT.: On (green), USER: On (red) ↓ 3) MODE: Flash (green), USER: On (red)
4 _H	Backup completed	MODE: Flash (green), BAT.: Flash (green), BOOT: Flash (green)
FF _H	Backup error	MODE: Flash (green), USER.: Flash (red), BAT.: Flash (green)

(5) Error causes

Even when backup is not completed successfully, a diagnostic error is not detected. In that case, the error cause is stored in SD689 (Backup error factor) or the error response is returned to the programming tool.

Value stored in SD689	Error response number	Error cause
100 _H ^{*1}	41FE _H *2	 Backup started without a memory card or SD memory card being inserted. Backup started while use of the SD memory card is disabled with the SD memory card lock switch. Backup preparation or backup started while use of the SD memory card is disabled by SM606 (SD memory card forced disable instruction).
200 _H	-	Size of backup target data exceeds the capacity of a memory card or SD memory card used. Free space of the standard RAM in a restoration-target CPU module is not enough.
300 _H	-	Write protection has been set to a memory card or SD memory card used.
400 _H	-	Writing data to a memory card or SD memory card did not complete normally.
500 _H	-	Reading data from a target drive did not complete normally (a program memory read error).
503 _H	-	Reading data from a target drive did not complete normally (a standard RAM read error).
504 _H	-	Reading data from a target drive did not complete normally (a standard ROM read error).
510 _H	-	Reading data from a target drive did not complete normally (a system data read error).
600 _H *1	4335 _H *2	Another backup preparation started while data were being backed up to the standard ROM.
601 _H *1	410A _H ^{*2}	Backup started while data were being written to the running CPU module (during online change).
602 _H *1	4336 _H *2	Backup preparation started while an external device (FTP client) is communicating with the CPU module using the FTP.
-	4082 _H *3, 4330 _H *4	Another backup preparation or backup started while data were being backed up.
-	4333 _H *2	Backup started while the CPU module was in "Before backup start" (SD690 = 0).
603 _H *1	4276 _H *2	Backup preparation started while the data logging function was being executed.
607 _H *1	4800 _H *2	Backup preparation started while the iQ Sensor Solution function (data backup/restoration) was being executed.
609 _H *1	4C1F _H *2	Backup preparation started while the CPU module data backup/restoration function was being executed.
701 _H *1	4426 _H *2	Backup preparation started when a block password for which "Execution Program Protection Setting" was enabled was set.

*1 Only when data are backed up using contacts

*2 Only when data are backed up using a programming tool

*3 When data are backed up from another boot source

*4 When data are backed up from the same boot source

(6) Operations and functions that cannot be performed during backup

Operation and function Change TC setting Online change (ladder mode) Online change (inactive block) for SFC program Write to PLC (including writing data to the CPU module during RUN) Remote latch clear Password registration Format PLC memory Arrange PLC memory Operation using programming tool Delete PLC data Write/delete PLC user data Program Memory Batch Download Export to ROM Format Latch data backup to standard ROM Monitor condition setup Executional conditioned device test Sampling trace registration Operation using CPU Module Logging Data logging function **Configuration Tool** Latch clear by using the special relay and special register areas File transfer function (FTP) for the built-in Ethernet function Data backup/restoration function for the iQ Sensor Solution function Others CPU module data backup/restoration function Operation history function Operation history display and data update (only during restoration) • Operation history clear (only during restoration)

The following table lists the operations and functions that cannot be performed during backup.

(7) Precautions

- Do not perform the following operations during data backup.
 - Insertion/removal of a memory card or SD memory card
 - Power-off of the CPU module
 - Reset
- Even when parameters that are backed up using contacts are booted to the Universal model QCPU whose serial number (first five digits) is "10101" or earlier, parameters are ignored. In this case, even if the backup start setup contact or backup start contact set in parameter is turned on, the operating status of the CPU module does not change. (No diagnostic error is detected.)
- When the data backup operation is ready, the CPU module stops the operations of the following functions.
 - The operations do not resume even after the data backup operation ends.
 - Refresh of network modules
 - Refresh of CC-Link IE Field Network Basic
 - Data link transfer
 - · Auto refresh of intelligent function modules
 - · Auto refresh of CPU shared memory
 - Simple PLC communication function
- Data cannot be backed up while data logging is being executed. Stop the data logging processing, and then start the data backup operation. For how to stop the data logging processing, refer to the following.
 - QnUDVCPU/LCPU User's Manual (Data Logging Function)
- If the data backup processing is performed while the CPU module is locked with a security key, an error occurs.

This function restores data backed up in a memory card or SD memory card to a replaced CPU module.

(1) Restoration using a programming tool

Data restoration using a programming tool can be performed on the "Restoration execution from backup data" window.

♡ [Online] ⇔ [PLC Module Change] ⇔ [Restore]

Click "Execute" to start restoration, select "Yes" in the screen appears, and power off and on or reset the CPU module. The restored data becomes valid. For details, refer to the following.

Derating manual for the programming tool used

(2) Automatic restoration

Check the "Auto restore at turn OFF \rightarrow ON or reset" checkbox in the PLC Module Change Setting window, opened by clicking the button in the PLC system tab of the PLC parameter dialog box. ($\square \square$ Page 264, Section 3.31.1 (1) (b)) After data are backed up and the CPU module is powered off and then on or is reset, restoration automatically starts. Optional items listed in the following table can be set at the same time.

Option setting item	Powering off and then on or resetting the CPU module		
option setting item	First time	Second time and later	
Restore for the first time only $1 + 2$	Restored	Not restored (The CPU module operates the memory card as usual.) *3	
Restore every time	Restored	Restored	

*1 This setting is valid only when backup data are stored in the ATA card or SRAM card. Note if the write protect switch of the SRAM card is set to be valid (write protection), the setting does not become valid and the data are restored even after the first time. ("RESTORE ERROR" (error code: 2226) occurs.)

*2 When using the FLASH card, restoration can be performed even after the first time.


*3 Data are restored using a programming tool for the second time and later.

Data are restored during initial processing after the CPU module is powered off and then on or is reset. After the data are restored, the operating status of the CPU module shifts to the one set with the RUN/STOP/RESET switch. Therefore, powering off and then on or resetting the CPU module again is not required. If a memory card or SD memory card needs to be changed after restoration, turn on SM609 (Memory card

remove/insert enable flag), check that SM600 (Memory card usable flags) turns off, and then change the card.

(3) Restoration behavior of data backed up

The following figures show the restoration behavior of data backed up.

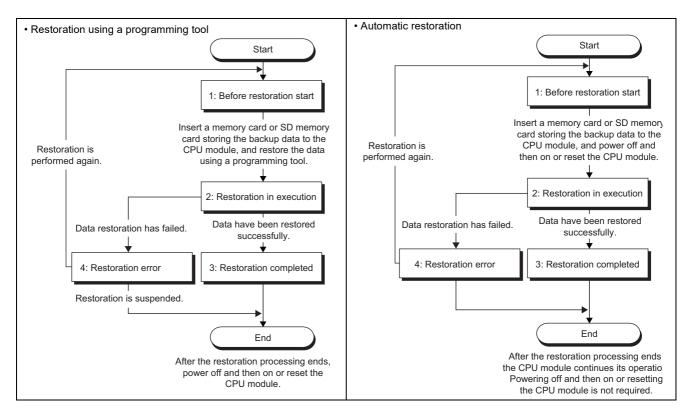

A value indicating restoration status is stored in SD693 (Restoration status).

Status	Description	Value stored in SD693
Before restoration start	Restoration processing has not been started.	0 _H
Restoration in execution	Data are being restored.	1 _H
Restoration completed	Data have restored normally.	2 _H
Restoration error	Data restoration has failed and an error has occurred.	FF _H

(4) Operation of the special relay and special register^{*1}

The following figure shows the operation of SM692 (Restoration complete flag).

		Before restoration start	Restoration in execution	Restoration completed
SM692 (Restoration	On			†
complete flag)	Off			

*1 For details of the special relay and special register used for this function, refer to the following.

(5) LED indication

Value stored in SD693	Restoration status	LED indication	
0 _H	Before restoration start	MODE: On (green)	
1 _H	Restoration in execution	 Indication status changes as follows at 800ms intervals. 1) MODE: Flash (orange), BAT.: On (green) ↓ 2) MODE: Flash (orange), BAT.: On (green), USER: On (red) ↓ 3) MODE: Flash (orange), USER: On (red) 	
2 _H	Restoration completed	 Restoration using a programming tool MODE: Flash (orange), BAT.: Flash (green), BOOT: Flash (green) Automatic restoration MODE: On (green) 	
FF _H	Restoration error	 Restoration using a programming tool MODE: Flash (orange), USER: Flash (red), BAT.: Flash (green) Automatic restoration MODE: On (green), ERR.: Flash (red) 	

The LEDs on the front of the CPU module indicate restoration status.

(6) Error causes

Even when restoration is not completed successfully, a diagnostic error is not detected. In that case, the error cause is stored in SD692 (Restoration error factor) or the error response is returned to the programming tool.

Value stored in SD692	Error response number	Error cause	
800 _H	-	The model of a restoration-target CPU module differs from that of a backup-source CPU module.	
801 _H	-	 Backup data files do not match. Reading backup data from a memory card or SD memory card did not complete normally. 	
810 _H	-	Writing backup data to the restoration-target drive did not complete normally.	
-	4335 _H *1	Restoration started while latch data were backed up to the standard ROM.	
-	410A _H *1	Restoration started while data were being written to the running CPU module (during online change).	
-	4336 _H ^{*1}	Restoration started while an external device (FTP client) is communicating with the CPU module using the FTP.	
-	4330 _H *1	Restoration started while another restoration was being executed.	
-	 Restoration started without a memory card or SD memory card being inserted. Restoration started while use of the SD memory card is disabled with the SD memory switch. Restoration started while use of the SD memory card is disabled by SM606 (SD me forced disable instruction). 		
811 _H	-	Free space of the standard RAM in a restoration-target CPU module is not enough.	
-	4276 _H *1	Restoration started while the data logging function was being executed.	
-	4800 _H ^{*1}	Restoration started while the iQ Sensor Solution function (data backup/restoration) was being executed.	
-	4C1F _H *1	Restoration started while the CPU module data backup/restoration function was being executed.	

*1 Only when data are restored using a programming tool

When automatic restoration did not complete normally, "RESTORE ERROR" (error code: 2228) occurs.

Error code	Error message	Error cause
2225		The model of a restoration-target CPU module differs from that of a backup-source CPU module.
2226	RESTORE ERROR	 Backup data file is corrupted. (The contents of backup data file do not match with the check code.) Reading backup data from a memory card or SD memory card did not complete normally. Since the write protect switch of an SRAM card or SD memory card is valid, the "Restore for the first time only" parameter cannot be set.
2227		Writing backup data to the restoration-target drive did not complete normally.
2228		Free space of the standard RAM in a restoration-target CPU module is not enough.

(7) Functions that cannot be executed during restoration


Functions that cannot be executed during restoration are the same as those cannot be executed during data backup. (Figure Page 270, Section 3.31.1 (6))

(8) Precautions

- Do not perform the following operations during restoration.
 - · Insertion/removal of a memory card or SD memory card
 - Power-off of the CPU module
 - Reset
- Even when a memory card storing backup data files is inserted to the Universal model QCPU whose serial number (first five digits) is "10101" or earlier, and the CPU module is powered off and on or is reset, the system ignores the files. (No diagnostic error is detected.)
- Do not use a memory card or SD memory card where a parameter file with boot settings is stored. If used, data are overwritten according to the boot settings even data are restored.
- If restoration is started using a programming tool, the CPU module stops the operations of the following functions. The operations do not resume even after data are restored.
 - Refresh of network modules
 - Refresh of CC-Link IE Field Network Basic
 - Data link transfer
 - Auto refresh of intelligent function modules
 - · Auto refresh of CPU shared memory
 - Simple PLC communication function
- If the model of a restoration-target CPU module differs from that of a backup-source CPU module, "RESTORE ERROR" (error code: 2225) occurs.
- Check that the free space of the standard RAM in a restoration-target CPU module is larger than backup data. If a backup-source CPU module uses an extended SRAM cassette, "RESTORE ERROR" (error code: 2228) occurs in the following cases.
 - Even though a backup-source CPU module uses an extended SRAM cassette, a restoration-target CPU module is not using it.
 - The size of the extended SRAM cassette used with a restoration-target CPU module is smaller than that of the extended SRAM cassette used with a backup-source CPU module.
- If the restoration processing is performed while the CPU module is locked with a security key, an error occurs.

This function backs up data such as program files, a parameter file, and device data*1 including the file register in a CPU module to an SD memory card. The data backed up can be restored as necessary.

*1 Except for devices and buffer memory in the intelligent function module

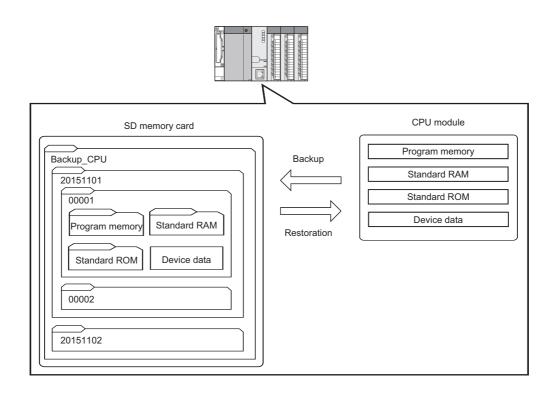

The following table lists the backup and restoration methods of the CPU module data backup/restoration function.

Function		Reference
Backup function	Backup by turning on SM1926	Frage 284, Section 3.32.1 (2)
Dackup function	Automatic backup using SD910	Figure 285, Section 3.32.1 (3)
Restoration function	Restoration by turning on SM1929	Fige 292, Section 3.32.2 (1)
	Automatic restoration using SD918	Frage 293, Section 3.32.2 (2)

Point P

The restoration function modifies programs, parameters, or device data in the CPU module. After restoration, check the restored data carefully before an actual operation. (Check the data with an engineering tool or a device monitor.)




Note 3.20 Universal

Only the High-speed Universal model QCPU and Universal model Process CPU support this function. When using the function, check the version of CPU module used. (F Page 467, Appendix 2)

(1) Backup data

The data backed up is saved in an SD memory card. The following shows the folder structure of the backup data.

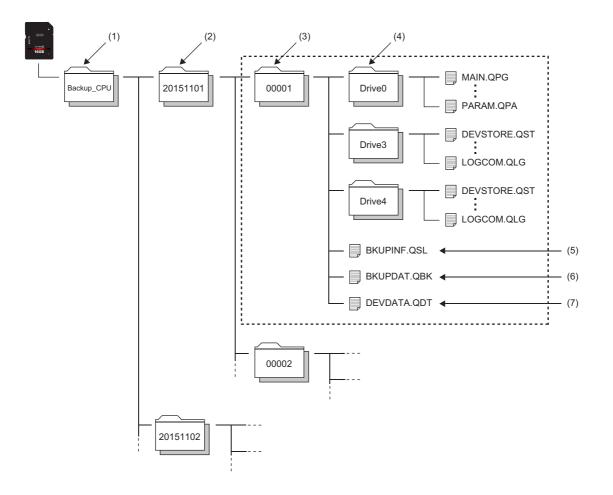

No.	Folder type	Folder name	Storable number of folders	Description
(1)	Backup data folder	Backup CPU (fixed)	One	A folder which stores whole backup data.
(2)	Date stamp folder	Automatically determined ^{*1} Folder name format: YYYYMMDD YYYY: Year the data backed up (4 digits) MM: Month the data backed up (2 digits) DD: Day the data backed up (2 digits)	Depends on the capacity of the SD memory card used ^{*2} , or 1 to 100 folders ^{*4}	Folders which store backup data by date. As for the upper limit value setting for the number of backup data, the number of backup data represents the number of date stamp folders.(\square Page 282, Section 3.32.1 (1))
(3)	Numbered folder	Automatically determined ^{*1} Folder name: Sequentially numbered from 00001 to 32767 (5 digits)	Depends on the capacity of the SD memory card used ^{*2}	Folders which store backup data in units of 1 backup data. Each backup data made on the same date is stored by sequentially numbered folders.
(4)	Drive folder	Drive 0 (fixed), Drive 3 (fixed), Drive 4 (fixed)	One each in a numbered folder	Folders which store files stored in each drive of a backup source CPU module by each drive.
(5)	System information file for CPU module data backup/restoration	BKUPINF.QSL	One in a numbered folder	Files which store the information required at a time of restoration, such as a list of the data to be backed up and identification information of the CPU module.
(6)	System data file for CPU module data backup/restoration	BKUPDAT.QBK	One in a numbered folder	 Files which store the following data. Data regarding operations of sampling trace setting at a time of a backup Data regarding operations of data logging setting Data stored to a flash ROM with the IP address change function Error history of a CPU module and intelligent function module.
(7)	Device data file for CPU module data backup/restoration	DEVDATA.QDT	One in a numbered folder	Files which store device data at a time of a backup. ^{*3}

*1 Folder names of date stamp folders and numbered folders are automatically determined by the CPU module.

*2 The number of storable folders is up to 32767.

*3 The file register (R, ZR), the extended data register (D), and the extended link register (W) are backed up as the file register file. Also, the local device is backed up as the local device file.

*4 For the modules whose serial number (first five digits) is "18052" or later, the number of folders can be set with SD1928 (Upper limit value setting for the number of backup data). (

(2) Target data for backup and restoration

The backup target data is all the target data in a CPU module. (FP Page 279, Section 3.32 (2) (b)) The restoration target data is set with SD917 (Restoration target data setting). (FP Page 290, Section 3.32.2)

(a) Target drives for backup and restoration

Target drives are Drive 0 (Program memory), Drive 3 (Standard RAM), and Drive 4 (Standard ROM). Drive 2 (SD memory card) cannot be backed up or restored.

(b) Target files for backup and restoration

The following lists the target files for backup and restoration.

O: Available, ×: Not available

	File name and	Availability of	
File type	extension	backup/restoration	
Parameter	PARAM.QPA	0	
Intelligent function module parameter	IPARAM.QPA	0	
Program ^{*1}	***.QPG	0	
Device comment	***.QCD	0	
Initial device value	***.QDI	0	
File register	***.QDR	0	
Local device	***.QDL	0	
Sampling trace file	***.QTD	0	
Device data storage file	DEVSTORE.QST	0	
Module error collection file	IERRLOG.QIE	0	
Boot setting file	AUTOEXEC.QBT	0	
Remote password	0000000.QTM	0	
Latch data backup file	LCHDAT00.QBP	0	
Backup data file	MEMBKUP0.QBP	×	
Data logging setting file	LOGCOM.QLG, LOG01.QLG to LOG10.QLG	0	
Data logging file	***.CSV	×	
PLC user data	***.CSV/BIN	0	
Symbolic information	***.C32	0	
Drive heading	QN.DAT	0	
System file for the iQ Sensor Solution function (data backup/restoration)	SSBRINF.QSI	×	
Backup data file for the iQ Sensor Solution function (data backup/restoration)	***.QBR	×	
Predefined protocol setting file	ECPRTCL.QPT	0	
Operation history file	OPERATE.QOL	0	

*1 The backup function cannot be executed when a block password for which "Execution Program Protection Setting" is enabled has been set.

(c) Applicable number of backup and restoration

Applicable number of backup and restoration is 32767, which is the same as the maximum number of folders. The number of files can be backed up or restored depends on the maximum number of files of each model and drive.

(d) Target device data for bakup and restoration

The following lists target device data.

O: Available, ×: Not available

Category	Device name	Backup	Restoration ^{*3}
	Input (X)	0	0
	Output (Y)	0	0
	Internal relay (M)	0	0
	Latch relay (L)	0	0
	Annunciator (F)	0	0
	Edge relay (V)	0	0
	Step relay (S)	0	0
Internal user device	Link relay (B)	0	0
	Link special relay (SB)	0	0
	Timer (T)	0	0
	Retentive timer (ST)		
		0	0
	Counter (C)	0	0
	Data register (D)	0	0
	Link register (W)	0	0
	Link special register (SW)	0	0
	Function input (FX)	0	×
	Function output (FY)	0	×
Internal system device	Special relay (SM)	0	O ^{*1*2}
	Function register (FD)	0	×
	Special register (SD)	0	O*1*2
	Link input (J □ \X)	×	×
	Link output (J □ \Y)	×	×
Link direct device	Link relay (J ロ ∖B)	×	×
	Link special relay (J ロ \SB)	×	×
	Link register (J ロ \W)	×	×
	Link special register (J ⊒ \SW)	×	×
Module access device	Intelligent function module device (U □ \G □)	×	×
	Cyclic transmission area device (U3E□\G□)	0	O ^{*1}
Index register or standard device register	Index register (Z) or standard device register (Z)	0	0
File register	File register (R, ZR)	0	0
Extended data register	Extended data register (D)	0	0
Extended link register	Extended link register (W)	0	0
Nesting	Nesting (N)	×	×
Pointer	Pointer (P)	×	×
	Interrupt pointer (I)	×	×
	SFC block device (BL)	0	×
Others	Network No. specification device (J)	×	×
	I/O No. specification device (U)	×	×
	Macro instruction argument device (VD)	×	×

- *1 The area used by the system may be overwritten after a restoration.
- *2 Whether to be restored the device can be set with SD918 (Restoration function setting).
- *3 Device data restored may be overwritten by the I/O refresh according to modules mounted on and refresh settings.

(3) Progression status of backup and restoration

Progression status of backup and restoration can be checked by SD1925(Number of backup/restoration uncompleted files) or SD1926(Backup/restoration progression status). However, the progression status of automatic restoration cannot be checked by the special register. For the operating status of automatic restoration, check the LED on the front side of the CPU module. (SP Page 293, Section 3.32.2 (2) (c))

Special register	Description	
	Displays the number of remaining files of backup and restoration.	
SD1925	• When a backup/restoration is started, the total number of backup/restoration files are stored.	
	When a backup/restoration is completed, 0 is stored.	
SD1926	The progression status of backup/restoration is displayed with 0 to 100%.	

3.32.1 Backup function

This function backs up data such as program files, a parameter file, and device data including the file register in a CPU module to an SD memory card.

Point P

The backup function is performed even while the CPU module is in RUN state.

When executing the backup function during RUN, do not make the device data change during the execution. (Page 287, Section 3.32.1 (5) (c))

(1) Upper limit value setting for the number of backup data

The upper limit value of the number of backup data and the operation when the number of backup data reaches the upper limit can be set^{*1} when a backup function has not been executed yet. (No backup data folder (Backup_CPU) exists in the SD memory card used.) As for the upper limit value setting, the number of backup data represents the number of date stamp folders.

To enable the upper limit value of the backup data and the operation when the number of backup data reaches the upper limit, specify the value in SD1928 (Upper limit value setting for the number of backup data) and SM923 (Upper limit setting flag for the number of backup data), and then turn on bit5 (Upper limit status setting for the number of backup data) of SD910. The value specified can be checked in SD923 (Upper limit value status for the number backup data). Turning off bit5 of SD910 disables the upper limit value setting.

Special relay/special register	Description	
SM923	 Specify the operation when the number of backup data reaches the upper limit value with this relay. (This relay is valid only when bit5 of SD910 is on.) Off: After the oldest date stamp folder is deleted, the backup processing is continued. On: The backup processing is not continued if the number of backup data exceeds the upper limit value. (if the processing is continued, the backup will complete with an error.) 	
Bit5 of SD910	 Set whether to enable or disable the upper limit value setting for the number of backup data with this bit. Off: Disable (No upper limit (As many date stamp folders are created as the capacity of an SD memory card.)) On: Enable 	
SD923	This register indicates the value (1 to 100) that is set to SD1928. If bit5 of SD910 is off, 0 is stored.	
SD1928	Set the upper limit value (1 to 100) of the number of backup data with this register.	
*1 For the modules w	*1 For the modules whose serial number (first five digits) is "18052" or earlier, this setting cannot be used. (The upper lim	

^{*1} For the modules whose serial number (first five digits) is "18052" or earlier, this setting cannot be used. (The upper limit value of the number of backup data is the maximum capacity of an SD memory card.)

Point P


Regardless of the upper limit value set, the backup will complete with an error if the number of backup data exceeds the capacity of an SD memory card.

(a) Status of special relay and special register

The following figure shows the status of the special relay and special register when the upper limit value of the number of backup data is set.

The CPU module checks the following at the timing when bit5 (Upper limit status setting for the number of backup data) of SD910 is turned on, and enables the upper limit value of the number of bakup data.

- A backup function has not been executed yet. (No backup data folder (Backup_CPU) exists in the SD memory card used.)
- The value set to SD1928 (Upper limit value setting for the number of backup data) is within the specified range (1 to 100).

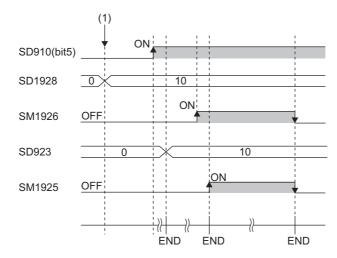

(1) The upper limit value of the number of backup data is set (0 to 10).

(2) Backup by turning on SM1926

This relay backs up data of a CPU module in a desired timing.

(a) Operating procedure


Back up data by turning on SM1926.

- **1.** To specify the upper limit value of the number of backup data, set the value with the following procedure
 - Set SD1928 (Upper limit value setting for the number of backup data).
 - Set SM923 (Upper limit setting flag for the number of backup data).
 - Turn on bit5 of SD910 (Backup function setting).

For the upper limit value of the number of backup data, refer to the following.

Page 282, Section 3.32.1 (1)

2. Turn off and on SM1926 (Backup execution request).

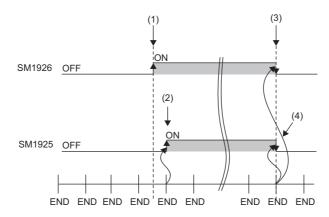

- (1) Backup execution requested
- (2) Turning on SM1925 (Backup execution status flag) by the system
- (3) Turning off SM1926 after completion of backup by the system
- (4) Turning off SM1925 by the system

If a backup is completed with an error and SM916 (Backup error check flag) turns on, check SD916 (Cause of error occurred during backup), take corrective action, and then backup again as necessary.

Point P

 Progression status of backup can be checked in SD1925 (Number of backup/restoration uncompleted files) and SD1926 (Backup/restoration progression status). (Page 281, Section 3.32 (3))

(3) Automatic backup using SD910

The data of CPU module is automatically backed up by an execution timing which is set in advance. The execution timing of the automatic backup is set with SD910 (Backup function setting). Multiple execution timing can be set simultaneously.

Bit pattern of SD910	Execution timing
Bit0: On	At the time set to SD913 on the day set to SD912
Bit1: On	At the time set to SD914 on the day of the week set to SD915
Bit15: On	When a CPU stop error has occurred

Point /

Since the special register set for the automatic backup is in latch area, the set data are hold.

(a) Retry of the automatic backup

Set whether to retry the automatic backup in the case the automatic backup is executed while any of the

exclusive functions (refer to Page 289, Section 3.32.1 (5) (i)) are being executed.*1

The retry is executed every three minutes and repeated 10 times.

Special relay/special register	Description	
SM924	 This relay turns on when the retry of the automatic backup is failed even after the specified number of retries are attempted. (This relay turns off at the start of the automatic backup. (This relay does not turn off when SM1926 (Backup execution request) is on.)) Off: Retry not executed/Retry being executed On: Retry failed 	
SM1931	This relay turns on while the retry is being executed. (This relay turns on at the start of the retry, and turns off when the automatic backup is triggered by the retry while the exclusive functions are not executed, or when the specified number of retries are attempted.) • Off: Retry not performed • On: Retry being performed	
Bit10 of SD910	Set whether to retry the automatic backup with this bit. • Off: No retry (The automatic backup will be completed with an error without a retry.) • On: Retry	

*1 Modules whose serial number (first five digits) is "18052" or earlier cannot use this setting. (The automatic backup cannot be executed while any of the exclusive functions are executed.)

To reflect the setting of the following special relay and special register areas, which are set before starting backup, in backup operation, turn off and on bit0, bit1, or bit15 of SD910.

When the following special relay and special register areas are changed while a backup is being executed, value in bit0 of SD910 is reflected next time a backup is executed.

- Bit0 of SD910 (When bit0, bit1, or bit15 of SD910 is turned off and on)
- SD912 (When bit0 of SD910 is turned off and on)
- SD913 (When bit0 of SD910 is turned off and on)
- SD914 (When bit1 of SD910 is turned off and on)
- SD915 (When bit1 of SD910 is turned off and on)

(b) Operating procedure (specifying day and time)

The data is automatically backed up at the specified day and time.

- To specify the upper limit value of the number of backup data, set the upper limit value setting. (The setting method and operating procedure are the same as the backup by turning on SM1926.)
 Page 284, Section 3.32.1 (2) (a))
- **2.** Set the day and time with SD912 and SD913.

Special register	Description
SD912	Set the day when the data is automatically backed up in BCD.
SD913	Set the time (hour and minute) when the data is automatically backed up in BCD.

- **3.** To retry the automatic backup, turn on bit10 of SD910 (Backup function setting). For the retry of the automatic backup, refer to the following.
 - Page 285, Section 3.32.1 (3) (a)

4. Turn on bit0 of SD910.

If a backup is completed with an error and SM916 (Backup error check flag) turns on, check SD916 (Cause of error occurred during backup), take corrective action, and then backup again as necessary.

In months that does not have the day specified with SD912 (Day and time setting for automatic backup [day]), no error occurs and automatic backup is not executed. For example, if SD912 is "31", the months when the automatic backup is executed shall be January, March, May, July, August, October, and December.

(c) Operating procedure (specifying time and days of the week)

The data is automatically backed up at the specified time and days of the week.

- To specify the upper limit value of the number of backup data, set the upper limit value setting. (The setting method and operating procedure are the same as the backup by turning on SM1926.)
 Page 284, Section 3.32.1 (2) (a))
- **2.** Set the time and days of the week with SD914 and SD915.

Special register	Description
SD914	Set the time (hour and minute) when the data is automatically backed up by BCD.
SD915	Set the days of the week when the data is automatically backed up. b0: Sunday, b1: Monday, b2: Tuesday, b3: Wednesday, b4: Thursday, b5: Friday, b6: Saturday

3. To retry the automatic backup, turn on bit10 of SD910 (Backup function setting). For the retry of the automatic backup, refer to the following.

Page 285, Section 3.32.1 (3) (a)


4. Turn on bit1 of SD910.

If a backup is completed with an error and SM916 (Backup error check flag) turns on, check SD916 (Cause of error occurred during backup), take corrective action, and then backup again as necessary.

(d) Operating procedure (when a CPU stop error has occurred)

The data is automatically backed up when a CPU stop error has occurred.

- To specify the upper limit value of the number of backup data, set the upper limit value setting. (The setting method and operating procedure are the same as the backup by turning on SM1926.)
 Page 284, Section 3.32.1 (2) (a))
- 2. To retry the automatic backup, turn on bit10 of SD910 (Backup function setting). For the retry of the automatic backup, refer to the following.
 - 🗇 Page 285, Section 3.32.1 (3) (a)
- **3.** Turn on bit15 of SD910.



(4) Checking errors

Even when an error has occurred, a diagnostic error is not detected. In that case, the error code is stored in SD916 (Cause of error occurred during backup). (QCPU User's Manual (Hardware Design, Maintenance and Inspection))

(5) Precautions

The following describes precautions for the backup function.

(a) Removal/insertion of the SD memory card and power-off/reset of the CPU module during the backup

Do not perform the following operations during the backup operation.

- · Removal and insertion of the SD memory card
- · Power-off or reset of the CPU module

If performed, the backup data in the SD memory card is left in an incomplete state, which is middle of the backup processing. Do not use these data for a restoration. If these data are used, the restoration is completed with an error.

(b) Suspending processing of the backup

The following operations can suspend the processing of the backup.

- · To disable the SD memory card operation forcibly
- · To enable removal and insertion of the SD memory card

If the backup processing is suspended, the backup data in the SD memory card is left in an incomplete state, which is middle of the backup processing. Do not use these data for a restoration. If these data are used, the restoration is completed with an error.

(c) Changing device data

Do not make the device data change during the execution of backup. Since the device data is backed up separately into multiple scans, the data inconsistency is occurred if the device data is changed.

(d) Changing backup target data

Do not change the backup target data in the CPU module during backup. If the target data are changed, the change is not reflected.

(e) Required time for backup

According to the data size or number of files stored in a CPU module, a backup may take time.

(f) The Special relay and special register which request function operations

Before executing backup, turn off the special relay and special register which request operating of the functions such as SM801 (Trace start). If backup is executed while they are ON, the corresponding requests may be turned on and the functions are executed when the data of the special relay and special register are restored.

(g) Data protected by security functions

Data protected by the following security functions cannot be backup up.

- File password 32
 - If a file with a file password is in the backup target data, the backup cannot be performed.
- File access control by security key
 If the CPU module is locked, the backup cannot be performed.

(h) When a backup is executed with the upper limit value setting for the number of backup data being valid

Check if there is enough free space in the SD memory card used before start of backup.

(i) Operations and functions which cannot be performed

The following lists the operations and functions which cannot be performed simultaneously during backup/restoration.

	Operation and function
	Change TC setting
	Online change (ladder mode)
	Online change (inactive block) for SFC program
	Write to PLC (including Write to PLC (during RUN))
	Write title
	Remote latch clear
	Password/Keyword
	New (registration/change)
	• Delete
	• Disable
	Locking CPU module with security key (file access control by security key)
	Format PLC memory
	Clear PLC memory (Clear all file registers)
Operation using programming tool	Arrange PLC memory
	Delete PLC data
	Write/delete PLC user data
	Program Memory Batch Download
	Latch data backup to standard ROM
	CPU module change function with memory card
	Monitor condition setup
	Executional conditioned device test
	Sampling trace function
	Start Trace
	Register Trace
	Write to PLC
	Clearing module error history
	Writing protocol setting data to the CPU module (predefined protocol support function)
	Data logging function
Operation using CPU Module	Deleting/writing the data logging setting
Logging Configuration Tool	Stopping data logging operation
	Deleting data logging file(s)
	Latch clear by using the special relay and special register areas
	Writing or deleting files using FTP or MC protocol
	File transfer function (FTP) for the built-in Ethernet function
Others	IP address change function of built-in Ethernet function
	Data backup/restoration function for the iQ Sensor Solution function
	Operation history function
	Operation history display and data update (only during restoration)
	Operation history clear (only during restoration)

(j) Backup execution during backup processing

During a backup processing, the backup by turning on SM1926 or the automatic backup cannot be executed. (Those execution will be ignored.)

3.32.2 Restoration function

This function restores data backed up to an SD memory card as necessary.

(a) Restoration target folders

Set a folder to be restored from backup data in an SD memory card with SD919 to SD921. The latest backup data can be restored with bit13 of SD918.

Special register	Description		
	Sets the function setting of restoration with bit patterns.		
Bit13 of SD918	Off: Restores the specified data in the restoration target folders.		
	On: Restores the latest data. ^{*1}		
SD919, SD920	Specifies the date of the folder to be restored in BCD.		
30919, 30920	SD919: Year, SD920: Month and day		
SD921	Specifies the numbered folder (00001 to 32767) to be restored.		

*1 The latest data indicates the backup data in the date stamp folder which is the closest to the present time, and has the rearmost serial number.

(b) Restoration target data

Set the restoration target data with SD917.

Value of SD917	Restoration target data setting
0	All target data
1	Device data only
2	All target data except for device data

(c) Restoration of the special relay and special register

Set whether to restore the special relay and special register with bit14 of SD918.

Bit14 of SD918 Description		
On	Restores the special relay and special register.	
Off	Does not restore the special relays and special registers.	

Note that the following special relay areas and special register areas, which are used for the CPU module backup/restoration function, are not restored even if bit14 of SD918 is on.

 SM916, SM922, SM924, SM1925, SM1926, SM1928, SM1929, SM1931, SD916, SD922, SD1925, SD1926

(d) Operation setting after restoration

At a time of restoration, whether to operate a CPU module with the state at backup or to operate with the initial status can be set with bit15 of SD918 (Restoration function setting). If value of SD917 (Restoration target data setting) is set to 1 (restoration target data is device data only), this setting is invalid since the device initial value file or the module error collection file are not restored.

	Operation setting after restoration			
ltem	Operate with the state at backup (b15 of SD918 = On)	Operate with the initial status (b15 of SD918 = Off)		
Device initial value	The device initial value is not set after restoration.	The device initial value is set after restoration. ^{*1} (The device data at backup is overwritten with the device initial value.)		
Module error collection	The error history at backup is restored.	The error history at backup is not restored.		

*1 The setting is valid for the automatic restoration. As for the restoration by turning SM1929 on, the device initial value is set when the CPU module is powered off and on or is switched STOP to RUN.

Point P

In the operation setting after restoration, the operation at the completion of the restoration is specified. Therefore, when the CPU module is switched from STOP to RUN, the device value changes depending on the operating specifications of the device memory at operating status change of the CPU module. (

(1) Restoration by turning on SM1929


The backup data is restored in an optional timing.

Point P

The restoration by turning on SM1929 can be executed only when the operating status of the CPU module is STOP.

(a) Operating procedure

- 1. Switch the operating status of the CPU module to STOP.
- 2. Set the data to be restored with SD917 (Restoration target data setting).
- **3.** Set the restoration target folder with SD919, SD920, and SD921. (Setting is not required when bit13 of SD918 = ON.)
- 4. Set the each setting with bit13 to 15 of SD918 (Restoration function setting).
- 5. Turn off and then on SM1929 (Restoration execution request).

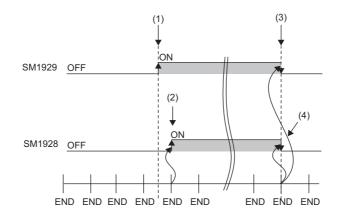

- (1) Restoration execution requested
- (2) Turning on SM1928 (Restoration execution status flag) by the system
- (3) Turning off SM1929 after completion of restoration by the system
- (4) Turning off SM1928 by the system

If a restoration is completed with an error and SM922 (Restoration error check flag) turns on, check SD922 (Cause of error occurred at restoration), take corrective action, and then restore the data again as necessary.

Point P

Progression status of restoration can be checked in SD1925 (Number of backup/restoration uncompleted files) and SD1926 (Backup/restoration progression status). ([] Page 281, Section 3.32 (3))

(2) Automatic restoration using SD918

The backup data is automatically restored when the CPU module is powered off and then on or is reset.

(a) Formatting at automatic restoration

At the execution of automatic restoration, set whether to format drives except for the SD memory card with bit1 of SD918 (Restoration function setting). This setting is valid only when the value of SD917 (Restoration target data setting) is 0 (all target data).

Bit1 of SD918	Description
Off	No format
On	Format

(b) Operating procedure

- 1. Set the data to be restored with SD917 (Restoration target data setting).
- 2. Set the restoration target folder with SD919, SD920, and SD921. (Setting is not required when bit13 of SD918 = ON.)
- 3. Set each setting with bit1 and bit13 to 15 of SD918 (Restoration function setting).
- 4. Turn on bit0 of SD918 (Restoration function setting).
- **5.** Power off and then on or reset the CPU module.

If a restoration is completed with an error and SM922 (Restoration error check flag) turns on, check SD922 (Cause of error occurred at restoration), take corrective action, and then restore the data again as necessary.

Point P

Since the special register set for the automatic restoration is in the latch area, the setting data is hold.
SD918 (Restoration function setting) holds the setting data when the CPU module is powered off and on or is reset. Therefore, if the CPU module is powered off and on or is restoration) of SD918 is remaining in ON, the automatic restoration is executed again. If the automatic restoration is not required at the next time the CPU module is powered off and on or is reset, turn off bit0 of SD918 after the restoration is completed, and then power off and on or reset the CPU module.

(c) Operating status

Operating status of the automatic restoration can be checked by the LEDs on the front side of the CPU module.

Operating status	LED indication
Before automatic restoration start	MODE: On (green), SD CARD: On (green)
Automatic restoration in execution	MODE: Flash (green), SD CARD: Flash (green)
Automatic restoration completed	MODE: On (green), SD CARD: On (green)
Automatic restoration error	MODE: On (green), ERR: Flash (red), SD CARD: On (green)

(3) Checking error

- Even when an error has occurred at a restoration by turning on SM1929, a diagnostic error is not detected. In that case, the error code is stored in SD922 (Cause of error occurred during restoration).
- When an error has occurred at an automatic restoration using SD918, a diagnostic error is detected. Also, an error code is stored in SD922 (Cause of error occurred during restoration).
- (DCPU User's Manual (Hardware Design, Maintenance and Inspection))

(4) Precautions

The following describes precautions for the restoration function.

(a) Removal/insertion of the SD memory card and power-off/reset of the CPU module during the restoration

Do not perform the following operations during the restoration operation.

- Removal and insertion of the SD memory card
- Power-off or reset of the CPU module

If performed, the data in the CPU module is left in an incomplete state, which is middle of the restoration processing. Do not run the CPU module with this incomplete state. Doing so may cause an unintended operation. Restore the data again or format each drive in the CPU module, and clear devices before writing programs or parameters to the programmable controller.

(b) Suspending processing of the restoration

Except for the automatic backup using SD918, the following operations can suspend the processing of the restoration.

- To disable the SD memory card operation forcibly
- · To enable removal and insertion of the SD memory card

If the restoration processing is suspended, the data in the CPU module is left in an incomplete state, which is middle of the restoration processing. Do not run the CPU module with this incomplete state. Doing so may cause an unintended operation. Restore the data again or format each drive in the CPU module, and clear devices before writing programs or parameters to the programmable controller.

(c) Model name of the CPU module to be restored

Always restore the data to the CPU module whose model name is the same as the one of the backup source. If not, restoration cannot be performed.

(d) Combination of automatic restoration and other functions

Do not set automatic restoration using SD918, boot operation, automatic restoration for the CPU module change function, and restoration for the latch data backup to standard ROM simultaneously. If those functions are set simultaneously, the automatic restoration is not operated when the CPU module is powered off and on or is reset.

(e) State of the CPU module

If the states of the CPU module differ between the restoration destination and the backup source, set SD917 to 0 (all target data) and then restore the data.

The data cannot be restored when SD917 is 1 (device data only) or SD917 is 2 (all target data except for all device data).

(f) High speed monitor area from other station

If a restoration is executed without formatting Drive 0 (program memory) of the CPU module to be restored, the setting of high speed monitor area from other station follows to the setting of the CPU module to be restored.

(g) When the same name file exists in the restoration-target CPU module

If the same name file as the one in the backup data exists in the restoration-target CPU module, the file shall be overwritten by the one in the backup data.

(h) Changing operating status during restoration

During a restoration, the CPU module remains in STOP status even though the RUN/STOP/RESET switch is changed from STOP to RUN, or remote RUN or remote PAUSE is operated. If the operating status of a CPU module is changed, it shifts to the one changed after the restoration is completed.

(i) Required time for restoration

According to the number of data (folders) backed up, file size, and number of files, a restoration may take time. Due to the time, for an automatic restoration at a multiple CPU system configuration, an error occurs in other CPU modules, and an error occurs also in the CPU module restored automatically after the completion of the restoration. The restoration itself, however, is completed correctly. Therefore, change SD917 (Restoration target data setting) so that only the device data, which is cleared by the restart of the system, shall be restored, and execute the automatic restoration again.

(j) Reflection of restored data

Some of the parameters are reflected only when the CPU module is powered off and then on or is reset. If a restoration is executed while the CPU module is in STOP state and then is switched to RUN, the CPU module may not operate with the backed up data. In that case, power off and then on or reset the CPU module. For device data, since the device data except the latch-specified devices is initialized by powering off and then on or resetting the CPU module, restore the device data again as the need arises.

(k) Completed with an error

Since a restoration is completed with an error, do not execute a restoration in the following situation.

- Any files which have exactly the same name as the backup data exist in the restoration destination, and also, which the file password is set
- The data in the backup folder is deleted (Do not delete the data in the backup folder that is likely to be restored)
- An error exists in the backup data (the backup data which has been changed its contents or which the CPU module is powered on and then off during the backup)

(I) Parameter-valid drive at automatic restoration

When bit1 of SD918 (Restoration function setting) is turned off (No format), always check the data in the CPU module of restoration destination before restoration. When the drive formatting is invalid, if the parameter-valid drive in the CPU module of the restoration destination is different from the one at the backup, parameters in the data backed up cannot be valid as following example.

Ex. When the parameter-valid drive at backup is the standard ROM (Drive 4), and parameters exist in the program memory (Drive 0) in the CPU module of restoration destination
 If the drive formatting at automatic restoration set to invalid, parameters are restored to Drive 4 while the parameter-valid drive is still Drive 0. Thus, parameters in the program memory shall be valid.

(m) The rise instruction at restoration

At a restoration of program files, the execution status of the instruction becomes non-execution. Therefore, if the restoration is executed while SD917 is 0 (all target data) or 2 (all target data except for device data) and the execution condition of the rise instruction (PLS and $\Box P$) is satisfied when the RUN/STOP/RESET switch from STOP to RUN, the rise instruction is executed.

(n) Restoration of SFC program and device data

When the SFC program and device data are restored, turn on SM326 (SFC device clear mode) and then switch to RUN after the restoration. If the CPU module is changed from STOP to RUN after the restoration while SM326 is off, the device is cleared.

(o) When using the IP address change function

If a backup is performed while the IP address is stored in IP address storage area (flash ROM), the value of the area is changed at a time of restoration. The IP address is changed at the following timing.

- · Restoration by turning on SM1929: When the CPU module is powered off and then on or is reset
- Automatic restoration using SD918: When an automatic restoration is executed

(p) Operations and functions which cannot be performed

Operations and functions which cannot be performed are the same as the ones at backup. (FP Page 289, Section 3.32.1 (5) (i))

(q) Operation behavior of data logging function and sampling trace function

If the data is backed up while the data logging function or sampling trace function is executed and each function is set as it is started automatically, when the CPU module is shift to RUN after restoration, the data logging function or sampling trace function is automatically started.

If the restart of each function after restoration is required without the above setting, each operation to start the data logging function or sampling trace function is required.

(r) Request source of the sampling trace function

If the data is backed up while the sampling trace function is executed and then start/suspend the trace or execute the trigger, the request is identified as the one from different request source. At that time, an alert window is displayed, this has no effect on the operation of the sampling trace function.

(s) Sampling trace function

If data are backed up while the sampling trace function is being executed, the restoration destination CPU module may misunderstand that a request is from a different request source when trace start/suspension or trigger execution is requested. An alarm message is displayed at this time. However, there is no impact on the operation of sampling trace function.

(t) Data protected by security functions

Data protected by the following security functions cannot be restored.

• File password 32

If the name of a file in the restoration destination CPU module and the name of a file in backup data are identical, and a file password has been set to the file, the restoration cannot be performed.

· File access control by security key

If the CPU module is locked, the backup cannot be performed.

(u) Continuation start of the SFC program after restoration

• Restored SFC program will not be executed with a continuation start, but with an initial start.

(v) When data is restored with the setting to restore the special relay and special

register


The CPU module is operated with the values of the backup function setting such as time/day of the week, day/time setting for the automatic backup, or the upper limit value of the number of backup data set before the restoration. (The special register except for the values of the backup function setting is overwritten.) To back up data with the values of the backup function setting set at the backup, set the values again.

(w) Restoration execution during restoration processing

During a restoration processing, the restoration by turning on SM1929 cannot be executed. (The execution will be ignored.)


3.33 Module Model Name Read PNote 3.21

This function reads the model name of a module on a base unit. The mounted module is identified in a ladder program and processing according to the module can be performed.

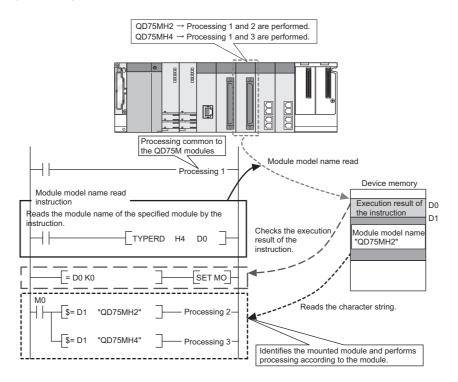

(1) Execution method

Use the TYPERD instruction to read model names. For details of the instruction, refer to the following. MELSEC-Q/L Programming Manual (Common Instruction)




Before executing the function, check the versions of the CPU module and programming tool used.

(Page 467, Appendix 2)

3.34 Module Error Collection PNote 3.22

This function collects errors occurred in the connected intelligent function modules in the CPU module. By storing the errors in a memory that can hold data in the event of a power failure, the errors can be held even after power-off or reset.

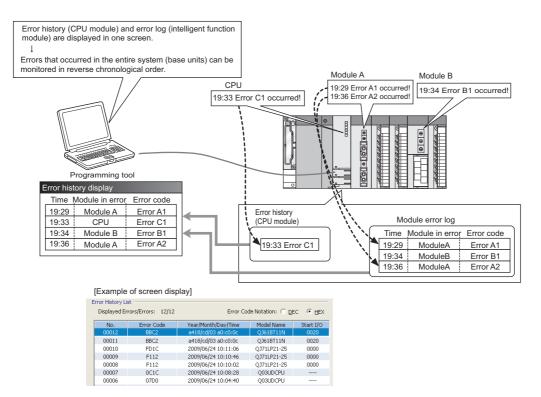


(1) Supported modules

The CPU module collects errors occurred in the connected intelligent function modules^{*1}. The CPU module does not collect the errors of intelligent function modules on other stations in the network.

*1 Indicates intelligent function modules that support this function. For supported module versions, refer to the manual for each module.

(2) Timing when module errors are collected

Module errors are not collected during execution of a program such as the COM instruction but collected in END processing.



Before executing the function, check the versions of the CPU module and GX Works2 used.

(Page 467, Appendix 2) GX Developer cannot display module errors.

(3) Storing module errors

The module errors can be stored either in the system memory^{*1} or the standard RAM. The errors are stored separately from error history (CPU module) data.

CPU module	System memory	Standard RAM
Q00UJCPU	40 (Fixed)	-
Q00UCPU, Q01UCPU	40 (Fixed)	1000
Q02UCPU, QnUD(H)CPU, Built-in Ethernet port QCPU	100 (Fixed)	1000

*1 The memory is managed inside the system.

(4) Setting method

Select "Collect error histories of intelligent function modules" in "Module Error History Collection (Intelligent Function Module)" in the PLC RAS tab of the PLC parameter dialog box.

Γ	Module Error History Collection (Intelligent Function Module)				
	Collection of intelligent function module error histories is valid.				
	* Selecting this enables intelligent function modules errors to be browsed in the "Error History" window of the system monitor.				
	Corresponding Memory System Memory				
	History No. 100 Item (321000)				
	Collection No. 1 Items/Scan (1100)				

ltem	Description	Setting range	Default
Corresponding Memory	Select a storage location.	 System Memory Standard RAM^{*1, *2} 	System Memory
History No.	Set the number of collected errors only when the errors are stored in the standard RAM.	32 to 1000	40/100
Collection No.	Set the number of collected errors in one scan. ^{*3}	 Stored in system memory: 1 to 100 Stored in standard RAM: 1 to 128 	1

*1 With CPU modules other than the High-speed Universal model QCPU and Universal model Process CPU, if a sampling trace file is stored in the standard RAM, the file will be deleted when the CPU module is powered off and then on or is reset. However, with the High-speed Universal model QCPU and Universal model Process CPU, the file will not be deleted.

*2 The battery consumption may be increased.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

*3 If collected module errors are frequently lost, set a greater value to "Collection No.". The recommended value is the number of intelligent function modules that support this function.

Parameter settings are enabled to the CPU module when:

- the CPU module is powered off and then on or
- the CPU module is reset.

(5) Monitoring module errors

Collected module error logs can be checked in the "Error History" screen of GX Works2.

```
<sup>™</sup> [Diagnostics] ⇔ [System Monitor] ⇔ [System Error History] button
```

STOP	Stop Monit	Connection Targ	get Module nannel List Serial Po	ort PLC Modul	e Connei	ction(USB) System Image	
tefine Searc	h						
Match all of t	he criteria						
None							
						Clear Refine Criteria Enter Refine Criteria.	
						Clear Renne Criteria Enter Renine Criteria	
rror History	,						
ror History Li	st					Error Details	
Displayed Er	rors/Errors: 39/39	Error Co	de Notation: 🔿 DE	C 🖲 HEX		Model Name Q03UDCPU	
				ic is then			
No. V	Error Code	Year/Month/Day/Time	Model Name	Start I/O	^	Start I/O	
00019	1876	2009/06/25 14:08:48	Q03UDCPU			Mount Position Main Base PLC Slot	
00018	1B76	2009/06/25 14:05:46	Q03UDCPU				
00017	1B76	2009/06/25 14:02:46	Q03UDCPU			Error and Solution Intelligent Module Information	
00016	0C1C	2009/06/25 13:57:56	Q03UDCPU				
00015	05DC	2009/06/24 10:23:13	Q03UDCPU			Explanation	
00014	08FC	2009/06/24 10:15:01	Q03UDCPU				
00013	07D0	2009/06/24 10:14:33	Q03UDCPU			An assignment error occurred in the CPU-mountable slot (CPU slot, I/O slot 0, 1) in excess of the number	
00012	FE26	2009/06/24 10:14:32	QJ71LP21-25	0000		of CPU modules specified in the multiple CPU setting	
00011	08FC	2009/06/24 10:14:17	Q03UDCPU			of the PLC parameter dialog box.	
00010	FD1C	2009/06/24 10:11:06	QJ71LP21-25	0000			
	F112	2009/06/24 10:10:46	QJ71LP21-25	0000		Solution	
00009	F112	2009/06/24 10:10:02	QJ71LP21-25	0000			
00009 00008						Set the same value to the number of CPU modules	
00009 00008 00007	0C1C	2009/06/24 10:08:28	Q03UDCPU				
00009 00008 00007 00006	0C1C 07D0	2009/06/24 10:04:40	Q03UDCPU			specified in the multiple CPU setting of the PLC	
00009 00008 00007 00006 00005	0C1C 07D0 08FC	2009/06/24 10:04:40 2009/06/24 10:04:22	Q03UDCPU Q03UDCPU			specified in the multiple CPU setting of the PLC parameter dialog box and the number of mounted CPU modules (including CPU (empty)).	
00009 00008 00007 00006 00005 00005	0C1C 07D0 08FC 07D0	2009/06/24 10:04:40 2009/06/24 10:04:22 2009/06/24 10:03:59	Q03UDCPU Q03UDCPU Q03UDCPU			specified in the multiple CPU setting of the PLC parameter dialog box and the number of mounted CPU modules (including CPU (empty)). Make the type specified in the I/O assignment	
00009 00008 00007 00006 00005 00004 00003	0C1C 07D0 08FC 07D0 BBC2	2009/06/24 10:04:40 2009/06/24 10:04:22 2009/06/24 10:03:59 00d0/ff/07 ac:00:00	Q03UDCPU Q03UDCPU Q03UDCPU Q03UDCPU Q061BT11N	 0020		specified in the multiple CPU setting of the PLC parameter dialog box and the number of mounted CPU modules (including CPU (empty))). Make the type specified in the I/O assignment where the D/C results of the I/O assignment	
00009 00008 00007 00006 00005 00004	0C1C 07D0 08FC 07D0	2009/06/24 10:04:40 2009/06/24 10:04:22 2009/06/24 10:03:59	Q03UDCPU Q03UDCPU Q03UDCPU			specified in the multiple CPU setting of the PLC parameter dialog box and the number of mounted CPU modules (including CPU (empty)). Make the type specified in the I/O assignment	

Item Description		Remarks
Error Code ^{*1}	Displays error code numbers.	-
Year/Month/Day/Time ^{*2} Displays the year, month, day, hour, minute, and second when an error occurred.		The year can be displayed within the range of 1980 to 2079.
Model Name	Displays a module model name.	-
Start I/O	Displays the start I/O number of a module in error.	-

*1 For details of error codes, refer to the manual for the intelligent function module.

*2 If an error occurred during initial processing, its occurrence time may be stored as "0000/00/00 00:00:00" in the module error collection file. In this case, the error is not displayed in correct order in Error History List.

Point P

• The Error History screen can be displayed by selecting a module figure in the System Monitor screen and clicking the Error History Detail button. In this case, only the errors of the selected module are displayed.

GX Works2 Version 1 Operating Manual (Common)

- Errors are not displayed for modules that do not support the module error collection function.
- Errors may not be displayed when they occur successively.

(6) Clearing module error history

Module error logs can be cleared by clicking the der History... button in the "Error History" screen. Note that error information on each intelligent function module displayed under "Error Details" is not cleared.

Point P The module error history is cleared when the standard RAM is formatted. Note that a module error collection file cannot be deleted since it is automatically created after the CPU module is powered off and then on or is reset. To delete the file, clear the setting and then format the standard RAM.

(7) Precautions


(a) Using the CPU module change function with memory card

Backing up or restoring data will stop collecting module errors.

(b) Using the CPU module data backup/restoration function


Backing up or restoring data during the module error collection will stop collecting module errors.

This function batch-reads the contents of local devices in a CPU module and saves them in a CSV file. This function enables saving all the contents of local devices in one CSV file.

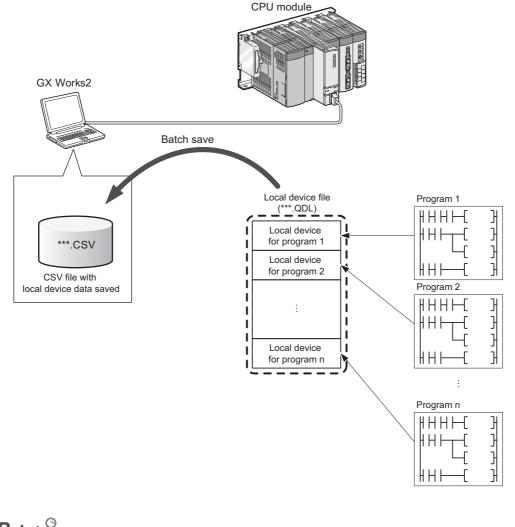

Point P

Use GX Works2 to execute this function. (GX Developer does not support the function.)



Before executing this function, check the versions of a CPU module and GX Works2 used.

(\fbox Page 467, Appendix 2) The Q00UJCPU does not support this function.

(1) Operating method

Open the "Local Device Batch Read + Save CSV" screen of GX Works2.

[™] [Online] ⇔ [Local Device Batch Read + Save CSV]

For details, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

(2) CSV file contents and format

For the contents and format of CSV files, refer to the following.

(3) Precautions

(a) When no local device file exists


The local device batch read function cannot be executed.

(b) When the CPU module is in RUN status

If the local device batch read function is executed while the CPU module is running, the module performs read processing through multiple scans, and the read data are divided into the number of scans. It is recommended to execute the function when the CPU module is in STOP or PAUSE status (when the device data do not change).

3.36 Send Points Extension Function (CC-Link IE Controller Network Module) PNote 3.24

This function extends the maximum number of link points per CC-Link IE Controller Network module. Cyclic transfer can be performed up to 32k points for link relay (LB) and 128k points for link register (LW).

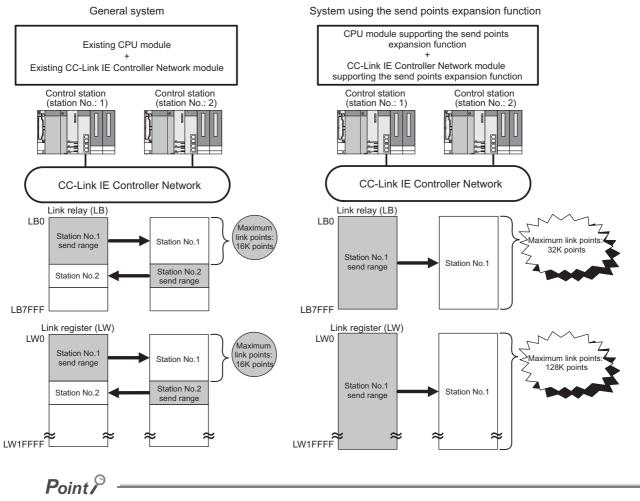

Use GX Works2 to execute this function. (GX Developer does not support the function.)

Dote 3.24 Universal

Before executing this function, check the versions of the CPU module and GX Works2 used.

(Page 467, Appendix 2)

(1) Settings

Set the following network parameters using GX Works2.

- · Network type
- Network range assignment
- Refresh parameters

For details, refer to the following.

CC-Link IE Controller Network Reference Manual

(2) Precautions

(a) Boot operation

If the parameters for the send points extension function are stored in a memory card or SD memory card and the parameters are transferred to a CPU module that does not support this function, "LINK PARA. ERROR" (error code: 3102) occurs.


(b) Restoring backup data from a memory card, SD memory card, or GOT

If the parameters for the send points extension function backed up in a memory card, SD memory card, or GOT are restored to a CPU module that does not support this function, "LINK PARA. ERROR" (error code: 3102) occurs.

3.37 Write-Protect Function for Device Data (from Outside the CPU Module) PNote 3.25


This function disables device data writing (including the file register) from outside the CPU module such as the programming tool, GOT, SLMP/MC protocol, and FTP to the write-protected range set in the parameter. Desired device data can be protected from tampering.

Even when the write-protected range is set, the operation of the CPU module which is set and device data writing by the execution of functions (device data writing by instructions and internal device data writing by initial device value setting, boot operation, and CPU module data backup/restoration function) are not inhibited.

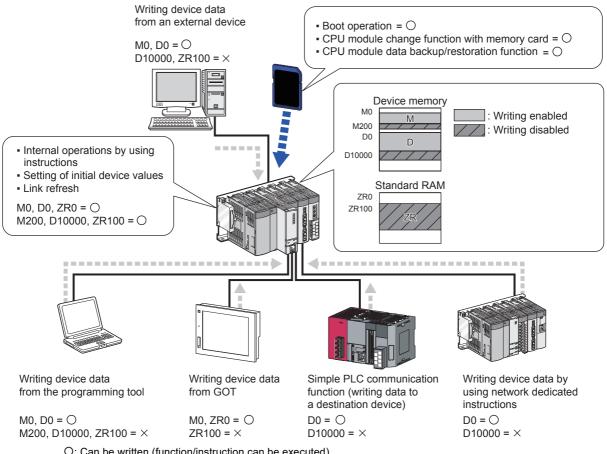

O: Can be written (function/instruction can be executed)

×: Cannot be written (function/instruction cannot be executed)



The write-protect function for device data (from outside the CPU module) can be used only with the High-speed Universal model QCPU and Universal model Process CPU. When using the write-protect function for device data (from outside the CPU module), check the versions of the CPU module and programming tool used. (FF Page 467, Appendix 2)

3.37.1 Setting method

												Disable device	e write from externa
	Sym.	Dig.	Devic Point		h (1) art	Latch (1) End	Latch (2) Start		tch (2) End	Local Device Start	Local Device End	Write Protection Start	Write Protection End
Input Relay	Х	16	8K										
Output Relay	Y	16	8K										
Internal Relay	M	10	28K										
Latch Relay	L	10	8K										
Link Relay	В	16	8K										
Annunciator	F	10	2K										
Link Special	SB	16	2K										
Edge Relay	V	10	2K										
Step Relay	S	10	8K										
Timer	Т	10	2K										
Retentive Timer	ST	10	0K										
Counter	C	10	1K										
Data Register	D	10	41K										
Link Register	W	16	8K										
Link Special	SW	16	2K										
Index	Z	10	20										
Device Total		59.0	K Word	s	Word [Device	54.0	KW	ords	Bit Device	64.0	K Bits	evice Setting HELP
-File Register Exte	File Register Extended Setting Capacity 32 K Points File Register Extended Setting HELP												
	s	Sym.)evice Points	Latch (Star			h (2) art	Latch (2 End	2) Device No. Start	Device No. End	Write Protection Start	Write Protection End
File Register	Z	R(R)	10	32K				0	327	67 ZR0	ZR32767		
Extended Data	а [D	10	OK [
Extended Link		W	16	OK									

Set the write-protected range in the device tab of the PLC parameter.

Selecting the "Disable device write from external" checkbox allows input of the write-protected range (Write Protection Start/End). (

To input the write-protected range of the file register, extended data register, and extended link register, set the file register file to "Use the following file" in the PLC file tab of the PLC parameter. (SP Page 441, Appendix 1.2.3)

Point

- Setting a file password to the user parameter file protects the setting of the write-protect function for device data (from outside the CPU module).
- Whether the write-protect function for device data (from outside the CPU module) is enabled or not can be checked in SM214 (Write-protect status for device data (from outside the CPU module).

3.37.2 Target devices

This section describes the devices that can be write-protected from outside the CPU module. Device data writing by digit specification of bit data, bit specification of word, and index modification cannot be performed when it is specified in the write-protected range.

One write-protected range can be set per device.

Device type

X(DX), Y(DY), M, L, B, F, SB, V, S, T, ST, C, D ^{*1} , W ^{*1} , SW, Z, ZR(R) ^{*2}	^{/*1} , SW, Z, ZR(R) ^{*2}	X(DX), Y(DY), M, L, B, F, SB, V, S, T, ST, C, D*
--	---	--

- *1 The extended data register and extended link register are included.
- *2 When the file register in the block switching method (R) is specified from the SLMP/MC protocol, the write-protected range depends on the block number which is enabled.

Point.

When the write-protect function for device data (from outside the CPU module) is enabled, device data writing by indirect specification cannot be executed regardless of the write-protected range specification.

Device data writing by the following files cannot be executed.

File type	Condition under which writing of files is inhibited
Initial device value file	The write-protect function for device data (from outside the CPU module) is enabled. ^{*1}
File register file	The write-protected range is set for the file register (ZR (R)), extended data register (D), and extended link register (W). ^{*2}

*1 The initial device value file cannot be written as long as this function is enabled, even if the write-protected range set does not include the device set as the initial device value range.

*2 When the write-protected range is set for the file register, the file register file cannot be written.

Even when the write-protect function for device data (from outside the CPU module) is enabled, files can be deleted (including format of the CPU memory).

The following table provides the availability of writing of files by the setting of the PLC file.

×: File cannot be written

	Initial devic	ce value file	File register file		
Item	Device in the write-protected range	Device out of the write-protected range	Device in the write-protected range	Device out of the write-protected range	
Not used	×	×	×	×	
Use the same file name as the program	×	×	×	×	
Use the following file	×	×	×	×	

3.37.3 Operations and functions that cannot be executed for devices in write-protected range

This section describes operations and functions that cannot be executed for devices in the write-protected range.

Operation and function						
		Watch window				
	Modify value ^{*1}	Device/buffer memory batch monitoring				
		Local device monitoring				
		Device memory				
	Write to PLC	Initial device value				
		File register				
Operation from the	Remote operation	Remote RUN when clearing is specified in clear mode				
programming tool		Remote latch clear				
		Clear device's whole memory				
	Clear PLC memory	Clear all file registers				
	External input/output forced on/off function					
	Registration					
	Executional conditioned device test					
	• Registration ^{*2}					
	Device data writing and writing of files using the SLMP/MC protocol (
	Device data writing and writing of files by instructions (
	Device data writing and writing of files by FTP (
Others	Device data writing from the programmable controller in another station or another CPU module					
	Simple PLC communication function					
	"Write" or "Transfer" from the communication destination					
	Latch clear by using the spe	ecial relay and special register areas ^{*3}				
	Change TC setting value from GOT when the setting value has been specified by the device ^{*4}					
*1. If a label is apparified, the expection connet be performed when the device assigned to the label is in the write protected						

*1 If a label is specified, the operation cannot be performed when the device assigned to the label is in the write-protected range.

*2 Device data writing by index modification or indirect specification cannot be executed regardless of the write-protected range. When the write-protected range has been set for the file register (ZR (R)), an error occurs in the file register (R) at registration.

*3 SD339 (Latch clear operation setting) is not cleared.

*4 When index modification is specified to the setting value of the timer or counter, an error occurs.

(1) SLMP/MC protocol

An error occurs when the following operations are performed to devices in the write-protected range from an external device such as a personal computer via the SLMP/MC protocol: writing/clearing of device data, writing/changing of the initial device value file or file register file.

An error also occurs when the following commands are executed in the predefined protocol support function or the SLMP frame send instruction.

		Command					
Classification	Operation	SLMP and 4C/3C/4E/3E frame	2C frame	1C frame		1E frame	
	Batch write	1401	3	BW	JW	02H	
	Daten white		4	WW	QW	03H	
Writing to device	Random write (Test)	1402	6	BT	JT	04H	
			7	WT	QT	05H	
	Multiple blocks batch write	1406	-	-	-	-	
Clearing device	Remote RUN when clearing is specified in the clear mode	1001	-	-	-	-	
	Remote latch clear	1005	-	-	-	-	

· Writing or clearing device data by using the SLMP/MC protocol

• Writing or changing the initial device value file or file register file by using the SLMP/MC protocol

Classification	Operation	Command		
Classification	Operation New file creation File copy File open	SLMP and 4C/3C/4E/3E frame		
	New file creation	1820		
Writing to file	New me creation	1202		
whiling to me	File copy	1824		
	New file creation File copy	1206		
		1827*1		
File change	File information modification	1204*2		
	File write	1829		
		1203		

*1 The operation cannot be performed only when the open mode is for writing (0100H).

*2 The operation cannot be performed only when the extension is changed to QDI (initial device value) or QDR (file register). (Subcommand: 0001, 0002)

Point *P*

For details on commands, refer to the following.

SLMP Reference Manual

MELSEC Communication Protocol Reference Manual

(2) Instruction

An error occurs when the following operations are performed to devices in the write-protected range from other CPU modules by using instructions: writing/clearing of device data, writing/transferring of the initial device value file or file register file.

Classification	Operation	Instruction
		SP.WRITE
		JP/GP.WRITE
	Writing data to the programmable controller in another station	JP/GP.SWRITE
		J(P).ZNWR
Writing to device		GP.RIWT
	Writing device data from another CPU module	D(P).DDWR
	Writing to a notification device for reading/writing data of programmable	JP/GP.SWRITE
	controller in another station (with the read/write notification)	JP/GP.SREAD
Clearing device	Demote DUN when electring is encoified in the electronede	Z(P).RRUN
Clearing device	Remote RUN when clearing is specified in the clear mode	J(P)/G(P).REQ

• Writing or transferring the initial device value file or file register file by an instruction

Classification	Instruction
Writing or transferring a file by FTP client	SP.FTPPUT

(3) File transfer function (FTP server)

An error occurs when the following operations are performed to the CPU module, in which the write-protect function for device data (from outside the CPU module) is enabled, by using the FTP command: writing/clearing of device data, writing (transferring)/changing of the initial device value file or file register file.

· Writing/clearing device data by the FTP command

Classification	Operation	Command (subcommand)		
Clearing device	Remote RUN when clearing is specified in the clear mode	quote (run)		
• Writing (transferring) or changing the initial device value file or file register file by the FTP command				
		0		

Classification	Operation	Command
Writing to file	File transfer	put
writing to me		mput
File change	Extension change to QDI or QDR	rename

3.37.4 Precautions

The following describes the precautions for the write-protect function for device data (from outside the CPU module).

(1) Execution of the executional conditioned device test


When specifying and registering the indirect specified/index-modified device or the file register (R) in the executional conditioned device test, disable the write-protect function for device data (from outside the CPU module) before execution.

If the function is enabled, an error occurs at registration when the indirect specified/index-modified device or the file register (R) is specified.

(2) Writing to the index register (Z) and index-modified device

When writing a value to the index register with the SLMP/MC protocol command 1402 (Write Random/Random write) and changing the access destination to write data by using the index register, disable the write-protect function for device data (from outside the CPU module) before execution. Alternatively, execute writing to the index register (Z) and writing to the index-modified device separately and with multiple commands. If they are specified simultaneously in a single command, an error occurs.

Ex. When the index register (Z0) is changed and device data are written to D0, D5, and D10

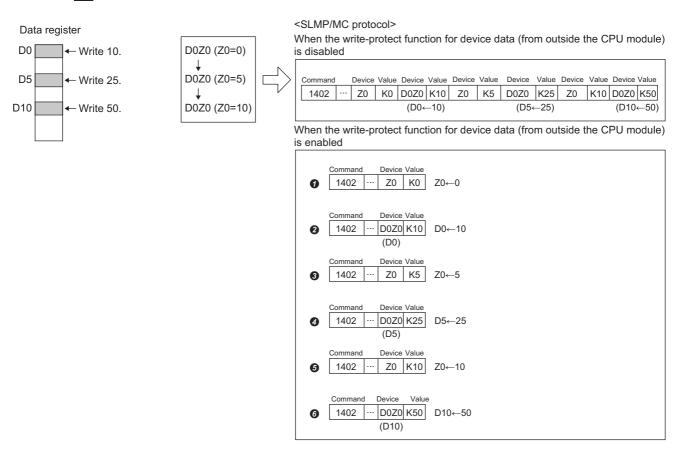

(3) Device memory or initial device value file, and writing parameter

Settings for the write-protect function for device data (from outside the CPU module) are enabled at the following timing:


- The CPU module is powered off and on.
- The CPU module is reset.
- The operating status of the CPU module is switched from STOP to RUN.
- Data are written to the CPU module.

If the parameter in which the write-protect function for device data (from outside the CPU module) is enabled at the same time when the device memory or initial device value in the write-protected range are written, the parameter is written first and instantly enabled. Consequently, an error occurs at writing the device memory or initial device value.

Write the device memory or initial device value before writing the parameter.

3.38 **Operation History Function P**Note 3.26


This function saves the operation information of device data writing and writing of files from outside the CPU module such as the programming tool, GOT, SLMP/MC protocol, and FTP into the CPU module as an operation history file, and displays it in the programming tool. Even if a problem occurs in the system due to incorrect operations, the history of operations to files and devices helps users to detect the incorrect operation and to investigate the cause of the problem.

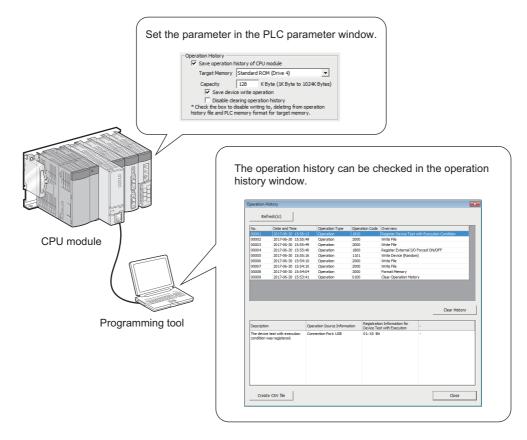

The operation history function consists of the following functions.

Function	Reference
Operation history save function	Page 316, Section 3.38.1
Operation history display	Page 326, Section 3.38.2
Operation history clear function	Page 326, Section 3.38.3


Operation history of device data writing and writing of files by operation of the CPU module itself or the execution of functions (writing device data or file internally) are not saved.



The operation history function can be used only with the High-speed Universal model QCPU and Universal model Process CPU. When using the operation history function, check the versions of the CPU module and the programming tool used. (Frage 467, Appendix 2)

(1) Setting method

To use the operation history function, select the "Save operation history of CPU module" checkbox in the PLC RAS tab of the PLC parameter. (



Point P

For a system where data is frequently written to devices and files, set a large capacity to save many histories. When setting a large capacity, specifying the SD memory card is highly recommended as the save destination memory.

3.38.1 Operation history save function

This function saves the memory operation history in the save destination set in the PLC parameter.

(1) Operation histories to be saved

The following table lists the operation histories to be saved.

Operation and function			
	Operation from the programming tool	 Current value change using watch/monitor^{*1} Remote RUN when clearing is specified in the clear mode Remote latch clear Registration of external input/output forced on/off function^{*1} Registration of executional conditioned device test^{*1} 	
Writing to device	Others	 Device data writing using the SLMP/MC protocol (Page 318, Section 3.38.1 (1) (a)) Device data writing by instructions (Page 319, Section 3.38.1 (1) (b)) Device data writing by FTP (Page 319, Section 3.38.1 (1) (c)) Device data writing from the programmable controller in another station or another CPU module Simple PLC communication function ("Write" or "Transfer" from the communication destination) Latch clear by using the special relay and special register areas 	
Writing to file	Operation from the programming tool	 Write to PLC Online Change Clear all file registers Writing protocol setting data of the predefined protocol support function^{*2} Writing the data logging setting Change TC setting value 	
	Others	 Writing files using the SLMP/MC protocol (Page 318, Section 3.38.1 (1) (a)) Writing files by instruction (Page 319, Section 3.38.1 (1) (b)) Writing files by FTP (Page 319, Section 3.38.1 (1) (c)) Change TC setting value from GOT^{*5} 	
Clear operation	Operation from the programming tool	 Clear device's whole memory Format PLC memory^{*3*4} Delete PLC data 	
Operating status change operation ^{*6}	Others	Changing operating status by the switch operation or remote operation	
Clock setting	Operation from the programming tool	Clock setting with the programming tool (excluding the time adjustment using SNTP)	
	Others	 Clock setting by the DATEWR/REQ/RTMWR instruction Clock setting by the special relay (SM210, SM1025) 	
Operation to the operation history file	Operation from the programming tool	 Clearing the operation history^{*3} Creating a new operation history file 	
Error history clear operation ^{*6}	Operation from the programming tool	Clearing an error history of the CPU module Clearing a module error collection	

- *1 This operation is saved when "Save device write operation" is enabled in the PLC RAS tab of the PLC parameter.
- *2 This operation is saved only when data is written to the CPU module.
- *3 Except when "Disable clearing operation history" is enabled in the PLC RAS tab of the PLC parameter.
- *4 When this operation is performed to the drive specified as the target memory for saving operation history, the history of operation history file creation is saved.
- *5 When the setting value is specified with the device, this operation is saved as device data writing. Since it is saved as a device, the operation is saved when "Save device write operation" is enabled in the PLC RAS tab of the PLC parameter.
- *6 When saving the operation history, check the versions of the CPU module and the programming tool used. (🕞 Page 467, Appendix 2)

Point P

Clear operations are saved even when "Save device write operation" is not enabled in the PLC RAS tab of the PLC parameter.

(a) SLMP/MC protocol

When the following operations are performed, operation histories are saved.

• Writing to device

			Com	Command			
Classification	Operation	SLMP and 4C/3C/4E/3E frame	2C frame	1C frame 1E		1E frame	
	Batch write	1401	3	BW	JW	02H	
	Datch white	1401	4	WW	QW	03H	
Writing to device ^{*1}	Random write (Test)	1402 -	6	BT	JT	04H	
			7	WT	QT	05H	
	Multiple blocks batch write	1406					
Clearing device	Remote RUN when clearing is specified in the clear mode	1001	-	-	-	-	
	Remote latch clear 1005						

*1 This operation is saved when "Save device write operation" is enabled in the PLC RAS tab of the PLC parameter.

Writing to file

Classification	Operation	Command
Classification	Operation	SLMP and 4C/3C/4E/3E frame
	File delete	1822
	File copy	1205
Writing to file		1824
		1206
	File open	1827 ^{*1}
File shares	File information modification	1204
File change	File write	1203*2

*1 The operation is saved only when the open mode is for writing (0100H).

*2 The operation is saved only for the batch write (subcommand: 0000H).

Remote operation

Classification	Operation	Command
Classification	Operation	SLMP and 4C/3C/4E/3E frame
	Remote RUN	1001
Pomoto operation	Remote STOP	1002
Remote operation	Remote PAUSE	1003
	Remote RESET	1006

(b) Instruction

When the following operations are performed, operation histories are saved.

Writing to device

Classification		Instruction
		SP.WRITE
Writing to device ^{*1}		JP/GP.WRITE
	Writing data to the programmable controller in another station	JP/GP.SWRITE
		J(P).ZNWR
		GP.RIWT
	Writing device data from another CPU module	D(P).DDWR
	Writing to a notification device for reading/writing data of programmable	JP/GP.SWRITE
	controller in another station (with the read/write notification)	JP/GP.SREAD
Clearing device Remote RUN when clearing is specified in the clear mode	Z(P).RRUN	
	Remote Row when cleaning is specified in the clear mode	J(P)/G(P).REQ

*1 This operation is saved when "Save device write operation" is enabled in the PLC RAS tab of the PLC parameter.

· Writing (transferring) of file

Classification	Instruction
Writing or transferring a file by FTP client	SP.FTPPUT

· Clock setting

Classification	Instruction
Clock data writing	DATEWR
Writing data to the clock of the programmable controller in another station	J(P)/G(P).REQ
	Z(P).RTMWR

• Remote RUN/Remote STOP

	Classification	Instruction
Remote RUN		Z(P).RRUN
Remote STOP		Z(P).RSTOP

(c) File transfer function (FTP server)

When the following operations are performed, operation histories are saved.

· Writing to device

Clearing device Remote RUN when clearing is specified in the clear mode guote	Classification	Operation	Command
	Clearing device	Remote RUN when clearing is specified in the clear mode	quote

• Writing to file

Classification	Operation	Command
	Creating new file	put
Writing to file		mput
writing to me	Deleting file	delete
		mdelete
File change	Modifying file information	rename

Remote operation

Classification	Operation	Command
Pomoto operation	Remote RUN	quote run
Remote operation	Remote STOP	quote stop

(2) Operation history file

The following describes the operation history file.

(a) Save destination memory

The operation history file can be saved in one of the following.

- Standard ROM
- · SD memory card

Select the save destination memory in the RAS tab of the PLC parameter. (FP Page 442, Appendix 1.2.4)

When the SD memory card is set as the save destination and the write protect switch of the SD memory card is enabled (write inhibited), the operation history is not saved. Therefore, if the write protect switch of the SD memory card is changed to be enabled during operation, an error occurs when the operation to be stored into operation history is performed after the write protect switch is enabled.

(b) File format

The file format of the operation history file is binary file. The operation history can be checked in the programming tool. (Page 326, Section 3.38.2)

(c) File name

The file name and extension of the operation history file is fixed to OPERATE.QOL.

(d) File size (size for saving)

The size of the operation history file can be changed in the RAS tab of the PLC parameter. (Page 442, Appendix 1.2.4)

The setting range is from 1 to 1024K bytes.

If the storage size exceeds the specified size, histories are deleted in order from the oldest one and the latest one is stored.

The following table lists each element to be stored in the operation history file and its size.

Element name	Size	
File header size	64 bytes (fixed)	
Operation history management information size	12 bytes (fixed)	
Size per operation history	40 bytes minimum (variable) ^{*1}	

*1 Since detailed information may differ depending on the operation history to be saved, the size per operation history is variable.

The number of the operations to be saved in the operation history file differs depending on the operation type to be saved. The following provides examples of the registrable number of operations when the size of the operation history file is the default of the function setting (128K bytes).

Ex. When programs (program name: 8 characters (12 characters including a period and extension)) are continued to be written to the CPU module [Calculation formula]

128 [K bytes] = 128 [bytes] × 1024 = 131072 [bytes] 131072 [bytes] - (64 [bytes] + 12 [bytes]) = 130996 [bytes] 130996 [bytes] ÷ 72 [bytes] = 1819 [operations]

Up to 1819 operation histories (2000:Write File) can be registered.

Ex. When one point of M0 (bit) is continued to be written with SLMP Write command to the CPU module [Calculation formula]

128 [K bytes] = 128 [bytes] × 1024 = 131072 [bytes] 131072 [bytes] - (64 [bytes] + 12 [bytes]) = 130996 [bytes] 130996 [bytes] ÷ 64 [bytes] = 2046 [operations]

Up to 2046 operation histories (1000: Write Device) can be registered.

The following shows an example of the operating procedure and the size of the operation history file.

Ex. When 100 programs (program name: 8 characters (12 characters including a period and extension)) are written to the CPU module by the following operating procedure.

[Operating procedure]

- **1.** Power on the CPU module with STOP state.
- 2. Write the parameter and 100 programs (program name: 8 characters (12 characters including a period and extension)) to the CPU module with the programming tool.
- **3.** Switch the operating status of the CPU module to RUN.

[Size of operation history file]

	Element name	Size
File header		64 bytes
Operation history mar	agement information	12 bytes
(Write File (PARAM.QPA)	72 bytes
	Write File (MAIN_001.QPG to MAIN_100.QPG)	7200 bytes
Total		7348 bytes ^{*1}

*1 If a CPU module supports the operating status change operation, the power-on, STOP, and RUN histories are registered so that the total size is 7444 bytes. Check the versions of the CPU module and the programming tool used. (Figure 467, Appendix 2)

(e) File creation timing

The following table lists the timing when an operation history file is created.

Timing	Description
The CPU module is powered off and on.	 When no operation history file exists When an operation history file exists and the file size is changed in the operation history setting^{*1}
The CPU module is reset.	 When no operation history file exists When an operation history file exists and the file size is changed in the operation history setting^{*1}
The PLC memory is formatted.	When the PLC memory is formatted for the save destination memory of the operation history setting of the PLC parameter
An operation history file is deleted.	When an operation history file stored in the save destination memory set in the operation history setting is deleted
An operation history file name is changed.	When the name of an operation history file stored in the save destination memory set in the operation history setting is changed
An SD memory card is inserted.*2	 When no operation history file exists When an operation history file exists and the file size is changed in the operation history setting^{*1}
The CPU module data backup/restoration function is executed.	When a restoration, whose setting for operation after restoration is set to operate with the initial status (b15 of SD918 is off), is executed

*1 The existing operation history file is deleted and a new file is created.

*2 An operation history file is created when the parameter-valid drive is the program memory or standard ROM and the SD memory card is set as the save destination memory in the operation history setting of the PLC parameter.

Point P

When a new operation history file is created, "Operation History File Creation Information" is saved.

The following table lists operations of the CPU module by the SD memory card status when the SD memory card is specified as the save destination memory.

• 0	perations when th	ne CPU module is	powered off and on or is reset
<u> </u>			

Status	Operation
An SD memory card is not inserted.	A stop error occurs when an operation history file is created.
The write protect switch of the SD memory card is enabled (write- protected).	If no operation history file exists, a stop error occurs when an operation history file is created. When an operation history file exists, the CPU module starts up successfully.
An SD memory card is inserted.	The CPU module starts up successfully.

• Operations when an operation whose operation history is saved in RUN/STOP (PAUSE) state is executed

Status	Operation
The SD memory card is removed or is forcibly disabled.	The operation history is temporarily saved in the internal memory. If the memory reaches the maximum number of operation histories it can store, all subsequent histories are lost.
The write protect switch of the SD memory card is enabled (write- protected).	A continuation error occurs at the execution of the operation to be saved. (The operation history can be displayed in the programming tool.)
The SD memory card is removed and other SD memory card in which the operation history file is stored is inserted.	 If the file size is same, operation histories are continued to be saved in the existing operation history file. If the file size is different, the existing operation history file is deleted and a new file is created.
The write protect switch of the SD memory card is changed to be disabled or the SD memory card forced disable is cleared.	Operation histories are continued to be saved in the existing operation history file.
An SD memory card is inserted. (The write protect switch of the SD memory card is disabled and the SD memory card forced disable is cleared.)	Operation histories are saved in the operation history file.

(f) Timing when the setting is enabled

Any changed parameters take effect when:

- The CPU module is powered off and on.
- The CPU module is reset.

Any parameters in which the save destination memory and file size are changed in STOP state does not take effect when the CPU module operating status is changed from STOP to RUN. In this case, the changed parameters will take effect the next time when the CPU module is powered off and on or is reset.

(3) The number of displayed operation histories

The latest operation histories are displayed in the programming tool. For the maximum number of displayed operation histories, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

(4) Loss of operation history

Some operation histories may be lost in the following cases.

- The CPU module is powered off and on or is reset immediately after the operation to be saved is performed (while the operation history is being written to the operation history file).
- Operations to be saved such as writing devices (writing to the operation history file) are frequently detected in the system.

When an operation history is lost, "*HST LOSS*" appears in the operation code in the operation history window. Whether any operation history has been lost or not can be checked in SM386 (Operation history information loss flag).

(5) Devices to be saved

If the following devices are written, "Write Device" is saved in the operation history. Writing by index modification or indirect specification is also saved. Although devices where the local device has been set are also saved, the local device and global device cannot be distinguished by the stored device name.

Device type

X(DX), Y(DY), M, L, B, F, SB, V, S, T(TS, TC, TN)^{*1}, ST(STS, STC, STN)^{*1}, C(CS, CC, CN)^{*1}, D^{*2}, W^{*2}, SW, FX, FY, SM, FD, SD, Z, R, ZR, Jn\X, Jn\Y, Jn\B, Jn\SB, Jn\W, Jn\SW, Un\G, U3En\G

*1 Timer, retentive timer, and counter are displayed as TS, STS, and CS in contact, TC, STC, and CC in coil, and TN, STN, and CN in current value.

*2 The extended data register and extended link register are included.

3.38.2 Operation history display

Operation histories can be checked in the "Operation History" window.

[™] [Diagnostics] ⇔ [PLC Diagnostics] ⇔ [Operation History] button

For details on the operation method and screen items, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

3.38.3 Operation history clear function

Clicking the [Clear History] button in the "Operation History" window clears all operation histories in the memory specified as the save destination memory.

♥♥ [Diagnostics] <> [PLC Diagnostics] <> [Operation History] button

For details on the operation method, refer to the following.

GX Works2 Version 1 Operating Manual (Common)

In the following cases, operation histories are not cleared and a message is displayed in the programming tool.

- "Disable clearing operation history" is enabled in the operation history setting in the PLC RAS tab of the PLC parameter (FPP Page 326, Section 3.38.3 (1)).
- The operation history file is being accessed from other programming tools.
- The operation history file cannot be accessed.

(1) Disabling the operation history clear

Enabling "Disable clearing operation history" in the operation history setting in the PLC RAS tab of the PLC parameter disables the operation history clear. (

The following table lists the operations which cannot be executed when "Disable clearing operation history" is enabled.

Operation				
Operation history file	Writing the file			
	Copying the file			
	Changing the file name			
	Deleting the file			
Clearing the operation history				

Formatting the PLC memory^{*1}

*1 The operation cannot be executed only when the PLC memory is formatted for the save destination memory of the operation history file.

3.38.4 Precautions

This section describes the precautions for the operation history function.

(1) Operation history display and data update during execution of another function

The operation history cannot be displayed and data cannot be updated^{*1} during execution of the following functions. Check that the following functions are not being executed before displaying the operation history or updating data.

- · Restoration by the CPU module change function with memory card
- · Restoration by the CPU module data backup/restoration function
- *1 Data update indicates the operation of clicking the [Refresh] button in the "Operation History" window of the programming tool. For details, refer to the following.
 Image: GX Works2 Version 1 Operating Manual (Common)

(2) Operating history clear during execution of anther function

No operation history can be cleared during execution of the following functions. Check that the following functions are not being executed before clearing the operation history.

- Backup and restoration by the CPU module change function with memory card
- · Backup and restoration by the CPU module data backup/restoration function

(3) Combination with the data logging function

When the operation history function is used, the collecting performance of the data logging is decreased. Therefore, missing may occur in the data logging with the setting where no missing has been occurred.

(4) Operation history display and data update during an operation to be saved such as device data writing

It is recommended to display the operation history or update data when the operation to be saved as the operation history is not being performed.

If device data writing is executed frequently with the setting for saving device data writing, it may takes several tens of seconds to display operation history or update data due to frequent save processing of the operation history. In addition, "*HST LOSS*" may appear when the operation history is displayed or data is updated. ([]] Page 325, Section 3.38.1 (4))

3.38.5 List of operation codes

This section lists the operation codes displayed in the operation history window of the operation history function.

(1) How to read the list

The list contains the following information.

Item	Description		
Operation Type	Information used to identify the operation type		
Operation Code (decimal)	The ID number assigned to operation information		
Overview	The overview of the detected operation		
Description	The description of the detected operation		
Detailed information 1 to 3	Details of the detected operation		

(a) Detailed information

The following table lists the details of information displayed in the detailed information 1 to 3.

Detailed information	Item	Description	
Detailed information 1	Operation Source Information	 Information on the operation source Connection port (connection information such as Ethernet and USB) I/O No. CPU number (a number assigned to CPU modules in a multiple CPU system) Network number Station number IP address 	
	Operation History File Creation Information	Information on the operation history file	
	Clock Information (Before Change)	Clock information before change	
	Drive/File Information	Information on the drive and file	
	Copy Source (SRC) Drive/File Information	Information on the drive and file of the copy source	
	Device Write Information	Information on the specified device (device name, data type, an number of points)	
Detailed information 2	Device Write Information (User Specification)		
	ON/OFF Registration Information	Information on the registered device (device name and on/off)	
	Registration Information for Device Test with Execution Condition	Information on the device registered for the executional conditioned device test function	
	Information for Clearing Device	Information on the cleared device	
	Clock Information (After Change)	Clock information after change	
Detailed information 3	Copy Destination (DST) Drive/File Information	Information on the drive and file of the copy destination	
	Device Write Information (Access Destination)	Information on the access destination device (device name and memory address)	

(2) List of operation codes

The following table lists the operation codes.

Operation Type	Operation	Overview	Description	Detailed information		
	Code (decimal)			Detailed information 1	Detailed information 2	Detailed information 3
System	0001	Create Operation History File	The operation history file was created.	Operation History File Creation Information	-	-
	0010	Power-on/Clear Reset	The system was powered on or reset was cleared.	-	-	-

	Onenetien			De	tailed informat	ion
Operation Type	Operation Code (decimal)	Overview	Description	Detailed information 1	Detailed information 2	Detailed information 3
	0100	Clear Operation History	The operation history was cleared.			
	0101	Clear Error History	The error history was cleared.	-	-	-
	0102	Clear Module Error Collection	The module error collection was cleared.			
	0200	Set Clock	The clock was set.	Operation Source Information	Clock Information (Before Change)	Clock Information (After Change)
	0201	Accept Remote Operation Request	The remote operation request (RUN/STOP/PAUSE) was accepted.		Remote Operation Type Information	
	0300	Change Operating Status (RUN)	Change operating status (RUN)			
	0301	Change Operating Status (RUN)	The operating status was changed to STOP.	-	-	
	0302	Change Operating Status (PAUSE)	The operating status was changed to PAUSE.			
	1000	Write Device	It was written to the device.		Device Write Information	
Operation	1101	Write Device (Random)	It was written to the device. (Write Random 1st Point to 10th Point)	Operation	Device Write Information (User Specification)	Device Write Information (Access Destination)
	1102	Write Device (Random 11th Point or later)	It was written to the device. (Write Random 11th Point to 20th Point)			
	1103	Write Device (Random 21st Point or later)	It was written to the device. (Write Random 21st Point to 30th Point)			
	1104	Write Device (Random 31st Point or later)	It was written to the device. (Write Random 31st Point to 40th Point)			
	1105	Write Device (Random 41st Point or later)	It was written to the device. (Write Random 41st Point to 50th Point)	Source Information		
	1106	Write Device (Random 51st Point or later)	It was written to the device. (Write Random 51st Point to 60th Point)			
	1107	Write Device (Random 61st Point or later)	It was written to the device. (Write Random 61st Point to 70th Point)			
	1108	Write Device (Random 71st Point or later)	It was written to the device. (Write Random 71st Point to 80th Point)			
	1109	Write Device (Random 81st Point or later)	It was written to the device. (Write Random 81st Point to 90th Point)			

	Operation			Detailed information		
Operation Type	Operation Code (decimal)	Overview	Description	Detailed information 1	Detailed information 2	Detailed information 3
	1110	Write Device (Random 91st Point or later)	It was written to the device. (Write Random 91st Point to 100th Point)			
	1111	Write Device (Random 101st Point or later)	It was written to the device. (Write Random 101st Point to 110th Point)			
	1112	Write Device (Random 111th Point or later)	It was written to the device. (Write Random 111th Point to 120th Point)			
	1113	Write Device (Random 121st Point or later)	It was written to the device. (Write Random 121st Point to 130th Point)			
	1114	Write Device (Random 131st Point or later)	It was written to the device. (Write Random 131st Point to 140th Point)		Device Write Information	Device Write Information
	1115	Write Device (Random 141st Point or later)	It was written to the device. (Write Random 141st Point to 150th Point)	Operation Source Information	(User Specification)	(Access Destination)
	1116	Write Device (Random 151st Point or later)	It was written to the device. (Write Random 151st Point to 160th Point)			
	1117	Write Device (Random 161st Point or later)	It was written to the device. (Write Random 161st Point to 170th Point)			
Operation	1118	Write Device (Random 171st Point or later)	It was written to the device. (Write Random 171st Point to 180th Point)			
	1119	Write Device (Random 181st Point or later)	It was written to the device. (Write Random 181st Point to 188th Point)			
	1201	Write Device (Block)	It was written to the device. (Write Block 1st Point to 10th Point)		Device Write Information	-
	1202	Write Device (Block 11th Point or later)	It was written to the device. (Write Block 11th Point to 20th Point)			
	1203	Write Device (Block 21st Point or later)	It was written to the device. (Write Block 21st Point to 30th Point)			
	1204	Write Device (Block 31st Point or later)	It was written to the device. (Write Block 31st Point to 40th Point)	-		
	1205	Write Device (Block 41st Point or later)	It was written to the device. (Write Block 41st Point to 50th Point)			
	1206	Write Device (Block 51st Point or later)	It was written to the device. (Write Block 51st Point to 60th Point)			

	Operation			De	tailed informat	ion
Operation Type	Code (decimal)	Overview	Description	Detailed information 1	Detailed information 2	Detailed information 3
	1207	Write Device (Block 61st Point or later)	It was written to the device. (Write Block 61st Point to 70th Point)			
	1208	Write Device (Block 71st Point or later)	It was written to the device. (Write Block 71st Point to 80th Point)			
	1209	Write Device (Block 81st Point or later)	It was written to the device. (Write Block 81st Point to 90th Point)			
	1210	Write Device (Block 91st Point or later)	It was written to the device. (Write Block 91st Point to 100th Point)			
	1211	Write Device (Block 101st Point or later)	It was written to the device. (Write Block 101st Point to 110th Point)	Operation Source Information	Device Write Information	-
	1212	Write Device (Block 111th Point or later)	It was written to the device. (Write Block 111th Point to 120th Point)			
Operation	1213	Write Device (Block 121st Point or later)	It was written to the device. (Write Block 121st Point to 130th Point)			
Operation	1214	Write Device (Block 131st Point or later)	It was written to the device. (Write Block 131st Point to 140th Point)			
	1215	Write Device (Block 141st Point or later)	It was written to the device. (Write Block 141st Point to 150th Point)			
	1216	Write Device (Block 151st Point or later)	It was written to the device. (Write Block 151st Point to 160th Point)			
	1217	Write Device (Block 161st Point or later)	It was written to the device. (Write Block 161st Point to 170th Point)			
	1218	Write Device (Block 171st Point or later)	It was written to the device. (Write Block 171st Point to 180th Point)			
	1219	Write Device (Block 181st Point or later)	It was written to the device. (Write Block 181st Point to 190th Point)			
	1220	Write Device (Block 191st Point or later)	It was written to the device. (Write Block 191st Point to 192nd Point)			

	Operation	Overview		De	tailed informat	ion
Operation	Code		Description	Detailed	Detailed	Detailed
Туре	(decimal)			information	information	information
	(1	2	3
	1800	Register External I/O Forced ON/OFF	The external I/O forced ON/OFF was registered.	Re Inf Re Inf De Wit Co Co Dr Inf Operation Source Information (S Dr	ON/OFF Registration Information	
	1810	Register Device Test with Execution Condition	The device test with execution condition was registered.		Registration Information for Device Test with Execution Condition	-
	2000	Write File	A new file was created, or the file was written.		Drive/File Information	
Operation	2001	Copy File	The file was copied.		Copy Source	Сору
Operation	2002	Rename File	The file was renamed.		(SRC) Drive/File Information	Destination (DST) Drive/File Information
	3000	Format Memory	The PLC memory was formatted.		Drive/File Information	
	3001	Clear Device Memory, and File Register	The device memory, and file register was cleared.		Information for Clearing Device	-
	3002	Delete File	The file was deleted.		Drive/File Information	

Function	Description
Automatic detection of connected device	Detects devices supporting iQ Sensor Solution connected to the CPU module, and automatically displays them on "List of devices" and "Device map area" using a programming tool.
System configuration check	Compares the system configuration information displayed on a programming tool with the actual system configuration, and checks if they match.
Communication setting reflection	Reflects the communication settings (such as IP addresses) of devices supporting iQ Sensor Solution on "Device map area" to the devices connected over Ethernet in the system.
Sensor parameter read/write	Reads/writes parameters from/to devices supporting iQ Sensor Solution.
Monitoring	Monitors the current values (such as measurement values and input/output values), status (error existence), and error information of devices supporting iQ Sensor Solution graphically using a programming tool.
Data backup/restoration	Backs up the setting data (such as parameters) of devices supporting iQ Sensor Solution to an SD memory card. The data backed up can be restored as necessary.

The iQ Sensor Solution function performs the following operation.



Note 3.27 Universal

For details of the function, refer to the following.

iQ Sensor Solution Reference Manual

Note 3.28 Universal

The iQ Sensor Solution function can be used only with the High-speed Universal model QCPU and Universal model

Process CPU. Before using the function, check the version of the CPU module and the programming tool used. (Page 467, Appendix 2)

PART 3 DEVICES, CONSTANTS

In this part, the devices and constants used in the CPU module are described.

CHAPTER4 DEVICES	. 336
CHAPTER5 CONSTANTS	. 417
CHAPTER6 CONVENIENT OF DEVICES	. 420

CHAPTER 4 DEVICES

This chapter describes the devices that can be used in the CPU module.

4.1 Device List

The following table shows the devices used in the CPU module and applicable ranges.

(1) Q00UJCPU, Q00UCPU, Q01UCPU, Q02UCPU

Classification	Turne	Name		Default	Parameter-	Deferrance	
Classification	Туре	Name	Point	nt Range		set range	Reference
		Input	8192	X0 to X1FFF	Hexadecimal		Page 348, Section 4.2.1
		Output	8192	Y0 to Y1FFF	Hexadecimal		Page 350, Section 4.2.2
		Internal relay	8192	M0 to M8191	Decimal		Page 351, Section 4.2.3
		Latch relay	8192	L0 to L8191	Decimal		Page 352, Section 4.2.4
	Bit device	Annunciator	2048	F0 to F2047	Decimal		Page 353, Section 4.2.5
		Edge relay	2048	V0 to V2047	Decimal		Page 357, Section 4.2.6
Internal user		Step relay	8192	S0 to S8191	Decimal	Can be changed	Page 360, Section 4.2.9
device		Link relay	8192	B0 to B1FFF	Hexadecimal	within 29K words. ^{*3}	Page 358, Section 4.2.7
		Link special relay	2048	SB0 to SB7FF	Hexadecimal		Page 359, Section 4.2.8
		Timer ^{*1}	2048	T0 to T2047	Decimal		Page 360,
		Retentive timer ^{*1}	0	(ST0 to ST2047)	Decimal		Section 4.2.10
		Counter ^{*1}	1024	C0 to C1023	Decimal		Page 369, Section 4.2.11
	Word device	Data register	12288	D0 to D12287	Decimal		Page 373, Section 4.2.12
		Link register	8192	W0 to W1FFF	Hexadecimal		Page 374, Section 4.2.13
		Link special register	2048	SW0 to SW7FF	Hexadecimal		Page 376, Section 4.2.14

Clossifiestics	Default		Parameter-	Boforonco			
Classification	Туре	Name	Point	Range		set range	Reference
		Function input	16	FX0 to FXF	Hexadecimal		Page 377,
							Section 4.3.1
	Bit device	Function output	16	FY0 to FYF	Hexadecimal		Page 377, Section 4.3.1
Internal system	uevice					Cannot be	Page 379,
device		Special relay	2048	SM0 to SM2047	Decimal	changed.	Section 4.3.2
	Word	Function register	5	FD0 to FD4	Decimal		Page 377, Section 4.3.1
	device	Special register	2048	SD0 to SD2047	Decimal		Page 379, Section 4.3.3
		Link input	8192	Jn\X0 to Jn\X1FFF	Hexadecimal		
	Bit	Link output	8192	Jn\Y0 to Jn\Y1FFF	Hexadecimal		
	device	Link relay	32768	Jn\B0 to Jn\B7FFF	Hexadecimal	0	D 000
Link direct device		Link special relay	512	Jn\SB0 to Jn\S1FF	Hexadecimal	Cannot be changed.	Page 380, Section 4.4
		Link register	131072	Jn\W0 to Jn\W1FFFF	Hexadecimal	changeu.	Section 4.4
	Word device	Link special register	512	Jn\SW0 to Jn\SW1FF	Hexadecimal		
Module access	Word	Intelligent function module device	65536	Un\G0 to Un\G65535 ^{*2}	Decimal		Page 384,
device de	device	Cyclic transmission area device ^{*4}	4096	U3En\G0 to U3En\G4095	Decimal	Cannot be changed.	Section 4.5
Index register or standard device register	Word device	Index register or standard device register	20	Z0 to Z19	Decimal	Cannot be changed.	Page 387, Section 4.6
File register ^{*7}	Word device	File register	0	-	-		Page 392, Section 4.7
Extended data register ^{*7}	Word device	Extended data register	0	-	-	0 to 4086K points ^{*6}	Page 402, Section 4.8
Extended link register ^{*7}	Word device	Extended link register	0	-	-		Page 402, Section 4.8
Nesting	-	Nesting	15	N0 to N14	Decimal	Cannot be changed.	Page 407, Section 4.9
Pointer	-	Pointer	4096 ^{*11}	P0 to P4095 ^{*12}	Decimal	Cannot be	Page 408, Section 4.10
		Interrupt pointer	256 ^{*8}	10 to 1255 ^{*9}	Decimal	changed.	Page 412, Section 4.11
	Bit device	SFC block device	128	BL0 to BL127	Decimal		Page 415, Section 4.12.1
Others		Network No. specification device	255	J1 to J255	Decimal	Cannot be	Page 415, Section 4.12.2
	-	I/O No. specification device	-	U0 to U7F, U3E0 to U3E2 ^{*10}	Hexadecimal	changed.	Page 416, Section 4.12.3
		Macro instruction argument device	10	VD0 to VD9	Decimal		Page 416, Section 4.12.4

Classification	Type	Name		Default	Parameter-	Reference			
Classification	Type	Name	Point	Range	set range	Kelefence			
		Decimal constant		K-2147483648 to K2147483647					
	Hexadecimal constant		Page 417, Section 5.2						
Constant	-	-	E	Single-precision floating-point data: E ± 1.17549435 — 38 to E ± 3.40282347 + 38					
		Real number constant		Double-precision floating-point data [*] E ± 2.2250738585072014 — 308 to E ± 1.7976931348623157 + 308		Page 418, Section 5.3			
		Character string constant	ι	Page 419, Section 5.4					

*1 These devices are used as a bit device for contacts and coils, and as a word device for controlling the present value.
 *2 The number of points that can be actually used varies depending on intelligent function modules. For the number of

buffer memory points, refer to the manual for the intelligent function module used.

*3 When changing device points, refer to F Page 345, Section 4.2 (1), the parts describing the precaution.

*4 Available only in multiple CPU systems.

*5 Up to 15 digits can be entered in a programming tool.

*6 This is the total number of points for the file register, extended data register (D), and extended link register (W).

*7 Not available for the Q00UJCPU.

*8 The number of points for the Q00UJCPU, Q00UCPU, and Q01UCPU is 128.

*9 The range for the Q00UJCPU, Q00UCPU, and Q01UCPU is I0 to I127.

*10 The range for the Q00UJCPU is U0 to UF, and for the Q00UCPU and Q01UCPU is U0 to U3F and U3E0 to U3E2.

*11 The number of points for the Q00UJCPU, Q00UCPU, and Q01UCPU is 512.

*12 The range for the Q00UJCPU, Q00UCPU, and Q01UCPU is P0 to P511.

(2) QnUD(H)CPU, QnUDE(H)CPU

					Parameter-		
Classification	Туре	Name	Point		set range	Reference	
		Input	8192	X0 to X1FFF	Hexadecimal		Page 348,
			0102		Tiexadeoimar		Section 4.2.1
		Output	8192	Y0 to Y1FFF	Hexadecimal		Page 350, Section 4.2.2
							Page 351,
		Internal relay	8192	M0 to M8191	Decimal		Section 4.2.3
		Latch relay	8192	L0 to L8191	Decimal		Page 352, Section 4.2.4
	Bit device	Annunciator	2048	F0 to F2047	Decimal		Page 353, Section 4.2.5
		Edge relay	2048	V0 to V2047	Decimal		Page 357, Section 4.2.6
Internal user		Step relay	8192	S0 to S8191	Decimal	Can be changed	Page 360, Section 4.2.9
device		Link relay	8192	B0 to B1FFF	Hexadecimal	within 29K words. ^{*3}	Page 358, Section 4.2.7
		Link special relay	2048	SB0 to SB7FF	Hexadecimal		Page 359, Section 4.2.8
		Timer ^{*1}	2048	T0 to T2047	Decimal		Page 360,
		Retentive timer ^{*1}	0	(ST0 to ST2047)	Decimal		Section 4.2.10
		Counter ^{*1}	1024	C0 to C1023	Decimal		Page 369, Section 4.2.11
	Word device	Data register	12288	D0 to D12287	Decimal		Page 373, Section 4.2.12
		Link register	8192	W0 to W1FFF	Hexadecimal		Page 374, Section 4.2.13
		Link special register	2048	SW0 to SW7FF	Hexadecimal		Page 376, Section 4.2.14
		Function input	16	FX0 to FXF	Hexadecimal		Page 377, Section 4.3.1
	Bit device	Function output	16	FY0 to FYF	Hexadecimal		Page 377, Section 4.3.1
Internal system device		Special relay	2048	SM0 to SM2047	Decimal	Cannot be changed.	Page 379, Section 4.3.2
	Word	Function register	5	FD0 to FD4	Decimal		Page 377, Section 4.3.1
	device	Special register	2048	SD0 to SD2047	Decimal		Page 379, Section 4.3.3
		Link input	16384 ^{*7}	Jn\X0 to Jn\X3FFF ^{*8}	Hexadecimal		
	Bit	Link output	16384 ^{*7}	Jn\Y0 to Jn\Y3FFF ^{*8}	Hexadecimal		
	device	Link relay	32768	Jn\B0 to Jn\B7FFF	Hexadecimal	Cannot be	Page 380,
Link direct device		Link special relay	512	Jn\SB0 to Jn\S1FF	Hexadecimal	changed.	Section 4.4
	Word	Link register	131072	Jn\W0 to Jn\W1FFFF	Hexadecimal		
	device	Link special register	512	Jn\SW0 to Jn\SW1FF	Hexadecimal		

	-			Default	Parameter-		
Classification	Туре	Name	Point	Range)	set range	Reference
	Mand	Intelligent function module device	65536	Un\G0 to Un\G65535 ^{*2}	Decimal	Cannot be changed.	D
Module access device	Word device	Cyclic transmission	4096	U3En\G0 to U3En\G4095	Decimal	Cannot be changed.	Page 384, Section 4.5
		area device ^{*4}	14336	U3En\G10000 to U3En\G24335	Decimal	Can be changed.	
Index register or standard device register	Word device	Index register or standard device register	20	Z0 to Z19	Decimal	Cannot be changed.	Page 387, Section 4.6
File register	Word device	File register	0	-	-		Page 392, Section 4.7
Extended data register	Word device	Extended data register	0 ^{*9}	-	-	0 to 4086K points ^{*6}	Page 402, Section 4.8
Extended link register	Word device	Extended link register	0	-	-		Page 402, Section 4.8
Nesting	-	Nesting	15	N0 to N14	Decimal	Cannot be changed.	Page 407, Section 4.9
Pointor	Pointer -	Pointer	4096 ^{*10}	P0 to P4095 ^{*11}	Decimal	Cannot be	Page 408, Section 4.10
i onter		Interrupt pointer	256	10 to 1255	Decimal	changed.	Page 412, Section 4.11
	Bit device	SFC block device	320	BL0 to BL319	Decimal		Page 415, Section 4.12.1
Others		Network No. specification device	255	J1 to J255	Decimal	Cannot be	Page 415, Section 4.12.2
Others	-	I/O No. specification device	516	U0 to U1FF, U3E0 to U3E3	Hexadecimal	changed.	Page 416, Section 4.12.3
		Macro instruction argument device	10	VD0 to VD9	Decimal		Page 416, Section 4.12.4
		Decimal constant		K-2147483648 to	K2147483647		Page 417, Section 5.1
		Hexadecimal constant		H0 to HFF	FFFFF		Page 417, Section 5.2
Constant	-	Pool number	E	Single-precision flc ± 1.17549435 — 38 tc			Page 418, Section 5.3
		Real number constant		Page 418, Section 5.3			
		Character string constant	ι	Jp to 32 characters, suc	ch as "ABC" and '	"123"	Page 419, Section 5.4

- *1 These devices are used as a bit device for contacts and coils, and as a word device for controlling the present value.
- *2 The number of points that can be actually used varies depending on intelligent function modules. For the number of buffer memory points, refer to the manual for the intelligent function module used.
- *3 When changing device points, refer to FP Page 345, Section 4.2 (1), the parts describing the precaution.
- *4 Available only in multiple CPU systems.

Jn\X/Y1FFF.

- *5 Up to 15 digits can be entered in a programming tool.
- *6 This is the total number of points for the file register, extended data register (D), and extended link register (W).
- *7 The number of points for the Universal model QCPU whose serial number (first five digits) is "12011" or earlier is 8192.
 *8 The range for the Universal model QCPU whose serial number (first five digits) is "12011" or earlier is Jn\X/Y0 to
- *9 The number of points for the Q50UDEHCPU and Q100UDEHCPU is 128K.
- *10 The number of points for the Q50UDEHCPU and Q100UDEHCPU is 8192.
- *11 The range for the Q50UDEHCPU and Q100UDEHCPU is P0 to P8191.

(3) QnUDVCPU, QnUDPVCPU

Closefficities	Trees	News	Parameter-	Deferrence			
Classification	Туре	Name	Point	Range		set range	Reference
		Input	8192	X0 to X1FFF	Hexadecimal		Page 348,
		· · · · · · · · · · · · · · · · · · ·					Section 4.2.1
		Output	8192	Y0 to Y1FFF	Hexadecimal		Page 350, Section 4.2.2
			*****	*8	Duringel		Page 351,
		Internal relay	28672 ^{*7}	M0 to M28672 ^{*8}	Decimal		Section 4.2.3
		Latch relay	8192	L0 to L8191	Decimal		Page 352, Section 4.2.4
	Bit						Page 353,
	device	Annunciator	2048	F0 to F2047	Decimal		Section 4.2.5
		Edge relay	2048	V0 to V2047	Decimal		Page 357,
			2010	101012011	Boolinia		Section 4.2.6
		Step relay	8192	S0 to S8191	Decimal		Page 360, Section 4.2.9
Internal user device						Can be changed. ^{*3}	Page 358,
		Link relay	8192	B0 to B1FFF	Hexadecimal	changed.	Section 4.2.7
		Link special relay	2048	SB0 to SB7FF	Hexadecimal		Page 359,
							Section 4.2.8
		Timer ^{*1}	2048	T0 to T2047	Decimal		Page 360,
		Retentive timer ^{*1}	0	(ST0 to ST2047)	Decimal		Section 4.2.10
		Counter ^{*1}	1024	C0 to C1023	Decimal		Page 369, Section 4.2.11
	Word						Page 373,
	device	Data register	41984 ^{*9}	D0 to D41983 ^{*10}	Decimal		Section 4.2.12
		Link register	8192	W0 to W1FFF	Hexadecimal		Page 374,
							Section 4.2.13
		Link special register	2048	SW0 to SW7FF	Hexadecimal		Page 376, Section 4.2.14
			40		l lavada simal		Page 377,
		Function input	16	FX0 to FXF	Hexadecimal		Section 4.3.1
	Bit	Function output	16	FY0 to FYF	Hexadecimal		Page 377,
Internal system	device					Cannot be	Section 4.3.1 Page 379,
device		Special relay	2048	SM0 to SM2047	Decimal	changed.	Section 4.3.2
		Function register	5	FD0 to FD4	Decimal		Page 377,
	Word		5		Decimal		Section 4.3.1
	device	Special register	2048	SD0 to SD2047	Decimal		Page 379, Section 4.3.3
		Link input	16384	Jn\X0 to Jn\X3FFF	Hexadecimal		
	Bit	Link output	16384	Jn\Y0 to Jn\Y3FFF	Hexadecimal		
	device	Link relay	32768	Jn\B0 to Jn\B7FFF	Hexadecimal	Cannot be	Page 380,
Link direct device		Link special relay	512	Jn\SB0 to Jn\S1FF	Hexadecimal	changed.	Page 380, Section 4.4
	Word	Link register	131072	Jn\W0 to Jn\W1FFFF	Hexadecimal	5	
	device	Link special register	512	Jn\SW0 to Jn\SW1FF	Hexadecimal		

Classification	ation Type Name Default					Parameter-	Reference	
Classification	Туре	Name	Point	Range		set range	Reference	
		Intelligent function module device	65536	Un\G0 to Un\G65535 ^{*2}	Decimal	Cannot be changed.	5 004	
Module access device	Word device	Cyclic transmission	4096	U3En\G0 to U3En\G4095	Decimal	Cannot be changed.	Page 384, Section 4.5	
		area device ^{*4}	14336	U3En\G10000 to U3En\G24335	Decimal	Can be changed.		
Index register or standard device register	Word device	Index register or standard device register	20	Z0 to Z19	Decimal	Cannot be changed.	Page 387, Section 4.6	
File register	Word device	File register	0	-	-	Can be	Page 392, Section 4.7	
Extended data register	Word device	Extended data register	0	-	-	changed. (in increments of	Page 402, Section 4.8	
Extended link register	Word device	Extended link register	0	-	-	1K) ^{*6}	Page 402, Section 4.8	
Nesting	-	Nesting	15	N0 to N14	Decimal	Cannot be changed.	Page 407, Section 4.9	
Pointer		Pointer	4096	P0 to P4095	Decimal	Cannot be	Page 408, Section 4.10	
Folitei	-	Interrupt pointer	256	10 to 1255	Decimal	changed.	Page 412, Section 4.11	
	Bit device	SFC block device	320	BL0 to BL319	Decimal		Page 415, Section 4.12.1	
Others		Network No. specification device	255	J1 to J255	Decimal	Cannot be	Page 415, Section 4.12.2	
Others	-	I/O No. specification device	516	U0 to U1FF, U3E0 to U3E3	Hexadecimal	changed.	Page 416, Section 4.12.3	
		Macro instruction argument device	10	VD0 to VD9	Decimal		Page 416, Section 4.12.4	
		Decimal constant		K-2147483648 to	K2147483647		Page 417, Section 5.1	
		Hexadecimal constant		H0 to HFFI	FFFFF		Page 417, Section 5.2	
Constant	-	_	E	Single-precision flo E ± 1.17549435 — 38 to	0.1		Page 418, Section 5.3	
		Real number constant		5.	Page 418, Section 5.3			
		Character string constant	ι	Jp to 32 characters, suc	h as "ABC" and	"123"	Page 419, Section 5.4	

- *1 These devices are used as a bit device for contacts and coils, and as a word device for controlling the present value.
- *2 The number of points that can be actually used varies depending on intelligent function modules. For the number of buffer memory points, refer to the manual for the intelligent function module used.
- *3 The setting range differs depending on the CPU module.
 - Q03UDVCPU: 30K words
 - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 40K words
 - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 60K words
 - When changing device points, refer to Page 345, Section 4.2 (1), the parts describing the precaution.
- *4 Available only in multiple CPU systems.
- *5 Up to 15 digits can be entered in a programming tool.
- *6 This is the total number of points for the file register, extended data register (D), and extended link register (W). The number of points differs depending on the CPU module. (The following is the number of points when an extended SRAM cassette (8M bytes) is used.)
 - Q03UDVCPU: 4192K points
 - Q04UDVCPU, Q04UDPVCPU: 4224K points
 - Q06UDVCPU, Q06UDPVCPU: 4480K points
 - Q13UDVCPU, Q13UDPVCPU: 4608K points
 - Q26UDVCPU, Q26UDPVCPU: 4736K points
 - The number of points differs depending on the CPU module.
 - Q03UDVCPU: 9216K points

*7

*9

- Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 15360K points
- Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 28672K points
- *8 The setting range differs depending on the CPU module.
 - Q03UDVCPU: M0 to M9215
 - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: M0 to M15359
 - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: M0 to M28671
 - The number of points differs depending on the CPU module.
 - Q03UDVCPU: 13312 points
 - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 22528 points
 - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 41984 points
- *10 The setting range differs depending on the CPU module.
 - Q03UDVCPU: D0 to D13311
 - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: D0 to D22527
 - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: D0 to D41983

4.2 Internal User Devices

Internal user devices can be used for various user applications.

(1) Points for internal user devices

The device points can be changed in the Device tab of the PLC parameter dialog box.

Q.	Parameter Setti	ng									
F	PLC Name PLC Sys	tem PLC	File PL	C RAS BO	ot File Pro	ogram SP	C Devic	e I/O Ass	ignment Mult	iple CPU Setti	ng Built-In Ethernet Port Setting
		Sym. Dig.	Device Points					th (2) nd Loc	al Device Start	Local Devic	e End
	Input Relay	X 16	8K								
	Output Relay	Y 16	8K								
	Internal Relay	M 10	15K)							
	Latch Relay	L 10	8K								
	Link Relay	B 16	8K	_				_			
	Annunciator	F 10	2K	_							
	Link Special	58 16	2K								
Most of the default device	Edge Relay	V 10	2K	-1				_		-	
			8K								
points can be changed.	Timer Retentive Timer	T 10 ST 10	2K 0K		-	-					
	Counter	C 10	UK								
	Data Register	D 10	22K		-		-				
	Link Register	W 16	8K				-	-			
	Link Special	SW 16	2K								
	Index	Z 10									
	Device Total Word Device Bit Device	35.0	K Wor K Wor K Bits	us Lato Lato ds Scal If th	:h(1) : Able :h(2) : Unat n time is ex ne latch is n	to clear the ble to clear tended by l ecessary, p	the latch rai blease set t	ising latch o y using latc nge setting he required	clear.	range,	uted by program. ameter.
		Cap	acity [K Points						
		Sym.	Dig.	Device L Points	atch (1) Start	Latch (1) End	Latch (2) Start	Latch (2) End	Device No. Start	Device No. End	Following setting are available when select "Use the following file" in file register setting of PLC file setting.
	File Register	ZR(R									Change of latch(2) of file register. Assignment to expanded data
	Extended Dat		10								register/expanded link register of a part
	Extended Lin	W .	16								of file register area.
	Indexing Setting	for Device			Latch	Interval Se	tting				
	32Bit Indexing				(• T	ime Setting			When time	setting is sele	cted, latch by specified time
	C Use Z Z		-				0 ms (1	to 2000ms	END proces) has passed	sing arter the	speaned time
		1					(1	0 2000115	, passed		
	Use ZZ				C P	er Scan					
Ī	Print Window	Print W	ndow Pr	eview		Acknow	ledge XY A	ssignment	Default		neck End Cancel

When changing device points, note the following.

- The number of points for the input (X), output (Y), and step relay (S) PNote 4.1 PNote 4.3 cannot be changed.
- · Set points for each device in increments of 16.
- · The total number of internal user device points differs depending on the CPU module.

(Page 336, Section 4.1)

• The maximum number of points for bit devices is 32K.

For the internal relay and link relay, the number of points can be set up to 60K. PNote 4.2

• For the timer (T), retentive timer (ST), or counter (C), one point includes one point of a word device and two points of a bit device. (

Note 4.1 Universal

For the Universal model QCPU whose serial number (first five digits) is "10042" or later, the step relay (S) points can be changed to 0K. (



Universal

Universal

This applies to the Universal model QCPU whose serial number (first five digits) is "10042" or later.

P Note 4.3

For the Universal model QCPU whose serial number (first five digits) is "12052" or later, the points for the step relay (S)

can be set up to the following points in increments of 1K. (

•Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 8192 points

•Universal model QCPU other than the Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 16384 points

Point *P*

- When changing device points, the following refresh ranges must not exceed the corresponding device ranges.
 Refresh range of network module
 - Refresh range of CC-Link IE Field Network Basic
 - Auto refresh range of intelligent function module

If device points are set exceeding the corresponding device range, data may be written to any other device or an error may occur.

- The total number of points for the internal relay, latch relay, annunciator, edge relay, link relay, link special relay, step relay, timer, retentive timer, and counter must be set within the following range.
 - Serial number (first five digits) of the Universal model QCPU is "10041" or earlier: Up to 64K points
 - Serial number (first five digits) of the Universal model QCPU is "10042" or later: Not limited
- If the device points of the internal user devices are changed and the parameters are written from the "Write to PLC" screen, the device address may be shifted and does not correspond to the original stored value. Because the shifted value might be used for the operation, the following files, which are created by using the parameters before the device point change, cannot be used under existing condition.
 - Sequence program files
 - SFC program files
 - Structured text program files

When change the device points of the internal user devices, perform the following operations from a programming tool. [Before changing the device points of the internal user devices]

Read devices to be used and each program from the CPU module.

[After the device points of the internal user devices are changed]

Write the devices and each program, which were read before the device point change, to the CPU module.

For the read/write of devices and programs, refer to the following.

(2) Memory size

Set the internal user devices so that the following condition is satisfied.

(Bit device size) + (Timer, retentive timer, and counter sizes) + (Word device size) \leq Total number of internal user device points

(a) Bit device

For bit devices, 16 points are calculated as one word.

(Bit device size) =
$$\frac{(X+Y+M+L+B+F+SB+V+S)}{16}$$
 words

(b) Timer (T), retentive timer (ST), and counter (C)

For the timer (T), retentive timer (ST), and counter (C), 16 points are calculated as 18 words.

(Timer, retentive timer, or counter size) =
$$\frac{(T+ST+C)}{16} \times 18$$
 words

(c) Word device

For the data register (D), link register (W), and link special register (SW), 16 points are calculated as 16 words.

(Word device size) =
$$\frac{(D+W+SW)}{16} \times 16$$
 words

(3) Device point assignment example

The following table shows device point assignment examples based on the device point assignment sheet in Page 575, Appendix 10.

Device name	Symbol	Numeric	Number of	Number of device point ^{*2}		Restrictio	tion check		
Device name	Symbol	notation	Points	Range	Siz	ze (words) ^{*3}	Р	oints (bits) ^{*2}	
Input relay ^{*1}	х	Hexadecimal	8K (8192)	X0000 to X1FFF	/16	512	×1	8192	
Output relay ^{*1}	Y	Hexadecimal	8K (8192)	Y0000 to Y1FFF	/16	512	×1	8192	
Internal relay	М	Decimal	16K (16384)	M0 to M16383	/16	1024	×1	16384	
Latch relay	L	Decimal	4K (4096)	L0 to L4095	/16	256	×1	4096	
Link relay	в	Hexadecimal	4K (4096)	B0000 to B0FFF	/16	256	×1	4096	
Annunciator	F	Decimal	1K (1024)	F0 to F1023	/16	64	×1	1024	
Link special relay	SB	Hexadecimal	2K (2048)	SB0000 to SB07FF	/16	128	×1	2048	
Edge relay	V	Decimal	1K (1024)	V0 to V1023	/16	64	×1	1024	
Step relay ^{*1}	s	Decimal	8K (8192)	S0 to S8191	/16	512	×1	8192	
Timer	т	Decimal	2K (2048)	T0 to T2047	$\times \frac{18}{16}$	2304	×2	4096	
Retentive timer	ST	Decimal	2K (2048)	ST0 to ST2047	$\times \frac{18}{16}$	2304	×2	4096	
Counter	с	Decimal	1K (1024)	C0 to C1023	$\times \frac{18}{16}$	1152	×2	2048	
Data register	D	Decimal	14K (14336)	D0 to D14335	×1	14336		-	
Link register	w	Hexadecimal	4K (4096)	W0000 to W4095	×1	4096		-	
Link special register	sw	Hexadecimal	2K (2048)	SW0000 to SW07FF	×1	2048		-	
Total						29568		63488	
						(29696 or less)		(65536 or less)	

*1 The points are fixed for the system. (Cannot be changed)

*2

The points for the step relay can be changed to 0 if the Universal model QCPU whose serial number (first five digits) is "10042" or later.

For the Universal model QCPU whose serial number (first five digits) is "12052" or later, a step relay can be set in

increments of 1k point and up to the following points. ([] Page 467, Appendix 2)


• Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 8192 points

• Universal model QCPU other than the Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 16384 points Up to 32K points can be set for each device.

However, up to 60K points can be set for each device of the internal relay and link relay if the Universal model QCPU whose serial number (first five digits) is "10042" or later,


*3 Enter the values multiplied (or divided) by the number shown in the Size (words) column.

The input (X) is used to send commands or data to the CPU module from external devices such as push-button switches, selector switches, limit switches, and digital switches.




(1) Concept of input (X)


One input point is assumed to be a virtual relay Xn in the CPU module. Programs use the normally open or closed contact of Xn.

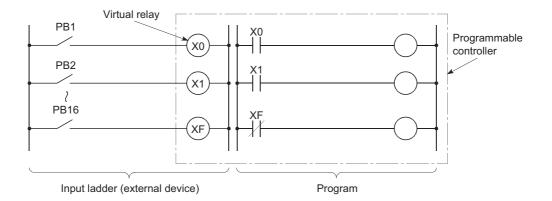

(2) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts of Xn used in a program, as long as the program capacity is not exceeded.



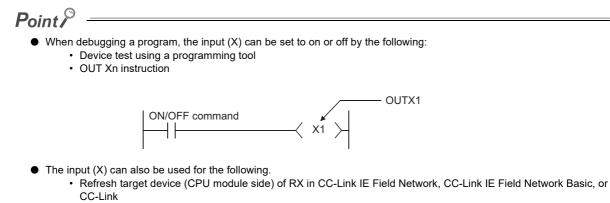


• Refresh target device (CPU module side) of CC-Link IE Controller Network or MELSECNET/H

4.2.2 Output (Y)


The output (Y) is used to output control results on programs to external devices such as signal lamps, digital displays, electromagnetic switches (contactors), or solenoids.

Data can be output to the outside like using a normally open contact.




(1) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts of Yn used in a program, as long as the program capacity is not exceeded.

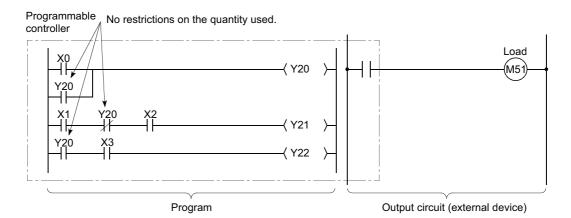

(2) Using the output (Y) as the internal relay (M)

The output (Y) corresponding to the slots for input modules or empty slots can be utilized as the internal relay (M).

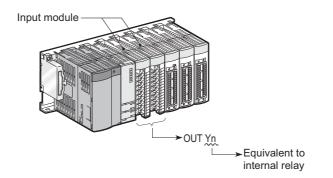

4.2.3 Internal relay (M)

The internal relay (M) is a device for auxiliary relays used in the CPU module.

All of the internal relays are set to off in the following cases:


- · When the CPU module is powered on from off
- When the CPU module is reset
- When latch clear is executed (F Page 124, Section 3.3 (7))

(1) Latch (data retention during power failure)

The internal relay cannot be latched.

(2) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts used in a program, as long as the program capacity is not exceeded.

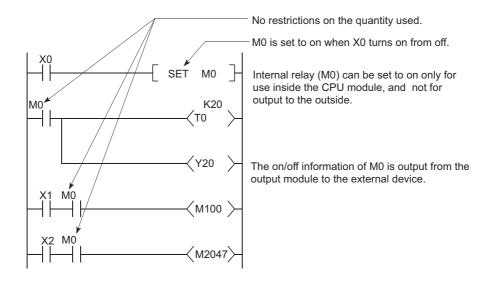

(3) Method for external output

The output (Y) is used to output sequence program operation results to external devices.

Point *P*

Use the latch relay (L) when latch (data retention during power failure) is required. (FF Page 352, Section 4.2.4)

The latch relay (L) is a device for auxiliary relays that can be latched inside the CPU module.

Latch relay data are retained by batteries in the CPU module during power failure.

Operation results (on/off information) immediately before the following will be also retained.

- · Powering off and then on the CPU module
- · Resetting the CPU module


(1) Latch relay clear

The latch relay is turned off by the latch clear operation. (France Page 124, Section 3.3 (7))

However, the latch relay set in "Latch (2) Start/End" in the Device tab of the PLC parameter dialog box cannot be turned off even by a latch clear operation.

(2) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts used in a program, as long as the program capacity is not exceeded.

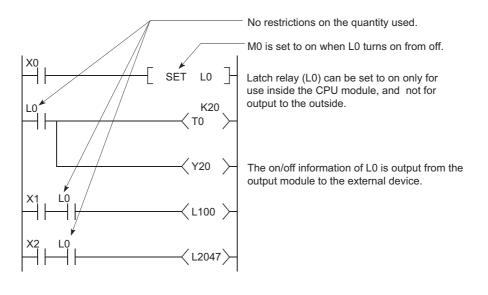

Point P

Scan time is prolonged when the latch relay (L) is used. Reducing the points of latch relay (L) can reduce the prolonging scan time. (

(3) Method for external output

The output (Y) is used to output sequence program operation results to external devices.

Point *P*

- If latch is not required, use the internal relay (M). (
- The latch clear invalid area is set in the Device setting of PLC parameter. (

4.2.5 Annunciator (F)

The annunciator (F) is an internal relay that can be effectively used in fault detection programs for a user-created system. When any annunciator turns on, SM62 turns on, and the number of annunciators turned on and the corresponding numbers are stored in SD62 to SD79. The annunciator number stored in SD62 is also registered to the error history area.


Special relay/special register	Description					
SM62	Turns on even if only one of the annunciator number areas is turned on.					
SD62	Stores the number of the annunciator that was turned on first.					
SD63	Stores the quantity of the annunciator number areas that are on.					
SD64 to SD79	Stores annunciator numbers in the order of turning on. (The same annunciator number is stored in SD62 and SD64.)					

(1) Applications of the annunciator

Using the annunciator in a fault detection program allows check for a system fault and identification of the fault (annunciator number) by monitoring the special register (SD62 to SD79) when the special relay (SM62) turns on.



In this program, when annunciator (F5) is turned on, the corresponding annunciator number is output to the outside.

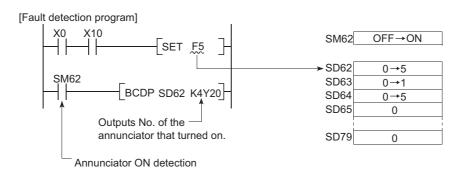

(2) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts used in a program, as long as the program capacity is not exceeded.

(3) Turning on the annunciator and processing

(a) Turning on the annunciator

The following instructions can be used.

SET F□ instruction

The SET F \square instruction can be used to turn on the annunciator only on the leading edge (off to on) of an input condition. Even if the input condition turns off, the annunciator is held on. Using many annunciator numbers can shorten scan time more than using the OUT F \square instruction.

OUT F□ instruction

The OUT F \square instruction can be also used to turn on or off the annunciator. However, since the processing is performed for every scan, the scan time is longer than the case of using the SET F \square instruction. In addition, execution of the RST F, LEDR, or BKRST instruction is required after the annunciator is turned off with the OUT F \square instruction. Therefore, use of the SET F \square instruction is recommended.


Point P

If the annunciator is turned on with any instruction other than SET F^{\Box} and OUT F^{\Box} (for example, the MOV instruction), the same operation as the internal relay (M) is performed.

The ON information is not stored in SM62, and annunciator numbers are not stored in SD62 and SD64 to SD79.

(b) Processing after annunciator on

- 1. Data stored in the special register (SD62 to SD79)
 - Turned-on annunciator numbers are stored in SD64 to SD79 in order.
 - The annunciator number in SD64 is stored in SD62.
 - · SD63 value is incremented by "1".

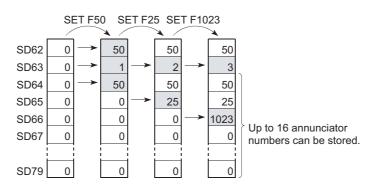

2. Processing on the CPU

The USER LED on the front side turns on (red).

3. On/off setting for the LED

Whether to turn on the USER.LED or not when the annunciator is turned on can be set in the LED indication setting. (FP Page 223, Section 3.20.2).

(4) Turning off the annunciator and processing

(a) Turning off the annunciator

The following instructions can be used.

RST F
 instruction

This is used to turn off the annunciator number that was turned on with the SET F instruction.

LEDR instruction

This is used to turn off the annunciator number stored in SD62 and SD64.


- BKRST instruction This is used to turn off all of the annunciator numbers within the specified range.
- OUT F[□] instruction

One annunciator number can be turned on or off with the same instruction.

However, even if an annunciator number is turned off with the OUT F instruction, the off processing described in Page 356, Section 4.2.5 (4) (b) is not performed.


If the annunciator is turned off with the OUT F[⊡] instruction, execution of the RST F[□], LEDR, or BKRST instruction is required.

Ex. Turning off annunciator 5 (F5)



Program that turns off annunciator 5 (F5)

Ex. Turning off all of the turned-on annunciator numbers



Program that turns off F0 to F9


For details of each instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)


(b) Processing after annunciator off

1. Data stored in the special register (SD62 to SD79) after execution of the LEDR instruction

- The annunciator number in SD64 is deleted, and the other annunciator numbers in the register addressed SD65 and after are shifted accordingly.
- The annunciator number in SD64 is stored into SD62.
- SD63 value is decremented by "1".
- If the SD63 value is changed to "0", SM62 is turned off.



- 2. Data stored in the special register (SD62 to SD79) when the annunciator is turned off with the RST F□ or BKRST instruction
 - The annunciator number specified with the RST or BKRST instruction is deleted, and the other annunciator numbers in the register addressed SD65 and after are shifted accordingly.
 - If the existing annunciator number in SD64 is turned off, a new annunciator number stored in SD64 will be stored in SD62.
 - SD63 value is decremented by "1".
 - If the SD63 value is changed to "0", SM62 is turned off.

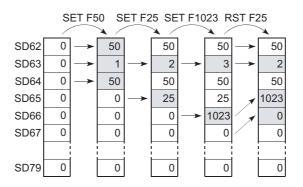


3. LED indication

When all of the annunciator numbers in SD64 to SD79 turn off, the LED that was turned on by turn-on of the annunciator will turn off. (\Box Page 354, Section 4.2.5 (3) (b))

Point P


4.2.6 Edge relay (V)

The edge relay (V) is a device in which the on/off information of contacts from the beginning of the ladder block is memorized. The device can be used only as contacts (cannot be used as coils).




(1) Applications of the edge relay

The edge relay can be utilized to detect the leading edge (off to on) in programs configured using index modification.

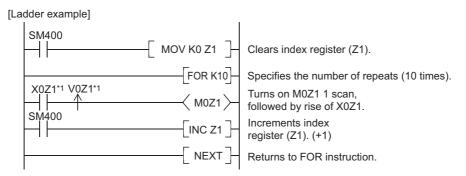


*1 The on/off information for X0Z1 is stored in the V0Z1 edge relay. For example, the on/off information of X0 is stored in V0, and that of X1 is stored in V1.

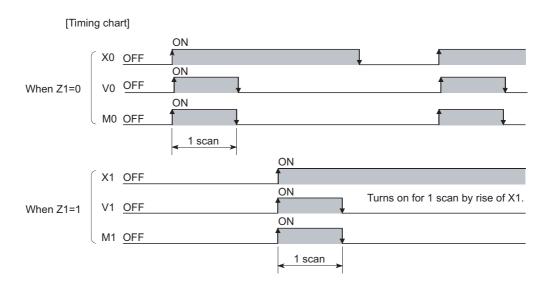

(2) Precautions


The edge relay of the same number cannot be used more than one time in a program.

The link relay (B) is a relay on the CPU module side, and it is used for refreshing the link relay (LB) data of another module such as a MELSECNET/H network module to the CPU module or refreshing the CPU module data to the link relay (LB) of the MELSECNET/H network module.

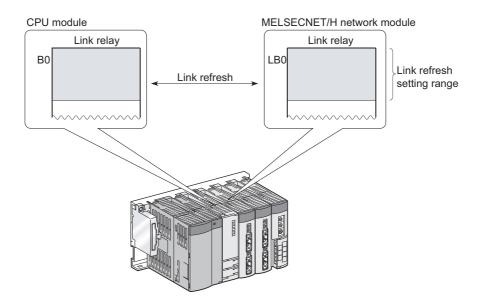

(1) Allowable number of normally open or closed contacts

There are no restrictions on the number of normally open or closed contacts used in a program, as long as the program capacity is not exceeded.

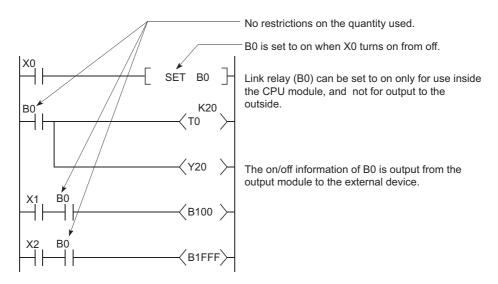

(2) Using the link relay in the network system

Network parameters must be set.

The link relay range areas that are not set by network parameters (not used for a network system such as a MELSECNET/H network) can be used as the internal relay or latch relay.

- Link relay range where no latch is performed ••••••Internal relay
- Link relay range where latch is performed ••••••Latch relay

Point P

To use the link device in the network module exceeding link relay points of the CPU module (default: 8192 points), change the link relay points in the Device tab of the PLC Parameter dialog box.

4.2.8 Link special relay (SB)

The Link special relay (SB) is a relay that indicates various communication status and detected errors of intelligent function modules such as CC-Link IE module or MELSECNET/H module.


Each of this device area is turned on or off according to a factor occurred during data link.

The communication status and errors on the network can be confirmed by monitoring the link special relay (SB).

(1) Number of link special relay points

The points for the link special relay in the CPU module is 2048. (SB0 to SB7FF).

However, the points can be changed in the Device tab of the PLC parameter dialog box. (FPP Page 447, Appendix 1.2.8) To an intelligent function module that has a link special relay, such as a CC-Link IE module or MELSECNET/H module, 512 points are assigned. Assigning the link special relay as shown in below allows refresh of the CC-Link link special relay (SB) to the link special relay (SB) of the CPU module.



For details of the link special relay, refer to the manual for an intelligent function module that has the link special relay.

4.2.9 Step relay (S)

This device is provided for SFC programs. For how to use the step relay, refer to the following manual.

MELSEC-Q/L/QnA Programming Manual (SFC)

Point/

Because the step relay is a device exclusively used for SFC programs, it cannot be used as an internal relay in the sequence program.

If used, an SFC error will occur, and the system may go down.

4.2.10 Timer (T)

Time counting starts when a coil is turned on, and it times out and the contact turns on when the current value reaches the set value.


The timer is of an incremental type.

(1) Timer types

Timers are mainly classified into the following two types.

- 1) Timer of which value is set to 0 when the coil is turned off.
- 2) Retentive timer that holds the current value even if the coil is turned off.

Also, low-speed and high-speed timers are included in timer 1), and low-speed and high-speed retentive timers are included in timer 2).



(2) Specification of the timer

• The same device is used for the low- and high-speed timers, and the type is determined according to the instruction used.

Ex. For the OUT T0 instruction, the low-speed timer is specified, and for the OUTH T0 instruction, the high-speed timer is specified.


 The same device is used for the low- and high-speed retentive timers, and the type is determined according to the instruction used.

Ex. For the OUT ST0 instruction, the low-speed retentive timer is specified, and for the OUTH ST0 instruction, the high-speed retentive timer is specified.

(3) Low-speed timer

This type of timer measures time in increments of 1 to 1000ms.

The timer starts time measurement when its coil is turned on, and when it times out, the contact is turned on. If the timer's coil is turned off, the current value is changed to "0" and the contact is turned off.

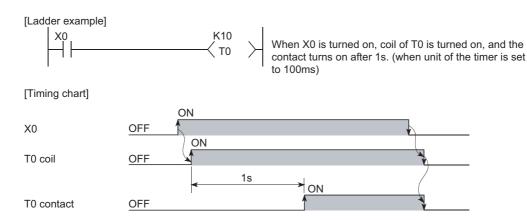

(a) time increment setting


The time increment is set in the PLC system tab of the PLC parameter dialog box. The default is 100ms, and it can be changed in increments of 1ms.



(4) High-speed timer

This type of timer measures time in increments of 0.01 to 100ms.

The timer starts time measurement when its coil is turned on, and when it times out, the contact is turned on. If the timer's coil is turned off, the current value is changed to "0" and the contact is turned off.

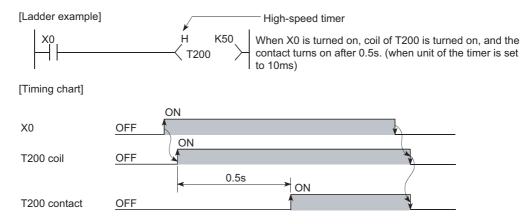

(a) Time increment setting

The time increment is set in the PLC system tab of the PLC parameter dialog box. The default is 10.0ms, and it can be changed in increments of 0.01ms.




(5) Retentive timer

This timer measures the period of time during which the coil is on.

The timer starts time measurement when its coil is turned on, and when it times out, the contact is turned on. Even if the timer's coil is turned off, the current value and the on/off status of the contact are retained. When the coil is turned on again, the measurement restarts from the retained current value.

(a) Retentive timer clear

The current value and the contact off status can be cleared with the RST ST^[] instruction.

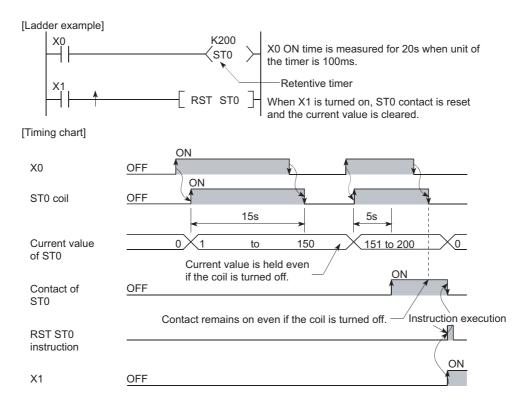

(b) Time increment setting

The time increment is set in the same manner as the corresponding low- or high-speed timer.

- · Low-speed retentive timer: Low-speed timer
- · High-speed retentive timer: High-speed timer

Point *P*

To use a retentive timer, set the points for it in the Device tab of the PLC parameter dialog box.

(6) Timer processing and accuracy


(a) Processing

When the OUT T^[] or OUT ST^[] instruction is executed, the on/off switching of the timer coil, current value update, and on/off switching of the contact are performed.

In the END processing, the current timer value is not updated and the contact is not turned on/off.




[Processing at execution of OUT T0 instruction]



(b) Accuracy

The value obtained by the END instruction is added to the current value when the OUT T \square or OUT ST \square instruction is executed.

The current value is not updated while the timer coil is off even if the OUT T \square or OUT ST \square instruction is executed.

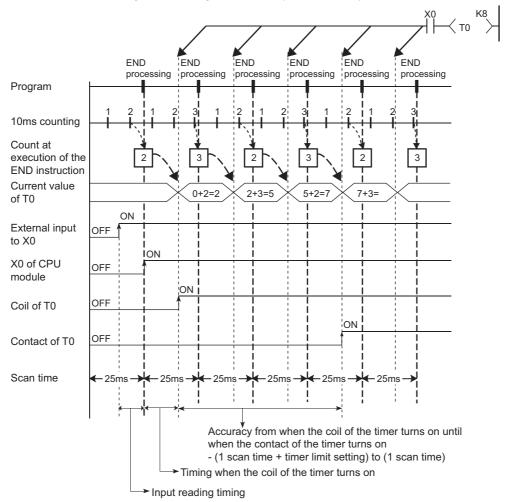

Timer limit setting=10ms, Setting value of T0=8 (10ms×8=80ms), Scan time=25ms


Accuracy of the timer response that is from reading input (X) to output the data is up to "2-scan time + timer limit setting".

(7) Precautions for using timers

(a) Use of the same timer

Do not use the OUT T[□] instruction that describes the same timer more than once within one scan.

If this occurs, the current timer value will be updated by each OUT T instruction execution, resulting in incorrect time measurement.



(b) When the timer is not executed in every scan

While a coil of a timer (for example. T1) is on, do not make the OUT T1 instruction jumped to any other part with another instruction such as CJ.

If jump of the OUT TD instruction has occurred, the current timer value is not updated.

Also, if a timer exists in a subroutine program, execute a subroutine call including the OUT T1 instruction once in each scan while the coil of the timer (for example, T1) is on.

Failure to do so will not update the current timer value.

(c) Programs that cannot use timers


Timers cannot be used in interrupt programs and fixed scan execution programs.

(d) When the set value is 0

The contact turns on when the OUT T^{\square} instruction is executed.


(e) Timer setting value and timer limit setting

Set the timer to meet the following condition:




If the values are set to become "Timer setting value < Scan time + Timer Limit Setting", the coil and the contact might be simultaneously turned on depending on the timing on which the coil is turned on. If the setting does not meet the above condition, make the value of the timer limit setting smaller to meet the condition.

Ex. Make the value of the timer limit setting smaller by changing from low speed timer to high speed timer. (Assume that the scan time is 20ms.)

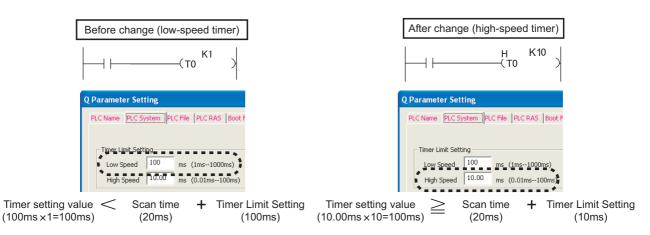


The following show the examples of the coil and the contact being simultaneously turned on if the values are set to become "Timer setting value < Scan time + Timer Limit Setting":

Ex. When the timer setting value is 1 (1 × 100ms), the scan time is 20ms, and the timer limit setting is 100ms If the coil of the timer (T0) is turned on at the next scan after the values satisfy "Count at execution of the END instruction ≥ Timer setting value", the coil and the contact are simultaneously turned on because the values satisfy "Timer current value = Timer setting value" at the start of the timer.

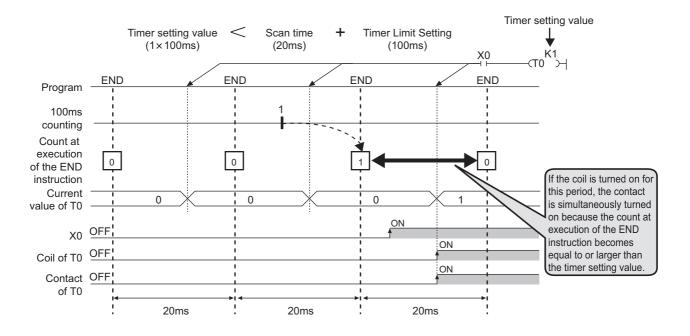

Ex. When the timer setting value is 2 (2 × 100ms), the scan time is 110ms, and the timer limit setting is 100ms If the coil of the timer (T0) is turned on at the next scan after the values satisfy "Count at execution of the END instruction ≥ Timer setting value", the coil and the contact are simultaneously turned on because the values satisfy "Timer current value = Timer setting value" at the start of the timer.

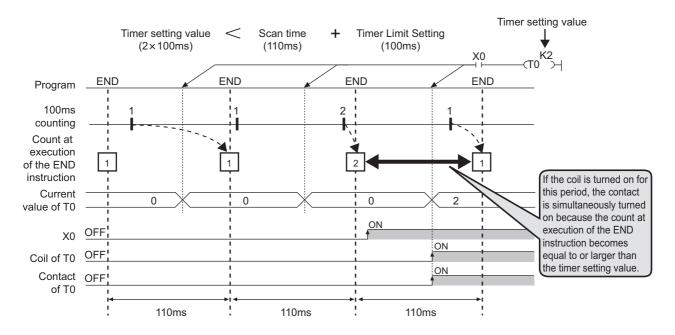

(f) When the set value is changed after time-out


Even if the set value is changed to a larger value after time-out of the timer, the timer remains timed-out and does not start the operation.


(g) When using multiple timers

When using multiple timers to update the respective current values at execution of each OUT T^O instruction, pay attention to the ladder sequence.

Ex. Creating an on/off ladder using two timers


[Correct ladder example]




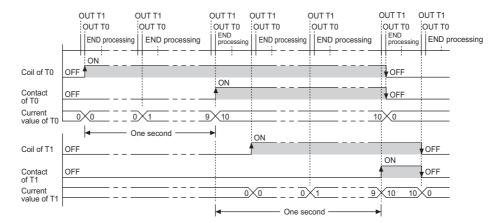

[Incorrect ladder example]

Coil of T1 is turned on within the same scan in which T0 was turned on.



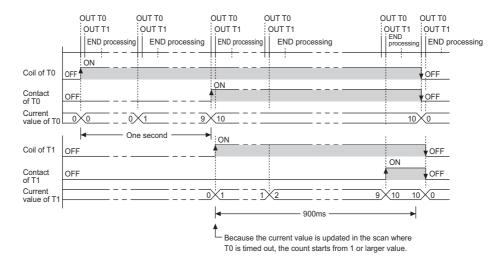

4.2.11 Counter (C)

The counter (C) is a device that counts the number of rises for input conditions in sequence programs. When the count value matches the set value, the counting stops and its contact is turned on. The counter is of an incremental type.

(1) Counter type

The following counter is available.

· Counter that counts the number of rises for input conditions in sequence programs

(2) Counting


(a) When the OUT C instruction is executed

The coil of the counter is turned on/off, the current value is updated (the count value + 1), and the contact is turned on.

In the END processing, the current counter value is not updated and the contact is not turned on.




[Processing at OUT C0 Instruction (X0: OFF to ON)]



(b) Current value update (count value + 1)

The current value is updated (count value + 1) at the leading edge (OFF \rightarrow ON) of the OUT C \Box instruction. The current value is not updated while the coil is off, or when it remains on or turns off from on by the OUT C \Box instruction.

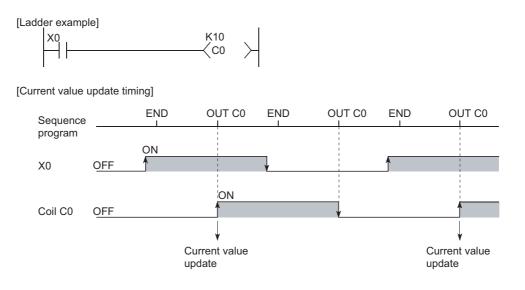


(c) Resetting the counter

The current counter value is not cleared even if the OUT C II instruction is turned off.

To clear the current value and to turn off the contact of the counter, use the RST C instruction.

At the time of execution of the RST C \square instruction, the counter value is cleared, and the contact is also turned off.

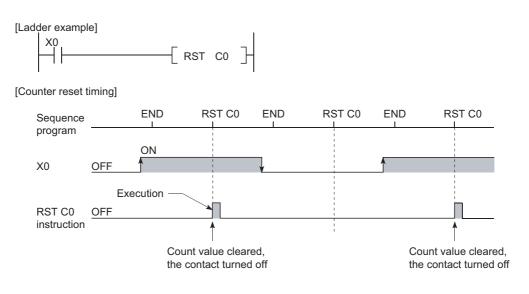


[Precautions for resetting the counter]

Execution of the RST C \square instruction also turns off the coil of C \square .


If the execution condition for the OUT C instruction is still ON after execution of the RST C instruction,

turn on the coil of C[□] at execution of the OUT C[□] instruction and update the current value (count value + 1).




In the above ladder example, when M0 turns on from off, the coil of C0 turns on, updating the current value. When C0 reaches the preset value finally, the contact of C0 turns on, and execution of the RST C0 instruction clears the current value of C0. At this time, the coil of C0 also turns off.

If M0 is still on in the next scan, the current value is updated since the coil of C0 turns on from off at execution of the OUT C0 instruction. (The current value is changed to 1.)

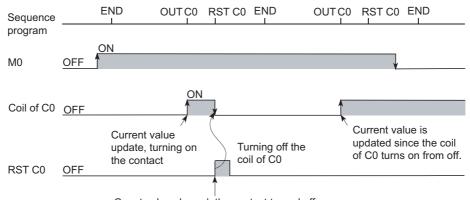

Count value cleared, the contact turned off

To prevent the above, it is recommended to add a normally closed contact of the OUT C0 instruction execution to the condition for the RST C0 instruction execution so that the coil of C0 does not turn off while the execution condition (M0) of the OUT C0 instruction is on.



(d) Maximum counting speed


The counter can count only when the on/off time of the input condition is longer than the execution interval of the corresponding OUT C \Box instruction.

The maximum counting speed is calculated by the following expression:

Maximum counting speed (Cmax) = $\frac{n}{100} \times \frac{1}{T}$ [times/s] • n: Duty (%)^{*1} • T: Execution interval of the OUT C \Box instruction (sec)


*1 Duty (n) is the ON-OFF time ratio of count input signal, and is expressed as a percentage value

When T1 \ge T2, n = $\frac{T2}{T1+T2} \times 100\%$ When T1 < T2, n = $\frac{T1}{T1+T2} \times 100\%$



Point P

The maximum counting speed can be increased by placing multiple counters within one scan. At this time, use the direct access input (DX^{\Box}) (\bigcirc Page 80, Section 2.8.2) for the counter input signal.



(3) Precautions

(a) When counting processing is suspended

If an interrupt occurs during execution of the processing shown below, counting is suspended until the execution of each processing is completed.

- · Each instruction on the sequence program
- Interrupt program
- · Fixed scan execution type program

Upon completion of the processing, the counting restarts.

However, if the same interrupt occurs again during each processing, these interrupts are counted as once.

4.2.12 Data register (D)

The data register (D) is a memory in which numeric data (-32768 to 32767, or 0000_{H} to FFFF_H) can be stored.

(1) Bit structure of the data register

(a) Bit structure and read/write unit

One point of the data register consists of 16 bits, and data can be read or written in units of 16 bits.



Point /

Data register data are handled as signed data.


In the case of the hexadecimal notation, 000_{H} to FFFF_H can be stored. However, because the most significant bit represents a sign bit, decimal values that can be specified are -32768 to 32767.

(b) When using a 32-bit instruction for the data register

For a 32-bit instruction, two consecutive points of the data register (D_n and D_{n+1}) are the target of the processing.

The lower 16 bits correspond to the data register number (Dn) specified in the sequence program, and the higher 16 bits correspond to the specified data register number + 1.

Ex. When D12 is specified in the DMOV instruction, D12 represents the lower 16 bits and D13 represents the higher 16 bits.




Data of -2147483648 to 2147483647 or 0000000_{H} to FFFFFFF_H can be stored in a two-point area of the data register. (The most significant bit in a 32-bit structure is a sign bit.)

(2) Retention of stored data

The data stored in the data register are held until other different data are stored. Note that the stored data are initialized when the CPU module is powered off or reset.

4.2.13 Link register (W)

The link register (W) is a memory in the CPU module, which is refreshed with link register (LW) data of an intelligent function module such as a MELSECNET/H network module.

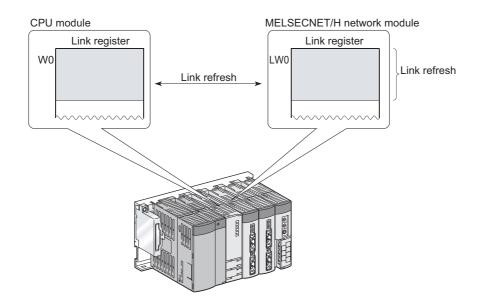

In the link register, numeric data (-32768 to 32767, or 0000_{H} to FFFF_H) are stored.

(1) Bit structure of the link register

(a) Bit structure and read/write unit

One point of the link register consists of 16 bits, and data can be read or written in units of 16 bits.



Point /

Link register data are handled as signed data.


In the case of the hexadecimal notation, 0000_{H} to FFFF_H can be stored. However, because the most significant bit represents a sign bit, decimal values that can be specified are -32768 to 32767.

(b) When using a 32-bit instruction for the link register

For a 32-bit instruction, two consecutive points of the data register (Wn and Wn+1) are the target of the processing.

The lower 16 bits correspond to the link register number (Wn) specified in the sequence program, and the higher 16 bits correspond to the specified link register number + 1.

Ex. When W12 is specified in the DMOV instruction, W12 represents the lower 16 bits and D13 represents the higher 16 bits.



Data of -2147483648 to 2147483647 or 00000000_{H} to FFFFFFF_H can be stored in a two-point area of the link register. (The most significant bit in a 32-bit structure is a sign bit.)

(2) Retention of stored data

The data stored in the link register are held until other different data are stored. Note that the stored data are initialized when the CPU module is powered off or reset.

Point P

To use the link device in the network module exceeding link register points of the CPU module (default: 8192 points), change the link register points in the Device tab of the PLC Parameter dialog box.

(3) Using the link register in a network system

Network parameters must be set.


The area range that is not set by network parameters can be used as a data register.

The link special register (SW) is used to store communication status data and error data of intelligent function modules, such as CC-Link IE module and MELSECNET/H module.

Because the data link information is stored as numeric data, error locations and causes can be checked by monitoring the link special register.

(1) Number of link special register points

The points for the link special register in the CPU module are 2048 (SW0 to SW7FF). However, the number of points can be changed in the Device tab of the PLC parameter dialog box. (For Page 447, Appendix 1.2.8) The link special register points for intelligent function modules (such as CC-Link IE modules and MELSECNET/H modules) are 512. Assign the link special register points as shown below. This enables data in the link special register (SW) of the CC-Link module to be refreshed to the link special relay (SW) of the CPU module.



For details of the link special register, refer to the manual for each intelligent function module that has the link special register.

4.3 Internal System Devices


Internal system devices are provided for system operations.

The allocations and sizes of internal system devices are fixed, and cannot be changed by the user.

4.3.1 Function devices (FX, FY, FD)

Function devices are used in subroutine programs with argument passing. Data are read or written between such subroutine programs and calling programs, using function devices.

Ex. When FX0, FY1, and FD2 are used in a subroutine program, and if X0, M0, and D0 are specified with a subroutine program call instruction, on/off data of X0 and FY1 are passed to FX0 and M0 respectively, and D0 data are passed to FD2.



(1) Applications of function devices

Because a device in each calling program can be determined by using a function device for subroutine programs, the same subroutine program can be used without considering other calling programs.

(2) Types of function devices

The following three types of function devices are available.

- Function input (FX)
- Function output (FY)
- Function register (FD)

(a) Function input (FX)

- The function input is used to pass on/off data to a subroutine program.
- Bit data specified by a subroutine call instruction with argument passing are fetched into a subroutine program and they are used for operations.
- All bit devices for the CPU module can be used.

(b) Function output (FY)

- The function output is used for passing an operation result (on/off data) in a subroutine program to a calling program.
- · An operation result is stored in the device specified in the subroutine program with argument passing.
- · All bit devices except for input devices of the CPU module (X and DX) can be used.

(c) Function register (FD)

- The function register is used for data writing or reading between a subroutine program and a calling program.
- The CPU module auto-detects the input or output conditions of the function register. Source data are input data of the subroutine program.
- Destination data are output data from the subroutine program.The function register of one point can occupy up to four words.
- Note that, however, the number of words used differs depending on the instruction in the subroutine program.

1) A one-word instruction uses one word only.



2) Two-word instruction uses two words.




3) At a destination using 32-bit multiplication or division, four words are used.



· Word devices of the CPU module can be used.

Point P

In subroutine programs with argument passing, do not use any devices that are used by the function register. If this occurs, function register values will not be normally passed to the calling program.

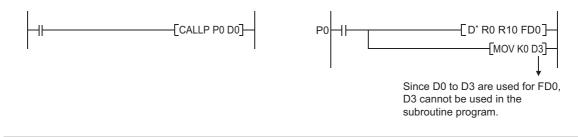

For use of function devices, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

4.3.2 Special relay (SM)

The special relay (SM) is an internal relay whose specifications are determined by the programmable controller. This device stores the CPU module status data. For details, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

4.3.3 Special register (SD)

The special register (SD) is an internal relay whose specifications are determined by the programmable controller. This device stores the CPU module status data (such as error diagnostics and system information). For details, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)


4.4 Link Direct Device

The link direct device is a device for direct access to the link device in a CC-Link IE Controller Network module, CC-Link IE Field Network master/local module or MELSECNET/H module. This CPU module can directly write data to or read data from the link device in each network module using sequence programs, regardless of the link refresh of the CPU module.


(1) Specification method and application example

(a) Specification method

 For a CC-Link IE Controller Network module and MELSECNET/H module, specify the device with a network number and a device number as shown below.

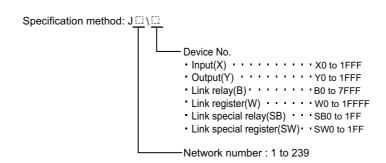


 For a CC-Link IE Field Network master/local module, specify the device with a network number and a device number as shown below.

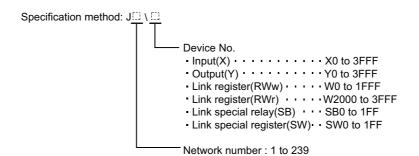


(b) Application example

For link register 10 (W10) of network number 2, "J2\W10" must be used.

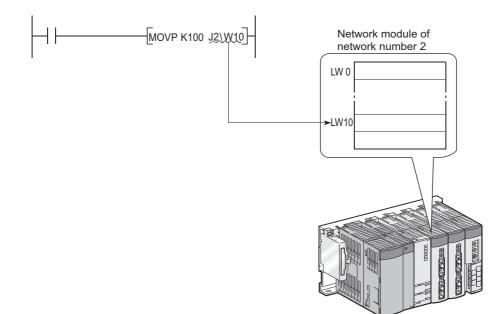

For a bit device (X, Y, B, or SB), the digit must be specified.




(2) Specification range

A link device that is not set in the Network parameter dialog box can be specified.

(a) Writing


• The write range must be within the link device send range that is set by common parameters on Network parameter setting dialog box, and it must be outside the refresh range set by network refresh parameters.

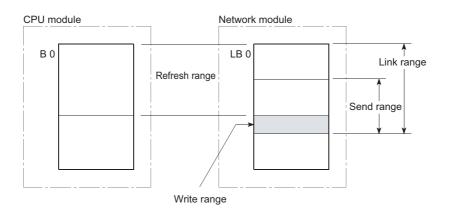

 Although writing can be done to a refresh range portion (specified by refresh parameters) within the link device range, the link module's link device data will be overwritten when a refresh occurs.
 When writing data by using a link direct device, write the same data to the relevant devices on the CPU module side, which are set by refresh parameters.

[Refresh parameter settings]

- 1) Network number: 1
- 2) CPU module (W0 to W3F) ↔ Network module (LW0 to LW3F)

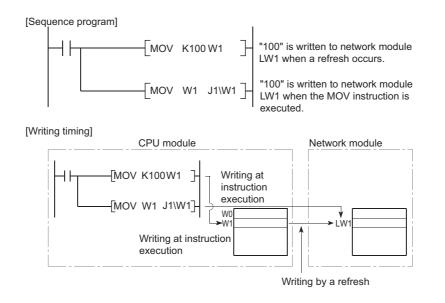

• If data are written to another station's write range using a link direct device, the data will be overwritten with other data that are received from the corresponding station.


(b) Reading

The link device ranges of network modules can be read.

Point P

Writing or reading data by using a link direct device is allowed for only one network module that is on the same network. If two or more network modules are mounted on the same network, a network module with the lowest slot number is the target of writing or reading by the link direct device.

For example, if network modules set as station numbers 1 and 2 are mounted on network number 1 as shown in below, station number 2 is the target of the link direct device.

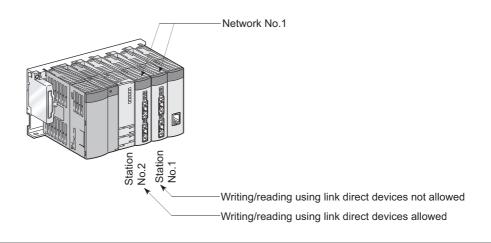

(3) Differences between link direct devices and link refresh

	ltem	Link direct device	Link refresh	
	Link relay	J⊡∖K4B0 or higher	B0 or higher	
Description on programs	Link register	J⊡\W0 or higher	W0 or higher	
	Link special relay	J⊡\K4SB0 or higher	SB0 or higher	
	Link special register	J⊡\SW0 or higher	SW0 or higher	
Number of steps		2 steps	1 step	
Range of network module access		J⊟\⊟0 to J⊟\⊡3FFF Range specified by refresh par		
Guaranteed access data integrity		2 word (32-bit) units		

For network parameters, common parameters, and network refresh parameters, refer to the following.

- Details: Details: Manual for each network module
- Setting method: Derating manual for the programming tool used


4.5.1 Intelligent function module device

The intelligent function module device allows direct access from the CPU module to the buffer memory of the intelligent function modules which are mounted on the main and extension base units.

(1) Specification method and application example


(a) Specification method

Specify the I/O number and buffer memory address of the intelligent function module.

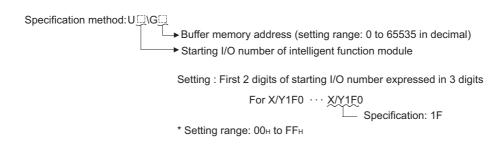

(b) Application example

Specify the device as shown below to store CH.1 to CH.4 digital output values of the Q64AD analog-digital converter module into D0 to D3 of the CPU module when the Q64AD is mounted in the position of I/O number 020 (X/Y020 to X/Y02F).

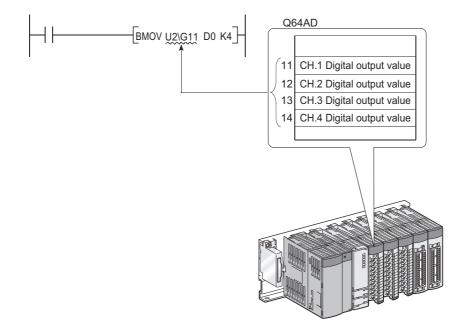

If the intelligent function module device is used, device comments can be attached to the buffer memory areas.

(2) Processing speed

The processing speed of the intelligent function module device is as follows:

• The processing speed of writing or reading using the intelligent function module device is slightly higher compared with the case of using the FROM or TO instruction.


Ex. "MOV U2\G11 D0"

• When reading from the buffer memory of an intelligent function module and another processing with one instruction, totalize the processing speed of the FROM or TO instruction and the other instruction.

Ex. "+ U2\G11 D0 D10"

Point P

Instead of using the intelligent function module device in the sequence program twice or more to write or read buffer memory data, using the FROM or TO instruction once in one place can increase the processing speed.

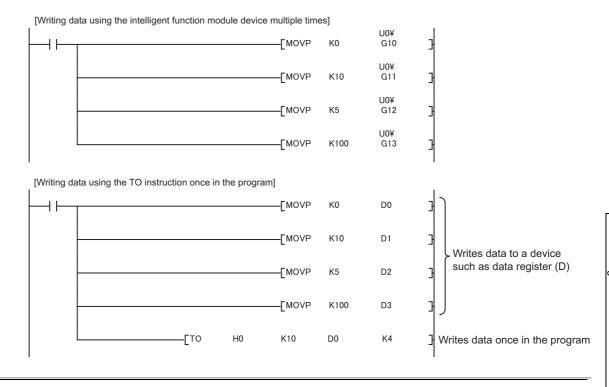

For buffer memory addresses and applications, refer to the manual for each intelligent function module used. For the FROM and TO instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

4.5.2 Cyclic transmission area device

The cyclic transmission area device is used to access the CPU shared memory of each CPU module in a multiple CPU system.

(1) Features

- The transfer speed is higher than the case of using the write (S.TO or TO) or read (FROM) instruction to the CPU shared memory, resulting in reduced programming steps.
- Using the cyclic transmission area device allows bit manipulation.
- By setting device comments for the cyclic transmission area device, program readability is increased.
- Because information on the CPU shared memory can be directly specified as an argument of the instruction, no interlock device is required.

(2) Specification method

Specify the I/O number of the CPU module and the CPU shared memory address.

Specification method: U3En\G□

CPU shared memory (setting range: 0 to 4096, 10000 to 24335 in decimal) Starting I/O number of the CPU module Setting: First 3 digits of starting I/O number CPU module mounting location: * CPU slot (CPU No.1): <u>3E00H</u> → 3E0 * Slot 0 (CPU No.2): <u>3E10H</u> → 3E1 * Slot 1 (CPU No.3): <u>3E20H</u> → 3E2 * Slot 0 (CPU NN.4): <u>3E20H</u> → 3E2

* Slot 2 (CPU No.4): <u>ЗЕЗОн</u> → 3ЕЗ


For details of the cyclic transmission area device, refer to the following.

QCPU User's Manual (Multiple CPU System)

4.6 Index Register (Z)/Standard Device Resister (Z)

4.6.1 Index register (Z)

The index register is used for indirect specification (index modification) in sequence programs. Index modification uses one point of the index register.

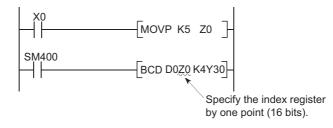

The index register has 20 points (Z0 to Z19).

(1) Bit structure of the index register

(a) Bit structure and read/write unit

One point of the index register consists of 16 bits, and data can be read or written in units of 16 bits.



Point P

Index register data are handled as signed data.


In the case of the hexadecimal notation, 0000_{H} to FFFF_H can be stored. However, because the most significant bit represents a sign bit, decimal values that can be specified are -32768 to 32767. (When using T, TS, or C device, specify the values within the range of -16384 to 16383.)

(b) When using the index register for a 32-bit instruction

The processing target is Zn and Zn+1.

The lower 16 bits correspond to the specified index register number (Zn), and the higher 16 bits correspond to the specified index register number + 1.

Ex. When Z2 is specified in the DMOV instruction, Z2 represents the lower 16 bits and Z3 represents the higher 16 bits. (The most significant bit in a 32-bit structure is a sign bit.)




(2) 32-bit index modification

For 32-bit index modification, use two points of the index register. The index register areas to be used for 32-bit index modification is set in two ways:.

· by specifying the index register range used, or

• by using "ZZ". PNote 4.4

Remark •••• For details and precautions of index modification using the index register, refer to the following. MELSEC-Q/L Programming Manual (Common Instruction)



When specifying the 32-bit index modification using "ZZ" with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used. (Appendix 2)

4.6.2 Standard device register (Z)

By using the index register between register operations, operations can be executed at a higher speed. The index register used in this case is called the standard device resister.

(1) Device number

Since the standard device register is the same device as the index register, pay attention not to use the same device number when using the index modification.

Remark For operation processing and processing time of the standard device register, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

4.6.3 Switching from the scan execution type to the interrupt/fixed scan execution type program

The CPU module performs the following when switching from the scan execution type program to the interrupt/fixed scan execution type program.

- · Saving and restoring the index register data
- · Saving and restoring block numbers of the file register

(1) Setting for saving and restoration

Saving and restoration setting can be enabled in the PLC system tab of the PLC parameter dialog box. To disable writing to the index register in the interrupt/fixed scan execution type program, select "High Speed Execution" in the Interrupt Program/Fixed Scan Program Setting area. If this setting is enabled, the program will switch faster than before.



(2) Processing of the index register

(a) When "High-speed execution" is not selected

- When switching from the scan execution type program to the interrupt/fixed scan execution type program The CPU module saves index register values in the scan execution type program, and passes them to the interrupt/fixed scan execution type program.
- When switching from the interrupt/fixed scan execution type program to the scan execution type program The CPU module restores the saved index register values.

Execution program	Scan execution type program	Switching	Interrupt/fixed scan execution type program	Restored ➤	Scan execution type program
Index register value	Z0=1 Saved	Passed	Z0=1 → Z0=3 ^{·1}		Z0=1 Restored
Save area of index register				1	
for scan execution type program	Z0=0	►Z0=1	Z0=1	Z0=1	Z0=1

*1 The Z0 value is changed to 3 in the interrupt program.

Point P

To pass index register values from the interrupt/fixed scan execution type program to the scan execution type program, use word devices.


(b) When "High-speed execution" is selected

- When switching from the scan execution type program to the interrupt/fixed scan execution type program The CPU module does not save/restore any index register values.
- When switching from the interrupt/fixed scan execution type program to the scan execution type program If data are written to the index register by the interrupt/fixed scan execution type program, the values of the index register used in the scan execution type program will be corrupted.

Execution program	Scan execution type program	Switching	Interrupt/fixed scan execution type program	Restored	Scan execution type program
Index register value	Z0=1	Passed	Z0=1 → Z0=3 ^{*1}	Passed	> Z0=3
Save area of index register	 	 		 	
for scan execution type program	Z0=0	Z0=0	Z0=0	Z0=0	Z0=0

*1 The Z0 value is changed to 3 in the interrupt program.

When writing data to the index register by the interrupt/fixed scan execution type program, use the ZPUSH or ZPOP instruction to save and restore the data.

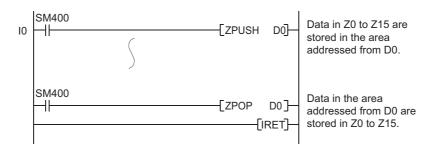

(3) Processing of file register's block numbers


- When switching from the scan execution type program to the interrupt/fixed scan execution type program The CPU module saves the file register block numbers in the scan execution type program, and passes them to the interrupt/fixed scan execution type program.
- When switching from the interrupt/fixed scan execution type program to the scan execution type program The CPU module restores the saved block numbers of the file register.

Execution program	Scan execution type program	Switching	Interrupt/fixed scan execution type program	Restored	Scan execution type program
Block No. of file register	Block 1 Saved	Passed	FIRSET K0] Block1 → 0		Block 1 Restored
Save area	Block 0	Block 1	Block 1	Block 1	Block 1

4.7 File Register (R) PNote 4.5

The file register (R) is a device provided for extending the data register.


The file register can be used at the same processing speed as the data register.

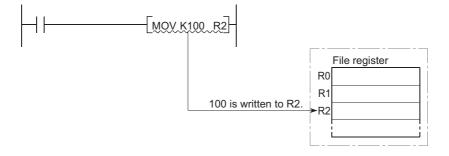

(1) Bit structure of the file register

(a) Bit structure and read/write unit

One point of the file register consists of 16 bits, and data can be read or written in units of 16 bits.




Most significant bit represents a sign bit.

(b) When using a 32-bit instruction for the file register

The processing target is Rn and Rn+1.

The lower 16 bits correspond to the file register number (Rn) specified in the sequence program, and the higher 16 bits correspond to the specified file register number + 1.

For example, when R2 is specified in the DMOV instruction, R2 represents the lower 16 bits and R3 represents the higher 16 bits.



Data of -2147483648 to 2147483647 or 00000000_{H} to FFFFFFF_H can be stored in a two-point area of the file register. (The most significant bit in a 32-bit structure is a sign bit.)



The Q00UJCPU does not have the file register.

(2) Clearing the file register

If the Latch (2) is set in the Device tab of the PLC parameter dialog box, the data in the file register are not cleared even if the CPU module is powered off or reset. (Data cannot be initialized by performing latch clear operation.^{*1}) For how to clear the data, refer to the "Data Clear Processing" section. (FFP Page 75, Section 2.7 (4))

*1 The latch range of the file register can be set in the Device tab of the PLC parameter dialog box. () Page 397, Section 4.7.4 (1) (c))

4.7.1 Storage location

File register data are stored in the following memory.

CPU module	Memory		
Q00UCPU, Q01UCPU, QnUDVCPU, QnUDPVCPU	Standard RAM		
Q02UCPU, QnUD(H)CPU, QnUDE(H)CPU	Standard RAM, SRAM card, Flash card		

4.7.2 File register size

The size of file register is the total number of points of the file register (ZR), extended data register (D), and extended link register (W). Set the size so that the total number of points will be less than the free space of memory specified as a storage location. The free space can be checked in the Confirm Memory Size window using a programming tool.

[™] [Tool]⇔[Confirm Memory Size]

(1) Storing data in the standard RAM

The following table lists the points available for the file register data to be stored in the standard RAM. Note that if data other than the file register data are stored in the standard RAM, the points will decrease. ($\Box = P$ Page 36, Section 2.1.1 (2))

CPU module	Point
Q00UCPU, Q01UCPU, Q02UCPU	64K
Q03UD(E)CPU	96K
Q03UDVCPU	96K
With an extended SRAM cassette (1M)	608K
With an extended SRAM cassette (2M)	1120K
With an extended SRAM cassette (4M)	2144K
With an extended SRAM cassette (8M)	4192K
Q04UD(E)HCPU	128K
Q04UDVCPU, Q04UDPVCPU	128K
With an extended SRAM cassette (1M)	640K
With an extended SRAM cassette (2M)	1152K
With an extended SRAM cassette (4M)	2176K
With an extended SRAM cassette (8M)	4224K
Q06UD(E)HCPU	384К

CPU module	Point
Q06UDVCPU, Q06UDPVCPU	384K
With an extended SRAM cassette (1M)	896K
With an extended SRAM cassette (2M)	1408K
With an extended SRAM cassette (4M)	2432K
With an extended SRAM cassette (8M)	4480K
Q10UD(E)HCPU, Q13UD(E)HCPU	512K
Q13UDVCPU, Q13UDPVCPU	512K
With an extended SRAM cassette (1M)	1024K
With an extended SRAM cassette (2M)	1536K
With an extended SRAM cassette (4M)	2560K
With an extended SRAM cassette (8M)	4608K
Q20UD(E)HCPU, Q26UD(E)HCPU	640K
Q26UDVCPU, Q26UDPVCPU	640K
With an extended SRAM cassette (1M)	1152K
With an extended SRAM cassette (2M)	1664K
With an extended SRAM cassette (4M)	2688K
With an extended SRAM cassette (8M)	4736K
Q50UDEHCPU	768K
Q100UDEHCPU	896K

(2) Storing data in an SRAM card

Up to 4086K points can be stored in one file. Since one block consists of 32K words, up to 128 blocks can be stored.

Note that the number of points or blocks that can be added depends on the size of the programs and device comments stored in the memory card.

(3) Storing data in a Flash card

Up to 2039K points can be stored in one file.

Since one block consists of 32K words, up to 64 blocks can be stored.

Note that the number of points or blocks that can be added depends on the memory card capacity and the size of the programs and device comments stored in the memory card.



For the memory cards available for the CPU module, refer to Page 37, Section 2.1.1 (4).

4.7.3 Differences in available accesses by storage memory

	Access	Standard RAM	SRAM card	Flash card
Program writ	ing	0	0	×
Program read	ding	0	0	0
Writing devic	e memory to programmable controller	0	0	×
Reading devi	ce memory from programmable controller	0	0	0
Data modification	Online test operation using a programming tool	0	0	×
	Writing data to a CPU module using a programming tool	0	0	×
	Writing data to a CPU module (flash ROM) using a programming tool	×	×	0
	Batch write by a serial communication module	0	0	×
	Device data writing from GOT1000 series	0	0	×
	Random write command from GOT1000 series	0	0	×

Accesses available for the file register vary for each memory.


4.7.4 Registration procedure for the file register

To use the file register, register files to the CPU module by the following procedure.

- 1. Set a file register file. (Page 395, Section 4.7.4 (1))
- 2. Write the file register file. (Page 398, Section 4.7.4 (2))

(1) Setting a file register file

Set whether to use a file register in the PLC file tab of the PLC parameter dialog box.

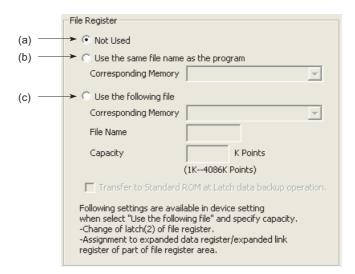

(a) Not Used

Select this in the following cases.

- When not using any file register
- When specifying a file register used in the sequence program (the QDRSET instruction is used for specification.)


(b) Use the same file name as the program.

Select this when executing the file register with the same file name as the sequence program. Select the memory to be used for the file register from a standard RAM or a memory card.

· When the program is changed

The file name of the file register is automatically changed to the same name as the program. This feature is useful if the file register is exclusively used for one program as a local device.

Ex. When each of file registers A to C has the same name with the corresponding one of the program A to C, the operation is as described below.

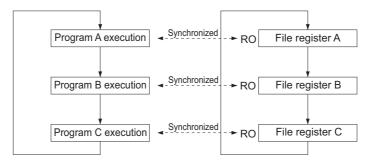

· Point setting for file registers

Set the number of file register points in the "File Register Detail Setting" screen when writing data to the programmable controller.

[™] [Online] ⇔ [Write to PLC] ⇔ the retain button of "File Register"

Point P

- Only one file register can be created in the standard RAM. (This applies to CPU modules except the High-speed Universal model QCPU and Universal model Process CPU.)
 To create more than one, use a SRAM or Flash card.
- With some instructions, file registers set for respective programs cannot be specified.
 For details, refer to the pages describing devices available for each instruction in the following manual.
 MELSEC-Q/L Programming Manual (Common Instruction)

(c) Use the following file.

Select this when one file register is to be shared by all execution programs.

Specify "Corresponding Memory", "File Name", and "Capacity" and write these parameters to the CPU module to create a file for the file register.


If the capacity is not specified, note the following.

- When the specified file register file is stored in the specified drive, the file is used. (The capacity is the same as that of the stored file register file.)
- If the file register file with the specified file name is not found on the specified drive, "PARAMETER ERROR" (error code: 3002) will occur.
- For use of an ATA card, "Memory card (ROM) cannot be selected for "Corresponding Memory". (File register data cannot be stored in ATA cards.)

Selecting "Memory card (ROM)"for "Corresponding Memory" and writing the settings to the CPU module will result in "PARAMETER ERROR" (error code: 3002).

Point P

If necessary, the latch range of a file register can be changed in the "Use the following file" setting.

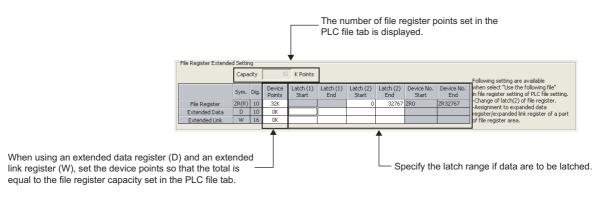

(2) Registering a file register file to the CPU module

🏷 [Online] 🗇 [Write to PLC]

Register a file to the CPU module by executing the write to PLC function.

Online Data Operation Connection Channel List System Image Serial Port PLC Module Connection(USB) C Read • Write C: Verify C Delete Execution Target Data(No / 11 PLC Module Intelligent Function Module Yes) Title Γ 🔢 Edit Data Parameter+Program Select All Cancel All Selections Target Detail Module Name/Data Name Title Last Change Target Memor Size 📴 (Untitled Project) Standard RAM 👌 PLC Data 👼 MAIN ~ 2013/01/29 11:36:19 532480 Bytes Necessary Setting/ No Setting / Already Set] Set if it is needed[No Setting / Already Set] Writing Size Use Volume Free Volume Refres<u>h</u> 532,480Bytes 1,310,720 OBytes Related Eunctions>> Execute Close

(a) Registration memory

Select a memory where the file register file is to be registered from the following.

- Standard RAM
- · Memory card (SRAM)
- · Memory card (Flash)

To use the same file name that is used in the program, register the file register file to the memory specified in the PLC File tab of the PLC parameter dialog box.

(b) File register size of the CPU module


The file register size can be set in increments of one point. Note that each file size is ensured in units of 256 points. Even if a file register is not specified from ZR0, the created file will have an assignment from ZR0 to the last number.

Ex. If the write range of a file register is specified to be ZR1000 to ZR1791, the created file register file will have an assignment from ZR0 to ZR1791. However, because the data in ZR0 to ZR999 are unreliable, specify the file register from ZR0. The size of the file register is checked in the units of 1K points. Therefore, the file register size must be specified from R0 in the units of 1K points.

4.7.5 Specification methods of the file register


(1) Block switching method

The file register points used are divided and specified in units of 32K points (R0 to R32767). If multiple blocks are used, the desired block is specified with the block number in the RSET instruction. Each block has a specification range of R0 to R32767.

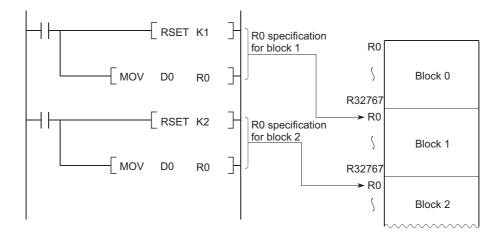

(2) Serial number access method

A file register whose size is exceeding 32K points can be specified using consecutive device numbers. Multiple blocks of a file register can be used as a continuous file register. This kind of device is expressed as "ZR".

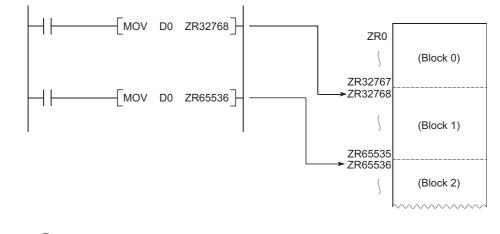

Point P

The block numbers and ZR device points that can be specified vary depending on the following.

- Storage location of the file register (Page 393, Section 4.7.1)
- File register size (FF Page 393, Section 4.7.2)

4.7.6 Precautions for using the file register

(1) No registration or use of an invalid file register number

(a) When the file of the file register has not been registered

Writing to or reading from the file register will result in "OPERATION ERROR" (error code: 4101).

(b) When writing to or reading from the file register exceeding the registered size

(points)

"OPERATION ERROR" (error code: 4101) will occur.

(2) File register size check

When writing to or reading from the file register, check the file register size so that data can be written or read within the size (points) set for the CPU module.

(a) Checking the file register size

The file register size can be checked in the File register capacity area (SD647).^{*1}

The file register size data in units of 1K points is stored in this SD647.

*1 If a file register file is switched to another, the size of the currently selected file register file is stored in SD647.

Point P

The remainder after dividing the file register size by 1K points is discarded.

To ensure an accurate "range of use" check, specify the file register setting in units of 1K points (1024 points).

(b) Checking timing


- In a program using any file register, check the file register size at step 0.
- After execution of the file register file switching instruction (QDRSET), check the file register size.
- Before executing the file register block switching instruction (RSET), check that space of 1K points or more is ensured in a block after switching. The space can be calculated using the following formula.
 (File register size) > [32K points × (Switching block No.) + 1K points]

(c) File register size checking procedure

- · Check the file register size used for each sequence program.
- Check the total file register size set in SD647 on the sequence program to see if there are sufficient number of points to be used or not.


[Program example 1]

The file register range of use is checked at the beginning of each program.

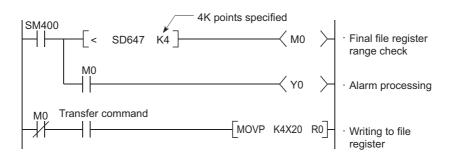


[Program example 2]

The file register range of use is checked after execution of the QDRSET instruction.

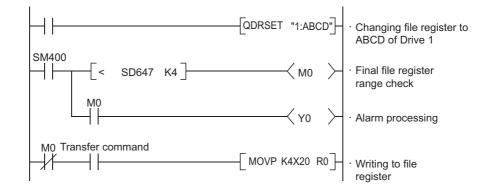

[Program example 3]

When a block is switched to another:

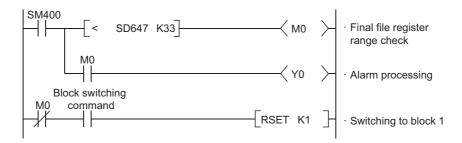


(3) Deleting a file register file

Delete an unnecessary file register file from "Delete PLC Data" of programming tool.

🏷 [Online] 🗢 [Delete PLC Data]

4.8 Extended Data Register (D) and Extended Link Register (W) PNote 4.6

The extended data register (D) and extended link register (W) are devices for using the large-capacity file register (ZR) area as an extended area of the data register (D) and link register (W). These devices can be programmed as the data register (D) and link register (ZR) area.

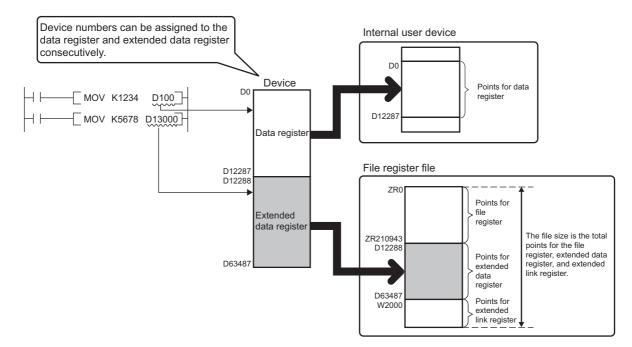


(1) Device numbers

Device numbers for the extended data register (D) and extended link register (W) can be assigned consecutively after those for the internal user devices, data register (D) and link register (W).

Point *P*

- Even though device numbers are consecutively assigned, there is no physical area contiguity between the data register (D) (internal user device) and the extended data register (D), and between the link register (W) (internal user device) and the extended link register (W). To use them as one contiguous area, set the points for the data register (D) and link register (W) (internal user device) to "0" in the Device tab of the PLC parameter dialog box, and use only the extended data register (D) and extended link register (W).
- When the file register (ZR), extended data register (D), and extended link register (W) are used for auto refresh, set the points so that they should not exceed those set in the "File Register Extended Setting" in the Device tab of the PLC parameter dialog box.



The Q00UJCPU does not support the use of these devices.

When using these devices with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU,

Q26UDHCPU, or QnUDE(H)CPU, check the version of the programming tool used. (FP Page 467, Appendix 2)

(2) Setting method

Since the extended data register (D) and extended link register (W) use the file register area, data must be set for both the file register setting and the device setting.

(a) File register setting

Select "Use the following file." in the PLC file tab of the PLC parameter dialog box, and do the setting as shown below. The "Use the same file name as the program." cannot be selected.

-File Register						
rile Register						
O Not Used						
O Use the same file name as the program						
Corresponding Memory	_					
Ouse the following file						
Corresponding Memory	Memory Card (RAM) (Drive 1) 💌					
File Name						
Capacity	K Points					
	(1K4086K Points)					
Transfer to Standard ROM at Latch data backup operation.						
Following settings are available in device setting when select "Use the following file" and specify capacity. -Change of latch(2) of file register. -Assignment to expanded data register/expanded link register of part of file register area.						

Item		Corresponding Memory	File Name	Capacity ^{*1}	Remarks
	Memory card	I (RAM) ^{*4}	Any	1 to 4086K points ^{*2}	-
	Memory card	I (ROM) ^{*4}	Any	1 to 2039K points ^{*3}	Read only
		Q00UCPU, Q01UCPU, Q02UCPU		1 to 64K points	
		Q03UD(E)CPU, Q03UDVCPU ^{*5}		1 to 96K points	
		Q04UD(E)HCPU, Q04UDVCPU ^{*5} , Q04UDPVCPU ^{*5}		1 to 128K points	
"Use the following file"	Standard Q0 RAM Q1 Q1 Q2	Q06UD(E)HCPU, Q06UDVCPU ^{*5} , Q06UDPVCPU ^{*5}	Any	1 to 384K points	
		Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU ^{*5} , Q13UDPVCPU ^{*5}		1 to 512K points	
		Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU ^{*5} , Q26UDPVCPU ^{*5}		1 to 640K points	
		Q50UDEHCPU		1 to 768K points	
		Q100UDEHCPU		1 to 896K points	

*1 The size of file register is the total number of points for the file register (ZR), extended data register (D), and extended link register (W). Set the size so that the total number of points will be less than the free space of memory specified as a storage location. The free space can be checked in the Confirm Memory Size window using a programming tool.

[™] [Tool] ⇒ [Confirm Memory Size]

*2 This is the maximum number of points when an SRAM card (8M bytes) is used.

*3 This is the maximum number of points when a Flash card (4M bytes) is used.

*4 The Q00UCPU, Q01UCPU, High-speed Universal model QCPU, and Universal model Process CPU do not support the use of memory card.


*5 For the memory size when an extended SRAM cassette is used, refer to Page 393, Section 4.7.2.

(b) Device setting


Set each number of points for the extended data register (D) and extended link register (W) in the File Register Extended Setting in the Device tab of the PLC parameter dialog box. Assign a part of the points set for the file register (ZR) in the PLC file tab to the extended data register (D) and extended link register (W). The latch range can be changed if necessary.

If data are to be latched, specify the latch range.

- Latch (1) and (2) of the extended data register (D)
- Latch (1) and (2) of the extended link register (W)

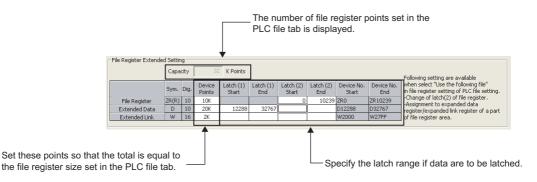

Once the points for the extended data register (D) and extended link register (W) is set, areas for these devices are reserved in the file register file.

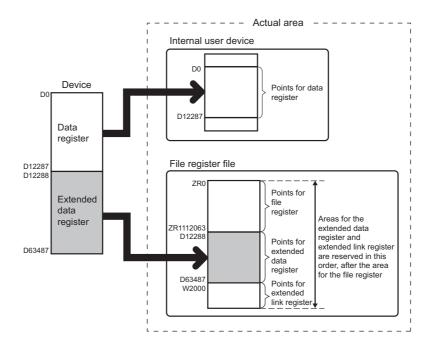

(3) Checking the points by the special register

The points for each of the file register (ZR), extended data register (D), and extended link register (W) can be checked in the following special register areas.

- SD306, SD307: File register (ZR)
- SD308, SD309: Extended data register (D)
- SD310, SD311: Extended link register (W)

(4) Precautions

For use of the extended data register (D) and extended link register (W), pay attention to the following.

- Since the file register (ZR) area is used, the values of the following items will be the same as those for the file register (ZR) when the extended data register (D) and extended link register (W) are specified.
 - Number of program steps
 - Instruction processing time
 - · Processing time of auto refresh with network modules
 - · Processing time of auto refresh with CC-Link IE Field Network Basic
 - · Processing time of auto refresh with intelligent function modules
 - · Processing time of auto refresh between CPU shared memories
- The file register size cannot be changed while the CPU module is in the RUN status.
- The file register cannot be switched to another by using the QDRSET instruction. ("OPERATION ERROR" (error code: 4100))
- Set the refresh ranges for the following auto refresh properly so that each refresh range does not cross over the boundary between the internal user device and the extended data register (D) or extended link register (W).
 - · Auto refresh with network modules
 - Auto refresh with CC-Link IE Field Network Basic
 - · Auto refresh with intelligent function modules
 - Auto refresh between CPU shared memories
- Set the following properly so that each specification does not cross over the boundary between the internal user device and the extended data register (D) or extended link register (W).
 - · Index modification
 - Indirect specification
 - Specification for instructions that use block data^{*1}
- *1 Block data means the following:

•Data used in instructions, such as FMOV, BMOV, and BK+, which treat more than one word for operation. •Control data, composed of two or more words, which are specified in instructions, such as SP.FWRITE and SP.FREAD.

•Data in a 32-bit or greater format (binary 32 bits, real number, indirect address of a device)

Remark

For details on the index modification and indirect specification with the extended data register (D) and extended link register (W), refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

 To access the extended data register (D) or extended link register (W) from a module that does not support the use of these devices, device numbers need to be specified with those of the file register (ZR). Calculation formulas for obtaining device numbers of the file register (ZR) to be specified to access the extended data register (D) and extended link register (W) and calculation examples are described below

	Item			Calculation formula			
Device number of the file register (ZR) used to access the ex	xtended o	lata register (D)	$ED_{ZN} = ZR_{C} + (ED_{N} - D_{C})$			
Device number of the file register (ZR) used to access the e	nk register (W)	$EW_{ZN} = ZR_{C} + ED_{C} + (EW_{N} - W_{C})$				
*1 Variables in the table indicate the following: • ZR_C : Points of the file register (ZR) • ED_{ZN} : Device number of the file register (ZR) used to access the extended data register (D) • ED_{N} : Access target device number of the extended data register (D) • D_C : Points of the data register (D) • ED_C : Points of the extended data register (D) • EW_{ZN} : Device number of the file register (ZR) used to access the extended link register (W) • EW_{ZN} : Device number of the file register (ZR) used to access the extended link register (W) • EW_{N} : Access target device number of the extended link register (W) (hexadecimal) • W_C : Points of the link register (W) [Calculation example] • D_C : Points of the data register (D) ••• 12288 points • W_C : Points of the link register (W) ••• 8192 points							
-	the link register (W) ••• the file register (ZR) •						
-	the extended data reg						
ED _{ZN} = 2048 + 2) Device number	of the file register (ZR (13000-12288) = 2760 of the file register (ZR · 2048 + (2100 _H - 8192)) used to	access W2100	92) = 4352			
File register (ZR) <	ZR0 : ZR2047 ZR2048 : ZR2760 : ZR4095 ZR4095 :		D0 : D12287 D12288 : 1) D13000 : D14335 W0 : W1999 W2000 :	<pre>Data register (D) Extended data register (D) Link register (W)</pre>			
	ZR4352		2) W2100	Extended link register (W)			

W27FF

ZR6143


4.9 Nesting (N)

Nesting (N) is a device used in the master control instructions (MC and MCR instructions) to program operation conditions in a nesting structure.

(1) Specification method using master control instructions

The master control instruction opens or closes a common ladder gate to switch the ladder of a sequence program efficiently.

Specify the nesting (N) in ascending order (in order of N0 to N14), starting from the outside of the nesting structure.

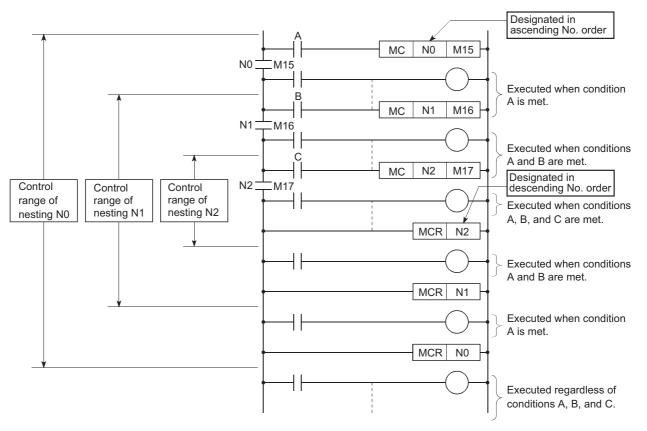

For use of the nesting, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)


4.10 Pointer (P)

The pointer (P) is a device used in jump instructions (CJ, SCJ, or JMP) or subroutine call instructions (such as CALL).

(1) Applications

Pointers can be used in the following applications.

- Specification of the jump destination in a jump instruction (CJ, SCJ, or JMP) and a label (start address of the jump destination)
- Specification of the call destination of a subroutine call instruction (CALL or CALLP) and a label (start address of the subroutine program)



(2) Pointer types

There are the following two different pointer types.

- Local pointer (Page 409, Section 4.10.1):
- The pointer used independently in each program
- Common pointer (Page 411, Section 4.10.2):
 The pointer that can be called in all running programs by the subroutine call instruction.

(3) Number of available pointer points

The following shows the available number of points.

CPU module	Points
Q00UJCPU, Q00UCPU, Q01UCPU	512 points
Q02UCPU, Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU	4096 points
Q50UDEHCPU, Q100UDEHCPU	8192 points


For the jump instructions and subroutine call instructions, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

4.10.1 Local pointer

The local pointer is a pointer that can be used independently in jump instructions and subroutine call instructions in each program.

The same pointer number can be used in respective programs.

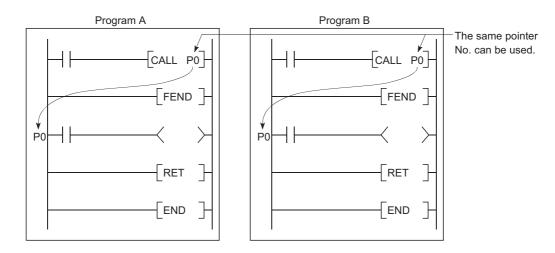


(1) Number of local pointer points


The local pointer can be divided for use of all the programs stored in the program memory. The local pointer number ranges from P0 to the highest number of the local pointer in use. (The CPU module's system computes the number of points used.)

Even if only P99 is used in a program, for example, the number of points used will be 100, which is from P0 to P99.

For using the local pointer for several programs, use the pointers in ascending order starting from P0 in each program.

4.10 Pointer (P) 4.10.1 Local pointer



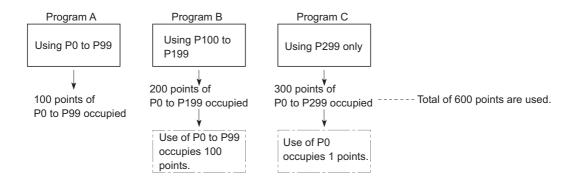

(2) Precautions for using the local pointer

(a) Program where the local pointer is described


A jump from another program is not allowed.

Use the ECALL instruction from another program when calling a subroutine program in a program file that contains any local pointer.

(b) Total number of local pointer points

If the total number of pointers (in all programs) exceeds the number of points available for each CPU module, a "Pointer configuration error" (error code: 4020) occurs. For the number of available pointer points of each CPU module, refer to Page 408, Section 4.10 (3).

4.10.2 Common pointer

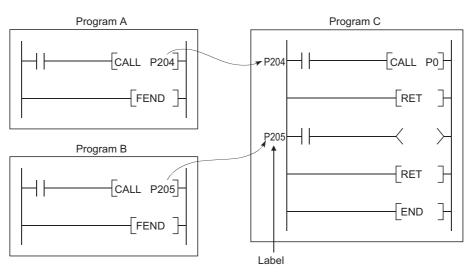

The common pointer is used to call subroutine programs from all programs that are being executed.

(1) Common pointer range


In the PLC system tab of the PLC parameter dialog box, set the start number for the common pointer. The common pointer range is from the specified pointer number to P4095.

However, the pointer number that can be entered here is a number higher than the total points used for the local pointer.

the common pointer.

(2) Precautions

- The same pointer number cannot be used as a label. Doing so will result in a "Pointer configuration error" (error code: 4021).
- If the total number of the local pointer points used in several programs exceeds the start number of the common pointer, a "Pointer configuration error (error code: 4020) will occur.

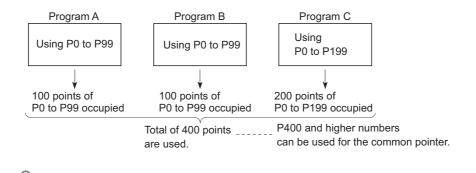


Point P

The jump instructions are not capable of executing a jump to the common pointer in other programs. Use the common pointer with subroutine call instructions only.

Δ

4.11 Interrupt Pointer(I)

The interrupt pointer (I) is used as a label at the start of an interrupt program, and can be used in any programs.



(1) Number of available points

The number of points and the range available for the interrupt pointer are shown below.

CPU module	Point	Range
Q00UJCPU, Q00UCPU, Q01UCPU	128 points	10 to 1127
Q02UCPU, Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU, Q50UDEHCPU, Q100UDEHCPU	256 points	10 to 1255

(2) Interrupt factors

The interrupt factors for the available interrupt pointers are shown below.

Interrupt factor	Interrupt pointer No.	Description	
Interrupt by an interrupt module ^{*1} I0 to I15		Interrupt input from an interrupt module	
Interrupt by a sequence-started module	116 to 127	Interrupt from an AnS/A series special function module ^{*2} that is capable of starting an interrupt in the CPU module	
Interrupt by the internal timer	I28 to I31, I49 ^{*5}	Fixed scan interrupt by the internal timer of the CPU module	
Multiple CPU synchronous interrupt ^{*3}	145	Fixed scan interrupt to execute synchronized control with the operation cycle of a motion controller	
Intelligent function module interrupt	150 to 1255	Interrupt from an intelligent function module ^{*4}	

*1 For available interrupt modules, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

*2 The corresponding module is an intelligent communication module. For details, refer to the manual for each module.

*3 Applicable when using the Universal model QCPU and motion controller that support the multiple CPU high speed transmission.

*4 This module can be a serial communication module, MELSECNET/H module, Ethernet module, or high-speed counter module. For details, refer to the manual for each module.

*5 Only the High-speed Universal model QCPU and Universal model Process CPU support the use of I49.

Point P

To use the intelligent function module interrupt (Page 232, Section 3.22), the intelligent function module setting (interrupt pointer setting) is required in the "PLC system" tab of the PLC parameter dialog box. (Page 439, Appendix 1.2.2)

4.11.1 List of interrupt pointer numbers and interrupt factors

The list of interrupt pointer numbers and interrupt factors are shown below.

(1) When a Q series interrupt module is mounted

I No.	Interrupt	factor	Priority	I No.		Interrupt factor	Priority				
10		1st point	6								
l1		2nd point	7								
12		3rd point	8								
13		4th point	9								
14		5th point	10								
15		6th point	11								
16		7th point	12	132 to		N/A					
17	Interrupt by an	8th point	13	144	-	N/A	-				
18	interrupt module	9th point	14								
19	(QI60)	10th point	15								
110		11th point	16								
111		12th point	17								
112		13th point	18								
113		14th point	19								
114	1	15th point	20	I45 ^{*2 *5}	Multiple CPU						
115		16th point	21		synchronous interrupt	0.88ms	1				
116	1st module	1st module	228	146 to 148							
117		2nd module	229		to 148 -	N/A	_				
118		3rd module	230		- 140 10 140	- 140 10 140				_	
119		4th module	231								
120	Interrupt by a	5th module	232	149	High-speed interrupt	0.1 to 1.0ms	*6				
121	sequence-started	6th module	233								
122	module	7th module	234								
123		8th module	235								
124		9th module	236		Intelligent						
125		10th module	237		function module	Specify an intelligent function					
126		11th module	238	150 to	interrupt ^{*3*4}	module or interrupt module (QI60)	22 to 227				
127		12th module	239	1255	/Interrupt by an	in parameter.					
I28 ^{*5}		100ms	5]	interrupt module (QI60)						
I29 ^{*5}	Interrupt by the	40ms	4		(000)						
130 ^{*5}	internal timer ^{*1}	20ms	3	-							
131 ^{*5}	10ms	2	1								

*1 The time-limit value of the internal timer is set by default. In the PLC system tab of the PLC parameter dialog box, the value can be changed within the range of 0.5ms to 1000ms in increments of 0.5ms.

*2 This is available for multiple CPU system configuration.

*3 To use the intelligent function module interrupt, the intelligent function module setting (interrupt pointer setting) is required in the PLC system tab of the PLC parameter dialog box. (For interrupt from an intelligent function module, refer to Page 232, Section 3.22.

*4 I50 has the highest priority (priority 22), and I255 has the lowest priority (priority 227).

*5 When an interrupt occurs, even if no interrupt pointer exists on the program, CAN'T EXECUTE(I) (error code: 4220) does not occur.

*6 To use I49, do not execute any other interrupt programs (I0 to I48, I50 to I255) nor fixed scan execution type programs. If executed, the interrupt program (I49) will not be executed at preset intervals.

(2) When an A series interrupt module is mounted

l No.	Interrupt	factor	Priority	I No.		Interrupt factor	Priority
10		1st point	224				
11		2nd point	225				
12	3	3rd point	226				
13		4th point	227				
14		5th point	228				
15		6th point	229				
16		7th point	230	132 to		N/A	
17	Interrupt by an	8th point	231	144	-	N/A	-
18	interrupt module	9th point	232				
19	(A1SI61)	10th point	233				
I10		11th point	234				
I11		12th point	235				
I12		13th point	236				
I13		14th point	237				
114	151	15th point	238	I45 ^{*2 *5}	Multiple CPU		1
115		16th point	239		synchronous interrupt	0.88ms	
I16		1st module	212	140.1			
117		2nd module 213	I46 to I48	-	N/A	-	
I18		3rd module	214				
119		4th module	215	149	High-speed interrupt	0.1 to 1.0ms	*6
120	Interrupt by a	5th module	216				
l21	sequence-started	6th module	217				
122	module	7th module	218				
123		8th module	219				
124		9th module	220		Intelligent function module		
125		10th module	221	150 to	interrupt ^{*3*4}	Specify an intelligent function	6 to 211
126		11th module	222	1255	/Interrupt by an	module or interrupt module	
127		12th module	223		interrupt module	(A1SI61) in parameter.	
I28 ^{*5}		100ms	5		(A1SI61)		
I29 ^{*5}	Interrupt by the	40ms	4				
130 ^{*5}	internal timer ^{*1}	20ms	3				
131 ^{*5}	1	10ms	2	-			

*1 The time-limit value of the internal timer is set by default. In the PLC system tab of the PLC parameter dialog box, the value can be changed within the range of 0.5ms to 1000ms in increments of 0.5ms.

*2 This is available for multiple CPU system configuration.

*3 To use the intelligent function module interrupt, the intelligent function module setting (interrupt pointer setting) is required in the PLC system tab of the PLC parameter dialog box. (For interrupt from an intelligent function module, refer to Page 232, Section 3.22.)

*4 I50 has the highest priority (priority 6), and I255 has the lowest priority (priority 211).

*5 When an interrupt occurs, even if no interrupt pointer exists on the program, CAN'T EXECUTE(I) (error code: 4220) does not occur.

*6 To use I49, do not execute any other interrupt programs (I0 to I48, I50 to I255) nor fixed scan execution type programs. If executed, the interrupt program (I49) will not be executed at preset intervals.

4.12 Other Devices

4.12.1 SFC block device (BL)

The SFC block is used to check that the specified block in the SFC program is activated.


Remark For use of the SFC block device, refer to the following. MELSEC-Q/L/QnA Programming Manual (SFC)

4.12.2 Network No. specification device (J)

The network No. specification device is used to specify the network number in the link dedicated instructions.

(1) Specification method


Specify as shown below by using the link dedicated instructions.

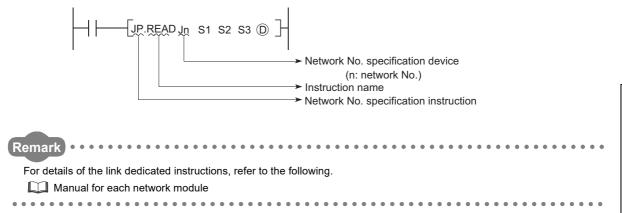

The I/O No. specification device is used to specify I/O numbers in the intelligent function module dedicated instructions.

(1) Specification method

Specify as shown below by using the intelligent function module dedicated instructions.

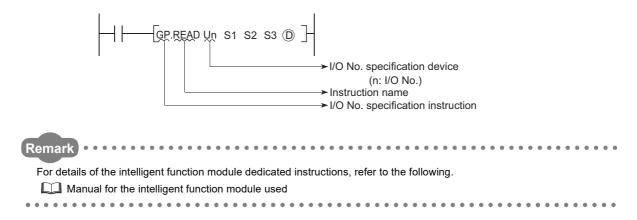


4.12.4 Macro instruction argument device (VD)

The macro instruction argument device (VD) is used with ladders registered as macros.

When a VD[□] setting is specified, the value is converted to the specified device when the macro instruction is executed.

(1) Specification method

Among the devices used in the ladders registered as macros, specify a device used for VD. When using macro instructions in the sequence program, specify devices that correspond to the macro instruction argument devices used in the macro registration ladders in ascending order.

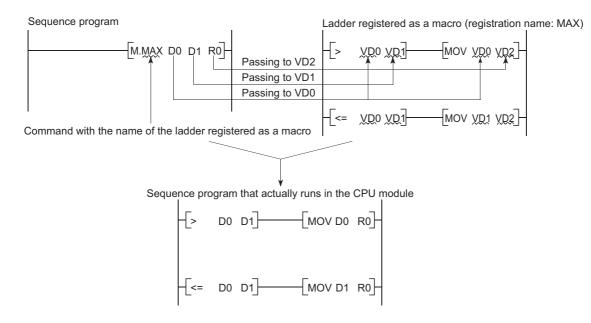

CHAPTER 5 CONSTANTS

5.1 Decimal Constant (K)

The decimal constant (K) is used to specify decimal data in sequence programs.

Specify it as K (example: K1234) in sequence programs.

In the CPU module, data are stored in binary (BIN). (FP Page 496, Appendix 4.1)

(1) Specification range

The specification ranges for decimal constants are as follows:

- When using word data (16-bit data) ••• K-32768 to K32767
- When using 2-word data (32-bit data) ••• K-2147483648 to K2147483647

Point *P*

The most significant bit represents a sign bit.

5.2 Hexadecimal Constant (H)

The hexadecimal constant (H) is a device for specifying hexadecimal or BCD data in sequence programs. (For BCD data, each digit of a hexadecimal number is specified with 0 to 9.) In sequence programs, specify it as H^[]] (example: H1234). ([] Page 497, Appendix 4.2)

(1) Specification range

The specification ranges for hexadecimal constants are as follows:

- When using word data (16-bit data) ••• H0 to HFFFF (For BCD data, H0 to H9999)
- When using 2-word data (32-bit data) ••• H0 to HFFFFFFF (For BCD data, H0 to H99999999)

The real number (E) is a device used to specify real numbers in sequence programs.

In sequence programs, specify it as E^[1] (example: E1.234). (^[] Page 499, Appendix 4.4)



(1) Specification range

(a) Real number setting range

• For single-precision floating-point data

 -2^{128} < Device $\leq -2^{-126}$, 0, $2^{-126} \leq$ Device < 2^{128}

• For double-precision floating-point data -2¹⁰²⁴ < Device \leq -2⁻¹⁰²², 0, 2⁻¹⁰²² \leq Device < 2¹⁰²⁴

(b) When an overflow or underflow has occurred

The following table shows the operation of the CPU module when an overflow or underflow has occurred during arithmetic operation.

Overflow	Underflow
OPERATION ERROR (error code: 4141)	Turned to 0 without any error

(c) When a special value^{*1} is input

If operation is performed with input data that contains a special value, "OPERATION ERROR" (error code: 4140) occurs.

*1 The special values are -0, unnormalized numbers, nonnumeric characters, and $\pm \infty$.

(2) Specification method

Real numbers can be specified in sequence programs by the following expressions.

• Normal expression ••• A numeric value can be specified as it is.

Ex. 10.2345 can be specified as E10.2345.

• Exponential expression ••• A numeric value is specified by (Value) × 10ⁿ.

Ex. 1234 is specified as E1.234 + 3.*1

*1 + 3 represents 10³ in E1.234 + 3.

5.4 Character String (" ")

The character string is a device used to specify a character string in sequence program. Characters enclosed in quotation marks (example: "ABCD1234") are specified.

(1) Available characters

The shift JIS code can be used for character strings. The CPU module distinguishes between upper and lower case characters.

(2) Number of specified characters

A string from the specified character to the NUL code (00_{H}) is one unit.

Note that, however, up to 32 characters can be specified for an instruction using a character string, such as \$MOV.

CHAPTER 6 CONVENIENT USAGE OF DEVICES

When multiple programs are executed in the CPU module, each program can be executed independently by specifying an internal user device as a local device.


Devices of the CPU module are classified into the following two types:

- · Global device that can be shared by multiple programs that are being executed.
- Local device that is used independently for each program.

6.1 Global Device

Programs being executed in the CPU module can share the global device.

Global device data are stored in the device memory of the CPU module, and can be shared by all programs.

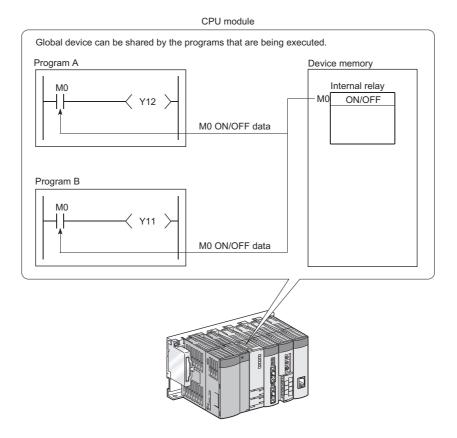

Point P

- All of the devices that have not been set as local devices (Page 422, Section 6.2) are global devices.
- For execution of multiple programs, the range to be shared by all programs and the range to be used independently by each program must be specified in advance.


	Example: Internal relay	_
M0	Shared by all programs	
	Used in program A	The range must be specified for each program.
	Used in program B	
	Used in program C	
	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~	J

# 6.2 Local Device PNote 6.1

The local device is a device that can be used independently for each program.

Using local devices allows programming of multiple independently-executed programs without considering other programs.


Note that local device data can be stored in the standard RAM and a memory card (SRAM) only.

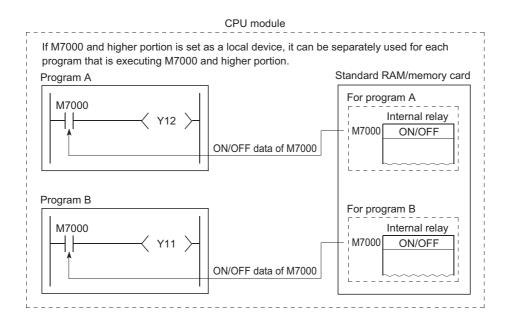

### (1) Devices that can be used as local devices

The following devices can be used as local devices.

- Internal relay (M)
- Edge relay (V)
- Timer (T, ST)
- Counter (C)
- Data register (D)
- Index register (Z) PNote 6.2



The Q00UJCPU does not support the use of local devices.


# Note 6.2 Universal

When using the index register as a local device with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, Q26UDHCPU, or QnUDE(H)CPU, check the versions of the CPU module and programming tool used.

( Page 467, Appendix 2)

# (2) Saving and restoring a local device file

When some programs use a local device, respective local device file data in the standard RAM or a memory card (SRAM) are exchanged with the device memory data of the CPU module after execution of each program. For this reason, the scan time increases by the time spent for data exchange.

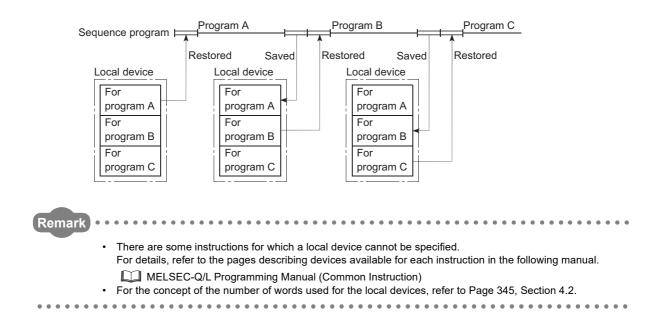


# (3) Local device setting

### (a) Setting the local device range

In the Device tab of the PLC parameter dialog box, set the range that is used as a local device.

	Sym.	Dig.	Device Points	Latch (1) Start	Latch (1) End	Latch (2) Start	Latch (2) End	Local Device Start	Local Device End
Input Relay	X	16	8K						
Output Relay	Y	16	8K						
Internal Relay	M	10	15K						
Latch Relay	L	10	8K						
Link Relay	В	16	8K						
Annunciator	F	10	2K						
Link Special	SB	16	2K						
Edge Relay	V	10	2K						
Step Relay	S	10	8K						
Timer	T	10	2K						
Retentive Timer	ST	10	OK						
Counter	C	10	1K						
Data Register	D	10	22K						
Link Register	W	16	8K						
Link Special	SW	16	2K						
Index	Z	10	20						
Device Total		39.2	K Words	Latch(1) : Able to clear the value by using latch clear.					
Word Device		35.0	K Words	Scan tir	Latch(2) : Unable to clear the value by using latch clear. Clearing will be executed by prog Scan time is extended by the latch range setting (including L).				
Bit Device		51.0	K Bits	If the latch is necessary, please set the required minimum latch range. When using the local devices, please do the file setting at PLC file setting parameter.					

Note that the local device range is common to all programs, and cannot be changed for each program. For example, if a local device range is specified as M0 to M100, this range setting applies to all programs that use the local device.

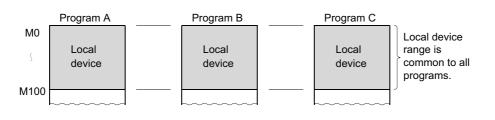

Point P

- The 32-bit index modification range must not overlap with the local device setting range of the index register. If overlapped, 32-bit index modification values will be written over the local device values.
- When CPU module parameters which contain local device setting of the index register are read from a programming tool that does not support the setting, all of the index register data will be read out as global device data.

#### (b) Setting the drive and file name

After setting the local device range, set a memory for storing the local device file and a file name in the PLC file tab of the PLC parameter dialog box.

File for Local Device					
C Not Used					
Use the following file					
Corresponding Memory	Memory Card (RAM) (Drive 1) 💌				
File Name					

# (c) Writing the setting data

Write the data set in (a) and (b) to the CPU module.

[™] [Online] ⇔ [Write to PLC]

**P**oint.

• If the size setting of the local device in the standard RAM is changed with a sampling trace file stored in the standard RAM, the sampling trace file is cleared. To save the trace results in your personal computer, perform the following operations.


♥ [Debug] ⇔ [Sampling Trace] ⇔ [Read from PLC]

• All devices that are not set as local devices are global devices.

6.2 Local Device

# (4) Setting of whether to use a local device (for each program) PNote 6.3


Use of the local device can be set for each program, and this function can reduce the scan time. Also, since the area for saving and restoring data is not required for the programs not using a local device, the local device file size can be reduced.

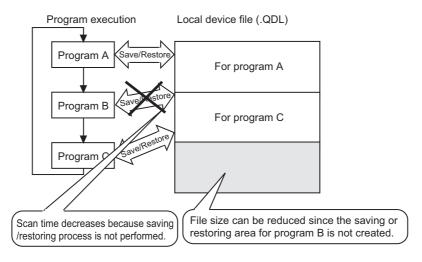

# (a) Setting method

In addition to the setting in (3) in this section, set the following.

Select the File Usability Setting button in the Program tab of the PLC parameter dialog box, and specify the programs that use the local device.

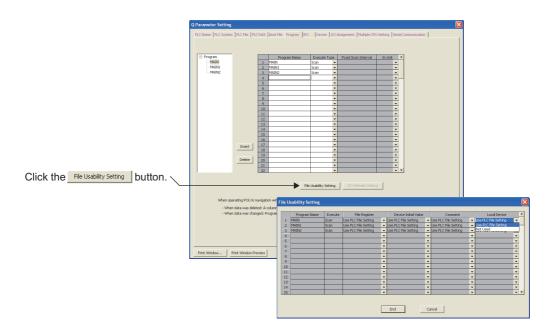

Note 6.3 Universal

When setting local devices for each program with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU,

Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool used. ( ) Page 467, Appendix 2)

# (b) Precautions

• Change of the local device

Do not change or refer to the local device in a program for which the local device is set to "Not Used". Even if the local device is changed in such a program, the changed data will not be held.

 Conditions for creating a local device file Creation of a local device file depends on the PLC parameter settings. Creation of a local device file depends on the PLC parameter settings. The following table shows the conditions to create a local device file.

O : Created, × : Not created

	PLC parameter se	etting	File creation	Error detection	
PLC file setting	Device setting ^{*1}	File Usability Setting	File creation		
Set	Set	Use PLC File Setting	0	-	
	Sel	Not Used	0	-	
	Not set	Use PLC File Setting	×	-	
	NOUSEL	Not Used	×	-	
Not set	Set	Use PLC File Setting	×	PARAMETER ERROR (error code: 3000)	
	Sel	Not Used	×	-	
	Not set	Use PLC File Setting	×	-	
	1101 361	Not Used	×	-	

*1 Indicates the local device range setting in the Device tab.


# (5) Using the local device corresponding to the file where a subroutine program is stored

When a subroutine program is executed, the local device corresponding to the file where the subroutine program is stored can be utilized.


Use of the relevant local device is set by ON/OFF of SM776.

SM776	Operation			
OFF	Perform operations with the local device that corresponds to the source file of the subroutine program.			
ON	Perform operations with the local device that corresponds to the file where the subroutine program is stored.			

# (a) When SM776 is off

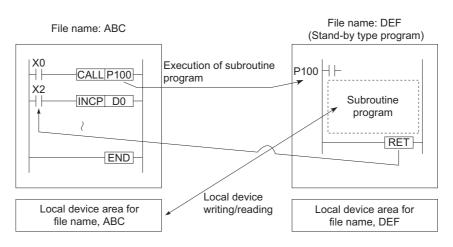

#### (b) When SM776 is on

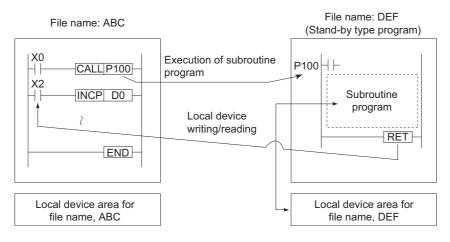

#### (c) Precautions

• When SM776 is on, local device data are read out when a subroutine program is called, and the data are saved after execution of the RET instruction.

Because of this, the scan time is increased if one subroutine program is executed with SM776 set to on.

- The on/off status of SM776 is set for each CPU module. It cannot be set for each file.
- If the on/off status of SM776 is changed during sequence program execution, control is implemented according to the information after the change.

# Remark For details of SM776, refer to the following. Image: Imag


# (6) Usage of the local device when an interrupt/fixed scan execution type program is executed

When the local device is used for an interrupt/fixed scan execution type program, turn on SM777 (Enable/disable local device in interrupt program). The programs will not function properly if SM777 is turned off.

*1 The index register set as the local device uses the local device area for the program executed before the interrupt/fixed scan execution type program, regardless of the on/off status of SM777.

**Ex.** Operation example when SM777 is turned on with the following setting

Program name	Execution type	Local device
А	Scan	Not used
В	Scan	Used
С	Scan	Used
Х	Fixed scan	Used

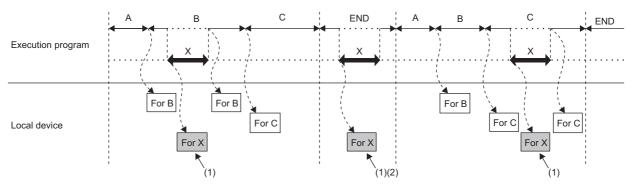

(1) Uses the program X local device.

(2) When an interrupt/fixed scan execution type program is executed during the END processing, the local device for Program C, which was executed before the END processing, is read out and saved. Thus, the END processing time increases by the time required for the read and save.

### (a) Precautions

- When SM777 is on, local device data are read out before execution of an interrupt/fixed scan execution type program, and the data are saved after execution of the IRET instruction.
   Because of this, the scan time is increased if one interrupt/fixed scan execution type program is executed with SM777 set to on.
- The on/off status of SM777 is set for each CPU module. It cannot be set for each file.
- For the local device monitoring, the target local device is monitored by switching the selection of corresponding program manually. When SM777 is off, when an interrupt occurred immediate after the switch processing, monitoring target local device is monitored. (The local device for the program executed prior to the interrupt (the program immediate before END) is not monitored.)



For details of SM777, refer to the following.

QCPU User's Manual (Hardware Design, Maintenance and Inspection)

# (7) Clearing local device data

Local device data is cleared by either of the following:

- · When the CPU module is powered off and then on or is reset
- When the CPU module status is changed from STOP to  $\ensuremath{\mathsf{RUN}}$

Local device data cannot be cleared using a programming tool.

Appendix 1 Parameters

# APPENDICES

# Appendix 1 Parameters

This chapter describes parameters set for programmable controller systems.

### (1) Parameter types

The following parameters are provided for CPU modules.

- PLC parameters ( Page 438, Appendix 1.2)
   These parameters are set when a CPU module is used stand alone in a system.
- Network parameters (FFP Page 459, Appendix 1.3)
   These parameters are set when a CPU module is used in combination with network modules, such as CC-Link IE Controller Network modules, MELSECNET/H modules, Ethernet modules, and CC-Link modules.
- Remote password (FP Page 465, Appendix 1.4)
   This parameter is set when the remote password function of Built-in Ethernet port QCPUs, Ethernet modules, or serial communication modules is used.

### (2) Parameter setting method

Use a programming tool.

For the setting, refer to the following.

Derating manual for the programming tool used

## Point P

The setting cannot be done in the grayed-out area (not selectable) of the screen because the function of the area is not available.



Each parameter number shown in the tables in this chapter is stored in the special register (SD16 to SD26) when an error occurs in parameter setting.

Identify the parameter error location from the parameter number.

# Appendix 1.1 List of parameter numbers

Each parameter number will be stored in SD16 to SD26 when an error occurs in the parameter settings. The following table lists the parameter items and corresponding parameter numbers. For explanation of M and N shown in the "Parameter No." column, refer to Appendix 1.3.

Parameter No.	Item		Set in:	Reference
0000 _H	Label		PLC Name	Dage 129 Appendix 1.2.1
0001 _H	Comment		PLC Name	Page 438, Appendix 1.2.1
		Туре		
0400 _H	I/O Assignment	Model Name		Page 59, Section 2.3.2,
0400H	NO Assignment	Points		Page 450, Appendix 1.2.9
		Start XY (Start I/O number)		
		Base Model Name		
0401 _H	Base Setting	Power Model Name		Page 54, Section 2.2.2,
040 IH		Extension Cable		Page 450, Appendix 1.2.9
		Slots	I/O Assignment	
0403 _H		Error Time Output Mode		Page 141, Section 3.8, Page 450, Appendix 1.2.9
0405 _H	Detailed Setting	I/O Response Time		Page 139, Section 3.7, Page 450, Appendix 1.2.9
0406 _H		Control PLC		QCPU User's Manual (Multiple CPU System)
0409 _H	Switch Setting	•		Page 450, Appendix 1.2.9
0E00 _H	No. of PLC			
0E01 _H	Operation Mode	-	Multiple CPU	Page 452, Appendix 1.2.10, QCPU User's Manual (Multiple
0E04 _H	I/O Sharing When Using	All CPUs Can Read All Inputs	Setting	CPU System)
0-0'H	Multiple CPUs	All CPUs Can Read All Outputs		

Parameter No.		Item	Set in:	Reference	
1000 _H	Timer Limit Cetting	Low Speed			
IUUUH	Timer Limit Setting	High Speed		Dess 120 Annondiv 1.2.2	
1001 _H		Contacts RUN PAUSE		Page 439, Appendix 1.2.2	
IOOTH	RUN-PAUSE Contacts	PAUSE			
1002 _H	Remote Reset			Page 136, Section 3.6.3,	
			_	Page 439, Appendix 1.2.2	
1003 _H	Output Mode at STOP to R	RUN		Page 125, Section 3.4, Page 439, Appendix 1.2.2	
1005 _H	Common Pointer No.				
1007 _H	Points Occupied by Empty	Slot	-	Page 439, Appendix 1.2.2	
1008 _H	Interrupt Program/Fixed Sc	PLC		Page 82, Section 2.9, Page 98, Section 2.10.4, Page 439, Appendix 1.2.2	
	System Interrupt Settings	Fixed Scan Interval (n : 28 to 31)			
100F _H	High Speed I/O Refresh	X Input			
1010 _H	Setting	Y Output			
1011 _H	High Speed Buffer	Buffer Read		Page 439, Appendix 1.2.2	
1012 _H	Transfer Setting	Buffer Write			
100A _H	Intelligent Function Module	e Setting (Interrupt Pointer Setting)	_		
100C _H	Module Synchronization		-		
	Use Serial Communication				
	Transmission Speed		-		
100E _H	Sum Check		Serial	Page 233, Section 3.23,	
	Transmission Wait Time		Communication	Page 457, Appendix 1.2.12	
	Online Change				
1013 _H	Service Processing Setting	I		Page 241, Section 3.24.1, Page 439, Appendix 1.2.2	
1014 _H	Latch Data Backup Operat	ion Valid Contact	PLC System	Page 254, Section 3.29, Page 439, Appendix 1.2.2	
1016 _H	Ethernet port setting		Built-in Ethernet port setting	Page 454, Appendix 1.2.11	
1017 _H	PLC Module Change Settir	ng	PLC System	Page 439, Appendix 1.2.2	
1019 _H	Simple PLC communication	n function	Built-in Ethernet port setting	Page 454, Appendix 1.2.11	
101F _H	MELSOFT Connection Ext	ended Setting			
1020 _H	Disable Using Port Setting		Built-in Ethernet		
				Page 454, Appendix 1.2.11	
1030 _H	CC-Link IEF Basic	Network Configuration Setting	port setting		

Parameter No.		ltem	Set in:	Reference
1100 _H	File Register			Page 392, Section 4.7, Page 441, Appendix 1.2.3
1101 _H	Comment File Used in a C	Command		Page 441, Appendix 1.2.3
1102 _H	Device Initial Value			Page 247, Section 3.25, Page 441, Appendix 1.2.3
1103 _H	File for Local Device		PLC File	Page 422, Section 6.2, Page 441, Appendix 1.2.3
1104 _H	Transfer to Standard ROM	1 at Latch data backup operation.		Page 254, Section 3.29, Page 441, Appendix 1.2.3
1105 _H	File used for SP.DEVST/S	DEVLD Instruction		Page 259, Section 3.30, Page 441, Appendix 1.2.3
2000 _H	Device Points			Page 336, Section 4.1, Page 447, Appendix 1.2.8
2001 _H	Latch (1) Start/End			Page 122, Section 3.3,
2002 _H	Latch (2) Start/End			Page 447, Appendix 1.2.8
2003 _H	Local Device Start/End			Page 447, Appendix 1.2.8
2000 _H	Eile Register Extended		Device	
2004 _H	File Register Extended	Latch (1) Start/End		Page 402, Section 4.8,
2005 _H	Setting	Latch (2) Start/End		Page 447, Appendix 1.2.8
2000 _H	Indexing Setting for ZR De	evice		Page 387, Section 4.6, Page 447, Appendix 1.2.8
2006 _H	Latch Interval Setting			Page 122, Section 3.3, Page 447, Appendix 1.2.8
2007	Disable device write from	external	During	Page 306, Section 3.37,
2007 _H	Write Protection Start/End		— Device	Page 447, Appendix 1.2.8
3000 _H	WDT (Watchdog Timer)	WDT Setting	PLC RAS	Page 193, Section 3.16, Page 442, Appendix 1.2.4
2000H	Setting	Initial Execution Monitoring Time	- PLU KAO	Page 92, Section 2.10.1, Page 442, Appendix 1.2.4

Parameter No.		Item	Set in:	Reference
		Carry Out Battery Check		
		Carry Out Fuse Blown Check		
3001 _H	Error Check	Verify Module		
<u>H</u>		Check Device Range at Indexing		
		Diagnose Redundant Power Supply		
		System		
		Computation Error		Page 195, Section 3.17,
		Expanded Command Error		Page 442, Appendix 1.2.4
	Fuse Blown			
	Operating Mode When	Module Verify Error		
3002 _H	There is an Error	Intelligent Module Program Execution Error	PLC RAS	
		File Access Error		
		Memory Card Operation Error		
		External Power Supply OFF	]	
3003 _H	Constant Scanning			Page 119, Section 3.2,
occoH	Constant Scanning			Page 442, Appendix 1.2.4
300A _H	Module Error History Coll	ection		Page 298, Section 3.34,
	,			Page 442, Appendix 1.2.4
300B _H	Operation History			Page 314, Section 3.38 Page 442, Appendix 1.2.4
				Page 142, Appendix 1.2.4 Page 142, Section 3.9,
4004 _H	Detailed Setting	PLC Operation Mode at H/W Error	I/O Assignment	Page 42, Section 3.9, Page 450, Appendix 1.2.9
5000 _H	Number of modules on M	LESECNET/H		5
5001 _H	Valid Module During Other Station Access			
5002 _H	Interlink Transmission Parameters			
			-	
5003 _H	Routing Parameters			
ENIMO	Start I/O No.		-	
5NM0 _H	Network No.			
ENIMO	Total Stations			
5NM0 _H	Mode		MELSECNET/H	Page 462, Appendix 1.3.3
5NM1 _H	Refresh Parameters			
5NM2 _H	Common Parameters			
5NM3 _H	Station Inherent Paramet	ers		
5NM5 _H	Sub-master parameters			
5NMA _H	Common Parameters 2			
	Station Inherent Paramet	ers 2		
5NMB _H	Interrupt Settings		1	
7000	Program		Brogram	Page 88, Section 2.10,
7000 _H	Program		Program	Page 445, Appendix 1.2.6
		Clear Program Memory		
7000 _H	Boot Option	Auto Download All Data from Memory Card to Standard ROM	Boot File	Page 104, Section 2.11, Page 444, Appendix 1.2.5
	Boot File Setting		1	
8002 _H	SFC Program Start Mode			
8003 _H	Start Conditions		SFC	Page 446, Appendix 1.2.7
		lock is Stopped	-	

Appendix 1 Parameters Appendix 1.1 List of parameter numbers

Parameter No.	Item	Set in:	Reference	
9000 _H	Number of modules on Ethernet			
	Start I/O No.			
	Network No.			
9N00 _H	Group No.			
	Station No.			
	Operation Setting			
9N01 _H	Initial Setting			
9N02 _H	Open Setting	Ethernet	Page 463, Appendix 1.3.4	
9N03 _H	Router Relay Parameter			
9N05 _H	Station No.<->IP Information			
9N06 _H	FTP Parameters			
9N07 _H	E-mail Setting			
9N08 _H	News Setting			
9N09 _H	Interrupt Settings			
9N04 _H	Routing Parameters			
A000 _H	Number of modules on CC-Link IE Controller Network			
A002 _H	Interlink Transmission Parameters			
A003 _H	Routing Parameters			
A080 _H	Network Type			
A082 _H	Interlink Transmission Parameters			
	Start I/O No.			
ANM0 _H	Network No.			
ANNOH	Total Stations	CC-Link IE Controller		
	Station No.	Network,	Page 460, Appendix 1.3.1,	
ANM0 _H	Mode	CC-Link IE Field	Page 461, Appendix 1.3.2	
ANM1 _H	Refresh Parameters	Network		
ANM2 _H	Common Parameters			
, <del>.</del> H	Network Configuration Settings			
	Station Inherent Parameters			
	Network Operation Settings			
ANM3 _H	IP Address Setting			
	IP Address			
	Interrupt Settings			

Parameter No.	Item		Set in:	Reference
C000 _H	Number of Modules			
	Remote Input (RX)			
	Remote Output (RY)			
	Remote Register (RWr)			
	Remote Register (RWw)			
CNM1 _H	Ver.2 Remote Input (RX)			
CINICIH	Ver.2 Remote Output (RY)			
	Ver.2 Remote Register (RV	Vr)		
	Ver.2 Remote Register (RV	√w)		
	Special Relay (SB)			
	Special Register (SW)			
	Start I/O No.		CC-Link	Page 464, Appendix 1.3.5
	Operation Setting			
	Total Module Connected			
	Retry Count Automatic Reconnection Station Count			
CNM2 _H	Standby Master Station No			
CININZH	PLC Down Select			
	Scan Mode Setting			
	Delay Time Setting			
	Station Information Setting			
	Remote Device Station Initial Setting			
	Interrupt Settings			
E002 _H E003 _H	Communication Area Settir	ng (Refresh Setting)		
E006 _H	Online Module Change			
E007 _H	Refresh parameter detailed	I device specification		Page 452, Appendix 1.2.10,
E008 _H	Multiple CPU High Speed Transmission Area	CPU Specific Send Range	Multiple CPU	QCPU User's Manual (Multiple CPU System)
E009 _H	Setting	Auto Refresh		
E00B _H	Multiple CPU Synchronous	Startup Setting		
E00C _H	Host Station			
EF00 _H	Programming tool paramet	ers	-	-
	1			

A

# Appendix 1.2 PLC parameters

This section describes PLC parameter details with setting windows.

### Appendix 1.2.1 PLC name

A label and a comment for the CPU module are set. The settings will be displayed in the list for the find CPU function. PNote Appx.1

Parameter Se	tting				
PLC Name PLC	System PLC File PLC RAS Boot Fil	e Program SFC Device I/O	Assignment   Multiple CPU	Setting Serial Com	munication
Label					
–					
Comment					

Item	Parameter No.	Description	Setting range	Default	Reference
Label	0000 _H	Set a label (name, application) for the CPU module.	Up to 10 characters	Blank	-
Comment	0001 _H	Set a comment for the CPU module label.	Up to 64 characters	Blank	-



The Universal model QCPUs other than the Built-in Ethernet port QCPU do not support the find CPU function.

### Appendix 1.2.2 PLC system

Parameters required for use of the CPU module are set.

Low Speed 100 ms (1ms1000ms)	Common Pointer No. P After (04095)
High Speed 10.00 ms (0.01ms100ms)	Points Occupied by Empty Slot (*1) 16  Points
RUN X (X0X1FFF) PAUSE X (X0X1FFF)	System Interrupt Settings Interrupt Counter Start No. C (0768)
tch Data Backup Function       Execute by Contact       Device Name       Image: standard RAM	Fixed Scan Interval           128         100.0         ms         (0.5ms-1000ms)           129         40.0         ms         (0.5ms-1000ms)           130         20.0         ms         (0.5ms-1000ms)
mote Reset	I31         I0.0         ms         (0.5ms-1000ms)         High Speed Interrupt Settings
utput Mode at STOP to RUN	Interrupt Program / Fixed Scan Program Setting
C Recalculate(Output is 1 scan later) pating Point: Arithmetic Processing	A-PLC Compatibility Setting Use special relay / special register from SM/SD 1000
Perform internal arithmetic operations in double precision     telligent Function Module Setting	Service Processing Setting © Execute the process as the scan 10 %
nterrupt Pointer Setting	C Specify service process time ms (0.2ms1000ms)
odule Synchronization Synchronize intelligent module's pulse up	Specify service process     Execution counts     C Execution counts
Ilt-in CC-Link Setting	PLC Module Change Setting

Ite	em	Parameter No.	Description	Setting range	Default	Reference
Timer Limit	Low Speed		Set the time limit for the low	1ms to 1000ms (in increments of 1ms)	100ms	Page 360,
Setting	High Speed	1000 _H	speed timer or high speed timer.	0.01ms to 100.0ms (in increments of 0.01ms)	10.0ms	Section 4.2.10
RUN- PAUSE	RUN	1001 _н	Set the contacts that control RUN/PAUSE of the CPU module.	X0 to 1FFF	Blank	Page 131, Section 3.6.1
Contacts	PAUSE	1001H	Setting of only the PAUSE contact is not allowed.	Setting of only the PAUSE		Page 134, Section 3.6.2
Latch Data	Execute by contact		Select to back up data using a contact. When selected, specify the device number used as a contact.	Х, М, В	Blank	– Page 254,
Backup Operation	Backup all files in the internal of standard RAM	1014 _H	Select to back up all files in the standard RAM.	-	Selected	Section 3.29
Remote Res	et	1002 _H	Select whether to allow the remote reset from programming tool.	Selected/deselected	Deselected	Page 136, Section 3.6.3
Output Mode RUN	e at STOP to	1003 _H	Set the status of the outputs (Y) when the operating status is switched from STOP to RUN.	Previous State, Recalculate (Output is 1 scan later)	Previous state	Page 125, Section 3.4
Intelligent Fu Module Setti Pointer Setti	ng (Interrupt	100A _H	Assign the interrupt pointers (I50 to I255) and set the start I/O number and start SI number of each intelligent function module.	Start I/O No.     Start SI No.     I50 to 255	Blank	Page 412, Section 4.11
Module Syno	chronization	100C _H	Select whether to synchronize CPU module startup with intelligent function module startup.	Selected/deselected	Selected	-

Α

lte	em	Parameter No.	Description	Setting range	Default	Reference
Common Po	inter No.	1005 _H	Set the start number of common pointers.	P0 to 4095	Blank	Page 411, Section 4.10.2
Points Occu Empty Slot	pied by	1007 _H	Set the number of points for empty slots on the main/extension base units.	0, 16, 32, 64, 128, 256, 512, or 1024 Points	16 Points	Page 54, Section 2.2.2
System Interrupt	Fixed Scan Interval (n: 28 to 31)	1008 _H	Set each execution interval for the interrupt pointers (I28 to I31).	0.5ms to 1000ms (in increments of 0.5ms)	• I28: 100.0ms • I29: 40.0ms • I30: 20.0ms • I31: 10.0ms	Page 412, Section 4.11
Settings	High Speed Interrupt Setting	100F _H to 1012 _H	Set this parameter when a high- speed interrupt pointer (I49) is used.	-	-	Page 225, Section 3.21
Interrupt Pro Scan Progra		1008 _H	Enable or disable high speed execution of interrupt programs or fixed scan programs.	Selected/deselected	Deselected	Page 82, Section 2.9, Page 98, Section 2.10.4
Service Proc Setting	cessing	1013 _H	<ul> <li>Select any of the following options.</li> <li>Execute the process as the scan time proceeds.</li> <li>Specify service process time.</li> <li>Specify service process execution counts.</li> <li>Execute it while waiting for constant scan setting.</li> </ul>	<ul> <li>1 to 99% (in increments of 1%)</li> <li>1 to 10 (in increments of 1 time)</li> <li>0.2 to 1000ms (in increments of 0.1ms)</li> <li>Blank</li> </ul>	Execute the process as the scan time proceeds.: 10%	Page 241, Section 3.24.1
PLC Module Setting (PLC Change Sett	Module	1017 _H	Set items required when performing the CPU module change with memory card function.	<ul> <li>Backup Start Setup Contact</li> <li>Backup Start Contact</li> <li>Backup Target Data</li> <li>Title Setting</li> </ul>	Blank	Page 260, Section 3.31

## Appendix 1.2.3 PLC file

Parameters required for the files used in the CPU module are set.

Not Used     Use the same file name as the program	Not Used
	C Use the same file name as the program
Corresponding Memory	Corresponding Memory
C Use the following file	C Use the following file
Corresponding Memory	Corresponding Memory
File Name	File Name
Capacity K Points	
(1K4086K Points)	File for Local Device
Transfer to Standard ROM at Latch data backup operation.	Not Used
Following settings are available in device setting	C Use the following file
when select "Use the following file" and specify capacity. -Change of latch(2) of file register.	Corresponding Memory v
Assignment to expanded data register/expanded link register of part of file register area.	File Name
mment File Used in a Command	File used for SP.DEVST/S.DEVLD Instruction
Not Used	Not Used
C Use the same file name as the program	C Use the following file
Corresponding Memory	Corresponding Memory
C Use the following file	File Name
Corresponding Memory	Capacity K Points
File Name	(1K512K Points)

Item	Parameter No.	Description	Setting range	Default	Reference
File Register ^{*1}	1100 _H	Set a file for the file register used in the program.	<ul> <li>Not Used</li> <li>Use the same file name as the program.</li> <li>Use the following file.</li> </ul>	Not Used	Page 392, Section 4.7
Transfer to Standard ROM at Latch data backup operation ^{*1}	1104 _H	Select whether to batch-transfer the data in the file register at the time of latch data backup to the standard ROM.	Checked/unchecked	Unchecked	Page 254, Section 3.29
Comment File Used in a Command	1101 _H	Set a file for device comments used in the program.	<ul> <li>Not Used</li> <li>Use the same file name as the program.</li> <li>Use the following file.</li> </ul>	Not Used	-
Device Initial Value	1102 _H	Set a file for initial values of the devices used for the CPU module.	<ul> <li>Not Used</li> <li>Use the same file name as the program.</li> <li>Use the following file.</li> </ul>	Not Used	Page 247, Section 3.25
File for Local Device ^{*1}	1103 _H	Set a file for local devices used in the program.	Not Used     Use the following file.	Not Used	Page 422, Section 6.2
File used for SP.DEVST/S.DEVLD Instruction	1105 _H	Set a device data file used for writing to or reading from the standard ROM.	Not Used     Use the following file.	Not Used	Page 259, Section 3.30

*1 Not available for the Q00UJCPU.

# Appendix 1.2.4 PLC RAS

Parameters required for performing the RAS functions are set.

NDT(Watchdog Timer)Setting	Constant Scanning
VDT Setting 200 ms (10ms2000ms)	ms (0.5ms2000ms)
Monitoring Time ms (10ms2000ms)	E man la laterar
ow Speed Execution ms (10ms2000ms)	Error history
Fror Check	C Record in the Following History File
Carry Out Battery Check	
Carry Out Fuse Blown Check	Target Memory
Verify Module	File Name
Check Device Range at Indexing	History No. Item (16100)
✓ Diagnose Redundant Power Supply System	
Operating Mode When There is an Error	Low Speed Program Execution Time
Computation Error Stop 💌	ms (1ms2000ms)
Expanded Command Error Stop 💌	
Fuse Blown	Module Error History Collection (Intelligent Function Module)
Module Verify Error	Collection of intelligent function module error histories is valid.
	* Selecting this enables intelligent function modules errors to be browsed in the "Error History" window of the system
Intelligent Module Program Execution Error Stop	monitor.
File Access Error Stop	Target Memory System Memory 👻
Memory Card Operation Error Stop	History No. 100 Item (32-1000)
External Power Supply OFF Stop	Collection No. 1 Items/Scan (1100)
Operation History	
Save operation history of CPU module	Memory Check
Target Memory	Check Program Memory
Capacity K Byte (1K Byte to 1024K Bytes)	
Save device write operation Disable clearing operation history	The memory check will be executed when PLC is changed to RUN and when END instruction is executed.

	Item	Parameter No.	Description	Setting range	Default	Reference	
WDT (Watchdog	WDT Setting	3000 _H	Set a watchdog timer value for the CPU module.	10ms to 2000ms (in increments of 10ms)	200ms	Page 193, Section 3.16	
Timer) Setting	Initial Execution Monitoring Time	3000H	Set a watchdog timer value in the case of using an initial execution type program.	10ms to 2000ms (in increments of 10ms)	Blank	Page 92, Section 2.10.1	
	Computation Error						
	Expanded Command Error*1				Stop		
	Fuse Blown						
	Module Verify Error						
Operating Mode When There is	Intelligent Module Program Execution Error	3002 _H	Set the operation mode of the CPU module when an error is detected.	Stop/Continue		Page 195, Section 3.17	
an Error	File Access Error						
	Memory Card Operation Error ^{*3}						
	External Power Supply OFF ^{*1}						
	Carry Out Battery Check						
	Carry Out Fuse Blown Check						
	Verify Module		Enable or disable detection of			Page 195,	
Error Check	Check Device Range at Indexing	3001 _H	the specified error.	Selected/deselected	Deselected	Section 3.17	
	Diagnose Redundant Power Supply System ^{*2}						
Constant Scannin	g	3003 _H	Set a constant scan time value.	0.5ms to 2000ms ^{*4}	Blank	Page 119, Section 3.2	

	ltem	Parameter No.	Description	Setting range	Default	Reference	
	Collection of intelligent function module error histories is valid.		Set whether to collect module errors.	Selected/deselected	Selected		
Module Error History	Corresponding Memory		Select a storage location. • System Memor • Standard RAM		System Memory		
Collection (Intelligent Function Module)	History No.	300A _H	Set the number of collected errors only when the errors are stored in the standard RAM.	32 to 1000	40/100	Page 298, Section 3.34	
	Collection No.		Set the number of collected errors in one scan.	<ul> <li>Stored in system memory: 1 to 100</li> <li>Stored in standard RAM: 1 to 128</li> </ul>	1		
	Save operation history of CPU module		Set whether to use the operation history function.	-	Unchecked		
	Target Memory		Set the destination memory to save the operation history file.	<ul> <li>Standard ROM (Drive 4)</li> <li>Memory Card (SD) (Drive 2)</li> </ul>	Standard ROM (Drive 4)		
Operation History ^{*5}	Capacity	Capacity 300B _H		1K to 1024K bytes	128K bytes	Page 314, Section 3.38	
	Save device write operation		Set whether to save the operation of device data writing from outside the CPU module.	-	Unchecked		
	Disable clearing operation history	<b>5</b> .		-	Unchecked		

*1 These items are provided for future expansion.

*2 When selecting this item for the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming tool. ( Page 467, Appendix 2)


*3 Not available for the Q00UJCPU, Q00UCPU, and Q01UCPU.

*4 The setting value differs depending on the CPU module used.
 CPU modules other than High-speed Universal model QCPU and Universal model Process CPU: in increments of 0.5ms
 High-speed Universal model QCPU and Universal model Process CPU: in increments of 0.1ms

*5 This setting item is available to the High-speed Universal model QCPU and Universal model Process CPU. Before setting this item, check the versions of the CPU module and GX Works2 used. (

### Appendix 1.2.5 Boot file


Parameters required for a boot from a memory card are set.

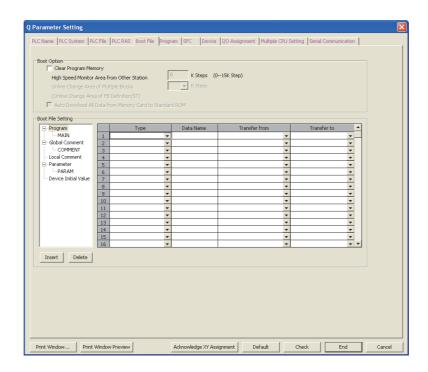

Ite	em	Parameter No.	Description	Setting range	Default	Reference
Boot Option	Clear Program Memory		Select whether to clear the program memory at the time of boot.	Selected/deselected	Deselected	Page 104,
Boot File Setting	Boot File Setting		Set the type and data name of the boot file, and transfer source drive for boot operation.	Type, Data Name, and Transfer from (The transfer target drive (Transfer to) is automatically set in the program memory.)	Blank	Section 2.11

### Appendix 1.2.6 Program

File names and execution types (execution conditions) are set for each program when two or more programs are written to the CPU module.

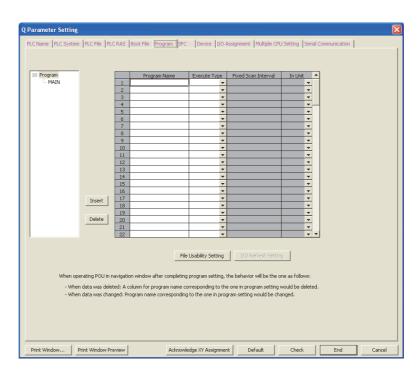


Item	Parameter No.	Description	Setting range	Default	Reference
Program setting	7000 _H	When writing two or more programs to the CPU module, set a file name and execution type (execution condition) of each program. Also, set a fixed scan interval (execution interval of the fixed scan execution type program).	<ul> <li>Program Name</li> <li>Execute Type (fixed scan interval when the fixed scan execution is selected)</li> <li>File Usability Setting^{*1}</li> </ul>	Blank	Page 88, Section 2.10

*1 Available for local devices only. When using the file usability setting, check the versions of the CPU module and programming tool. (

### Appendix 1.2.7 SFC

The mode and conditions for starting an SFC program, and the output mode in the case of a block stop are set.

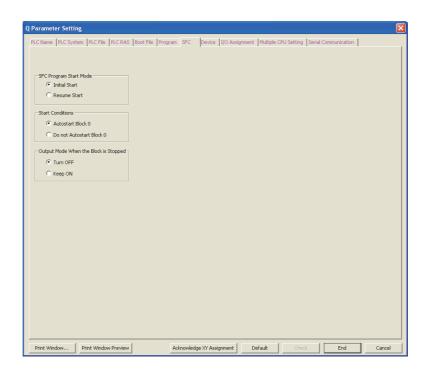

Item	Parameter No.	Description	Setting range	Default	Reference	
SFC Program Start Mode	8002 _H	Set the mode and conditions for		Initial Start	MELSEC- Q/L/QnA	
Start Conditions	8003 _H	starring an SFC program, and	MELSEC-Q/L/QnA	Autostart Block 0		
Output Mode When the Block is Stopped	8006 _H	also set the output mode in case a program block is stopped.	Programming Manual (SFC)	Turn OFF	Programming Manual (SFC)	

## Appendix 1.2.8 Device

Number of points, latch range, and local device range are set for each device.

		-									e write from external
	Sym.	Dig.	Device Points	Latch (1) Start	Latch (1) End	Latch (2) Start	Latch (2) End	Local Device Start	Local Device End	Write Protection Start	Write Protection End
Input Relay	х	16	8K	U Cart	2110	Utont	210		Ling		Line
Output Relay	Y	16	8K								
Internal Relay	M	10	28K	í – – –							
Latch Relay	L	10	8K	"							
Link Relay	В	16	8K								
Annunciator	F	10	2K								
Link Special	SB	16	2K								
Edge Relay	V	10	2K								
Step Relay	S	10	8K								
Timer	Т	10	2K								
etentive Timer	ST	10	0K								
Counter	С	10	1K								
Data Register	D	10	41K								
Link Register	W	16	8K								
Link Special	SW	16	2K								
Index	Z	10	20								
evice Total	5	59.0	K Words	Word	Device	54.0	K Words	Bit Device	64.0	K Bits	Device Setting HELP
ile Register Exte	, ended 9	Setting	1		,				,		
File Register Extended Setting Capacity K Points File Register Extended					ints					File Register Exte	nded Setting HELP
		ym.		vice Latch ints Star				2) Device No. Start	Device No. End	Write Protection Start	Write Protection End
	s	ym.									
File Register		ym. R(R)	10								
File Register Extended Dat	Z		10 10								
	Z	R(R)									

Item	Parameter No.	Description	Setting range	Default	Reference
Device Points ^{*1}	2000 _H	Set the number of device points that is appropriate to the system.	X (8K), Y (8K), and S (8K) ^{*3} are fixed. Setting is available within the range of 29K words ^{*8} in total, including the above fixed points (1.5K words). One device: Up to 32K points ^{*7}	• X: 8K • Y: 8K • M: 8K ^{*9} • L: 8K ^{*2} • B: 8K • F: 2K • SB: 2K • V: 2K • S: 8K ^{*3} • T: 2K • ST: 0K • C: 1K • D: 12K ^{*10} • W: 8K • SW: 2K	Page 336, Section 4.1
Latch (1) Start/End (Latch clear valid) ^{*2}	2001 _H	Set a latch range (start and end device numbers), which can be cleared by a latch clear operation.	Setting is available for only one range for each of B, F, V, T, ST, C, D, and W devices.	Blank	Page 122, Section 3.3
Latch (2) Start/End (Latch clear invalid) ^{*2}	2002 _H	Set a latch range (start and end device numbers), which cannot be cleared by a latch clear operation.	Setting is available for only one range for each of L, B, F, V, T, ST, C, D, and W devices.	Blank	Page 122, Section 3.3
Local Device Start/End ^{*6}	2003 _H	Set a range (start and end device numbers), which is used for a local device.	Setting is available for only one range for each of M, V, T, ST, C, D, and Z devices. ^{*5}	Blank	Page 422, Section 6.2

Α

Ite	em	Parameter No.	Description	Setting range	Default	Reference	
File	Device Points	2000 _H	Set points for the file register (ZR), extended data register (D), and extended link register (W).	Point assignment to the file register (ZR), extended data register (D), or extended link register (W). Assign part of the points of the file register to the extended data register and extended link register.	Blank	Page 336, Section 4.1, Page 402, Section 4.8	
Register Extended Setting ^{*6}	Latch (1) Start/End (Latch clear valid)	2004 _H	Set a latch range (start and end device numbers), which can be cleared by a latch clear operation.	Each latch range for the file register (ZR), extended data register (D), or extended link register (W).	Blank	Page 122, Section 3.3	
	Latch (2) Start/End (Latch clear invalid)	2005 _H	Set a latch range (start and end device numbers), which cannot be cleared by a latch clear operation.	Each latch range for the file register (ZR), extended data register (D), or extended link register (W).	Blank	Page 122, Section 3.3	
Indexing Setting for ZR Device	32Bit 2000 _H		Select Z or ZZ device for 32-bit indexing.	Z0 to Z18 (when using Z device)	Use Z	MELSEC-Q/L Programming Manual (Common Instruction)	
Latch Interva	al Setting ^{*6}	2006 _H	Set a latch interval.	1 to 2000ms	Each Scan	Page 122, Section 3.3	
Disable devid external	Disable device write from external		Set whether to use the write- protect function for device data (from outside the CPU module).	-	Unchecked		
Write Protect	2007 _H Write Protection Start/End		Set the write-protected range (set the start device number and the end device number). To set this item, select the checkbox of "Disable device write from external".	One range per device (available to X, Y, M, L, B, F, SB, V, S, T, ST, C, D, W, SW, Z, ZR (R), extended data register, extended link register)	Blank	Page 306, Section 3.37	
		00		st not exceed the refresh ranges of ne new device point setting exceeds the c			
	data	may be writte	n to another device or an error r	nay occur.		<b>C</b>	
			ch range is set, the scan time inc e 479, Appendix 3.2 (6))	creases. When latching a device, con	sider the increa	se in the scan	
	*3 For t	he Universal r	nodel QCPU whose serial numb	er (first five digits) is "10042" or later, whose serial number (first five digits) i	•		
	step	relay (S) can • Q00UJCPU	be set up to the following in incr , Q00UCPU, Q01UCPU, and Q0	ements of 1K points. (🗊 Page 46	7, Appendix 2)		
			· · ·	gits) of the Universal model QCPU is '			
		•	<b>o</b>	th the Q03UDCPU, Q04UDHCPU, Q0	-		

Q26UDHCPU, or QnUDE(H)CPU, check the versions of the CPU module and programming tool used. (

*6 Not available for the Q00UJCPU.

*7 For the Universal model QCPU whose serial number (first five digits) is "10042" or later, the maximum number of points for the internal relay (M) and link relay (B) is 60K. (

- *8 The setting range differs depending on the CPU module.
  - Q03UDVCPU: 30K words
  - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 40K words
  - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 60K words
- *9 The default value differs depending on the CPU module.
  - Q03UDVCPU: 9K points
  - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 15K points
  - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 29K points
- *10 The default value differs depending on the CPU module.
  - Q03UDVCPU: 13K points
  - Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU: 22K points
  - Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU: 41K points
- *11 Only the High-speed Universal model QCPU and Universal model Process CPU can select "Time Setting". The latch interval setting is fixed to "Each Scan" for other CPU modules.

*12 This setting item is available to the High-speed Universal model QCPU and Universal model Process CPU. Before setting this item, check the versions of the CPU module and GX Works2 used. (

### Appendix 1.2.9 I/O assignment

The mounting status of each module in the system is set.


0 PLC			Model Name	Points	Start XY	-	tting
	PLC	-			<b>•</b>		
1 0(*-0)		-			*	Detailed Se	tting
2 1(*-1) 3 2(*-2)		- -			* *	Select PLC	type
3 2(*-2) 4 3(*-3)		*			-		
4 3(*-3) 5 4(*-4)		• •			• •	Select mo	dule
6 5(*-5)		-			-	_	
7 6(*-6)		•			-	*	
Ext.Base1						<ul> <li>C Detail</li> </ul>	
Base Setting(*	Base Model Name		ver Model Name	Extension C		Slots Base Mode	• —
Main						Auto	
						Detai	
Ext.Base2 Ext.Base3						▼ 8 Slot Defa	a de
Ext.Base4						-	
Ext.Base5						▼ 12 Slot Def	ault
Ext.Base6						▼ Select	
Ext.Base7						module na	me
(*1)Settir	g should be set as same wher	ı using multiple CPU.	Export to CSV F	ile Import Multip	le CPU Parameter	Read PLC Data	

lt	tem	Parameter No.	Description	Setting range	Default	Reference	
	Туре		Set the type of the mounted module.	<ul> <li>CPU No.2 to No.4: No.n/Empty (Set "CPU (Empty)" for the slot where no CPU module is mounted.)</li> <li>Empty, Input, Hi. Input, Output, I/O Mix, Intelligent, or Interrupt</li> </ul>			
	Model Name	0400 _H	Set the model name of the mounted module. (Entered at user's discretion. Do not use the one for the CPU module.)	Up to 16 characters	Blank	Page 59, Section 2.3.2	
	Points		Set the number of points assigned to each slot.	0, 16, 32, 48, 64, 128, 256, 512, or 1024 points			
	Start XY		Set the start I/O number of each slot.	0 _H to FF0 _H			
	Base Model Name		Set the model name of the main base unit or extension base unit. (Entered at user's discretion. Do not use the one for the CPU module.)	Up to 16 characters		Page 54, Section 2.2.2	
Base Setting	Power Model Name	0401 _H	Set the model name of the power supply module on the main base unit or extension base unit. (Entered at user's discretion. Do not use the one for the CPU module.)	Up to 16 characters	Blank		
	Extension Cable		Set the extension cable name. (Entered at user's discretion. Do not use the one for the CPU module.)	Up to 16 characters			
	Slots		Set the number of slots of the main base unit or extension base unit. This setting must be done for all base units.	2, 3, 5, 8, 10, or 12			
Switch Setting		0407 _H	Set various switches of an intelligent function module.	Refer to the manual for the intelligent function module used.	Blank	Page 143, Section 3.10	

Item		Parameter No.	Description	Setting range	Default	Reference
Error Time Output Mode		0403 _H	Set whether to clear or hold the output in case of a stop error in the control CPU.	Clear/Hold	Clear	Page 141, Section 3.8
Detailed Setting	PLC Operation Mode at H/W Error	4004 _H	Set whether to stop or continue the operation of the control CPU in case of a hardware failure of the intelligent function module.	Stop/Continue	Stop	Page 142, Section 3.9
	I/O Response Time	se 0405 _H Set a response time for the input module, high-speed input module, I/O combined module, or interrupt module, or interrupt module or interrupt module. Input or I/O Mix: 1ms, 5ms, 10ms, 20ms, or 70ms • Hi. Input or Interrupt: 0.1ms, 0.2ms, 1mt		<ul> <li>Input or I/O Mix: 10ms</li> <li>Hi. Input or Interrupt: 0.2ms</li> </ul>	Page 139, Section 3.7	
	Control PLC	0406 _H	Set the control CPU for the input/output modules and intelligent function module.	PLC No.1, No.2, No.3, or No.4	PLC No.1	QCPU User's Manual (Multiple CPU System)
Select PLC type		PLC type - Sets the model of the conne module automatically in the Assignment" area by selecti module from the pull-down i		-	Blank	Dago 54
		-	Sets the model name, points, and start I/O number of the selected module automatically in the "I/O Assignment" area by selecting the module from the pull-down menu.	-	Blank	Page 54, Section 2.2.2

#### Appendix 1.2.10 Multiple CPU setting PNote Appx.2

Parameters required for configuring a multiple CPU system are set.

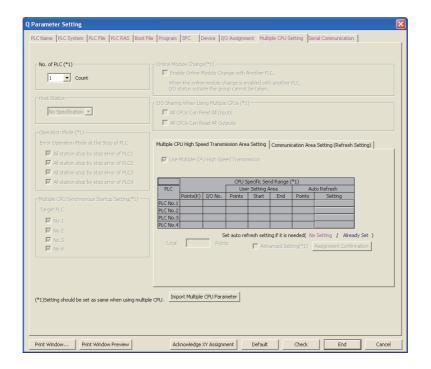



Note Appx.2 Universal

The Q00UJCPU cannot be used in multiple CPU systems.

	Item		Parameter No.	Description	Setting range	Default	Reference
No. of PLC			0E00 _H	Set the number of CPU modules used in a multiple CPU system.	1 to 4	1	
Host Station ^{*1}	Host Station ^{*1}		E00C _H	Set a CPU number for which the multiple CPU setting parameters are set. (Set the number of the connected CPU module.)	PLC No.1 to No.4	Blank	
Operation Mode			0E01 _H	Select the multiple CPU system operation to be performed in case a stop error occurs in any of CPU No.2 to No.4. When CPU No.1 results in a stop error, the multiple CPU system stops. (Fixed)	Selected/deselected	All items selected	
Multiple CPU S Setting ^{*1}	Synchronous Startup E00B _H Enable or disable synchronous startup of the CPU modules on the multiple No.1 to No.4 CPU system.		No.1 to No.4	All items selected			
Online Module	Online Module Change ^{*1}		E006 _H	Enable or disable the online module change in the multiple CPU system. (When enabled, the CPU module cannot read the I/O data outside the specified group.)	Selected/deselected	Deselected	
I/O Sharing Wi	I/O Sharing When Using Multiple CPUs All CPUs All Inputs All CPUs Can Read All OUtputs		0E04 _H	Select whether to read the input data of the input modules or intelligent function modules controlled by another CPU.	Selected/deselected	Deselected	
Multiple CPUs			0F0+H	Select whether to read the output data of the output modules controlled by another CPU.	Selected/deselected	Deselected	QCPU
Multiple CPU High Speed	CPU Specific Send Range		E008 _H	Set the size of the multiple CPU high- speed transmission area that is assigned to each CPU module of the multiple CPU system.	Simple setting:0 to 12K (in increments of 1K points) Advanced setting:0 to 16K (in increments of 0.5K points)	3K points	User's Manual (Multiple CPU System)
Transmission Area Setting ^{*1}	Auto Refresh	Refresh setting	E009 _H E00A _H	Set an area range for data communication performed with the auto refresh function in the user area of the multiple CPU high-speed transmission area.	Available devices ^{*2} :X, Y, M, L, B, D, W, R, ZR, SM, SD, SB, and SW	-	
					[Set Starting Devices for each PLC] Selected/deselected	Deselected	
			In the multiple CPU system, data are	[CPU Specific Send Range] 0 to 2048 points (in increments of 2 points) per CPU Up to 8K points (8192 points) per system			
Communicatio Setting)	Communication Area Setting (Refresh Setting)		Е002 _Н Е003 _Н	transferred by auto refresh among respective CPU modules. Set the devices to be written or read and their points.	<ul> <li>[PLC Side Device]</li> <li>B, M, Y, D, W, R, or ZR</li> <li>Occupies the device of the points set for the send range and starting from the specified device number.</li> <li>One point in the send range equals 16 points in B, M, or Y.</li> <li>One point in the send range equals one point in D, W, R, or ZR.</li> </ul>	Blank	

*1 Not available for the Q00UCPU, Q01UCPU, and Q02UCPU.

*2 SM, SD, SB, and SW are valid only when they are selected as send devices.

A

### Appendix 1.2.11 Built-in Ethernet port setting PNote Appx.3

Parameters required for using the built-in Ethernet port are set.

) Parameter Setting	X
PLC Name PLC System PLC File PLC RAS Boot File Program SFC D	evice I/O Assignment Multiple CPU Setting Built-in Ethernet Port Setting
□P Address Setting Input Format DEC ▼	Open Setting In Ethernet Configuration window
IP Address 192 168 3 39	FTP Setting
Subnet Mask Pattern	Time Setting
Default Router IP Address	MELSOFT Connection Extended Setting
	CC-Link IEF Basic Setting
Communication Data Code	Disable Using Port Setting
C ASCII Code	
Enable online change (FTP, MC Protocol)	
Disable direct connection to MELSOFT	
Do not respond to search for CPU (Built-in Ethernet port) on network	
Simple PLC Communication Setting IP packet transfer setting IP packet transfer setting IP packet transfer	
Print Window Print Window Preview Acknowledge X	Y Assignment Default Check End Cancel



The Universal model QCPUs other than the Built-in Ethernet port QCPU do not have any Ethernet port.

Item Paramete No.		Parameter No.	Description	Setting range	Default	Reference
IP Address Setting			<ul> <li>IP Address: Enter the IP address of the CPU module.</li> <li>Subnet Mask Pattern: Enter the subnet mask pattern when using a router.</li> <li>Default Router IP Address: Enter the IP address of the router.</li> </ul>	<ul> <li>IP Address: 0.0.0.1 to 223.255.255.254 (00000001_H to 0DFFFFFE_H)</li> <li>Subnet Mask Pattern: Blank or 192.0.0.0 to 255.255.255.252 (0C0000000_H to 0FFFFFFC_H)</li> <li>Default Router IP Address: Blank or 0.0.0.1 to 223.255.255.254 (00000001_H to 0DFFFFFE_H)</li> </ul>	<ul> <li>IP Address: 192.168.3.39</li> <li>Subnet Mask Pattern: Blank</li> <li>Default Router IP Address: Blank</li> </ul>	
Communica Code	ation Data	1016 _H	Select the code for MC protocol communication.	Binary Code/ASCII Code	Binary Code	QnUCPU User's Manual
Ethernet Conf. ^{*1} /Open Setting			Set when using the following functions. • MC protocol • MELSOFT connection • Socket communication • Predefined protocol	-	Blank	(Communication via Built-in Ethernet Port)
FTP Setting	]		Set data when using the file transfer function (FTP).	-	Blank	
Time Settin	Time Setting		Set data when using the time setting function.	-	Blank	
	MELSOFT Connection Extended Setting ^{*1}		Set data when using the MELSOFT connection extended setting.	-	Blank	
CC-Link IEF Basic	Network Configuration Setting	1030 _H	Set the network configuration when using CC-Link IE Field Network Basic.	-	Blank	CC-Link IE Field Network Basic
Setting ^{*1}	Refresh Setting	1031 _H	Set this parameter to refresh link device data to the internal device or file register automatically.	-	Blank	Reference Manual
Enable onlii (FTP, MC P	0		Enable or disable writing data in devices or files to the running CPU module when MC protocol or FTP is used.	Selected/deselected	Deselected	
Disable direct connection to MELSOFT		1016 _H	Enable or disable direct connection to MELSOFT. To enhance the security with the remote password setting, check it to disable it.	Selected/deselected	Deselected	QnUCPU User's Manual (Communication
Do not respond to search for CPU (Built-in Ethernet port) on network			Checking this box disables response to the find CPU function of the MELSOFT connection. To enhance the security, check it to disable this.	Selected/deselected	Deselected	via Built-in Ethernet Port)
Simple PLC communica	) tion function	1019 _H	Set parameters when using the simple PLC communication function.	-	-	
IP packet transfer setting		1016 _H	Set data when using IP packet transfer function.	Use/Not used	Not used	Manual for the CC-Link IE Field Network module used

Appendix 1 Parameters Appendix 1.2 PLC parameters

Item	Parameter No.	Description	Setting range	Default	Reference
Disable Using Port Setting ^{*1}	1020 _H	Set parameters when using the disable using port setting.	<ul> <li>■MELSOFT Transmission Port:</li> <li>Disable the port No.5001, 5006 to use for UDP/IP</li> <li>Disable the port No.5007 to use for TCP/IP</li> <li>■Built-in Ethernet Funciton:</li> <li>Disable the port No.61440 to use for iQ Sensor Solution function</li> <li>Disable the port No.61441 to use for SP.SLMPSND instruction</li> </ul>	Blank	QnUCPU User's Manual (Communication via Built-in Ethernet Port)

*1 This setting item is available to the High-speed Universal model QCPU and Universal model Process CPU. Before setting this item, check the versions of the CPU module and GX Works2 used. (

### Appendix 1.2.12 Serial communication PNote Appx.4

The transmission speed, sum check, transmission wait time, and RUN write setting for using the serial communication function of the CPU module are set.

Parameter Setting						D
PLC Name PLC System PLC File PLC RAS	300t File Program SFC	Device I/O Assign	nment   Multiple CP	J Setting Serial	Communication	
Use Serial Communication						
Transmission Speed						
19.2Kbps 💌						
🔽 Sum Check						
Transmission Wait Time						
No wait time						
Online Change						
Data format value is fixed as below. Start bit:1. Parity bit:0dd Data bit:6 Stop bit:1						
Print Window Print Window Preview						

ltem	Parameter No.	Description	Setting range	Default	Reference
Use Serial Communication		Select the item when using the serial communication function.	Selected/deselected	Deselected	
Transmission Speed		Set a transmission speed for data communication with the external device.	9.6Kbps, 19.2Kbps, 38.4Kbps, 57.6Kbps, 115.2Kbps	19.2Kbps	
Sum Check	100E _H	Set whether to add a sum check code to a message sent or received when using the serial communication function, according to the specifications of the external device.	Selected/deselected	Selected	Page 233, Section 3.23
Transmission Wait Time		Set a period of waiting time on the CPU module side in case the CPU module cannot receive data immediately after the external device sends data.	No wait time/10ms to 150ms (in increments of 10ms)	No wait time	
Online Change		Enable or disable writing of data from the external device to the running CPU module.	Selected/deselected	Deselected	

### Note Appx.4 Universal

Before using the serial communication function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, or Q26UDHCPU, check the versions of the CPU module and programming

tool used. ( Page 467, Appendix 2)

The Built-in Ethernet port QCPU does not support the serial communication function.

### Appendix 1.2.13 Acknowledge XY assignment

The parameters set in the I/O Assignment, Ethernet/CC IE/MELSECNET setting, and CC-Link setting can be checked.

Y No.	Тура	e	Slot	Module Type	Points	Model Name	Duplication
	Network	I/O Assignment					
0000							
0010							
020							
030							
040							
050							
060							
070							
080							
090							
0A0							
)0B0							
00C0							
00D0							

ltem	Parameter No.	Description	Setting range	Default	Reference
Acknowledge XY Assignment	-	The data set in the I/O Assignment, Ethernet/CC IE/MELSECNET setting, and CC-Link setting can be checked.	-	-	-
Export to CSV File	-	Writes parameters set in this screen to a CSV file.	-	-	-

# Appendix 1.3 Network Parameters

This section describes network parameter details with setting windows.

- ■Symbols, M and N, used in the "Parameter No." column
  - M and N in "Parameter No." in this section denote the following:
    - N: Indicates the module number.
    - M: Indicates the network type.

### (1) For CC-Link IE, MELSECNET/H

М	Network type
1 _H	CC IE Control (Control station), MELSECNET/H mode (Control station), MELSECNET/H Extended mode (Control station), MELSECNET/10 mode (Control station)
2 _H	CC IE Control (Normal station), MELSECNET/H mode (Normal station), MELSECNET/H Extended mode (Normal station), MELSECNET/10 mode (Normal station)
5 _H	MELSECNET/H (Remote master station)
8 _H	CC IE Field (Master station), CC IE Field (Submaster station) (when parameters are set)
9 _H	CC IE Field (Local station), CC IE Field (Submaster station) (when no parameter is set)
A _H	MELSECNET/H (Standby station)
B _H	MELSECNET/H mode multiplexed remote I/O network master station
D _H	MELSECNET/H mode multiplexed remote I/O network sub-master station (when no parameter is set)
E _H	MELSECNET/H mode multiplexed remote I/O network sub-master station (when parameters are set)

### (2) For CC-Link

М	Network type
0 _H	Master station
1 _H	Local station
2 _H	Standby master station

Α

### Appendix 1.3.1 CC-Link IE Controller Network setting

A Network Parameter - MELSECNET/CC IE/Ethernet Module Configuration 🗖 Set network configuration setting in CC IE Field configuration window Module 1 CC IE Control(Control Station) Module 3 Network Type None
 0000 None -Start I/O No. Network No. Total Stations Group No. Station No. Online Mode work Range As Refresh Paramete Specify Station No. by Parameter . 
 Necessary Setting( No Setting / Already Set )
 Set if it is needed( No Setting / Already Set )

 Start I/O No. :
 Valid Module During Other Station Access
 Ŧ Interlink Transmission Parameters Start I/O No. : Valid Module During Please input 16-point unit(HEX) to start I/O No. in which module is mounted. Acknowledge XY Assignment Routing Parameters Assignment Image Check End Cancel Print Window Preview Print Window... -

Network parameters for the CC-Link IE Controller Network are set.

ltem	Parameter No.	Description	Setting range	Default	Reference
Network Type	A000 _H				
Station number setting method	AUOOH				
Start I/O No.					
Network No.	ANM0 _H				
Total Stations	ANNOH				
Station No.					
Group No.	0Amn _H	Set network parameters for the	Refer to the manual for the	-	-
Mode	ANM0 _H	CC-Link IE Controller Network.	CC-Link IE Controller Network.		
Refresh Parameters	ANM1 _H				
Common Parameters	ANM2 _H				
Station Inherent Parameters	ANM3 _H				
Interlink Transmission Parameters	A002 _H				
Routing Parameters	5003 _H				

### Appendix 1.3.2 CC-Link IE Field Network setting

Network parameters for the CC-Link IE Field Network are set.

Network Parameter - MELSECNET/	CC IE/Ethernet Module Configuratio	n				
Set network configuration setting in CC 1	E Field configuration window					
	Module 1	Module 2	Module 3			
Network Type	CC IE Field (Master Station)	None 👻	None 👻			
Start I/O No.	0000					
Network No.	1					
Total Stations	2					
Group No.						
Station No.	0					
Mode	Online (Normal Mode) 🗸 🗸	<b>•</b>	<b>•</b>			
	Network Configuration Settings					
	Network Operation Settings					
	Refresh Parameters					
	Interrupt Settings					
	Specify Station No. by Parameter 🗸 🗸					
•						
Necessary Setting( No Setting / Already Set )         Set if it is needed( No Setting / Already Set )           Interlink Transmission Parameters         Start I/O No. :         Valid Module During Other Station Access 1           Please input 16-point unit(HEX) to start I/O No. in which module is mounted.         Please input 16-point unit(HEX)						
Acknowledge XY Assignment Routing Parameters	Assignment Image Group Setting	Check End	Cancel			
Print Window Preview						
4						

Item	Parameter No.	Description	Setting range	Default	Reference
Network Type	4080				
Station number setting method	A080 _H				
Start I/O No.					
Network No.					
Total Stations	ANM0 _H		Refer to the manual for the CC-Link IE Field Network.	-	
Station No.					
Mode					-
Refresh Parameters	ANM1 _H				
Network Configuration Settings	ANM2 _H				
Network Operation Settings	ANM3 _H				
Interrupt Settings	ANNOH				
Interlink Transmission Parameters	A082 _H				
Routing Parameters	5003 _H				

Appendix 1 Parameters Appendix 1.3 Network Param

### Appendix 1.3.3 MELSECNET/H setting

Network parameters for MELSECNET/H are set.

A Network Parameter - MELSECNET/CC IE/Ethernet Module Configuration									
Set network configuration setting in CC IE Field configuration window								<u> </u>	
		M	odule 1	T	Mo	odule 2		Module 3	
Netv	work Type	MNET/H Mode(Cont	rol Station)	•	None		None		•
Sta	rt I/O No.		000	30 Î					
Net	twork No.			1					
Tota	al Stations			2					
Gr	roup No.			1					
Sta	ation No.								
	Mode	Online		-			r		•
		Network Ra	nge Assignment						
		Refrest	Parameters						
		Interro	ipt Settings						
		Return as Control S	tation	•					
		Optical/Coaxial		•					
4									
Necessary Setting( No Setting / Already Set ) Set if it is needed( No Setting / Already Set ) Interlink Transmission Parameters Start I/O No. : Valid Module During Other Station Access 1 Please input 16-point unit(HEX) to start I/O No. in which module is mounted.									
Acknowledge XY	Routing Parameters	Assignment Image	Group Setting,	wi iit	Check	End	Cancel	1	
Assignment		noong amone image	anaap aattiing	L	CHOCK		Cancor		
Print Window	Print Window Preview								_
4							1		

ltem	Parameter No.	Description	Setting range	Default	Reference
Number of modules on MELSECNET/H	5000 _H				
Start I/O No.					
Network No.	5NM0 _H				
Total Stations					
Group No.	05mn _H				
Mode	5NM0 _H				
Refresh Parameters	5NM1 _H		Refer to the manual for the Q series-compatible MELSECNET/H.		
Common Parameters	5NM2 _H	Set MELSECNET/H network parameters.		-	-
Station Inherent Parameters	5NM3 _H				
Common Parameters 2	5NMA _H				
Station Inherent Parameters 2	5NMB _H	-			
Interrupt Settings	SININDH				
Valid Module During Other Station Access	5001 _H				
Interlink Transmission Parameters	5002 _H				
Routing Parameters	5003 _H	1			

### Appendix 1.3.4 Ethernet setting

Network parameters for Ethernet are set.

	Set network configuration setting in CC IE Field configuration window						
	Module 1	Module 2	Module 3				
Network Type	Ethernet 👻	None	None				
Start I/O No.	0000						
Network No.	1						
Total Stations							
Group No.	1						
Station No.	1						
Mode	Online 🗸	-					
	Operation Setting						
	Initial Setting						
	Open Setting						
	Router Relay Parameter						
	Station No. <->IP Information						
	FTP Parameters						
	E-mail Setting						
	Interrupt Settings						
		needed the Setting J. Alwards Set )					
St	ing( No Setting / Already Set ) Set if it is r art I/O No. : ease input 16-point unit(HEX) to start I/O No. in wh	Valid Module During Other Station Access					

Item	Parameter No.	Description	Setting range	Default	Reference	
Number of modules on Ethernet	9000 _H					
Start I/O No.						
Network No.	-					Αp
Group No.	9N00 _H					Appendix Appendix
Station No.						dix
Operation Setting						- <u></u> ω -
Initial Setting	9N01 _H	Set Ethernet network parameters.	Refer to the manual for the Q series-compatible Ethernet.	-		arar Net
Open Setting	9N02 _H					arameters Network F
Router Relay Parameter	9N03 _H				-	( Pa
Station No.<->IP Information	9N05 _H					arameters Network Parameters
FTP Parameters	9N06 _H					eters
E-mail Setting	9N07 _H					-
News Setting	9N08 _H					
Interrupt Settings	9N09 _H					
Valid Module During Other Station Access	5001 _H					
Routing Parameters	9N04 _H					

463

# Appendix 1.3.5 CC-Link setting

Parameters for CC-Link are set.

	1		2	3
Start I/O No.		0000		
Operation Setting	Operation Setting			
Туре	Master Station	<b>•</b>	<b>•</b>	
Master Station Data Link Type	PLC Parameter Auto Start	•	<b>•</b>	
Mode	Remote Net(Ver.1 Mode)	-	•	
Total Module Connected		64		
Remote input(RX)				
Remote output(RY)				
Remote register(RWr)				
Remote register(RWw)				
Ver.2 Remote input(RX)				
Ver.2 Remote output(RY)				
Ver.2 Remote register(RWr)				
Ver.2 Remote register(RWw)				
Special relay(SB)				
Special register(SW)				
Retry Count		3		
Automatic Reconnection Station Count		1		
Standby Master Station No.				
PLC Down Select	Stop	-	-	
Scan Mode Setting	Asynchronous	-	<b>•</b>	
Delay Time Setting		0		
Station Information Setting	Station Information			
Remote Device Station Initial Setting	Initial Setting			
Interrupt Settings	Interrupt Settings			
Necessary Setting( No Setting / Alrea	dy Set ) Set if it is needed( No	Setting / Alrea	dy Set )	

Item	Parameter No.	Description	Setting range	Default	Reference
Number of Modules	C000 _H				
Туре	C000H				
Start I/O No.					
Operation Setting	CNM2 _H				
Total Module Connected					
Remote Input(RX)					
Remote Output(RY)					
Remote Register(RWr)				-	
Remote Register(RWw)	CNM1 _H				
Ver.2 Remote Input(RX)	CINNITH	Set CC-Link parameters.			
Ver.2 Remote Output(RY)					
Ver.2 Remote Register(RWr)			Refer to the manual for		
Ver.2 Remote Register(RWw)			CC-Link.		-
Special Relay(SB)					
Special Register(SW)					
Retry Count					
Automatic Reconnection Station Count					
Standby Master Station No.					
PLC Down Select	CNM2 _H				
Scan Mode Setting					
Delay Time Setting					
Station Information Setting					
Remote Device Station Initial Setting					
Interrupt Settings					

# Appendix 1.4 Remote Password

This section provides the list of parameters for remote password and describes parameter details.

Remote Password Setting							
Password Setting Password Setting Password Characters that can be used in password 4 characters. Numbers, A-Z a-2, Special characters. Password Active Module Setting							
	Model Name	StartXY	Condition				
	<b></b>						
	-						
	-						
	-						
	<b>▼</b>						
	-						
Necessary Setting( No Setting / Already Set )							
	Clear	End	Cancel				

Remote Password Detail Setting	×						
User Connection No.							
Connection 1 Connection 2 Connection 3 Connection 4							
Connection 5 Connection 6 Connection 7 Connection 8							
Connection 9 Connection 10 Connection 11 Connection 12							
Connection 13 Connection 14 Connection 15 Connection 16							
- System Connection							
MELSOFT Transmission Port(TCP/IP)							
MELSOFT Transmission Port(UDP/IP)							
FTP Transmission Port(TCP/IP)							
Direct Connection of MELSOFT							
Regard as Error when Remote Password Mismatch Count Reaches Upper Limit							
Regard as Error when Reinote Password Misinatch Count Reaches opper Linit							
Upper Limit of Mismatch Count							
Clear Mismatch Count when Remote Password Matches							
When the remote password is enabled, write the parameter to the programmable controller CPU and reset it, or turn off the power and turn on the power again.							
End Cancel							

lte	em	Parameter No.	Description	Setting range	Default	Reference
Password S	Setting	-	Enter a remote password.	Four characters or less (alphanumeric characters, special symbols)	-	
Password Active	Model Name	-	Select a model name of the module for which the remote password set to the CPU module is checked.	Built-in Ethernet port QCPU     QJ71E71     QJ71C24/CMO	-	
Module Setting	Start XY	-	Set the start address of the module for which the remote password is checked.	0000 _H to 0FE0 _H	-	
Detail		-	Set details of the remote password for the QJ71E71.	-	-	• Built-in Ethernet
User Con No. ^{*1}	User Connection No.*1 System Connection*2 Regard as Error when Remote Password Mismatch Count Reaches Upper Limit		Select user connection No.	Connection 1 to Connection 16	-	port QCPU: QnUCPU User's
System C			Select a valid port of the remote password for system connection.	<ul> <li>Built-in Ethernet port QCPU</li> <li>MELSOFT Transmission Port (TCP/IP)</li> <li>MELSOFT Transmission Port (UDP/IP)</li> <li>FTP Transmission Port (TCP/IP)</li> <li>Direct Connection of MELSOFT</li> <li>QJ71E71</li> <li>Auto Open UDP Port</li> <li>FTP Transmission Port (TCP/IP)</li> <li>MELSOFT Application Transmission Port (TCP/IP)</li> <li>MELSOFT Application Transmission Port (UDP/IP), Dedicated Instruction, CC-Link IE, NET/10(H) Relay Transmission Port</li> <li>HTTP Port, HTTP Protocol</li> </ul>	-	Manual (Communication via Built-in Ethernet Port) • QJ71E71: Ethernet module manual • QJ71C24: Serial communication module manual
Remote P Mismatch			Set upper limit of mismatch count.	Set whether to regard it as an error when the number of mismatches on remote password reaches the upper limit.	Unchecked	
Upper L Mismato		-	Set upper limit of remote password mismatch count.	1 to 65535	10	

*1

This is a connection used by users for communications using the MC protocol or fixed buffer. This is a connection used by a system for FTP or MELSOFT (TCP/IP, UDP/IP) communications. *2

# Appendix 2 Functions Added or Changed by Version Upgrade

The Universal model QCPU is upgraded when some functions are added or specifications are changed. Therefore, the functions and specifications differ depending on the function version and serial number.

× : Not supported, – : Not related to the programmir					
Function	Function	Serial number	Programming tool version		
i unction	version	(first 5 digits)	GX Works2	GX Developer	
Use of the PC CPU module ^{*1} ( D QCPU User's Manual (Multiple CPU System))		"09072" or later		-	
Setting of whether to use local device for each program (				Version 8.62Q or later	
Program memory batch transfer execution status check (SM165) ([ Page 36, Section 2.1.1 (1) (d))		*0			
Multiple CPU high-speed transmission dedicated instruction ^{*1} ( I MELSEC-Q/L Programming Manual (Common Instruction))		*6		-	
Display of the amount of battery consumption ( D QCPU User's Manual (Hardware Design, Maintenance and Inspection))			Version 1.15R or later		
Bit device extension (					
Executional conditioned device test (		"10042" or later	Version 1.73B or later		
Sampling trace auto start function*1 (					
CC-Link IE group cyclic transmission function ( CC-Link IE Controller Network Reference Manual)	-				
Scan time measurement (				Version 8.68W or later	
External input/output forced on/off (					
Monitor condition setting ^{*1} (	В				
Redundant power supply system ^{*1} (					
32-bit indexing with "ZZ" specification ( L MELSEC-Q/L Programming Manual (Common Instruction))					
Extended data register (D) and extended link register (W) *1 *2 ([]] Page 402, Section 4.8)		"09042" or later ^{*1}		Version 8.70Y or later	
Serial communication function (Q02UCPU) (					
CPU module change function with memory card ^{*1} (			Version 1.15R	Version 8.76E	
Local device setting of the index register ^{*1} (		"10102" or later	or later	or later	
Communication using the A-compatible 1C/1E frame (MC protocol)*3 *4					
( MELSEC Communication Protocol Reference Manual)					
$A \rightarrow QnA$ converted special relay/special register (SM1000 to SM1255, SD1000 to SD1255) (  QCPU User's Manual (Hardware Design, Maintenance and Inspection))		"10102" or later		Version 8.78G	
Socket communication function ^{*1} ( C QnUCPU User's Manual (Communication via Built-in Ethernet Port))		"11012" or later		or later	

Not supported, -: Not related to the programming tool

Function	Function	Serial number	Programming tool version		
Function	version	(first 5 digits)	GX Works2	GX Developer	
Module model name read (		"11043" or later	Version 1.15R or later	Version 8.82L or later	
Module error collection function*1 *5 (		"11043" or later	Version 1.12N or later	×	
IP address change function ^{*1} ( C QnUCPU User's Manual (Communication via Built-in Ethernet Port))		"11082" or later	-	-	
Local device batch read function *1 (			Version 1.31H		
CC-Link IE Field Network ( C MELSEC-Q CC-Link IE Field Network Master/Local Module User's Manual)		"12012" or later	or later		
Send points extension function ^{*5} (CC-Link IE Controller Network module) (					
Online change of inactive blocks (SFC) ^{*1} ( L MELSEC-Q/L/QnA Programming Manual (SFC))			Version 1.40S or later		
Expansion of SFC step relay points (				×	
Operation mode setting at SFC double block START ^{*1} ( L MELSEC- Q/L/QnA Programming Manual (SFC))		"12052" or later			
SFC comment readout instruction ^{*1} ( L MELSEC-Q/L/QnA Programming Manual (SFC))	-		_		
Data up to 10238 bytes can be exchanged with the SP.SOCSND/S(P).SOCRCV(S)/S(P).SOCRDATA instructions ^{*1}					
( Du QnUCPU User's Manual (Communication via Built-in Ethernet Port))					
Parameter-valid drive information (		_	Version 1.40S or later	×	
Program cache memory auto recovery function ( Page 252, Section 3.28)	В	"12122" or later			
Extension of available index register range (Z0 to Z19) when Jn and Un are used in the dedicated instruction ( Analysis for the network module and the intelligent function module used)		"13022" or later	-		
Storage of device memory error information (Memory check function)		15022 Of later		_	
( CPU User's Manual (Hardware Design, Maintenance and Inspection))					
Storage of program error location (Memory check function) ( QCPU User's Manual (Hardware Design, Maintenance and Inspection))		"13042" or later			
Serial communication function (Q03UD/Q04UDH/Q06UDH/Q10UDH/Q13UDH/Q20UDH/Q26UDHCPU) () Page 233, Section 3.23)		"13062" or later	Version 1.62Q or later	×	
SFC control target block switching ( MELSEC-Q/L/QnA Programming Manual (SFC))			Version 1.73B or later	×	
AnS/A series compatible extension base unit		"12102" at latar			
Communication using the A-compatible 1E frame (MC protocol) through built-		"13102" or later			
in Ethernet port ( I MELSEC Communication Protocol Reference Manual)			_	_	
IP packet transfer function (CC-Link IE Field Network) ( C QnUCPU User's Manual (Communication via Built-in Ethernet Port))*1*5		"14022" or later	Version 1.77F or later	×	
Own station number setting function for CC-Link IE Field Network			<u> </u>		
( III MELSEC-Q CC-Link IE Field Network Master/Local Module User's Manual)		"14042" or later	Version 1.87R or later	×	
Writing/reading data to/from refresh devices with the specified station number*1 ( MELSEC-Q/L Programming Manual (Common Instruction))		*10	-	-	

Function	Function	Serial number	Programming	g tool version	
Function	version	(first 5 digits)	GX Works2 GX Developer		
High-speed interrupt function (		-	Version 1.98C or later	×	
Data logging function ^{*7} (口) QnUDVCPU/LCPU User's Manual (Data Logging Function))		_	Version 1.98C or later	×	
IP packet transfer function (CC-Link IE Controller Network) ( QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1 *5}		"14022" or later	Version 1.98C or later	×	
Use of the file register in communication using the A-compatible 1E frame (MC protocol) through built-in Ethernet port ( Communication via Built-in Ethernet Port)) ^{*1}		*8			
Expansion of routing parameter settings(Line MELSEC-Q/L Programming Manual (Common Instruction)) ^{*1}		*9	-	-	
Latch clear by using the special relay and special register areas ( $\int \vec{\mathcal{F}}$ ) Page 75, Section 2.7 (4) (a)) ^{*1}		*10			
Predefined protocol function(口) QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1}		"15103" or later	Version 1.501X or later	×	
Reading/writing device data from/to the CPU module on another station by specifying an IP address ( I Qual QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1}		"16043" or later	Version 1.513K or later	×	
Support of the iQ Sensor Solution function (data backup/restoration only) for AnyWireASLINK and CC-Link ( i iQ Sensor Solution Reference Manual)* ¹		"17012" or later	1.530C or later	_	
Support of the iQ Sensor Solution function (data backup/restoration only) for CC-Link IE Field Network ( $\square$ iQ Sensor Solution Reference Manual) ^{*1}		"17052" or later	x	-	
MELSOFT connection extended setting ( C QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1}	В		1.535H or later	×	
CPU module data backup/restoration function (	D	"17103" or later	-	-	
Upper limit value setting for the number of backup data (CPU module data backup/restoration function) ( $\boxed{}$ Page 282, Section 3.32.1 (1)) ^{*1} Retrying the automatic backup (CPU module data backup/restoration function) ( $\boxed{}$ Page 285, Section 3.32.1 (3) (a)) ^{*1}		"18052" or later	_	_	
Support of the iQ Sensor Solution function (automatic detection of connected device, system configuration check, communication setting reflection, sensor parameter read/write, monitoring, and data backup/restoration) for built-in Ethernet (		"18072" or later	1.550Y or later	_	
CC-Link IE Field Network Basic ^{*7}			1.555D or later	×	
SLMP frame send instruction(口) QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1}		"18112" or later	_	_	
Write-protect function for device data (from outside the CPU module) (		"19062" or later	1.566Q or later	×	
Operation history function (					
Simple PLC communication function (		"20042" or later	1.575Z or later	×	
Simple PLC communication function (for MELSEC iQ-F series)(囗囗 QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1}		"20102" or later	1.580E or later	×	
Disable using port setting ( C QnUCPU User's Manual (Communication via Built-in Ethernet Port)) ^{*1} Saving the operating status change operation and error history clear operation (		"24082" or later	1.615R or late	×	

A

- *1 Some models do not support the function. For details, refer to the corresponding reference.
- *2 Use the Universal model QCPU whose serial number (first five digits) is "10042" or later to store data of the extended data register (D) and extended link register (W) in the standard ROM using the latch data backup function.
  () Page 254, Section 3.29).
- *3 Communication using the A-compatible 1E frame is available only via any Ethernet module. If the module is connected to the built-in Ethernet port of the CPU module, this function is not available.
- *4 Communication using the A-compatible 1C frame is available only via any serial communication module. If the module is connected to the built-in RS-232 interface of the CPU module, this function is not available.
- *5 For the versions of the intelligent function modules that support the function, refer to the manual for the intelligent function module used.
- *6 The serial number (first five digits) differs depending on the CPU module.
  - Q13UDHCPU, Q26UDHCPU: "10011" or later
  - CPU modules other than above: "10012" or later
- *7 Only the QnUDVCPU and QnUDPVCPU support this function.
- *8 The serial number (first five digits) differs depending on the CPU module.
  - QnUDE(H)CPU: "14112" or later
  - QnUDVCPU: "15043" or later
  - QnUDPVCPU: "15072" or later
- *9 The serial number (first five digits) differs depending on the CPU module.
  - QnU(D)(H)CPU, QnUDE(H)CPU: "14112" or later
  - QnUDVCPU: "15043" or later
  - QnUDPVCPU: "15072" or later
- *10 The serial number (first five digits) differs depending on the CPU module.
  - QnUDVCPU: "15043" or later
  - QnUDPVCPU: "15072" or later
- *11 The serial number (first five digits) differs depending on the CPU module.
  - QnUD(E)(H)CPU: "14072" or later
  - QnUD(P)VCPU: "16043" or later


# Appendix 3 CPU Module Processing Time

This chapter describes the CPU module processing time.

This section describes the scan time structures and CPU module processing time.

# Appendix 3.1 Scan time structure


A CPU module sequentially performs the following processing in the RUN status. Scan time is the time required for all processing and executions to be performed.

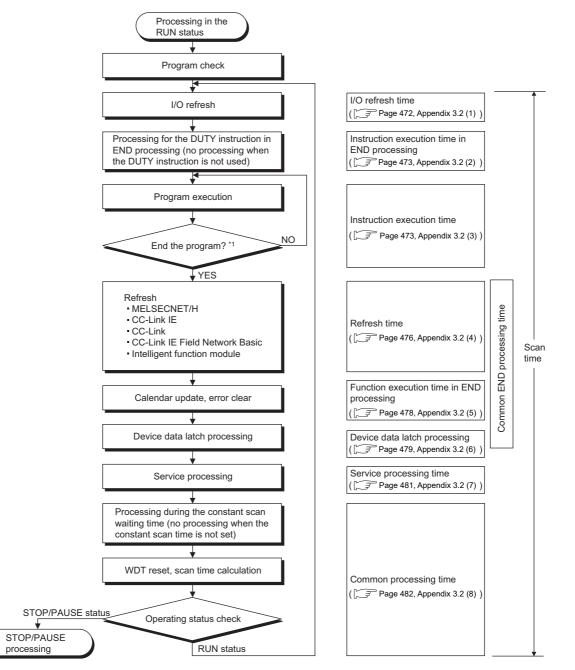

*1 End of a program indicates the timing when the END, GOEND, FEND, or STOP instruction is executed.

# (1) How to check scan time

The CPU module measures current, minimum, and maximum values of the scan time. The scan time can be checked by monitoring the special register (SD520, SD521, and SD524 to SD527). Accuracy of each stored scan time is ±0.1ms.

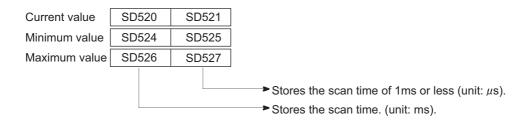

**Ex.** If the stored values in SD520 and SD521 are 3 and 400 respectively, the scan time is 3.4ms.

# Appendix 3.2 Time required for each processing included in scan time

This section describes how to calculate the processing time and execution time described in Page 471, Appendix 3.1.

# (1) I/O refresh time

I/O refresh time is the time required for refreshing I/O data to/from the following modules mounted on the main base unit and extension base units.

- Input module
- Output module
- Intelligent function module
- Calculation method

Use the following expression to calculate the I/O refresh time. For N1 and N2, refer to the following table.

(I/O refresh time) = (number of input points/16) × N1 + (number of output points/16) × N2

CPU module		Q3⊡SB, ]RB, ]DB		Q6⊡B, ∃RB	QA1S6ADF	QA1S6⊡B, P+A1S5⊡B, +A1S6⊡B ^{*1}		6⊡B, 2+A5⊡B, +A6⊡B ^{*1}
	N1	N2	N1	N2	N1	N2	N1	N2
Q00UJCPU, Q00UCPU, Q01UCPU	1.8µs	1.1µs	2.6µs	1.9µs	4.9µs	4.0µs	5.7µs	4.9µs
Q02UCPU	1.5µs	1.1µs	2.4µs	1.9µs	4.5µs	4.0µs	5.3µs	4.9µs
Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q50UDEHCPU, Q100UDEHCPU	1.5µs	1.0µs	2.3µs	1.8µs	4.3µs	3.9µs	5.0µs	4.8µs
Q04UDPVCPU, Q06UDPVCPU, Q13UDPVCPU, Q26UDPVCPU	1.5µs	1.0µs	2.3µs	1.8µs	Not applicable	Not applicable	Not applicable	Not applicable

*1 Applicable only when the CPU module whose serial number (first five digits) is "13102" or later is used.

## (2) Instruction execution time in END processing

This is the processing time of the DUTY instruction in END processing.

The user timing clock (SM420 to SM424 and SM430 to SM434) specified with the DUTY instruction is turned on/off during the END processing.

CPU module	Processing time i	n END processing
CF0 module	When set to 1	When set to 5
Q00UJCPU, Q00UCPU, Q01UCPU	0.0120ms	0.0140ms
Q02UCPU	0.0050ms	0.0055ms
Q03UD(E)CPU	0.0043ms	0.0046ms
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.0041ms	0.0045ms
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.0040ms	0.0042ms

# (3) Instruction execution time

Instruction execution time is the time required for all instructions used in the program to be executed.

For the processing time required for each instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

When calculating instruction execution time, add the overhead time given in the following tables. Two kinds of overhead time (pre-start and program-end) need to be added to interrupt programs.

#### (a) Pre-start overhead time for interrupt programs

CPU module	Fixed scan interrupt (I28 to I31) (I45)		is interrupt	High- speed interrupt (I49)	Interrupt ^{*1} from Ql60 c (I50 to I127 intelligent mod	or interrupt ) from the function	
	Without	With high-	Without	With high-	With high-	Without	With high-
	high-speed start	speed start	high-speed start	speed start	speed start	high-speed start	speed start
Q00UJCPU, Q00UCPU, Q01UCPU	55µs	35µs				76µs	55µs
Q02UCPU	48µs	17µs				60µs	31µs
Q03UD(E)CPU	47µs	17µs	46µs	16µs		54µs	22µs
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU	46µs	16µs	44µs	14µs		52µs	22µs
Q50UDEHCPU, Q100UDEHCPU	73µs	16µs	71µs	14µs		79µs	22µs

CPU module		n interrupt o I31)	Multipl synchronou (l4	us interrupt	High- speed interrupt (I49)	Interrupt ^{*1} from Ql60 c (I50 to I127 intelligent mod	or interrupt ) from the function
	Without	With high-	Without	With high-	With high-	Without	With high-
	high-speed start	speed start	high-speed start	speed start	speed start	high-speed start	speed start
Q03UDVCPU,							
Q04UDVCPU,							
Q04UDPVCPU,							
Q06UDVCPU,							
Q06UDPVCPU,	11µs	8µs	11µs	8µs	7.0µs	20.5µs	17.5µs
Q13UDVCPU,							
Q13UDPVCPU,							
Q26UDVCPU,							
Q26UDPVCPU							

*1 Indicates the value when the QI60 is mounted on the slot 0 of the main base unit.

# (b) Program-end overhead time for interrupt programs

CPU module	Without high-speed start	With high-speed start
Q00UJCPU, Q00UCPU, Q01UCPU	28µs	15µs
Q02UCPU	26µs	7µs
Q03UD(E)CPU	26µs	7µs
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU	26µs	7µs
Q50UDEHCPU, Q100UDEHCPU	44µs	7µs
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	5.4µs	5.2µs

# (c) Overhead time for fixed scan execution type programs

CPU module	Without high-speed start	With high-speed start
Q00UJCPU, Q00UCPU, Q01UCPU	92µs	60µs
Q02UCPU	73µs	25µ <b>s</b>
Q03UD(E)CPU	73µs	24µs
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU	72µs	23µs
Q50UDEHCPU, Q100UDEHCPU	117µs	23µs
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	18.5µs	15.5µs

# (d) Overhead time when local devices in the interrupt program are enabled

When SM777 (Enable/disable local device in interrupt program) turns on, the time given in the following tables will be added to the overhead time given in Page 473, Appendix 3.2 (3) (a). Each n, N1, N2, and N3 in the table indicates the following.

- n: Number of local device points (unit: K words)
- N1: Number of devices that specified a local device
- N2: Number of word device points that specified a local device
- N3: Number of bit device points that specified a local device

	When a local device file in the standard RAM is used				
CPU module	Additional time to the pre-start overhead time for interrupt programs (Page 473, Appendix 3.2 (3) (a))	Additional time to the program-end overhead time for interrupt programs (Page 474, Appendix 3.2 (3) (b))			
Q00UCPU, Q01UCPU	(13.2 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + 210µs	(8 × N1) + (0.23 × (N2 + (N3 ÷ 16))) + 30µs			
Q02UCPU	(13.2 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + 210µs	(8 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + 30µs			
Q03UD(E)CPU	(8 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + 80µs	(8 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + 20µs			
Q03UDVCPU	(4.1 × N1) + (0.165 × (N2 + (N3 ÷ 16))) + 22.0µs	(4.1 × N1) + (0.165 × (N2 + (N3 ÷ 16))) + 5.7µs			
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	(8 × N1) + (0.10 × (N2 + (N3 ÷ 16))) + 80µs	(8 × N1) + (0.10 × (N2 + (N3 ÷ 16))) + 20µs			
Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	(4.0 × N1) + (0.085 × (N2 + (N3 ÷ 16))) + 22.0µs	(4.0 × N1) + (0.085 × (N2 + (N3 ÷ 16))) + 5.7µs			

	When a local device file in the standard RAM is used (with an extended SRAM cassette)				
CPU module	Additional time to the pre-start overhead time for interrupt programs (Page 473, Appendix 3.2 (3) (a))	Additional time to the program-end overhead time for interrupt programs (Page 474, Appendix 3.2 (3) (b))			
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	(4.2 × N1) + (0.220 × (N2 + (N3 ÷ 16))) + 22.0µs	(4.2 × N1) + (0.220 × (N2 + (N3 ÷ 16))) + 5.7µs			

	When a local device file in the SRAM card is used				
CPU module	Additional time to the pre-start overhead time for interrupt programs (Page 473, Appendix 3.2 (3) (a))	Additional time to the program-end overhead time for interrupt programs (Page 474, Appendix 3.2 (3) (b))			
Q02UCPU	(16 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + 260µs	(16 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + 60µs			
Q03UD(E)CPU	(12 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + 100µs	(12 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + 20µs			
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	(12 × N1) + (0.40 × (N2 + (N3 ÷ 16))) + 100µs	(12 × N1) + (0.40 × (N2 + (N3 ÷ 16))) + 20µs			

Α

# (4) Refresh time

Refresh time is the total time required for the CPU module to refresh data with the network such as CC-Link IE, MELSECNET/H, and CC-Link.

#### (a) Refresh with CC-Link IE

This is the time required for refreshing data between link devices in a CC-Link IE module and devices in the CPU module.

#### (b) Refresh with MELSECNET/H

This is the time required for refreshing data between link devices in a MELSECNET/H module and devices in the CPU module.

#### (c) Auto refresh with CC-Link

This is the time required for refreshing data between a CC-Link system master/local module and the CPU module.



For each refresh time, refer to the following.

Manual for each network module

#### (d) Refresh with CC-Link IE Field Network Basic

This is the time required for refreshing data between link devices of CC-Link IE Field Network Basic and user devices in the CPU module.

Calculation method

Calculate using the following formulas. Use the values in the following table for KN1 to KN4.

 $\alpha T = KM1 + KM2 \times (((RX + RY) \div 16) + RWw + RWr) + \alpha E [\mu s]$  $\alpha E = KM3 + KM4 \times (((RX + RY) \div 16) + RWw + RWr) [\mu s]$ 

- $\alpha$ T: Link refresh time
- $\alpha$ E: Link refresh time when the file register (R, ZR) is used^{*1}
- RX: Number of points of remote input (RX) refreshed by the master station^{*2}
- RY: Number of points of remote output (RY) refreshed by the master station^{*2}
- RWw: Number of points of remote register (RWw) refreshed by the master station^{*2}
- RWr: Number of points of remote register (RWr) refreshed by the master station^{*2}
- KM1 to KM4: Constant

				KM4	
CPU module	KM1	KM2	КМЗ	Without extended SRAM cassette	With extended SRAM cassette
Q03UDVCPU	20.0	0.02	3.0	0.05	0.11
Q04UDVCPU, Q04UDPVCPU	20.0	0.02	3.0	0.05	0.11
Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	20.0	0.02	3.0	0.05	0.11

*1 This time is added when the file register (R, ZR) is used.

*2 This value is determined according to the number of device stations to be connected and the number of occupied stations.

## (e) Auto refresh with an intelligent function module

This is the time required for refreshing data between the buffer memory of an intelligent function module and devices in the CPU module.

#### Calculation method

Calculate using the following formulas. Use the values in the following tables for KN1 and KN2.

CPU module	When an intelligent function module is mounted on the main base unit		When an intelligent function module is mounted on the extension base unit	
	KN1	KN2	KN1	KN2
Q00UJCPU	96.3µs	6.7µs	79.7µs	8.9µs
Q00UCPU, Q01UCPU	96.3µs	6.7µs	79.7µs	8.1µs
Q02UCPU	23µs	6.0µs	45µs	7.0µs
Q03UD(E)CPU	6.0µs	5.0µs	7.0µs	6.0µs
Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU, Q50UDEHCPU, Q100UDEHCPU	4.0µs	5.0µs	5.0µs	6.0µs

(Refresh time) = KN1 + KN2 × (number of refresh points)

Ex. When the number of auto refresh points for the analog-digital converter module (Q64AD) is 4 points (when the module is mounted on the Q26UDHCPU main base unit)

 $0.024 \text{ (ms)} = 0.004 + 0.005 \times 4$ 

# (5) Function execution time in END processing

This is the time required for updating calendar or clearing error in END processing.

#### (a) Calendar update

The following processing time is required to change or read the clock data when the clock data set request (SM210 changes from off to on) or the clock data read request (SM213 turns on) is issued.

	Processing time in END processing		
CPU module	When the clock data set	When the clock data	
	request is issued	read request is issued	
Q00UJCPU, Q00UCPU, Q01UCPU	0.028ms	0.017ms	
Q02UCPU	0.027ms	0.013ms	
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.011ms	0.004ms	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU,Q26UDVCPU, Q26UDPVCPU	0.011ms	0.007ms	

## (b) Error clear

The following processing time is required to clear continuation errors stored in SD50 on the rising edge of SM50 (Error reset).

	Processing time in END processing		
CPU module	When the error is cleared		
or o module	(the one detected by the	When the error is cleared	
	annunciator)		
Q00UJCPU, Q00UCPU, Q01UCPU	0.185ms	0.180ms	
Q02UCPU	0.180ms	0.175ms	
Q03UD(E)CPU	0.068ms	0.062ms	
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.065ms	0.062ms	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU,Q26UDVCPU, Q26UDPVCPU	0.03ms	0.026ms	

#### (c) Error clear by types

The following processing time is required to clear continuation errors by types.

	Processing time in END processing		
CPU module	When the error is cleared (the one detected by the annunciator)	When the error is cleared	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.04ms	0.036ms	

#### (6) Device data latch processing time

When the latch range is set in the Device tab of the PLC parameter dialog box^{1 * 2 * 3}, the processing time listed in the following tables is required. Each N1, N2, and N3 in the table indicates the following.

- N1: Number of devices specified to be latched (Count the latch range (1) and the latch range (2) as different devices.)
- N2: Number of bit device points specified to be latched
- N3: Number of word device points specified to be latched

## (a) When the latch interval is set to "Each Scan"

The processing time listed in the following table is required.

CPU module	Processing time
Q00UJCPU, Q00UCPU, Q01UCPU	(4.4 × N1) + (0.12 × (N2 ÷ 16 + N3))µs
Q02UCPU	(4.0 × N1) + (0.12 × (N2 ÷ 16 + N3))µs
Q03UD(E)CPU	(3.0 × N1) + (0.12 × (N2 ÷ 16 + N3))µs
Q03UDVCPU	(1.0 × N1) + (0.085 × (N2 ÷ 16 + N3)) + 1.2µs
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	(3.0 × N1) + (0.05 × (N2 ÷ 16 + N3))µs
Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	(1.0 × N1) + (0.045 × (N2 ÷ 16 + N3)) + 1.2µs

- *1 When setting the latch range of the timer (T), retentive timer (ST), and counter (C), one point for word device and two points for bit device are occupied per point.
- *2 The case where the points are set for the latch relay (L) is included.
- *3 The scan time will not increase if the latch range is set for the file register (ZR), extended data register (D), or extended link register (W).

#### (b) When the latch interval is set to "Time Setting"

The processing time listed in the following table is required. The scan time including the first END processing after a preset time has elapsed increases.

CPU module	Processing time	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU,	(1.0 × N1) + (0.004 × (N2 + 16 + N2)) + 17 Eve	
Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	(1.0 × N1) + (0.004 × (N2 ÷ 16 + N3)) + 17.5µs	

Point P

To reduce the scan time increase due to latch^{*1}, minimize the number of latch points (latch (1) setting, latch (2) setting, and latch relay) as much as possible by performing the following.

- Move data to be latched to the file register.
- Store device data that is less frequently updated in the standard ROM with the SP.DEVST instruction. (The device data stored in the standard ROM can be read with the S(P).DEVLD instruction. (
- Set the latch interval to "Time Setting". ( Page 124, Section 3.3 (5) (b))
- *1 For file registers (including an extended data register (D) and an extended link register (W)), the scan time is not increased due to latch.

## (7) Service processing time

Service processing is the communication processing with a programming tool and external devices. When monitoring device data, reading programs, and setting monitor conditions in a programming tool, the processing time listed in the following table is required.

#### (a) Processing time to monitor device data and read programs

	Processing time ^{*1}		
CPU module	Monitoring device data	Reading programs	
	(Data register: 32 points)	(10K step)	
Q00UJCPU, Q00UCPU, Q01UCPU	1.60ms	3.70ms	
Q02UCPU	1.00ms	1.55ms	
Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU,	0.35ms	0.95ms	
Q20UDHCPU, Q26UDHCPU	0.00115	0.35113	
Q03UDECPU, Q04UDEHCPU, Q06UDEHCPU, Q10UDEHCPU,			
Q13UDEHCPU, Q20UDEHCPU, Q26UDEHCPU, Q50UDEHCPU,	0.90ms	1.10ms	
Q100UDEHCPU			
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU,			
Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU,	0.29ms	0.95ms	
Q26UDPVCPU			

*1 The time in the table is for the case where the service processing count is set to one.

# (b) Processing time to set monitor conditions

CPU module	Processing time		
or o module	Specified step match	Specified device match	
Q02UCPU	0.03ms	0.04ms	
Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU	0.01ms	0.03ms	

Α

# (8) Common processing time

The CPU module performs common processing by the system. The common processing time shown below is required.

CPU module	Processing time
Q00UJCPU, Q00UCPU, Q01UCPU	0.28ms
Q02UCPU	0.20ms
Q03UDCPU	0.13ms
Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU,	0.10ms
Q20UDHCPU, Q26UDHCPU	
Q03UDECPU	0.22ms
Q04UDEHCPU, Q06UDEHCPU, Q10UDEHCPU, Q13UDEHCPU,	0.18ms
Q20UDEHCPU, Q26UDEHCPU, Q50UDEHCPU, Q100UDEHCPU	0.10110
Q03UDVCPU	0.140ms ^{*1}
Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU,	0 125ms ^{*1}
Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.120018

*1 At default setting of parameters, and including processing time for latching 8K points of latch relay (L).

# (9) Multiple CPU high speed transmission processing time

This is the processing time required for data transmission between the CPU modules when the multiple CPU high speed transmission function is used.

For the multiple CPU high speed transmission processing time, refer to the following.

QCPU User's Manual (Multiple CPU System)

# Appendix 3.3 Factors that increase the scan time

When executing any of the functions or operations described in this section, add the given processing time in this section to the time value calculated in Page 471, Appendix 3.1.

# (1) Sampling trace

When the sampling trace function ( $\square$  Page 184, Section 3.14) is executed, the processing time listed in the following table is required.

[Conditions] Processing time (when 50 points of the internal relay (for bit device) and 50 points of the data register (for word device) are set as sampling trace data)

	CPU module	Processing time
	Q00UCPU, Q01UCPU	0.12ms
	Q02UCPU	0.09ms
	Q03UD(E)CPU	0.07ms ^{*1}
Standard RAM	Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU	0.06ms ^{*1}
	Q50UDEHCPU, Q100UDEHCPU	0.06ms
	Q03UDVCPU	0.045ms ^{*1}
	Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.045ms ^{*1}
Standard RAM (with an extended SRAM cassette)	Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.05ms ^{*1}
	Q02UCPU	0.09ms
	Q03UD(E)CPU	0.08ms ^{*1}
SRAM card	Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU	0.06ms ^{*1}
	Q50UDEHCPU, Q100UDEHCPU	0.06ms

*1 When specifying devices in the trigger point setting, the scan time may be increased by up to 0.163µs per instruction.

# (2) Use of local devices

When local devices are used, the processing time listed in the following table is required. Each n, N1, N2, N3, and N4 in the table indicates the following.

- n: Number of programs using a local device^{*1}
- N1: Number of devices that specified a local device
- N2: Number of word device points that specified a local device (except index register)
- N3: Number of bit device points that specified a local device
- N4: Number of index register points that were specified as a local device

CPU module		Processing time
	Q00UCPU, Q01UCPU	((16.0 × N1) + (0.23 × (N2 + (N3 ÷ 16))) + (1.49 × N4) + 98.3) × n +92.0μs
	Q02UCPU	((24.0 × N1) + (0.23 × (N2 + (N3 ÷ 16))) + (1.57 × N4) + 108) × n +59.0μs
	Q03UD(E)CPU	((8.0 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + (0.65 × N4) + 38.0) × n + 14.2µs
Standard RAM	Q03UDVCPU	((4.1 × N1) + (0.165 × (N2 + (N3 ÷ 16))) + (0.15 × N4) + 31.0) × n + 10.0μs
	Q04UD(E)HCPU, Q06UD(E)HCPU	((8.0 × N1) + (0.10 × (N2 + (N3 ÷ 16))) + (0.47 × N4) + 35.5) × n + 12.7μs
	Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	((8.0 × N1) + (0.10 × (N2 + (N3 ÷ 16))) + (0.68 × N4) + 35.5) × n + 17.3µs
	Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	((4.0 × N1) + (0.085 × (N2 + (N3 ÷ 16))) + (0.15 × N4) + 31.0) × n + 10.0μs
Standard RAM (with an extended SRAM cassette)	Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	((4.2 × N1) + (0.22 × (N2 + (N3 ÷ 16))) + (0.20 × N4) + 31.0) × n + 10.0µs
	Q02UCPU	((24.0 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + (1.40 × N4) + 66.0) × n + 83.0μs
SRAM card	Q03UD(E)CPU	((12.0 × N1) + (0.43 × (N2 + (N3 ÷ 16))) + (0.68 × N4) + 41.0) × n + 17.0μs
	Q04UD(E)HCPU, Q06UD(E)HCPU	((12.0 × N1) + (0.40 × (N2 + (N3 ÷ 16))) + (0.59 × N4) + 38.5) × n + 17.0μs
	Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	((12.0 × N1) + (0.40 × (N2 + (N3 ÷ 16))) + (0.79 × N4) + 44.7) × n + 12.1µs

*1 When the serial number (first five digits) of the Q02UCPU, Q03UDCPU, Q04UDHCPU, or Q06UDHCPU is "10011" or earlier, "n" indicates the number of executed programs.

#### (a) When local devices in a subroutine program are enabled

When SM776 (Enable/disable local device at CALL) is turned on, the processing time listed in the following table is required for each subroutine call. Each n, N1, N2, N3, and N4 in the table indicates the following.

- n: Number of local device points (unit: K words)
- N1: Number of devices that specified a local device
- N2: Number of word device points that specified a local device (except index register)
- N3: Number of bit device points that specified a local device
- N4: Number of index register points that were specified as a local device

	When a local device file in the standard RAM is used			
CPU module	Processing time when a subroutine program in the same file is called	Processing time when a subroutine program in a different file is called		
Q00UCPU, Q01UCPU	0.00µs	(20.3 × N1) + (0.760 × (N2 + (N3 ÷ 16))) + (4.47 × N4) + 257.0µs		
Q02UCPU	0.00µs	(20.3 × N1) + (0.760 × (N2 + (N3 ÷ 16))) + (4.71 × N4) + 257.0µs		
Q03UD(E)CPU	0.00µs	(16 × N1) + (0.44 × (N2 + (N3 ÷ 16))) + (1.30 × N4) + 100μs		
Q03UDVCPU	0.00µs	(6.1 × N1) + (0.330 × (N2 + (N3 ÷ 16))) + (0.30 × N4) + 66μs		
Q04UD(E)HCPU, Q06UD(E)HCPU	0.00µs	(16 × N1) + (0.20 × (N2 + (N3 ÷ 16))) + (0.94 × N4) + 100μs		
Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.00µs	(16 × N1) + (0.20 × (N2 + (N3 ÷ 16))) + (1.36 × N4) + 100µs		
Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.00µs	(6 × N1) + (0.162 × (N2 + (N3 ÷ 16))) + (0.30 × N4) + 66μs		

	When a local device file in the standard RAM is used (with an extended SRAM cassette)		
CPU module	Processing time when a subroutine program in the same file is called	Processing time when a subroutine program in a different file is called	
Q03UDVCPU	0.00µs	(6.2 × N1) + (0.440 × (N2 + (N3 ÷ 16))) + (0.40 × N4) + 66μs	
Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.00µs	(6.2 × N1) + (0.432 × (N2 + (N3 ÷ 16))) + (0.40 × N4) + 66μs	

	When a local device file in the SRAM card is used		
CPU module	Processing time when a subroutine program in the same file is called	Processing time when a subroutine program in a different file is called	
Q02UCPU	0.00µs	(20.3 × N1) + (0.760 × (N2 + (N3 ÷ 16))) + (2.80 × N4) + 257.0µs	
Q03UD(E)CPU	0.00µs	(24 × N1) + (0.86 × (N2 + (N3 ÷ 16))) + (1.36 × N4) + 120μs	
Q04UD(E)HCPU, Q06UD(E)HCPU	0.00µs	(24 × N1) + (0.80 × (N2 + (N3 ÷ 16))) + (1.18 × N4) + 100μs	
Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.00µs	(24 × N1) + (0.80 × (N2 + (N3 ÷ 16))) + (1.58 × N4) + 120μs	

# (3) Execution of multiple programs

When multiple programs are executed, the processing time listed in the following table is required for each program.

CPU module	Processing time
Q00UJCPU, Q00UCPU, Q01UCPU	0.053 × n ^{*1} ms
Q02UCPU	0.04 × n ^{*1} ms
Q03UD(E)CPU	0.02 × n ^{*1} ms
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.02 × n ^{*1} ms
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.010 × n ^{*1} ms

*1 "n" indicates the number of program files.

# (4) Removal and insertion of a memory card

When a memory card is removed or inserted, the processing time listed in the following table is required only for one scan where a memory card is removed or inserted.

	Processing time		
CPU module	When a memory card is inserted	When a memory card is removed	
Q02UCPU	0.7ms	0.2ms	
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.6ms	0.1ms	

# (5) Removal and insertion of an SD memory card

When an SD memory card is removed or inserted, the processing time listed in the following table is required only for one scan where a memory card is removed or inserted.

	Processing time		
CPU module	When an SD memory card is inserted	When an SD memory card is removed	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.59ms	0.32ms	

# (6) Use of the file register

When "Use the same file name as the program." is selected in the PLC file tab of the PLC parameter dialog box, the processing time listed in the following table is required. When "Use the following file." is selected, the scan time will not be increased.

CPU module		Processing time
	Q00UCPU, Q01UCPU	0.135ms
	Q02UCPU	0.082ms
	Q03UD(E)CPU	0.043ms
Standard RAM	Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.041ms
	Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.016 × n ^{*1} ms
Standard RAM (with an extended SRAM cassette)	Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.016 × n ^{*1} ms
	Q02UCPU	0.11 × n ^{*1} ms
SRAM card	Q03UD(E)CPU	0.06 × n ^{*1} ms
	Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	0.06 × n ^{*1} ms

*1 "n" indicates the number of program files.

# (7) Online change

When data is written to the running CPU module, the processing time described below is required.

# (a) Online change (ladder mode)

When a program in the running CPU module is changed in ladder mode, the processing time listed in the following table is required.^{*1}

*1 The time in the table is for the case where the service processing count is set to one.

	Reserved area for online change		
CPU module	The reserved area for online	The reserved area for online	
	change is not changed.	change is re-set.	
Q00UJCPU, Q00UCPU, Q01UCPU	Up to 2.1ms	Up to 2.1ms	
Q02UCPU	Up to 1.3ms	Up to 1.3ms	
Q03UD(E)CPU	Up to 1.0ms	Up to 1.0ms	
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	Up to 0.7ms	Up to 0.7ms	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	Up to 0.6ms	Up to 0.6ms	

# (b) Online change (files)


When a file is written to the running CPU module, the processing time listed in the following table is required.*1

*1 The time in the table is for the case where the service processing count is set to one.

CPU module	Processing time		
CFO module	Scan time = 2ms	Scan time = 20ms	
Q00UJCPU	Up to 4.00ms	Up to 6.20ms	
Q00UCPU	Up to 3.50ms	Up to 5.80ms	
Q01UCPU	Up to 3.50ms	Up to 5.60ms	
Q02UCPU	Up to 4.80ms	Up to 4.80ms	
Q03UD(E)CPU	Up to 3.75ms	Up to 3.75ms	
Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	Up to 3.70ms	Up to 3.70ms	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	Up to 0.8ms	Up to 0.8ms	

# (8) Non-group output status read

In multiple CPU systems, the scan time increases when "All CPUs Can Read All Outputs" is selected in the Multiple CPU settings screen of the PLC parameter dialog box.

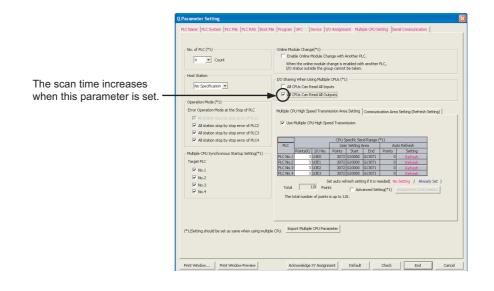

Α

# (9) Scan time measurement

When the scan time is measured (Page 181, Section 3.13.3), the processing time listed in the following table is required.

CPU module	Processing time	
Q00UJCPU	180.3 + 5.9 × number of branch instructions $\mu s^{*1}$	
Q00UCPU, Q01UCPU	179.5 + 5.8 × number of branch instructions $\mu s^{*1}$	
Q02UCPU	40.0 + 3.0 × number of branch instructions $\mu s^{*1}$	
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	40.0 + 1.5 × number of branch instructions $\mu s^{*1}$	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	30.0 + 0.40 × number of branch instructions $\mu s^{*1}$	

*1 The number of the branch instructions is a total of the following instructions, which are executed during the scan time measurement.

- Pointer branch instruction: CJ, SCJ, JMP
- Subroutine program call instruction: CALL(P), FCALL(P), ECALL(P), EFCALL(P), XCALL(P), RET

# (10)Monitor condition setting

When the monitor condition is set (Page 146, Section 3.11.1), the processing time listed in the following table is required.

	Processing time		
CPU module	Specified step matches the execution condition	Specified device matches the execution condition (Device D matches the condition)	
Q02UCPU	30µs	40µs	
Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU	10µs	30µs	

# (11)Time taken to collect module errors

When using the module error collection, the scan time increases by the time found by the following calculation formula. Each N1 and N2 in the calculation formula indicates the following.

Calculation formula

Collection time = N1 + N2 × (Number of module errors collected in one scan)

CPU module	Main base unit		Extension base unit	
	N1	N2	N1	N2
Q00UJCPU	175µs		190µs	
Q00UCPU, Q01UCPU	145µs	120µs	190µs	140µs
Q02UCPU	145µs	90µs	185µs	105µs
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU, Q100UDEHCPU	15µs	70µs	15µs	100µs

CPU module	Main ba	ase unit	Extension	base unit
	N1	N2	N1	N2
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	6µs	45µs	6µs	70µs

# (12)Batch transfer of data to the program memory

When data in the program cache memory is batch-transferred to the program memory, the processing time listed in the following table is required.^{*1}

*1 The time in the table is for the case where the service processing count is set to one.

CPU module	Process	sing time
CPO module	Scan time = 2ms	Scan time = 20ms
Q00UJCPU, Q00UCPU, Q01UCPU	2.35ms	5.10ms
Q02UCPU	2.35ms	4.50ms
Q03UDCPU	1.10ms	3.65ms
Q04UDHCPU, Q06UDHCPU, Q10UDHCPU, Q13UDHCPU, Q20UDHCPU, Q26UDHCPU	1.05ms	3.65ms
Q03UDECPU, Q04UDEHCPU, Q06UDEHCPU, Q10UDEHCPU, Q13UDEHCPU, Q20UDEHCPU, Q26UDEHCPU, Q50UDEHCPU, Q100UDEHCPU	1.40ms	4.00ms
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	0.60ms	0.60ms

# (13) Diagnostics of the redundant power supply system

When the "Diagnose Redundant Power Supply System" is selected on the PLC RAS tab of the PLC parameter dialog box, the processing time listed in the following table is required.

	Proces	sing time
CPU module	With a power supply	Without a power supply
	module failure ^{*1}	module failure ^{*1}
Q00UCPU	125µs	165µs
Q01UCPU	125µs	135µs
Q02UCPU	90µs	90µs
Q03UD(E)CPU, Q03UDVCPU, Q04UD(E)HCPU, Q04UDVCPU, Q04UDPVCPU, Q06UD(E)HCPU, Q06UDVCPU, Q06UDPVCPU, Q10UD(E)HCPU, Q13UD(E)HCPU, Q13UDVCPU, Q13UDPVCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q26UDVCPU, Q26UDPVCPU, Q50UDEHCPU, Q100UDEHCPU	43µs	52µs

*1 A power supply module failure indicates any of the following.

- The redundant power supply module has failed.
- Power for the redundant power supply module is turned off.
- The redundant power supply module is not mounted.


# (14)A-PLC compatibility setting

When "A-PLC Compatibility Setting" is enabled in the PLC System tab of the PLC Parameter dialog box, the processing time listed in the following table is required.

CPU module	Processing time
Q00UJCPU, Q00UCPU, Q01UCPU	95µs
Q02UCPU	90µs
Q03UD(E)CPU, Q04UD(E)HCPU, Q06UD(E)HCPU, Q10UD(E)HCPU,	
Q13UD(E)HCPU, Q20UD(E)HCPU, Q26UD(E)HCPU, Q50UDEHCPU,	34µs
Q100UDEHCPU	
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU,	13µs
Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU	15µ5

# (15)High-speed interrupt function

The high-speed interrupt function performs the following operations.

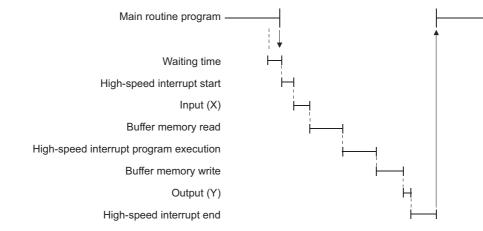

The processing time of each operation is as follows.

#### (a) Waiting time

For the waiting time before a high-speed interrupt starts, refer to Page 229, Section 3.21.3 (1).

#### (b) High-speed interrupt start

For the overhead time at the startup of a high-speed interrupt, refer to Page 473, Appendix 3.2 (3) (a).

#### (c) Input (X)

The processing time listed in the following table is required.

Processing time = (KM1 × total number of X points) + (KM2 × number of setting points) + KM3 [µs]

CPU module		Main base unit		E	tension base u	nit
CFO module	KM1	KM2	КМЗ	KM1	KM2	КМЗ
Q03UDVCPU, Q04UDVCPU,						
Q04UDPVCPU, Q06UDVCPU,						
Q06UDPVCPU, Q13UDVCPU,	0.09	0.20	4.50	0.14	0.20	6.00
Q13UDPVCPU, Q26UDVCPU,						
Q26UDPVCPU						

# (d) Buffer memory read

The processing time listed in the following table is required.

		Read d	ata size:	16 words	or less		l	Read dat	a size: m	ore than	16 words	5
CPU module	Ма	in base u	unit	Exter	ision bas	e unit	Ма	in base u	unit	Exten	ision bas	e unit
	KM1	KM2	KM3	KM1	KM2	KM3	KM1	KM2	KM3	KM1	KM2	KM3
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU, Q06UDVCPU, Q06UDPVCPU,	1.25	0.55	10.00	2.75	0.56	27.00	0.36	0.55	10.00	0.90	0.56	27.00
Q13UDVCPU, Q13UDPVCPU, Q26UDVCPU, Q26UDVCPU	1.25	0.00	10.00	2.15	0.00	27.00	0.00	0.00	10.00	0.90	0.00	27.00

Processing time = (KM1 × total number of words transferred) + (KM2 × number of setting points) + KM3 [µs]

#### (e) Buffer memory write

The processing time listed in the following table is required.

Processing time = (KM1 × total number of words transferred) + (KM2 × number of setting points) + KM3 [µs]

		Write d	ata size:	16 words	or less			Write dat	a size: m	ore than	16 words	5
CPU module	Ma	in base u	unit	Exter	ision bas	e unit	Ma	in base ι	unit	Exten	ision bas	e unit
	KM1	KM2	KM3	KM1	KM2	КМ3	KM1	KM2	KM3	KM1	KM2	KM3
Q03UDVCPU,												
Q04UDVCPU,												
Q04UDPVCPU,												
Q06UDVCPU,												
Q06UDPVCPU,	1.17	1.30	15.00	2.57	0.50	23.00	0.35	1.30	15.00	0.90	0.50	23.00
Q13UDVCPU,												
Q13UDPVCPU,												
Q26UDVCPU,												
Q26UDPVCPU												

#### (f) Output (Y)

The processing time listed in the following table is required.

Processing time = (KM1 × total number of Y points) + (KM2 × number of setting points) + KM3 [µs]

CPU module	1	Main base uni	t	Ext	ension base (	unit
CFO module	KM1	KM2	KM3	KM1	KM2	KM3
Q03UDVCPU, Q04UDVCPU, Q04UDPVCPU,						
Q06UDVCPU, Q06UDPVCPU, Q13UDVCPU,	0.06	0.20	2.80	0.11	0.20	2.60
Q13UDPVCPU, Q26UDVCPU, Q26UDPVCPU						

#### (g) High-speed interrupt end

For the overhead time at the end of a high-speed interrupt, refer to Page 474, Appendix 3.2 (3) (b).

Α

# **Appendix 4** Data Used in Sequence Programs

The CPU module represents numeric and alphabetic data using two symbols (states): 0 (off) and 1 (on).

Data represented using these two symbols is called binary number (BIN).

The CPU module can also use hexadecimal (HEX) (each hexadecimal digit represents four binary bits), binary-coded decimal (BCD), or real numbers.

The following table lists the numeric representations of BIN, HEX, BCD, and DEC (decimal).

	BIN (B	inary)		DEC (Decimal)	HEX (Hexadecimal)	BCD (B	inary-co	oded de	cimal)
			0	0	0				0
			1	1	1				1
			10	2	2				10
			11	3	3				11
			•	4	4				•
			•	5	5				•
			•	6	6				•
			•	7	7				•
			•	8	8				•
			1001	9	9				1001
			1010	10	A			1	0000
			1011	11	В			1	0001
			1100	12	С			1	0010
			1101	13	D			1	0011
			1110	14	E			1	0100
			1111	15	F			1	0101
		1	0000	16	10			1	0110
		1	0001	17	11			1	0111
		•	•	•	•			•	•
		•	•	•	•			•	•
		•	•	•	•			•	•
		10	1111	47	2F			100	0111
		•	•	•	•				
		•	•	•	•				
		•	•	•	•				
0111	1111	1111	1110	32766	7FFE	I	-		
0111	1111	1111	1111	32767	7FFF		-		
1000	0000	0000	0000	-32768	8000	1000	0000	0000	0000
1000	0000	0000	0001	-32767	8001	1000	0000	0000	0001
•	•	•	•	•	•				
•	•	•	•	•	•				
•	•	•	•	•	•				
1111	1111	1111	1110	-2	FFFE		-		
1111	1111	1111	1111	-1	FFFF		-		

# (1) Inputting numeric values externally to the CPU module

When setting a numeric value to the CPU module externally using a digital switch, BCD (binary-coded decimal) can be used as DEC (decimal) by the method given below.

## (a) Numeric values used inside the CPU module

The CPU module performs program operations in binary. If the value set in binary-coded decimal is used without conversion, the CPU module performs program operations regarding the set value as binary.


Therefore, the program operations are not performed correctly.

#### (b) Using any numeric data regardless of the data type

To convert the data set in binary-coded decimal into binary, which can be used in the CPU module, use the BIN instruction.

The BIN instruction allows the CPU module to use any external numeric data regardless of the data type. For details of the BIN instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

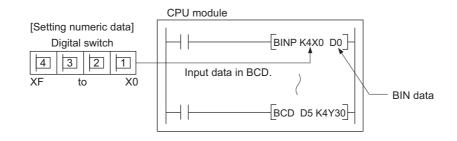

# (2) Outputting numeric values externally from the CPU module

When externally displaying numeric values operated in the CPU module, a digital indicator can be used.

#### (a) Outputting numeric values

The CPU module performs program operations in binary.


If the binary values used in the CPU module are output to a digital indicator, the indicator does not show the values correctly.

To convert the data set in binary into binary-coded decimal, which can be used in the external indicator, use the BCD instruction.

The BCD instruction allows the external indicator to display values in decimal.

For details of the BCD instruction, refer to the following.

MELSEC-Q/L Programming Manual (Common Instruction)

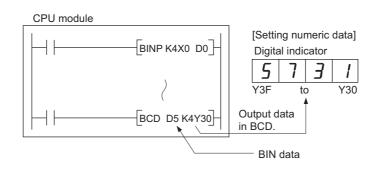

# (1) Definition

Binary is a numeral system that represents numeric values using two symbols, 0 (off) and 1 (on). Decimal notation uses the symbols 0 through 9. When the symbols for the first digit are exhausted (a digit reaches 9), the next-higher digit (to the left) is incremented, and counting starts over at 0. In binary notation, only the symbols 0 and 1 are used. After a digit reaches 1, an increment resets it to 0 and the next digit (to the left) is incremented. (The numeric value becomes 10, which is equal to 2 in decimal.) The following table lists the numeric representations in BIN and DEC.

DEC (Decimal)	BIN (Binary)	
0	0000	
1	0001	Carry
2	0010	
3	0011	Carry
4	0100	
5	0101	
6	0110	
7	0111	Carry
8	1000	
9	1001	
10	1010	
11	1011	


# (2) Numeric representation in BIN

#### (a) Bit configuration of BIN used in the CPU module

Each register (such as the data register, link register) in the CPU module consists of 16 bits.

#### (b) Numeric data available in the CPU module

Each register in the CPU module can store numeric values in the range of -32768 to 32767. The following figure shows the numeric representations for registers.

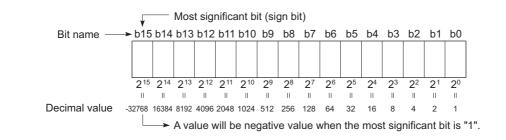

# Point P

A numeric value of 2ⁿ is assigned for each bit of registers. Note that an unsigned binary number (0 to 65535) cannot be used in the most significant bit position since the most significant bit is a sign bit.

- The most significant bit is "0"...Positive
- The most significant bit is "1"...Negative

# Appendix 4.2 HEX (<u>Hexadecimal</u>)

# (1) Definition

Hexadecimal (HEX) is a numeral system that represents four binary bits as one digit. With four binary bits, sixteen different numeric values, 0 to 15, can be represented.

Hexadecimal notation uses 16 symbols to represent numeric values 0 to 15 in one digit, the symbols 0 to 9 to represent values zero to nine, and  $A_H$  to  $F_H$  to represent values ten to fifteen. After a digit reaches  $F_H$ , the next-higher digit (to the left) is incremented.

The following table lists the numeric representations in BIN, HEX, and DEC (decimal).

DEC (Decimal)	HEX (Hexadecimal)	BIN (Binary)	
0	0		0
1	1		1
2	2		10
3	3		11
•	•		•
•	•		•
•	•		•
9	9		1001
10	A		1010
11	В		1011
12	С		1100
13	D		1101
14	E		1110
15	F		1111
16	10	1	0000
17	11	1	0001
•	•		•
•	•		•
•	•		•
47	2F	10	1111

#### (2) Numeric representation in HEX

Each register (such as the data register, link register) in the CPU module consists of 16 bits. In the 16-bit configuration register, 0 to  $\mathsf{FFF}_{\mathsf{H}}$  can be specified in hexadecimal.

Carry

# (1) Definition

BCD is a numeral system that uses four binary bits to represent the decimal digits 0 through 9. The difference from hexadecimal is that BCD does not use letters A to F. The following table lists the numeric representations in BIN, BCD, and DEC.

	Decimal)	BCD (Binary-coded I	BIN (Binary)	DEC (Decimal)
	0		0000	0
	1		0001	1
	10		0010	2
	11		0011	3
	100		0100	4
	101		0101	5
	110		0110	6
	111		0111	7
	1000		1000	8
Com	1001		1001	9
Carry	0000	1	1010	10
	0001	1	1011	11
	0010	1	1100	12

# (2) Numeric representation in BCD

Each register (such as the data register, link register) in the CPU module consists of 16 bits. Therefore, the numeric values can be stored in each register are those in the range between 0 to 9999 in BCD.

# Appendix 4.4 Real number (Floating-point data)

There are two types of real number data: single-precision floating-point data and double-precision floating-point data.


# (1) Single-precision floating-point data

#### (a) Internal representation

Internal representation of real numbers used in the CPU module is given below. Real number data can be represented as follows, using two word devices.

[Sign] 1. [Mantissa] × 2^[Exponent]

The bit configuration and the meaning of each bit are described below.

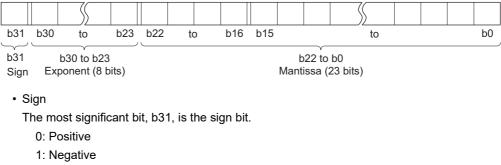

Exponent

The 8 bits, b23 to b30, represent the excess n of 2ⁿ.

The following shows the excess n according to the binary values in b23 to b30.

b23 to b30	FFн	FЕн	FDн	$\langle \rangle$	81н	80н	7Fн	7Ен	(	$\langle \rangle$	02н	01н	00н
n	Not used	127	126	$\langle$	2	1	0	-1		$\rangle$	-125	-126	Not used

Mantissa

Each of the 23 bits, b0 to b22, represents the "XXXXXX..." portion when the data is represented in binary, "1.XXXXXX...".

#### (b) Calculation example

Calculation examples are shown below. (The "X" in (nnnnn) x indicates the numeral system used.)

• Storing "10"

 $\begin{array}{ll} (10)_{10} \rightarrow (1010)_2 \rightarrow (1.010000..... \times 2^3)_2 \\ & \text{Sign:} & \text{Positive} \rightarrow 0 \\ & \text{Exponent:} & 3 \rightarrow 82_H \rightarrow (10000010)_2 \\ & \text{Mantissa:} & (010\ 00000\ 00000\ 00000\ 00000)_2 \end{array}$ 

In this case, the value will be encoded as  $41200000_{H}$ .

• Storing 0.75

 $(0.75)_{10} \rightarrow (0.11)_2 \rightarrow (1.100.... \times 2^{-1})_2$ 

 Sign:
 Positive  $\rightarrow 0$  

 Exponent:
  $-1 \rightarrow 7E_H \rightarrow (0111110)_2$  

 Mantissa:
 (100 00000 00000 00000 00000)_2

In this case, the value will be encoded as  $3F400000_{H}$ .

Sig	n	Ex	Exponent					Mantissa																				
0	0 1	1 1	1 1	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
$\subseteq$	~~				$\subseteq$	$\neg \gamma$			$\subseteq$		γ—	_	$ \subseteq $		$\sim$		$\subseteq$	-γ								-γ		ר
	<b>↓</b>		↓ I			↓					Ļ			,					r			,				V		
	3		F			4				(	Ò			(	Ó			Ċ	)			(	Ď			Ó	)	

Point P

Values after the decimal point (in binary) is calculated as follows.

**Ex.** (0.1101)₂

0.	1	1	0	1
	^	^	1	^

The bit represents 2⁻¹. The bit represents 2⁻². The bit represents 2⁻³. The bit represents 2⁻⁴.

 $(0.1101)_2 = 2^{-1} + 2^{-2} + 2^{-4} = 0.5 + 0.25 + 0.0625 = (0.8125)_{10}$ 


# (2) Double-precision floating-point data

#### (a) Internal representation

Real number data used in the CPU module is internally represented as follows, using four word devices.

[Sign] 1. [Mantissa] × 2^[Exponent]

The bit configuration and the meaning of each bit are described below.



• Sign

The most significant bit, b63, is the sign bit.

- 0: Positive
- 1: Negative
- Exponent

The 11 bits, b52 to b62, represent the excess n of 2ⁿ.

The following shows the excess n according to the binary values in b52 to b62.

b52 to b6	62 7FFн	7FEн	7FDн	(	$\langle \rangle$	400н	3FFн	3FEн	3FDн	3FCн	(	$\langle \rangle$	02н	01н	00н
n	Not used	1023	1022	(	$\langle$	1	0	-1	-2	-3		$\langle$	-1021	-1022	Not used

#### Mantissa

Each of the 52 bits, b0 to b51, represents the "XXXXXX..." portion when the data is represented in binary, "1.XXXXXX...".


#### (b) Calculation example

Calculation examples are shown below. (The "X" in (nnnnn) x indicates the numeral system used.)

• Storing "10"

 $(10)_{10} \rightarrow (1010)_2 \rightarrow (1.010000..... \times 2^3)_2$ Sign: Positive  $\rightarrow 0$ Exponent:  $3 \rightarrow 401_H \rightarrow (100\ 0000\ 0001)_2$ 

In this case, the value will be encoded as  $401400000000000_{H}$ .

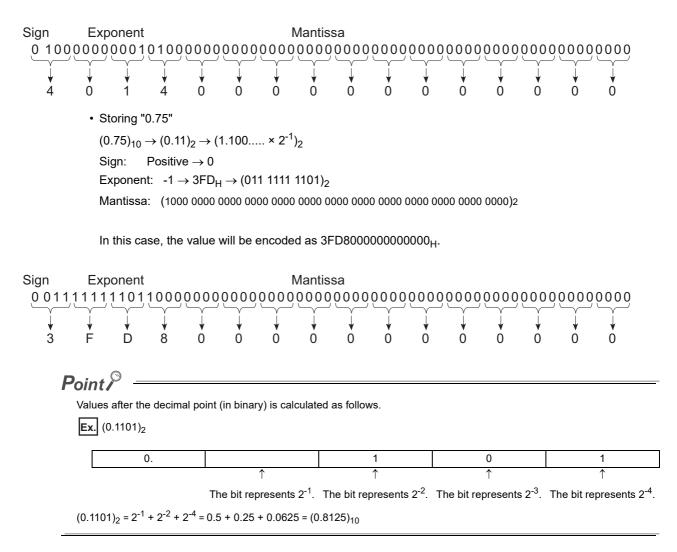

## Appendix 4.5 Character string data

### (1) Definition

The CPU module uses shift JIS code character strings.

Appendix 4 Data Used in Sequence Programs Appendix 4.5 Character string data

# Appendix 5 Replacing Basic Model QCPU or Qn(H)CPU with QnUCPU

## Appendix 5.1 Replacement precautions

This section describes precautions for replacing the Basic model QCPU or High Performance model QCPU with the Universal model QCPU and the replacement methods.

## Appendix 5.1.1 Replacing Basic model QCPU with Universal model QCPU

### (1) System configuration

Item	Precautions	Replacement method	Reference
GOT	GOT900 series cannot be connected.	Use GOT1000 or GOT2000 series.	
Applicable products and software	Products and software compatible with the Universal model QCPU must be used.	Products need to be replaced for the compatibility with the Universal model QCPU and software need to be upgraded for the communication with the Universal model QCPU are described in Page 515, Appendix 5.2.	Page 515, Appendix 5.2
Multiple CPU system	To configure a multiple CPU system, CPU modules compatible with the Universal model QCPU must be used.	CPU modules compatible with the Universal model QCPU are described in Page 515, Appendix 5.2.	Page 515, Appendix 5.2

#### (2) Program

ltem	Precautions	Replacement method	Reference
Language and instruction	Some instructions are not supported.	Replace the instructions not supported in the Universal model QCPU are described in Page 520, Appendix 5.3.	Page 520, Appendix 5.3
Floating-point operation	When using the floating-point data comparison instructions, LDED, ANDED, ORED, LDEDD, ANDEDD, and OREDD, if the comparison source data are -0, nonnumeric, unnormalized number, or $\pm \infty$ , "OPERATION ERROR" (error code: 4101) is detected. ^{*1} ( $\Box$ indicates one of the following; =,<>,<=,=>,=,<>.)	When the floating-point data comparison instructions are used, modify the program as described in Page 544, Appendix 5.4.2.	Page 499, Appendix 4.4, Page 544, Appendix 5.4.2
Device range check at index modification	When a device number exceeds a setting range due to index modification, "OPERATION ERROR" (error code: 4101) is detected.	Deselect the "Check Device Range at Indexing" checkbox in the PLC RAS tab of the PLC parameter dialog box so that checking is not performed.	Page 548, Appendix 5.4.3
Latch setting	If latch ranges of internal user devices are specified, the processing time is added in proportion to the device points set to be latched.	<ul> <li>The latch function of the Universal model QCPU is enhanced.</li> <li>(1) Large-capacity file register (R, ZR)</li> <li>(2) Writing/reading device data to the standard ROM (SP.DEVST and S(P).DEVLD instructions)</li> <li>(3) Latch range specification of internal devices</li> <li>(4) "Time Setting" specification in the latch interval setting parameter^{*2}</li> <li>Change the latch method to the one described above according to the application.</li> </ul>	Page 122, Section 3.3, Page 124, Section 3.3 (5) (b), Page 552, Appendix 5.4.4

ltem	Precautions	Replacement method	Reference
Interrupt counter	Interrupt counter is not supported.	Check the numbers of executions for interrupt programs on the Interrupt program monitor list screen.	Page 180, Section 3.13.2
SCJ instruction	When the SCJ instruction is used in the Universal model QCPU, the AND SM400 (or NOP instruction) needs to be inserted immediately before the SCJ instruction.	Insert the AND SM400 (or NOP instruction) immediately before the SCJ instruction when the SCJ instruction is used.	Section 6.5 in the MELSEC-Q/L Programming Manual (Common Instruction)
JP/GP.SREAD and JP/GP.SWRITE instructions	Use of the completion notification device of the target station specified in D3 when the SREAD and SWRITE instructions are used is available. (The Basic model QCPU ignores the device specified in D3.)	To get the same operation as the Basic model QCPU, omit D3 or use the READ instruction instead of the SREAD instruction.	Section 8.3.2, 8.3.4 in the QnACPU Programming Manual (Common Instructions)
ZPUSH instruction	The number of index registers is increased to 20 for the Universal model QCPU. The area for saving the data in the index register with the ZPUSH instruction is increased as well.	Increase the save area used for the ZPUSH instruction as needed.	Section 7.19 in the MELSEC-Q/L Programming Manual (Common Instruction)
Use of the annunciator (SET F⊡ and OUT F⊡ instructions)	When the annunciator is turned on by the SET F□ or OUT F□ instruction, the USER LED turns on. (The ERR.LED does not turn on.)		
I/O refresh between programs	I/O refresh between programs cannot be executed.	Execute I/O refresh at the start or end of each program with the RFS or COM instruction. (When the COM instruction is used, I/O refresh to be executed can be specified in SD778 by turning on SM774.)	
SM/SD	Usage of a part of the special relay and special register is different.	Replace the corresponding special relay and special register as described in Page 564, Appendix 5.5.	Page 564, Appendix 5.5
Multiple CPU system	The start address for the user setting area (auto refresh) in the CPU shared memory is changed.	If the user setting area in the CPU shared memory is specified in the program, change the address for the user setting area by performing an operation for replacing a device in a programming tool. (Example: "MOV D0 U3E0\G192" → "MOV D0U3E0\G2048")	
File register	To use the file register, capacity setting is required.	Set the capacity of the file register used in the PLC file tab of the PLC parameter.	
SFC program	The following settings are required for using SFC programs. Program setting (when both sequence programs and SFC programs exist) Common pointer No. setting (to execute the CALL instruction from SFC programs)	Set program details in the Program tab of the PLC parameter dialog box. Enter a common pointer number in the PLC system of the PLC parameter dialog box.	Page 447, Appendix 1.2.8
Number of steps	<ul> <li>The number of steps increases by one^{*3} when:</li> <li>Index modification is performed.</li> <li>A leading or trailing edge instruction is used.</li> <li>Bit devices are used as word data by specifying digits using K1, K2, K3, K5, K6, or K7, or by specifying a device number of other than multiples of 16.</li> </ul>	<ul> <li>If index modifications mentioned on the left are frequently used in the program, the program size may exceed the storage capacity of the replaced CPU module. After the program controller type is changed, check the program size using the confirm memory size function. If the program size exceeds the storage capacity, take the following actions or change the CPU module to that with larger program memory.</li> <li>Move parameters and device comments to the standard ROM.</li> <li>Reduce the reserved area for online change.</li> <li>Use the file register, extended data register, and extended link register within 64K words because the number of steps decreases by one when used in that way.</li> </ul>	MELSEC-Q/L Programming Manual (Common Instruction)

*1 This will not apply when the Basic model QCPU is replaced with the High-speed Universal model QCPU and Universal model Process CPU.

*2 Only the High-speed Universal model QCPU and Universal model Process CPU support this setting.

*3 This will apply only when the Basic model QCPU is replaced with the High-speed Universal model QCPU and Universal model Process CPU.

## (3) Drive and file

Item	Precautions	Replacement method	Reference
Boot file setting	The boot file setting is not supported.	Since the Universal model QCPU holds the data in the program memory even when the battery voltage drops, the boot file setting is not necessary. Move files with the boot setting (from the standard ROM to the program memory) to the program memory.	Page 104, Section 2.11

## (4) External communication (Service processing)

ltem	Precautions	Replacement method	Reference
Time reserved for communication processing	The time reserved for communication processing (SM315/SD315) is not supported.	Set service processing time in the PLC system tab of the PLC parameter dialog box.	Page 241, Section 3.24.1
MC protocol	The following commands cannot specify monitoring conditions. Randomly reading data in units of word (Command: 0403) Device memory monitoring (Command: 0801) The applicable frame types are as follows: QnA-compatible 3C/4C frame QnA-compatible 3E frame 4E frame		MELSEC Communication Protocol Reference Manual

## (5) Battery installation position

ltem	Precautions	Replacement method	Reference
Battery installation position	<ul> <li>The battery replacement method is different.</li> <li>The battery installation position varies depending on the model.</li> <li>Q00JCPU, Q00CPU, Q01CPU</li> <li>On the front of the module.</li> <li>Q00UJCPU, Q00UCPU, Q01UCPU</li> <li>At the bottom of the module.</li> </ul>	For the battery replacement method, refer to the in the Reference column.	QCPU User's Manual (Hardware Design, Maintenance and Inspection)

### (6) Program size

Item	Precautions	Replacement method	Reference
Program size	Data in the program memory of the Basic model QCPU may exceed the size of the program memory of the Universal model QCPU.	Store parameter and device comment files in the standard ROM.	

# Appendix 5.1.2 Replacing High Performance model QCPU with Universal model QCPU

## (1) System configuration

ltem	Precautions	Replacement method	Reference
Use of AnS/A series module	The Universal model QCPU whose serial number (first 5 digits) is "13102" or later must be used.	Use Q series modules when using the Universal model QCPU whose serial number (first 5 digits) is "13101" or earlier.	
GOT	GOT900 series cannot be connected.	Use GOT1000 or GOT2000 series.	
Programming tool connection	Applicable USB cables are different. • High Performance model QCPU A-B type • Universal model QCPU A-miniB type	Use USB cables of A-miniB type. Or, use USB conversion adapters of B-miniB type.	
Applicable products and software	Products and software compatible with the Universal model QCPU must be used.	Products need to be replaced for the compatibility with the Universal model QCPU and software need to be upgraded for the communication with the Universal model QCPU are described in Page 515, Appendix 5.2.	Page 515, Appendix 5.2
	To configure a multiple CPU system, CPU modules compatible with the Universal model QCPU must be used.	CPU modules compatible with the Universal model QCPU are described in Page 515, Appendix 5.2.	Page 515, Appendix 5.2
Multiple CPU system	In a multiple CPU system using the Motion CPU, an existing auto refresh area and user setting area cannot be used for data communication with the Motion CPU.	For data communication with the Motion CPU, use an auto refresh area and user setting area in the multiple CPU high-speed transmission area.	Chapter 4 in the QCPU User's Manual (Multiple CPU System)
Redundant power supply system	To check the status of the power supply module in a redundant power supply system by using SM1780 to SM1783/SD1780 to SD1783 or with the system monitor screen, the Universal model QCPU whose serial number (first 5 digits) is "10042" or later must be used.	Check the status of the power supply module with the LED on the front of the module when using the Universal model QCPU whose serial number (first 5 digits) is "10041" or earlier. (In a redundant power supply system, the status of the power supply module cannot be stored in SM1780 to SM1783/SD1780 to SD1783. The status cannot be displayed on the system monitor screen either.)	Section 7.1 in the QCPU User's Manual (Hardware Design, Maintenance and Inspection)
MELSECNET/H	The simple dual-structured network function is not supported.		Section 7.7 in the Q Corresponding MELSECNET/H Network System Reference Manual (PLC to PLC network)
MELSECNET/H, CC-Link IE Controller Network	Interlink transmission timing differs.	Add a handshake program to the send side and receive side so that the module does not receive data while sending data.	Section 6.2 in the Q Corresponding MELSECNET/H Network System Reference Manual (PLC to PLC network), Section 4.1 in the MELSEC- Q CC-Link IE Controller Network Reference Manual

## (2) Program

Item	Precautions	Replacement method	Reference
Language and instruction	Some instructions are not supported.	Replace the instructions not supported in the Universal model QCPU are described in Page 520, Appendix 5.3.	Page 520, Appendix 5.3
	The Universal model QCPU performs program operations of floating-point data in single precision.	Instructions for floating-point double-precision operations are added for the Universal model QCPU. Replace the instructions if floating-point double-precision operations are required, as described in Page 537, Appendix 5.4.1.	
Floating-point operation	When using the floating-point data comparison instructions, LDED, ANDED, ORED, LDEDD, ANDEDD, and OREDD, if the comparison source data are -0, nonnumeric, unnormalized number, or $\pm \infty$ , "OPERATION ERROR" (error code: 4101) is detected. ^{*2} ( $\Box$ indicates one of	When the floating-point data comparison instructions are used, modify the program as described in Page 544, Appendix 5.4.2.	Page 499, Appendix 4.4, Page 537, Appendix 5.4.1, Page 544, Appendix 5.4.2
	the following; =,<>,<=,>=,<,>.)		
Device range check at index modification	When a device number exceeds a setting range due to index modification, "OPERATION ERROR" (error code: 4101) is detected.	Deselect the "Check Device Range at Indexing" checkbox in the PLC RAS tab of the PLC parameter dialog box so that checking is not performed.	Page 195, Section 3.17 Page 548, Appendix 5.4.3
	Low-speed execution type programs are not supported.	Use scan execution type programs or fixed scan execution type programs.	Page 88, Section 2.10
Program execution type	A program execution type cannot be changed by remote operation. For the QnUDVCPU and QnUDPVCPU whose serial number (first five digits) is "18112" or later, however, a program execution type can be changed by remote operation when it is the scan execution type or stand-by type.	Use instructions for switching program execution types, such as PSTOP, POFF, and PSCAN.	Page 102, Section 2.10.5
Latch setting	If latch ranges of internal user devices are specified, the processing time is added in proportion to the device points set to be latched. (For example, if 8K points are latched for the latch relay (L), the processing time of 28.6µs is required.)	<ul> <li>The latch function of the Universal model QCPU is enhanced.</li> <li>(1) Large-capacity file register (R, ZR)</li> <li>(2) Writing/reading device data to the standard ROM (SP.DEVST and S(P).DEVLD instructions)</li> <li>(3) Latch range specification of internal devices</li> <li>(4) "Time Setting" specification in the latch interval setting parameter^{*3}</li> <li>Change the latch method to the one described above according to the application.</li> </ul>	Page 122, Section 3.3, Page 124, Section 3.3 (5) (b), Page 552, Appendix 5.4.4
	The interrupt pointer (I49) for the high-speed	Consider the use of interrupt pointers for fixed	
Interrupt program	interrupt function is not supported.*2	scan interrupt (I28 to I31). Check the numbers of executions for interrupt programs on the Interrupt program monitor list screen.	Page 180, Section 3.13.2
	The interrupt pointers (I32 to I40) due to an error are not supported.		Page 412, Section 4.11
SCJ instruction	When the SCJ instruction is used in the Universal model QCPU, the AND SM400 (or NOP instruction) needs to be inserted immediately before the SCJ instruction.	Insert the AND SM400 (or NOP instruction) immediately before the SCJ instruction when the SCJ instruction is used.	Section 6.5 in the MELSEC-Q/L Programming Manual (Common Instruction)
ZPUSH instruction	The number of index registers is increased to 20 for the Universal model QCPU. The area for saving the data in the index register with the ZPUSH instruction is increased as well.	Increase the save areas used for the ZPUSH instruction as needed.	Section 7.19 in the MELSEC-Q/L Programming Manual (Common Instruction)

Α

Item	Precautions	Replacement method	Reference
File usability setting for each program	The following file usability setting for each program is not available. ^{*1} • File register • Initial device value • Comment	When file usability is set, modify the program as described in Page 554, Appendix 5.4.5.	Page 88, Section 2.10, Page 554, Appendix 5.4.5
I/O refresh setting for each program	I/O refresh setting for each program is not available.	Use the RFS instruction if I/O refresh setting for each program is required.	MELSEC-Q/L Programming Manual (Common Instruction)
	Usage of a part of the special relay and special register is different.	Replace the corresponding special relay and special register as described in Page 564, Appendix 5.5.	Page 564, Appendix 5.5
SM/SD	A series-compatible special relay and special register are not supported. (SM1000 to SM1255/SD1000 to SD1255)	By using a programming tool, A series- compatible special relay and special register can be replaced with the Universal model QCPU-compatible special relay and special register. Note, however, that the ones which are not compatible with the Universal model QCPU are replaced with SM1255 and SD1255. Modify programs as needed.	QCPU User's Manual (Hardware Design, Maintenance and Inspection)
Processing time	Scan time and each processing time are different.	Modify programs as needed, checking the processing timing.	
Number of steps	<ul> <li>The number of steps increases by one^{*4} when:</li> <li>Index modification is performed.</li> <li>A leading or trailing edge instruction is used.</li> <li>Bit devices are used as word data by specifying digits using K1, K2, K3, K5, K6, or K7, or by specifying a device number of other than multiples of 16.</li> </ul>	If index modifications mentioned on the left are frequently used in the program, the program size may exceed the storage capacity of the replaced CPU module. After the program controller type is changed, check the program size using the confirm memory size function. If the program size exceeds the storage capacity, take the following actions or change the CPU module to that with larger program memory. • Move parameters and device comments to the standard ROM. • Reduce the reserved area for online change. • Use the file register, extended data register, and extended link register within 64K words because the number of steps decreases by one when used in that way.	MELSEC-Q/L Programming Manual (Common Instruction)

Q06UDHCPU if the serial number (first five digits) is "10011" or earlier.
*2 This will not apply when the High Performance model QCPU is replaced with the High-speed Universal model QCPU and Universal model Process CPU.

*3 Only the High-speed Universal model QCPU and Universal model Process CPU support this setting.

*4 This will apply only when the High Performance model QCPU is replaced with the High-speed Universal model QCPU and Universal model Process CPU.

### (3) Drive and file

Item	Precautions	Replacement method	Reference
Boot file setting	Files in the standard ROM cannot be booted to the program memory.	Since the Universal model QCPU holds the data in the program memory even when the battery voltage drops, the boot file setting is not necessary. Move files with the boot setting (from the standard ROM to the program memory) to the program memory.	Page 104, Section 2.11, Page 557, Appendix 5.4.6
	Booting operation is different.	Replacement method when the parameter-valid drive and the boot file setting are set in the High Performance model QCPU is described in Page 557, Appendix 5.4.6.	
	A memory card (SRAM card, ATA card, or Flash card) cannot be specified as a transfer source. ^{*1}	Specify an SD memory card as a transfer source.	

Item	Precautions	Replacement method	Reference
Automatic all data write from memory card to standard ROM	The setting method of this function is different.	In the Boot file tab of the PLC parameter dialog box, select "standard ROM" for the transfer destination. Note, however, that the transfer destination of "program" is fixed to "program memory". (Setting by DIP switches is not necessary.)	Page 104, Section 2.11
Davies comment	A device comment file cannot be stored in an SRAM card. ^{*1}	Store the file in the standard RAM.	
Device comment	A device comment file cannot be stored in an ATA card nor Flash card. ^{*1}	Store the file in an SD memory card.	
	An initial device value file cannot be stored in an SRAM card. ^{*1}	Store the file in the standard RAM or standard ROM.	Dana 047, Oaction 0.05
Initial device value	An initial device value file cannot be stored in an ATA card nor Flash card. ^{*1}	Store the file in an SD memory card.	Page 247, Section 3.25
Local device	A local device file cannot be stored in an SRAM card. ^{*1}	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the local device file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 422, Section 6.2
File register	A file register file cannot be stored in an SRAM card. ^{*1}	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the file register file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 393, Section 4.7.1
File register	A file register file cannot be stored in a Flash card. (Sequence programs only can read file register data in a Flash card.) ^{*1}	Use the initial device value file in an SD memory card or the FREAD/FWRITE instructions.	Page 247, Section 3.25, MELSEC-Q/L Programming Manual (Common Instruction)
Sampling trace	A sampling trace file cannot be stored in an SRAM card. ^{*1}	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the sampling trace file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 184, Section 3.14 (2)
CPU module change function with memory card	A memory card cannot be specified as a backup destination or restoration source.	Specify an SD memory card as a backup destination or restoration source.	Page 260, Section 3.31

*1 This applies when the High Performance model QCPU is replaced with the High-speed Universal model QCPU and Universal model Process CPU.

#### (4) External communication

Item	Precautions	Replacement method	Reference
Module service interval time read	The module service interval time cannot be read.		Page 241, Section 3.24.1
MC protocol	To access CPU modules by using A-compatible 1C frame and A-compatible 1E frame, the Q10UDHCPU, Q20UDHCPU, Built-in Ethernet port QCPU, or the modules (Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU) whose serial numbers (first 5 digits) are "10102" or later must be used. The following commands cannot specify monitoring conditions. • Randomly reading data in units of word (Command: 0403) • Device memory monitoring (Command: 0801) The applicable frame types are as follows: • QnA-compatible 3C/4C frame • QnA-compatible 3E frame • 4E frame	Use the frame types below when using the modules (Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU) whose serial numbers (first 5 digits) are "10101" or earlier. • QnA-compatible 2C/3C/4C frame • QnA-compatible 3E frame • 4E frame	MELSEC Communication Protocol Reference Manual

Α

### (5) Diagnostic function

Item	Precautions	Replacement method	Reference	
Error history	Error history data cannot be stored in the memory card.	The Universal model QCPU can store history data by the number of storable history data in a memory card (100) to the system memory.	Page 206, Section 3.18	
LED indication priority setting	LED indication priority cannot be set. Only LED indication setting at error occurrence is supported.		Page 223, Section 3.20.2	

### (6) Debugging

Item	Precautions	Replacement method	Reference
Monitor condition setting	To use the monitor condition setting, the Q10UDHCPU, Q20UDHCPU, Built-in Ethernet port QCPU, or the modules (Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU) whose serial numbers (first 5 digits) are "10042" or later must be used.		Page 146, Section 3.11.1, Page 184, Section 3.14
Scan time measurement	Time required for executing a part of the program cannot be measured using the scan time measurement function. ^{*1}	Calculate the time using instruction processing time described in the manual.	Page 181, Section 3.13.3     Appendix 1 in the     MELSEC-Q/L     Programming Manual     (Common Instruction)
External input/output forced on/off	To use the external input/output forced on/off function, the Q10UDHCPU, Q20UDHCPU, Built-in Ethernet port QCPU, or the modules (Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU) whose serial numbers (first 5 digits) are "10042" or later must be used. ^{*2}	on, the Q10UDHCPU, Q20UDHCPU, in Ethernet port QCPU, or the modules UCPU, Q03UDCPU, Q04UDHCPU, JDHCPU, Q13UDHCPU, and JDHCPU) whose serial numbers (first 5 Input and output targeted for forced on/off are referred to or changed using the direct input	

* 1 Scan time of each program can be checked on the Program monitor list screen.

* 2 Device test can be performed when the modules (Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, and Q26UDHCPU) whose serial numbers (first five digits) are "10041" or earlier are used.

### (7) Switch on the front of the CPU module

ltem	Precautions	Replacement method	Reference
	The operation method with the RESET/RUN/STOP switch is modified.	The RESET/STOP/RUN switch of the Universal model QCPU can be used for the reset operation of the CPU module and switching between the STOP and RUN status.	Section 6.1.3 in the QCPU User's Manual (Hardware Design, Maintenance and Inspection)
Switch on the front of the CPU module	Latch data cannot be cleared by the switch.	<ul> <li>Perform either of the following operations to clear latch data.</li> <li>Remote latch clear using a programming tool</li> <li>Latch clear by using the special relay and special register areas^{*1}</li> </ul>	Page 137, Section 3.6.4
	The system protect cannot be set by the switch.	Data in the files can be protected by setting a password for each file. Password for each file can be registered with a programming tool.	Page 207, Section 3.19
	The parameter-valid drive setting is not necessary.	The Universal model QCPU automatically determines the parameter-valid drive. Change the setting as described in Page 557, Appendix 5.4.6 when the parameter-valid drive is set to other than the program memory in the High Performance model QCPU.	Page 42, Section 2.1.2, Page 557, Appendix 5.4.6

*1

Only the High-speed Universal model QCPU whose serial number (first five digits) is "15043" or later and the Universal model Process CPU whose serial number (first five digits) is "15072" or later support this type of latch clear operation.

Α

## (8) SFC

Item	Precautions	Replacement method	Reference		
Step transition monitoring timer	The step transition monitoring timer is not supported.	Change the program as described in Appendix 3.1 in the manual in the Reference column.	Section 4.6 and Appendix 3.1 in the MELSEC- Q/L/QnA Programming Manual (SFC)		
	The periodic execution block setting is not supported.	Change the program as described in Appendix 3.2 in the manual in the Reference column.	Section 4.7.4 and Appendix 3.2 in the MELSEC- Q/L/QnA Programming Manual (SFC)		
SFC operation mode setting	To select an operation mode at double block START, the Universal model QCPU whose serial number (first 5 digits) is "12052" or later must be used.	An operation mode at double block START is fixed to "WAIT" when the Universal model QCPU whose serial number (first 5 digits) is "12051" or earlier is used.	Section 4.7.5 in the MELSEC-Q/L/QnA Programming Manual (SFC)		
	An operation mode at transition to active step cannot be selected. (Fixed to "TRANSFER".)		Section 4.7.6 in the MELSEC-Q/L/QnA Programming Manual (SFC)		
SFC program for program execution management	SFC programs for program execution management are not supported.	Ition			
SFC control instruction	Some SFC control instructions are not supported.	SFC control instructions not supported in the Universal model QCPU and replacing methods are described in Page 520, Appendix 5.3.	Page 520, Appendix 5.3     Section 4.4 in the     MELSEC-Q/L/QnA     Programming Manual     (SFC)		
SFC comment readout instruction	-		Section 4.8 in the MELSEC-Q/L/QnA Programming Manual (SFC)		
Method of SFC program change	SFC program files cannot be written to the running CPU module. (Programs in SFC Figure can be changed online.)	<ul> <li>Write program data to the CPU module after changing the Universal model QCPU status to STOP.</li> <li>An inactive block in an SFC program can be changed by online change of inactive block.^{*1}</li> </ul>	Section 6.6 in the MELSEC-Q/L/QnA Programming Manual (SFC)		

*1 This operation is available for the Universal model QCPU other than the Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU and whose serial number (first five digits) is "12052" or later.

## Appendix 5.2 Applicable devices and software

## (1) Products need to be replaced for the compatibility with the Universal model QCPU

The following tables show products need to be replaced for the compatibility with the Universal model QCPU. (As for products not listed in the tables below, replacement is not required.)

#### (a) Communication module

		Serial number (first five digits) of the product compatible with the Universal model QCPU ^{*2}					
Product	Model	Used with Q02U/Q03UD/ Q04UDH/ Q06UDHCPU	Used with Q13UDH/ Q26UDHCPU	Used with Q00UJ/Q00U/ Q01U/Q10UDH/ Q20UDHCPU, or QnUDE(H)CPU	Used with High-speed Universal model QCPU	Used with Universal model Process CPU	
Web server module ^{*1}	• QJ71WS96	"09042" or later	"10011" or later	"10012" or later	"14122" or later	"14122" or later	
MES interface module	• QJ71MES96	"09042" or later	"10011" or later	"10012" or later	"14122" or later	"14122" or later	
High speed data logger module	• QD81DL96	No restrictions	No restrictions	No restrictions	"14122" or later	"14122" or later	

*1 The Universal model QCPU does not operate normally when the Web server module on which GX RemoteService-I is installed is used.

*2 The Universal model QCPU does not operate normally when a product not compatible with the Universal model QCPU is used.

#### (b) PC interface board

Product			Dedicated software package version compatible with the Universal model QCPU ^{*1}					
		Model	Used with Q02U/Q03UD / Q04UDH/ Q06UDHCPU	Used with Q13UDH/ Q26UDHCPU	Used with Q00UJ/Q00U/ Q01U/Q10UDH/ Q20UDHCPU, or QnUDE(H)CPU	Used with High-speed Universal model QCPU	Used with Universal model Process CPU	
CC-Link IE Field Network interface board		• Q81BD-J71GF11-T2	No restrictions	No restrictions	No restrictions	1.03D or later	1.12N or later	
CC-Link IE Controller Network interface board		<ul> <li>Q81BD-J71GP21-SX</li> <li>Q81BD-J71GP21S-SX</li> <li>Q80BD-J71GP21-SX</li> <li>Q80BD-J71GP21S-SX</li> </ul>	No restrictions	1.03D or later	1.06G or later	1.15R or later	1.15R or later	
	SI/QSI/H- PCF optical	• Q80BD-J71LP21-25 • Q80BD-J71LP21S-25	15R or later	18U or later				
MELSECNET/H	cable	• Q81BD-J71LP21-25	19V or later	19V or later				
interface board	GI optical cable	• Q80BD-J71LP21G	15R or later	18U or later	20W or later	25B or later	1.15R or later	
	Coaxial cable	• Q80BD-J71BR11	Tor of later	Too of later				
CC-Link system r	naster/local	• Q80BD-J61BT11N	1.02C or later	1.05F or later	1.07H or later	1.12N or later	1.12N or later	
interface board		• Q81BD-J61BT11	1.06G or later	1.06G or later				

*1 No restrictions on the board itself.

Α

#### (c) GOT

		GT Designer2 OS version compatible with the Universal model QCPU ^{*1}					
Product	Model	Used with Q00UJ/Q00U/ Q01U/Q10UDH/ Q20UDHCPU	Used with Q02U/Q03UD/ Q04UDH/ Q06UDHCPU	Q13	l with UDH/ DHCPU	Used with Q03UDE/ Q04UDEH/ Q06UDEH/ Q13UDEH/ Q26UDEHCPU	Used with Q10UDEH/ Q20UDEHCPU
	GT16□-□			-			
	GT15□-□	2.91V or later	2.60N or later	2.76E	or later	2.81K or later	2.91V or later
GOT1000	GT14□-□			-			
	GT11□-□	2.91V or later	2.60N or later	2.76E	or later	2.81K or later	2.91V or later
	GT10□-□	2.91V or later	2.76E or later	2.76E	or later		
Product	Model	GT Work	s3 OS version co	mpatible	e with the	e Universal model	QCPU ^{*1}
Floudet	Model	High-speed U	niversal model Q	CPU	Universal model Process CPU		
	GT16□-□	1.	64S or later		1.73B or later		
	GT15□-□	1.	64S or later		1.73B or later		
GOT1000	GT14 <b>□</b> -□	1.	64S or later			1.73B or late	r
	GT11□-□	1.	64S or later		1.73B or later		
	GT10□-□	1.	64S or later		1.73B or later		

*1 No restrictions on GOT itself.

#### (d) Network module and serial communication module

		Module version	compatible with the Universa	I model QCPU
Product	Model Model Used with Q00UJ/Q00U/Q01U/Q02U/ Q03UD/Q04UDH/Q06UDH/ Q10UDH/Q13UDH/Q20UDH/ Q26UDHCPU		Used with QnUDE(H)CPU	Used with QnUDV/QnUDPVCPU
MELSECNET/H model	• QJ71LP21-25 • QJ71LP21S-25 • QJ71LP21G • QJ71LP21GE • QJ71BR11	No restrictions	Some restrictions depending on use conditions ^{*1}	
Serial communication module	• QJ71C24N • QJ71C24N-R2 • QJ71C24N-R4		Serial number (first five digits) "10042" or later	No restrictions

*1 The serial number (first five digits) of the MELSECNET/H module must be "10042" or later if all conditions 1) to 4) described below are satisfied.

1) A multiple CPU system including Built-in Ethernet port QCPU is configured.

2) A programming tool or GOT is connected to an Ethernet port of the Built-in Ethernet port QCPU.

3) A programming tool or GOT accesses the CPU module on another station via the MELSECNET/H module controlled by another CPU.

4) The access target on another station is A/QnA series CPU module.

# (2) CPU modules that can configure a multiple CPU system with the Universal model QCPU

CPU modules that can configure a multiple CPU system with the Universal model QCPU are shown below.

#### (a) For the QnUD(H)CPU or Built-in Ethernet port QCPU

			A	Applicable version	ı		
CPU module	Model	Configured with Q03UD/ Q04UDH/ Q06UDHCPU	Configured with Q13UDH/ Q26UDH, Q03UDE/ Q04UDEH, Q06UDEH/ Q13UDEH/ Q26UDEHCPU	Configured with Q10UDH/ Q20UDH/ Q10UDEH/ Q20UDEHCPU	Configured with High-speed Universal model QCPU	Configured with Universal model Process CPU	Restrictions
Motion CPU	Q172DCPU     Q173DCPU     Q172DCPU-S1     Q173DCPU-S1     Q172DSCPU     Q172DSCPU     Q173DSCPU			No restrictions			Use only the multiple CPU high-speed main base unit (Q3□DB) as a main base unit.
PC CPU module	• PPC- CPU852(MS)	Driver S/W (PPC-DRV-02) version 1.01 or later	Driver S/W (PPC-DRV-02) version 1.02 or later	Driver S/W (PPC-DRV-02) version 1.03 or later	ľ	N/A	
	• Q06CCPU-V • Q06CCPU-V-B	No restrictions	Serial number (first five digits) "10012" or later	Serial number (first five digits) "10102" or later	ľ	N/A	
C Controller module	• Q12DCCPU-V		No restrictions		Serial number (first five digits) "14122" or later	N/A	
module	• Q24DHCCPU-V		No restrictions		Serial number (first five digits) "14122" or later	Serial number (first five digits) "15051" or later	
	• Q24DHCCPU- LS			No restrictions			
High Performance model QCPU	Q02CPU     Q02HCPU     Q06HCPU     Q12HCPU     Q25HCPU		Function version B or later				
Process CPU	Q02PHCPU     Q06PHCPU     Q12PHCPU     Q25PHCPU			No restrictions			

### (b) For the Q00UCPU, Q01UCPU, or Q02UCPU

		Applicabl		
CPU module	Model	Configured with Q00U/Q01UCPU	Configured with Q02UCPU	Restrictions
Motion CPU	• Q172CPUN(-T) • Q173CPUN(-T) • Q172HCPU(-T) • Q173HCPU(-T)	No rest	The multiple CPU high-speed main base unit (Q3□DB) cannot be used as a main base unit.	
PC CPU module	• PPC- CPU852(MS)	Driver S/W (PPC-DRV-02) version 1.03 or later	Driver S/W (PPC-DRV-02) version 1.01 or later	
	• Q06CCPU-V • Q06CCPU-V-B	Serial number (first five digits) "10102" or later	No restrictions	
C Controller module	Q12DCCPU-V     Q24DHCCPU-V     Q24DHCCPU-LS	No restrictions		

# (3) Software need to be upgraded for the compatibility with the Universal model QCPU

The following table shows software need to be upgraded for the communication with the Universal model QCPU. (As for software not listed in the table below, version upgrade is not required.)

		Ve	rsion compatible with t	he Universal model QC	PU
Product	Model	Used with Q02U/ Q03UD/Q04UDH/ Q06UDHCPU	Used with Q13UDH/ Q26UDHCPU	Used with Q03UDE/Q04UDEH/ Q06UDEH/Q13UDEH /Q26UDEHCPU	Used with Q00UJ/ Q00U/Q01U/Q10UDH /Q20UDH/Q10UDEH/ Q20UDEHCPU
GX Developer	SW8D5C-GPPW-E	Version 8.48A or later	Version 8.62Q or later	Version 8.68W or later	Version 8.78G or later
GX Configurator-AD	SW2D5C-QADU-E	Version 2.05F or later ^{*1}	Version 2.05F or later ^{*2}	Version 2.05F or later ^{*3}	Version 2.05F or later ^{*4}
GX Configurator-DA	SW2D5C-QDAU-E	Version 2.06G or later ^{*1}	Version 2.06G or later ^{*2}	Version 2.06G or later ^{*3}	Version 2.06G or later ^{*4}
GX Configurator-SC	SW2D5C-QSCU-E	Version 2.12N or later ^{*1}	Version 2.12N or later ^{*2}	Version 2.17T or later ^{*3}	Version 2.17T or later ^{*4}
GX Configurator-CT	SW0D5C-QCTU-E	Version 1.25AB or later ^{*1}	Version 1.25AB or later ^{*2}	Version 1.25AB or later*3	Version 1.25AB or later ^{*4}
GX Configurator-TI	SW1D5C-QTIU-E	Version 1.24AA or later ^{*1}	Version 1.24AA or later ^{*2}	Version 1.24AA or later ^{*3}	Version 1.24AA or later ^{*4}
GX Configurator-TC	SW0D5C-QTCU-E	Version 1.23Z or later ^{*1}	Version 1.23Z or later ^{*2}	Version 1.23Z or later ^{*3}	Version 1.23Z or later ^{*4}
GX Configurator-FL	SW0D5C-QFLU-E	Version 1.23Z or later ^{*1}	Version 1.23Z or later ^{*2}	Version 1.23Z or later ^{*3}	Version 1.23Z or later ^{*4}
GX Configurator-QP	SW2D5C-QD75P-E	Version 2.25B or later	Version 2.29F or later	Version 2.30G or later ^{*5}	Version 2.32J or later
GX Configurator-PT	SW1D5C-QPTU-E	Version 1.23Z or later ^{*1}	Version 1.23Z or later ^{*2}	Version 1.23Z or later ^{*3}	Version 1.23Z or later ^{*4}
GX Configurator-AS	SW1D5C-QASU-E	Version 1.21X or later ^{*1}	Version 1.21X or later ^{*2}	Version 1.21X or later ^{*3}	Version 1.21X or later ^{*4}
GX Configurator-MB	SW1D5C-QMBU-E	Version 1.08J or later ^{*1}	Version 1.08J or later ^{*2}	Version 1.08J or later ^{*3}	Version 1.08J or later ^{*4}
GX Configurator-DN	SW1D5C-QDNU-E	Version 1.23Z or later ^{*1}	Version 1.23Z or later ^{*2}	Version 1.24AA or later ^{*3}	Version 1.24AA or later ^{*4}
GX Configurator-DP ^{*6}	SW7D5C-PROFID-E	Version 7.02C or later ^{*7}	Version 7.03D or later	Version 7.03D or later	Version 7.04E or later
MX Component	SW3D5C-ACT-E	Version 3.09K or later	Version 3.10L or later	Version 3.11M or later	Version 3.12N or later
GX Simulator	SW7D5C-LLT-E	Version 7.23Z or later ^{*4}	Version 7.23Z or later ^{*4}	Version 7.23Z or later ^{*4}	Version 7.23Z or later ^{*4}

*1 The software can be used by installing GX Developer Version 8.48A or later.

*2 The software can be used by installing GX Developer Version 8.62Q or later.

*3 The software can be used by installing GX Developer Version 8.68W or later.

*4 The software can be used by installing GX Developer Version 8.78G or later.

*5 GX Configurator-QP Version 2.29F can be used when connected via USB.

*6 When using the GX Configurator with the Q50UDEH/Q100UDEHCPU, use the Version 7.07H or later.

*7 When using the GX Configurator with the Q02UCPU, use the Version 7.03D or later.

#### (4) Software not supported in the Universal model QCPU

The following table shows software not supported in the Universal model QCPU.

Product	Model
GX Explorer	SWDD5C-EXP-E
GX Converter	SWDD5C-CNVW-E

## Appendix 5.3 Instructions

# Appendix 5.3.1 Instructions not supported in the Universal model QCPU and replacing methods

The Universal model QCPU does not support instructions listed in the following tables. Instructions need to be replaced using replacing methods described in the tables. (If no instruction in the list is used, replacement is not required.)

Symbol	Instruction	Replacing method	Reference	
IX				
IXEND	<ul> <li>Index modification of entire ladder</li> </ul>	Instructions can be replaced using a replacement program.	Page 523, Appendix 5.3.3 (1)	
IXDEV	Modification value specification in Change the program so that the device offset values specified by			
IXSET	index modification of entire ladder	the IXSET instruction are directly set to the index modification table using the MOV instruction.	Page 525, Appendix 5.3.3 (2)	
PR	Print ASCII code instruction	<ul> <li>It is recommended to use GOT as an ASCII code display device. ASCII codes stored in devices are directly displayed as characters on GOT.</li> <li>Instructions can be replaced using a replacement program.</li> </ul>		
PRC	Print comment instruction	<ul> <li>It is recommended to use GOT as an ASCII code display device. Device comments can be displayed on GOT.</li> <li>Comment data can be output to a display device in the replacement program of the PR instruction after reading data using the reading device comment data instruction (COMRD(P)).</li> </ul>	Page 527, Appendix 5.3.3 (3)	
CHKST	Specific format failure check	Instructions can be replaced using a replacement program		
СНК	instruction Instructions can be replaced using a replacement program.		Dega 521 Appendix 5.2.2 (1)	
CHKCIR	Format change instruction for CHK	Failure detection ladder patterns can be changed in a	Page 531, Appendix 5.3.3 (4)	
CHKEND	instruction	replacement program.		
PLOW	Program low-speed execution registration instruction	<ul> <li>Use the PSCAN instruction instead of this instruction when low-speed execution type programs are replaced with scan execution type programs.</li> <li>No instruction can be used if low-speed execution type programs are replaced with fixed scan execution type programs.</li> </ul>		
РСНК	Program execution status check instruction	Check a program execution status on the Program monitor list screen of programming tool. For details, refer to Page 180, Section 3.13.1 in this manual.	t	
KEY	Numerical key input instruction	<ul> <li>It is recommended to use GOT as a numeral input device.</li> <li>Instructions can be replaced using a replacement program.</li> </ul>	Page 534, Appendix 5.3.3 (5)	
PLOADP	Load program from memory card	Store all programs to be executed in the program memory. The		
PUNLOADP	Unload program from memory card Universal model QCPU can neither add programs to t memory nor change them with other programs during			
PSWAPP	Load + Unload	capacity of the program memory is not enough, store parameters, device comments, and initial device values in the program memory into the standard ROM or a memory card instead.		

Symbol	Instruction	Replacing method	
LD TRn			
AND TRn			
OR TRn			
LDI TRn			
ANDI TRn			
ORI TRn	Forced transition check instruction	When the programmable controller type is changed, these instructions are converted into SM1255. Modify programs as needed.	
LD BLm\TRn	Forced transition check instruction		
AND BLm\TRn			
OR BLm\TRn			
LDI BLm\TRn			
ANDI BLm\TRn			
ORI BLm\TRn			
SCHG(D)	Active step change instruction	Refer to Appendix 3 "Restrictions on Basic Model QCPU, Universal Model QCPU, and LCPU and Alternative Methods" in the MELSEC-Q/L/QnA Programming Manual (SFC).	
SET TRn			
SET BLm\TRn	Transition control instruction	Refer to Appendix 3 "Restrictions on Basic Model QCPU, Universal Model QCPU, and LCPU	
RST TRn		and Alternative Methods" in the MELSEC-Q/L/QnA Programming Manual (SFC).	
RST BLm\TRn			
BRSET(S) ^{*1}	Block switching instruction	When the programmable controller type is changed, these instructions are converted into SM1255. Modify programs as needed.	

*1 Usable for the Universal model CPU whose serial number (first five digits) is "13102" or later.

# Appendix 5.3.2 Replacing programs using multiple CPU transmission dedicated instructions

#### (1) Replacing the module with the QnUD(H)CPU or Built-in Ethernet port QCPU

The following table shows instructions need to be replaced and corresponding alternative instructions. For the specifications of each instruction, refer to the manuals for the Motion CPU.

Symbol	Instruction description	Symbol of alternative instruction
S(P).DDWR	Write other CPU device data into host CPU	D(P).DDWR
S(P).DDRD	Read other CPU device data into host CPU	D(P).DDRD
S(P).SFCS	Request of motion SFC program startup	D(P).SFCS
S(P).SVST	Request of servo program startup	D(P).SVST
S(P).CHGA	Current value change of halted axis/synchronized encoder/cam axis	D(P).CHGA
S(P).CHGV	Axis speed change during positioning and JOG operation	D(P).CHGV
S(P).CHGT	Torque control value change during operation and suspension in real mode	D(P).CHGT
S(P).GINT	Request of other CPU interrupt program startup	D(P).GINT

### (2) Replacing the module with the Q00UCPU, Q01UCPU, or Q02UCPU

The Q00UCPU, Q01UCPU, and Q02UCPU support the same multiple CPU transmission dedicated instructions used in the Basic model QCPU.

The alternative instructions in the table in (1) are not available for Q00UCPU, Q01UCPU, and Q02UCPU.

#### Appendix 5.3.3 **Program replacement examples**

This section shows program replacement examples for the instructions of which replacement programs are available in Page 520, Appendix 5.3.1. (Skip this section if instructions listed in Page 520, Appendix 5.3.1 are not used.)

#### (1) Replacement example of the IX and IXEND instructions


Since index registers are saved using the ZPUSH instruction, a 23-word index register save area is required.

#### (a) Example of device assignment

Before replacement		After replacement	
Application	Device	Application	Device
Index modification table	D100 to D115	Index modification table	D100 to D115
		Index register save area	D200 to D222


If the device numbers in the example above are used for other applications, assign unused device numbers instead.

#### (b) Program before replacement

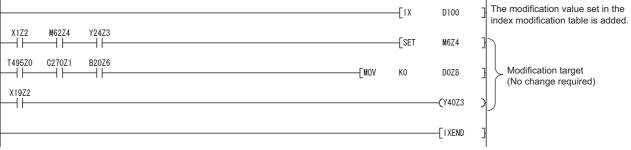

#### (c) Program after replacement

- Replace the IX instruction with the ZPUSH instruction and the processing for setting the contents of index modification table to index registers.
- Replace the IXEND instruction with the ZPOP instruction.

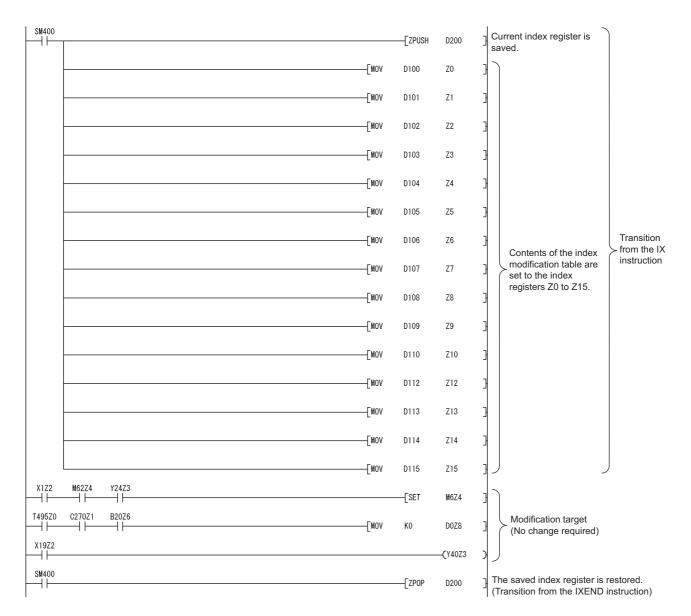

#### (2) Replacement example of the IXDEV and IXSET instructions

Change the program so that the device offset value specified by the contacts between the IXDEV and the IXSET instructions are directly set to the index modification table using the MOV instruction.

For the devices whose device offset value is not specified by the IXDEV and IXSET instructions, set the device offset value to 0 in the program after replacement.

The following figure shows how the device offset value is set in the program before and after replacement by the IXDEV and IXSET instructions.

Device offset	specification	Inde	ex modification table
Timer		<b>}</b>	. (D)+0
Counter		<b>}</b> ───►	. (D)+1
Input ^{*1}	x□ ⊣⊢	▶	. (D)+2
Output ^{*1}		}►	. (D)+3
Internal relay		<b>}</b> ───►	. (D)+4
Latch relay		}►	. (D)+5
Edge relay		<b>}</b> ─── <b>→</b>	. (D)+6
Link relay ^{*1}	B□ ⊣⊢	}►	. (D)+7
Data register	DD.XX 	<b>}</b> ─── <b>→</b>	. (D)+8
Link register ^{*1}	w⊡.xx ⊣⊢	<b>}</b> ─── <b>→</b>	. (D)+9
File register	R⊡.XX ⊣⊢	┣───→	. (D)+10
Intelligent function	U□\G□.XX	Start I/O number	. (D)+11
module device ^{*2}		Buffer memory address	(D)+12
Link direct device*3	JO\BO 	┣───►	. (D)+13
File register (through number)	ZR⊡.XX ⊣⊢	] <b>&gt;</b>	. (D)+14
Pointer		] <b>&gt;</b>	. (D)+15

*1 Device numbers are represented in hexadecimal. Use hexadecimal constants (HD) when setting values in the index modification table.

*2 Start I/O numbers (UD) are represented in hexadecimal. Use hexadecimal constants (HD) when setting values in the index modification table.


*3 Devices B, W, X, or Y can be specified following J□\. Set device numbers for B, W, X, and Y as device offset values of each device in the index modification table. For example, if "J10\Y220" is specified by the IXDEV and IXSET instructions, set "K10" in (D)+13 and "H220" in (D)+3 in the replacement program. ((D) indicates the start device in the index modification table.)

#### (a) Program before replacement



#### (b) Program after replacement

The device offset values for input (X), output (Y), internal relay (M), ≻data register (D), link register (W), and pointer (P) are set to the index modification table starting from D0.

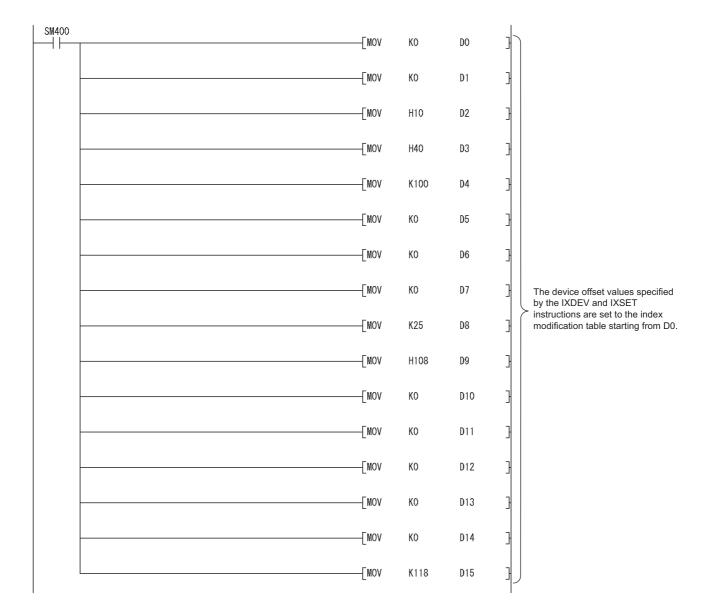

#### (3) Replacement example of the PR instruction

The number of output characters can be switched by the on/off status of SM701.


#### (a) Example of device assignment

Before replacement		
Application	Device	
Output string	D0 to D3	
ASCII code output signal	Y100 to Y107	
Strobe signal	Y108	
In-execution flag	Y109	

After replacement		
Application	Device	
Output string	D0 to D3	
ASCII code output signal	Y100 to Y107	
Strobe signal	Y108	
In-execution flag	Y109	
Output string storage address (BIN32)	D20 to D21	
Output string storage address (BIN32) (Used for sub-routine programs and interrupt programs)	D200 to D201	
Number of output characters	D202	
Output module start Y number	D203	
Character extraction position	D204	
Number of extracted characters	D205	
String output status value	D206	
Result of string extraction by the MIDR instruction	D207	
String output in-execution flag	M200	
For index modification	Z0	


If the device numbers in the example above are used for other applications, assign unused device numbers instead.

#### (b) Program before replacement



#### (c) Program after replacement

In the sequence program after replacement, three programs are required as shown below.

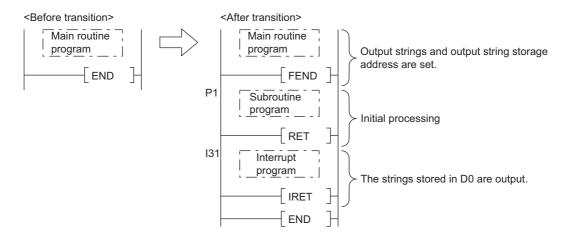

#### **1.** Main routine program


- Replace the PR instruction with the CALL instruction so that a subroutine program is called.
- Output string storage device ("D0" in the program below) cannot be specified directly with the CALL instruction. Use the ADRSET instruction to acquire the indirect address for the CALL instruction.
- Y device ("Y100" in the program before replacement shown in (b)) cannot be specified directly as output Y number with the CALL instruction. Specify the output Y number in integer.
- An interrupt program is used to output character codes via the output module. Enable the execution of interrupt programs using the EI instruction.

MO Y109	[\$MOVABCDEFGHIJKLMNOPQRSTUVWXYZDO	E
	[ADRSET DO D20	] The strings stored in D0 and
	[CALLP P1 D20 H100	later are output from Y100 to Y108.
	[EI	An execution of interrupt program is enabled.
	[FEND	E

#### **2.** Subroutine program


P1

- In the subroutine program, the data for outputting ASCII codes using a fixed scan interrupt program (10ms) are set to work devices. Also, the flag for activating the processing in the fixed scan interrupt program is turned on.
- · Specify the following arguments for the subroutine program.

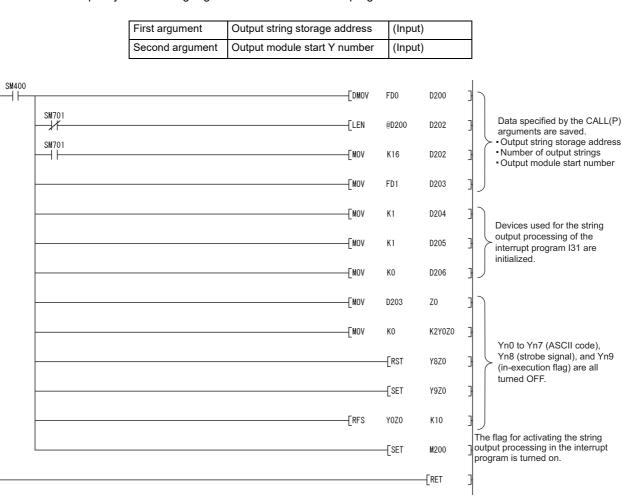

#### 3. Interrupt program

The following processing is added to a fixed scan interrupt program (10ms). The fixed scan interrupt program outputs ASCII codes from the output module and controls the strobe signal.

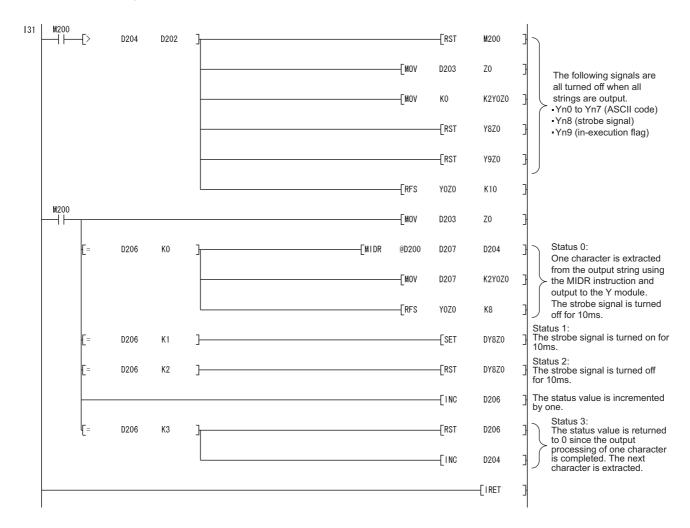

#### (4) Replacement example of the CHKST and CHK instructions

In the example below, if the replacement program for the CHKST and CHK instructions detects a failure, a failure number (contact number + coil number) is stored in D200 and the annunciator F200 is turned on.

#### (a) Example of device assignment

Before replacement		
Application	Device	
Advance end detection sensor input 1	X100	
Retract end detection sensor input 1	X101	
Advance end detection sensor input 2	X102	
Retract end detection sensor input 2	X103	
Advance end detection sensor input 3	X104	
Retract end detection sensor input 3	X105	
Advance end detection sensor input 4	X106	
Retract end detection sensor input 4	X107	
Failure detection output 1	Y100	
Failure detection output 2	Y102	
Failure detection output 3	Y104	
Failure detection output 4	Y106	

After replacement		
Application	Device	
Advance end detection sensor input 1	X100	
Retract end detection sensor input 1	X101	
Advance end detection sensor input 2	X102	
Retract end detection sensor input 2	X103	
Advance end detection sensor input 3	X104	
Retract end detection sensor input 3	X105	
Advance end detection sensor input 4	X106	
Retract end detection sensor input 4	X107	
Failure detection output 1	Y100	
Failure detection output 2	Y102	
Failure detection output 3	Y104	
Failure detection output 4	Y106	
Coil number (failure type detected)	D100	
Contact number	D101	
Failure number	D200	
Failure detection display	F200	
For index modification	Z0	

If the device numbers in the example above are used for other applications, assign unused device numbers instead.

When the advance end detection sensor input performs a failure detection of Xn, assign device numbers for the retract end detection sensor input and the failure detection output as described below.


Advance end detection sensor input	Xn
Retract end detection sensor input	Xn+1
Failure detection output	Yn

#### (b) Program before replacement

				Ссн	kst ]
X100	X102 ──┤	X104 ──┤	X106	Ссн	к ]


#### (c) Program after replacement

In the sequence program after replacement, two programs are required as shown below.

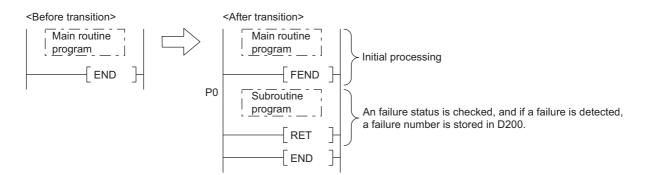


#### **1.** Main routine program

- Replace the CHKST and CHK instructions with the CALL instructions so that a subroutine program is called.
- One CALL instruction is required for each device specified as check condition in front of the CHK instruction. (In the program before replacement shown in (b), four CALL instructions need to be added since there are four check conditions in front of the CHK instruction.)
- Device number and contact number of X devices (check condition) are specified in each CALL instruction.
- Contact number is used to display failure number when a failure is detected.

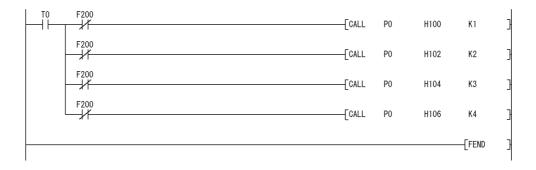

#### **2.** Subroutine program

- In the subroutine program, a failure status is checked using a failure detection ladder pattern.
- If a failure is detected, a failure number is stored in D200 and the annunciator F200 is turned on.
- Specify the following arguments for the subroutine program.



P0	SM400							 	—[MOV	FD0	ZO	]	
										[RST	D100	3	
	xozo	X1Z0	Yozo						[MOV	<b>K</b> 1	D100	]	
	xozo	X1Z0	YOZO	[=	D100	KO	}		[MOV	K2	D100	3	
	xozo	Yozo ──┤ ├─	[=	D100	КО	]			—[MOV	КЗ	D100	]	<pre><failure detection="" target=""> If a failure is detected, the additional additactional additional additional additional additional a</failure></pre>
	Yozo →/f	X1Z0 ──┤	-[=	D100	KO	]			[MOV	K4	D100	3	coil number corresponding to the failure type is set to D100.
	Yozo ──	X1Z0	-[=	D100	KO	]			—[MOV	K5	D100	]	D100.
	Yozo	xozo	-[=	D100	KO	]			[MOV	K6	D100	] .	
l	[<>	D100	KO	}				 	—[MOV	FD1	D101	3 -	If a failure is detected, a
									—[SFL	D101	K4	3	failure number is created by combining the coil
								 [wor	D100	D101	D200	]	number corresponding to the failure type and the contact number.
										[SET	F200	3	The annunciator is turned on.
											[RET	3	

## (d) Replacement method when failure detection ladder patterns are changed by the CHKCIR and CHKEND instructions

Failure detection ladder patterns can be changed in the subroutine program described in (c).

#### (5) Replacement example of the KEY instruction

#### (a) Example of device assignment

Before replacement				
Application	Device			
Numeric input execution instruction	МО			
Input complete flag	M1			
Input data area	D200 to D203			
ASCII code input signal	X100 to X107			
Strobe signal	X108			

After replacement						
Application	Device					
Numeric input execution instruction	мо					
Input complete flag	M1					
Input data area	D200 to D203					
ASCII code input signal	X100 to X107					
Strobe signal	X108					
Input data area address (BIN32)	D210 to D211					
(Input data area + 0) address (BIN32)	D212 to D213					
(Input data area + 1) address (BIN32)	D214 to D215					
(Input data area + 2) address (BIN32)	D216 to D217					
For shifting input data	D218					
For converting input data	D219 to D220					


If the device numbers in the example above are used for other applications, assign unused device numbers instead.

#### (b) Program before replacement



#### (c) Program after replacement

In the sequence program after replacement, two programs are required as shown below.

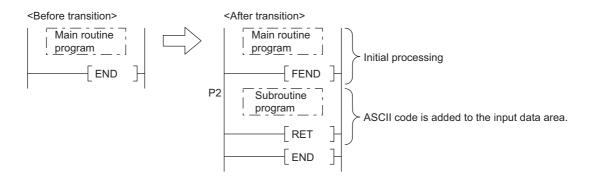

#### 1. Main routing program


- Set "0" in the input data area on the rising edge of the execution instruction ("M0" in the program below) and initialize the program.
- Execute the CALL instruction on every rising edge of the strobe signal ("X108" in the program below) so that a subroutine program is called.
- In the subroutine program, input codes are added to the input data area and the completion status is checked.
- Pass the following data to the subroutine program at execution of the CALL instruction.
  - 1) ASCII code input values from the input module (Xn0 to Xn7)
    - 2) Number of digits to be input
    - 3) Indirect address of the input data area (Use the ADRSET instruction to acquire the indirect address for the input data area.)
    - 4) Bit devices to be turned on when input is completed

M0					[ADRSETF	P D200	D210	
					—[MOVP	KO	D200	The input data area is initialized.
					[DMOVP	KO	D201	
	X108 	[CALL	P2	K2X100	K8	D210	M1	A subroutine program is called at the rising edge of the strobe signal.
							[FEND	Э

#### **2.** Subroutine program

- In the subroutine program, ASCII codes specified by an argument are added to the input data area and the completion status is checked.
- Specify the following arguments for the subroutine program.

First argument	ASCII code input from the input module (K2Xn)	(Input)
Second argument	Number of digits to be input	(Input)
Third argument	Indirect address of the input data area	(Input)
Fourth argument	Bit device to be turned on when input is completed	(Output)

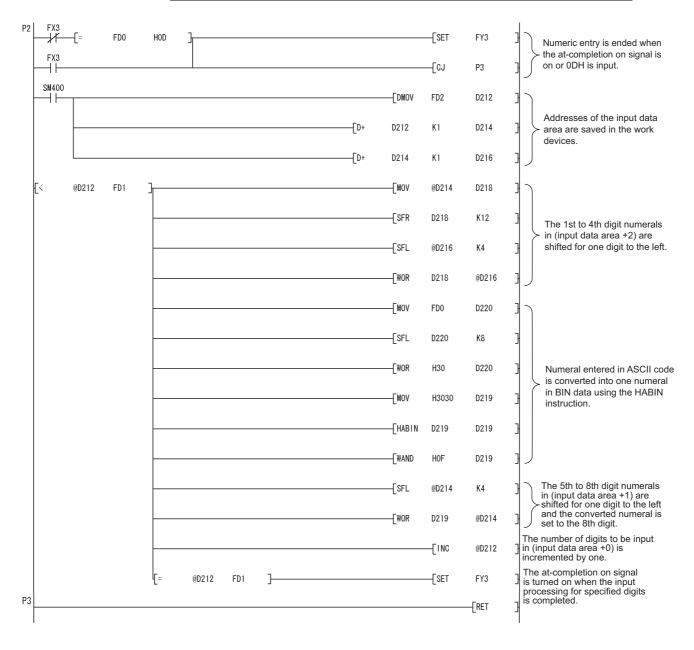

## Appendix 5.4 Functions

## Appendix 5.4.1 Floating-point operation instructions

## (1) Differences between High Performance model QCPU and Universal model QCPU

#### (a) High Performance model QCPU

The High Performance model QCPU can perform only the single-precision floating-point operation instructions. Note, however, that internal operation processing can be performed in double precision by selecting the item shown below (default: selected).

Selected by default. ——	Timer Link Setting:         Low Speed       100         High Speed       10.0         RUH-PAUSE Contacts       RUH-PAUSE Contacts         RUH-PAUSE Contacts       (00-XIFFF)         PAUSE X       (00-XIFFF) </th <th>Common Pointer No. P       After (0-4095)         Points Occupied by Empty Sist (*1)       16       Points         System Interrupt Settings       Interrupt Occupied Start No. C       (0-768)         Toterupt Occupied Start No. C       (0-768)       Interrupt Occupied Start No. C         129       0.00 ms (0.5ms-1000ms)       130       0.00 ms (0.5ms-1000ms)         131       10.0 ms (0.5ms-1000ms)       High Speed Interrupt Settings         Interrupt Program / Fixed Scan Program Setting       Interrupt Setting         AFLC Compatibility Setting       Interrupt Setting         Vis section Havy / Speed Indexter from SN(5D 1000       Service Processing Setting         Service Processing Setting       System Section         Improved       Specify service process the scan         Specify service process the scan       System Section         Specify service process the scan       System Section         Specify service process the scan       Times (1-10 Times)         Specify service process the scan section for constart scan scan scan scan scan scan scan scan</th>	Common Pointer No. P       After (0-4095)         Points Occupied by Empty Sist (*1)       16       Points         System Interrupt Settings       Interrupt Occupied Start No. C       (0-768)         Toterupt Occupied Start No. C       (0-768)       Interrupt Occupied Start No. C         129       0.00 ms (0.5ms-1000ms)       130       0.00 ms (0.5ms-1000ms)         131       10.0 ms (0.5ms-1000ms)       High Speed Interrupt Settings         Interrupt Program / Fixed Scan Program Setting       Interrupt Setting         AFLC Compatibility Setting       Interrupt Setting         Vis section Havy / Speed Indexter from SN(5D 1000       Service Processing Setting         Service Processing Setting       System Section         Improved       Specify service process the scan         Specify service process the scan       System Section         Specify service process the scan       System Section         Specify service process the scan       Times (1-10 Times)         Specify service process the scan section for constart scan scan scan scan scan scan scan scan
	(*1)Setting should be set as same when using multiple CPU.	PIC Module Change Setting

#### (b) Universal model QCPU

The Universal model QCPU supports the double-precision floating-point operation instructions. The operation can be performed either in single precision or double precision depending on the data. Therefore, the "Perform internal arithmetic operations in double precision" item in the PLC system tab of the PLC parameter dialog box cannot be selected.

Because of this new function, operation results (both in single precision and double precision) slightly differ between the High Performance model QCPU and the Universal model QCPU if "Perform internal arithmetic operations in double precision" is selected in the High Performance model QCPU.

If higher accuracy is required in floating-point operations, replace the floating-point operation instructions as described in Page 540, Appendix 5.4.1 (4). However, if six or less digits are used as significant digits for the floating-point operation instructions, replacement is not necessary. The single-precision floating-point operation results in the Universal model QCPU can be used as they are in the system. When not replacing the instructions, ensure that it does not cause any problems in the system.

#### (2) Floating-point operation instructions for the Universal model QCPU

The following table lists floating-point operation instructions for the Universal model QCPU. Specifications of the single-precision floating-point operation instructions are compatible with those for the High Performance model QCPU.

		Instructi	Instruction symbol			
lı	nstruction name	Single-precision floating-point data	Double-precision floating-point data	Remarks		
				□ indicates one of		
Comparison	Floating-point data comparison			the following;		
		ORE	ORED	<>,=,<,>,<=,>=.		
Data transfer	Floating-point data transfer	EMOV(P)	EDMOV(P)			
	Floating-point data addition	E+(P)	ED+(P)			
Four arithmetic	Floating-point data subtraction	E-(P)	ED-(P)	_		
operation	Floating-point data multiplication	E*(P)	ED*(P)			
	Floating-point data division	E/(P)	ED/(P)			
	Conversion from BIN 16-bit data to floating-point data	FLT(P)	FLTD(P)			
	Conversion from BIN 32-bit data to floating-point data	DFLT(P)	DFLTD(P)			
Data conversion	Conversion from floating-point data to BIN 16-bit data	INT(P)	INTD(P)			
	Conversion from floating-point data to BIN 32-bit data	DINT(P)	DINTD(P)			
	Floating-point sign inversion	ENEG(P)	EDNEG(P)			
	SIN operation	SIN(P)	SIND(P)			
	COS operation	COS(P)	COSD(P)			
	TAN operation	TAN(P)	TAND(P)			
	SIN-1 operation	ASIN(P)	ASIND(P)			
	COS-1 operation	ACOS(P)	ACOSD(P)			
Special function	TAN-1 operation	ATAN(P)	ATAND(P)			
	Conversion from angle to radian	RAD(P)	RADD(P)			
	Conversion from radian to angle	DEG(P)	DEGD(P)			
	Square root	SQR(P)	SQRD(P)			
	Exponential operation	EXP(P)	EXPD(P)			
	Natural logarithm operation	LOG(P)	LOGD(P)	1		

Floating-point data can be converted mutually between single precision and double precision using instructions in the following table.

Instruction name	Instruction symbol
Single precision to double precision conversion	ECON(P)
Double precision to single precision conversion	EDCON(P)

# (3) Advantages and disadvantages when using the double-precision floating-point data of the Universal model QCPU

The following table shows the advantages and disadvantages when executing the double-precision floating-point operation instructions in the Universal model QCPU.

If higher accuracy is required in floating-point operations, it is recommended to replace the instructions with the double-precision floating-point operation instructions.

Advantage	Disadvantage
The results are more accurate than those of the single-precision floating-point operation instructions.	The instruction processing speed is slower than that of the single- precision floating-point operation instructions. ^{*1} Double-precision floating-operation data use twice as many word device points as single-precision floating-operation data.

*1 The processing speed of the double-precision floating-point operation instructions in the Universal model QCPU is higher than that of floating-point operation instructions using internal double-precision operations in the High Performance model QCPU.

The following table lists the comparison between single-precision and double precision floating-point data.

	tem	Single-precision floating-point data	Double-precision floating-point data
Word point required for data	retention	2 words	4 words
Setting range		$-2^{128} < N \le -2^{-126}, 0,$ $2^{-126} \le N < 2^{128}$	$\begin{aligned} -2^{1024} < & N \le -2^{-1022},  0, \\ 2^{-1022} \le & N \le 2^{1024} \end{aligned}$
	Mantissa	23 bits	52 bits
Precision (number of bits)	Exponent	8 bits	11 bits
	Sign	1 bit	1 bit
Instruction processing speed (Q04UDHCPU/ Q06UDHCPU) (minimum)	Data comparison (Conductive status) (LDE>= / LDED>=)	0.0285µs	3.6µs
	Data transfer (EMOV/EDMOV)	0.019µs	1.7µs
	Addition (3 devices) (E+ / ED+)	0.0665µs	4.8µs
	SIN operation (SIN/SIND)	4.1µs	8.5µs
	Data comparison (Conductive status) (LDE>= / LDED>=)	0.0098µs	1.8µs
Instruction processing speed (High-speed Universal model QCPU) (minimum)	Data transfer (EMOV/EDMOV)	0.0039µs	0.0078µs
	Addition (3 devices) (E+ / ED+)	0.015µs	1.9µs
	SIN operation (SIN/SIND)	1.6µs	2.6µs

### (4) Replacing the High Performance model QCPU with the Universal model QCPU

(a) Replacing all single-precision floating-point operation instructions with doubleprecision floating-point operation instructions

Single-precision floating-point data occupy two points of word device per data. On the other hand, four points are required per double-precision floating-point data. Therefore, all device numbers for storing floating-point data need to be reassigned.


- **Ex.** Replacing the floating-point operation [A × B + C] (Changing all floating-point data into double precision.)
  - Device assignment

Before replacement				After replacen	nent
Application	Device	Data type	Application	Device	Data type
Data A	D0 to D1		Data A	D0 to D3	
Data B	D2 to D3	Floating-point data	Data B	D4 to D7	Floating-point data
Data C	D4 to D5	(single precision)	Data C	D8 to D11	(double precision)
Result	D6 to D7		Result	D12 to D15	

Program before replacement



• Program after replacement



# (b) Replacing a part of floating-point operation instructions with double-precision floating-point operation instructions

Only operations that require high accuracy are replaced with double-precision floating-point operation instructions.

Using the ECON and EDCON instructions, convert floating-point data mutually between single precision and double-precision. The flow of a replacement program is as follows:

- Data required for operations are converted from single precision to double precision using the ECON instruction.
- Operations are performed in double precision using the double-precision floating-point operation instructions.
- Operation results are converted from double precision to single precision using the EDCON instruction.

A program example that floating-point data are converted mutually between single precision and double precision before and after operations is shown below.

**Ex.** Replacing the floating-point operation [A × B + C] (Using the ECON and EDCON instructions)

· Device assignment


Before replacement					
Application	Device	Data type			
Data A	D0 to D1				
Data B	D2 to D3	Floating-point data			
Data C	D4 to D5	(single precision)			
Result	D6 to D7				

				nent				
ре	Αμ	oplicat	tion	Device		Data type		
	Data	a A		D0 to D1				
data	Data	a B		D2 to D3		Floating-point data		
on)	Data	a C		D4 to D5		(single precision)		
	Res	ult		D6 to D7				
	Data	a A		D10 to D	13	]		
	Data	a B		D14 to D	17	Floating-point data		
	Data	a C		D18 to D	21	(double precision)		
	Res	ult	_ [	D22 to D	25			
		[E* [E+	D0 D6	D2 D4	D6 D6	3 J		
	[ECON	DO	D10	Ę	Flactin	a point data ara		
	ECON	D2	D14	] [	≻ convert	g-point data are ted from single precision ble precision.		
	ECON	D4	D18	J				
[ED*	D10	D14	D22	3	Onoret	ion is porformed using		

Program after replacement

· Program before replacement

MO

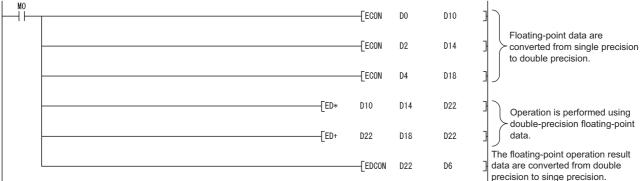

# (c) Replacing a part of floating-point operation instructions with double-precision floating-point operation instructions using subroutine programs

The flow of a replacement program described in (b) can be regarded as one subroutine program. Create a subroutine program for each floating-point operation instruction and then replace the original floatingpoint operation instructions with the CALL(P) instruction so that the corresponding subroutine program is called.

With this method, changes in the program are minimized, but the processing for calling subroutine programs increases the scan time.

In addition, since conversions from double precision to single precision are performed for each instruction, rounding-off errors generated during operations are larger than those in the replacement program described in (b).


**Ex.** Replacing the floating-point operation[A × B + C] (Using a subroutine program)


Before replacement					
Application	Device	Data type			
Data A	D0 to D1				
Data B	D2 to D3	Floating-point data			
Data C	D4 to D5	(single precision)			
Result	D6 to D7				


After replacement					
Application	Device	Data type			
Data A	D0 to D1				
Data B	D2 to D3	Floating-point data			
Data C	D4 to D5	(single precision)			
Result	D6 to D7				
Subroutine input data 1	D900 to D903				
Subroutine input data 2	D904 to D907	Floating-point data (double precision)			
Subroutine operation result	D908 to D911				

#### Device assignment

#### Program before replacement





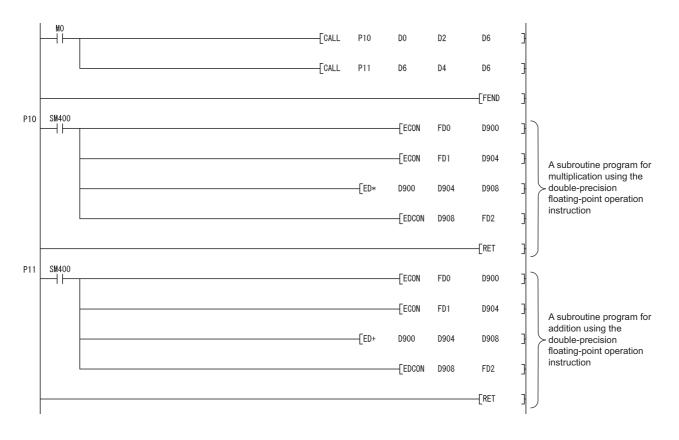

Appendix 5 Replacing Basic Model QCPU or Qn(H)CPU with QnUCPU Appendix 5.4 Functions

Α

### Appendix 5.4.2 Error check processing for floating-point data comparison instructions (excluding High-speed Universal model QCPU)

### (1) Input data check

Error check processing for floating-point data comparison instructions performed in the Universal model QCPU are enhanced. Input of a "special value" (-0, nonnumeric, unnormalized number, or  $\pm \infty$ ) is checked, and if those special values are input, the CPU module detects "OPERATION ERROR" (error code: 4140). When the LDED, ANDED, ORED, LDEDD, ANDEDD, and/or OREDD instructions (D indicates one of the following; =,<>,<,>,<=,>=) are used in the program, "OPERATION ERROR" (error code: 4140) may be detected if invalid floating-point data exist. This occurs even when interlocks are provided using the valid data flags (the signal which shows the floating-point validity).

Invalid floating-point data are not stored in the result of operations performed in the Universal model QCPU. Those invalid data are considered to be stored in the following cases:

- The same device is used for storing floating-point data and other data, such as binary values, BCD values, and strings.
  - $\rightarrow$  Use different devices for storing floating-point data and data other than floating-point data.
- Floating-point data externally written are invalid.
  - $\rightarrow$  Take measures on the external-source side so that valid data are written.

If an error occurs in the floating-point data comparison instructions, take appropriate measures to remove error causes described above.

Ex.1) Detecting "OPERATION ERROR" (error code: 4140) in the LDED instruction

[Ladder mode]

100	M100					EMOV	D90	D100	]	100 101 103 104 105	LD EMOV OUT LD	M100 D90 M101 M101 D100 D100	D100
104	M101	E<=	D100	E10	}			(M101)	ر ک	109 113	LDE<= ORE>= ANB OUT	D100 D100 M102	E10 E200
		[E>=	D100	E200	ŀ								

In the ladder block starting from the step 104, the floating-point data comparison instructions of the step 105 and 109 are not executed when the M101 (valid data flag) is off.


However, the LDE<= instruction of the step 105 and the ORE>= instruction of the step 109 are executed regardless of the execution result of the LD instruction of the step 104 in the program above.

Therefore, even when the M101 is off, "OPERATION ERROR" (error code: 4140) will be detected in the LDE<= instruction of the step 105 if a "special value" is stored in D100.

For the method of avoiding "OPERATION ERROR", refer to Page 546, Appendix 5.4.2 (2).

[List mode]


#### Ex.2) Not detecting "OPERATION ERROR" (error code: 4140) in the ANDED instruction

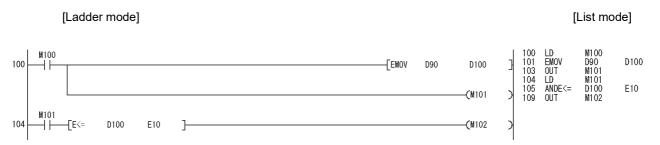

In the ladder block starting from the step 104, the ANDE<= instruction of the step 105 is not executed when the M101 (valid data flag) is off.

The ANDE<= instruction of the step 105 is not executed when the M101 is off in the LD instruction of the step 104 in the program above. Therefore, when the M101 is off, "OPERATION ERROR" (error code: 4140) will not be detected even if a "special value" is stored in D100.

#### Ex.3) Detecting "OPERATION ERROR" (error code: 4140) in the ANDED instruction

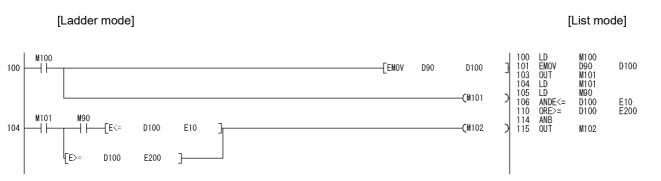

In the ladder block starting from the step 104, the ANDE<= instruction of the step 106 and the ORE>= instruction of the step 110 are not executed when the M101 (valid data flag) is off.


However, if the M90 is on in the LD instruction of the step 105, the ANDE<= instruction of the step 106 is executed. Therefore, even when the M101 is off, "OPERATION ERROR" (error code: 4140) will be detected in the ANDE<= instruction of the step 106 if the M90 is on and a "special value" is stored in D100. For the method of avoiding "OPERATION ERROR", refer to Page 546, Appendix 5.4.2 (2).

# (2) Method of avoiding "OPERATION ERROR" (error code: 4140) in the floating-point data comparison instructions


As shown in the modification examples below, connect the contacts of valid data flag in series for each floatingpoint data comparison instruction. (Use AND connection for connecting the contact of the valid data flag and the floating-point data comparison instruction.)

Ensure that there is no line (OR connection) between the valid data flag and the floating-point data comparison instruction.

<Modification example 1>

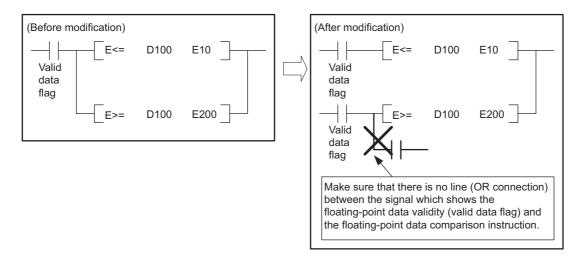


<Modification example 2>

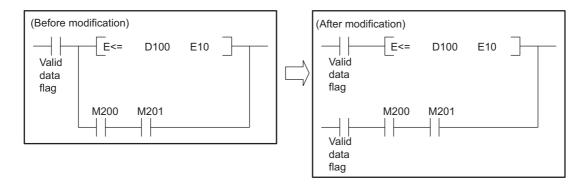


Program examples after modification for Example 1) and 3) in (1) are shown below.



Program after modification for Example 1) ("OPERATION ERROR" (error code: 4140) is no longer detected.)

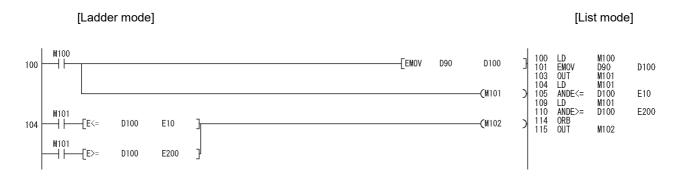

Ex.5) Program after modification for Example 3) ("OPERATION ERROR" (error code: 4140) is no longer detected.)

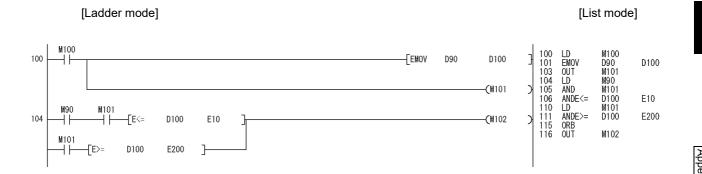

### Appendix 5.4.3 Range check processing for index-modified devices

### (1) Device range check

Error check processing at index modification of devices has been enhanced for the Universal model QCPU. Each index-modified device range is checked, and if the check target device is outside the device range before index modification, the CPU module detects "OPERATION ERROR" (error code: 4101).


Point *P* 

For details on the index-modified device range check, refer to the following.

Ex.1) Detecting "OPERATION ERROR" (error code: 4101) by error check processing at index modification of devices (QnU(D)(H)CPU, QnUDE(H)CPU, LCPU)




In Example 1), when the contact (M0) is on and the value -1 or less is specified in Z1, the device D0Z1 is included in the C device range, exceeding the D device range, as shown in the following figure. As a result, "OPERATION ERROR" (error code: 4101) will be detected.

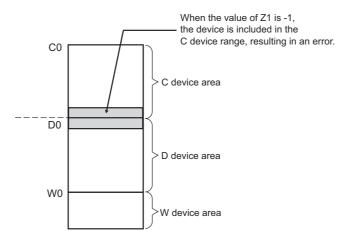

When an error is detected, check the index modification value (value of Z1 in the above example) and remove the error cause.

Examples of the cases where an error is detected and not detected are shown below.

Ex.2) Detecting "OPERATION ERROR" (error code: 4101) (QnU(D)(H)CPU, QnUDE(H)CPU, LCPU)

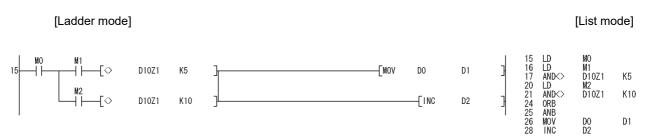

In Example 2, in the ladder block starting from the step 15, the AND<> instruction of the step 17 or 21 is supposed to be not executed when M0 (valid data flag) is off.

However, since the LD instruction which is always executed is used in the step 16 and 20, the AND<> instruction of the step 17 or 21 is executed regardless of the execution status of the LD instruction in the step 15 when M1 or M2 is on.

For this reason, even when M0 is off, if the D10Z1 value is outside the D device range, "OPERATION ERROR" (error code: 4101) will be detected in the AND<> instruction of the step 17.

Note that the step 26 (MOV D0 D1) and the step 28 (INC D2) are not executed. For the actions to be taken to avoid "OPERATION ERROR" (error code: 4101), refer to Page 550, Appendix 5.4.3 (2) 1) to 4).

Ex.3) Detecting "OPERATION ERROR" (error code: 4101) (QnU(D)(H)CPU, QnUDE(H)CPU, LCPU)

-Гмоу D0

In Example 3, even when M0 (valid data flag) in the step 15 is off, the AND instruction in the next step (step 16) will be executed. For this reason, if the X10Z1 value is outside the X device range, "OPERATION ERROR" (error code: 4101) will be detected in the AND instruction of the step 16.

For the actions to be taken to avoid "OPERATION ERROR" (error code: 4101), refer to Page 550, Appendix 5.4.3 (2) 1), 3), and 4).

Ex.4) Not detecting "OPERATION ERROR" (error code: 4101)

[Lado	lor	mod	പ
ILauc	101	mou	디

[List mode]




In Example 4, the AND<> instruction of the step 16 is not executed when M0 (valid data flag) of the step 15 is off. For this reason, "OPERATION ERROR" (error code: 4101) will not be detected no matter what the D10Z1 value is.

### (2) Actions taken to avoid "OPERATION ERROR" (error code: 4101)

If the index-modified device range does not need to be checked, set the parameter as described in 1). If the index-modified device range needs to be checked, but the detection of errors shown in Examples 2 and 3 in Page 548, Appendix 5.4.3 (1) should be avoided, take actions described in 2) to 4).

- 1) Deselect the "Check Device Range at Indexing" item in the PLC RAS tab of the PLC parameter dialog box so that the index-modified device range will not be checked.
- As shown in the following modification example, connect the valid data flag contact in series for each instruction that performs the index-modified device range check processing (except when a Highspeed Universal model QCPU and Universal model Process CPU are used).

<Modification example>

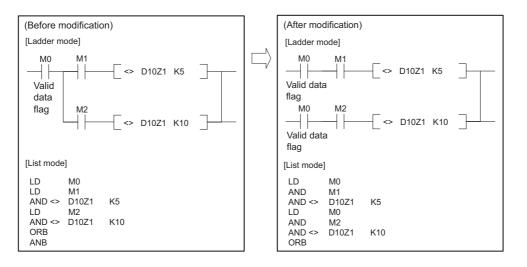

In the program before modification (on the left), the instruction immediately before the AND<> instruction is regarded as the LD instruction. However, in the program after modification (on the right), the same instruction will be regarded as the AND instruction.

In the program after modification, only when both contacts of M0 and M1 (or M2) turn on, the AND<> instruction is executed. As a result, no error will be detected during index-modified device range check processing.

3) Use the index register as a local device.


With a project where multiple programs are executed, to avoid the detection of "OPERATION ERROR" (error code: 4101) both when multiple programs are executed and a particular program alone is executed, use the index register as a local device.

Using the index register as a local device provides an independent index register for each program. Even if another program overwrites the index register with a "value that causes the index-modified device to be outside the device range," it will not affect the value of the index register used in the program where the error occurs with the overwritten value. As a result, "OPERATION ERROR" (error code: 4101) will not be detected.

Note that the scan time increases because the time for saving and restoring the file register file increases. For the local device settings, refer to Page 424, Section 6.2 (3).


Ex. When the index register is used as a local device

Even when program A overwrites the index register Z0 with a value of 30000, no change is made to the index register Z0 used by program B. No error occurs as long as X10Z0 does not exceed the X device range.

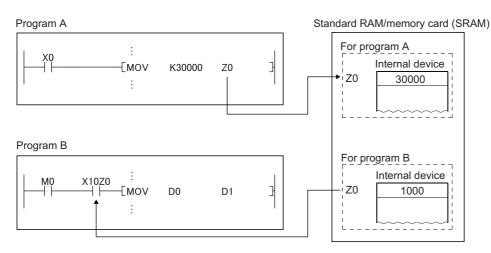

Ex. When the index register is not used as a local device


When program A overwrites the index register Z0 with a value of 30000, the value of the index register Z0 used by program B is also changed. An error occurs when X10Z0 exceeds the X device range.

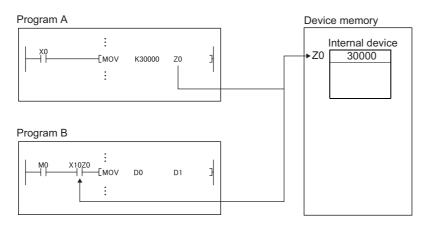

#### 4) Use the CJ instruction.

When the CJ instruction is used as shown below and the previous condition (denoted as "(1) LD M0" in the figure below) is off, avoid the execution of a contact instruction that uses the index register (denoted as "(2) LD X10Z0" in the figure below). When condition (1) is off, instruction (2) is not executed and the value of the device used as a contact is not read. Thus, the device range check processing does not detect "OPERATION ERROR" (error code: 4101).

Note that the use of the CJ instruction increases the scan time.

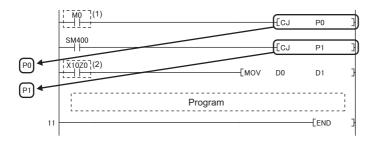

Α

### Appendix 5.4.4 Device latch function

### (1) Overview

The device latch function^{*1} of the Universal model QCPU is more enhanced than than of the Basic model QCPU or High Performance model QCPU.

This section describes the enhanced device latch function of the Universal model QCPU.

*1 The latch function is used to hold device data even when the CPU module is powered off or reset.

### (2) Device data latch methods

Device data of the Universal model QCPU can be latched by:

- using the large-capacity file register^{*1},
- writing/reading device data to/from the standard ROM (with the SP.DEVST and S(P).DEVLD instructions),
- · specifying a latch range of internal user devices, or
- setting intervals ("Time Setting") in the latch interval setting parameter.*2
- *1 The extended data register (D) and extended link register (W) are included.
- *2 Only the High-speed Universal model QCPU and Universal model Process CPU support the setting.

### (3) Details of each latch method

#### (a) Large-capacity file register

Data in the file register can be latched by batteries.*1

File register size is larger and processing speed is higher in the Universal model QCPU, compared to the Basic model QCPU and High Performance model QCPU.

To latch a lot of data (many device points), use of the file register is effective. For the file register size in each CPU module, refer to Page 393, Section 4.7.2 (1).

*1 The latch range can be changed in the Device tab of the PLC parameter dialog box. (Setting of a file register: Page 397, Section 4.7.4 (1) (c), Settings of an extended data register (D) and an extended link register (W): 397, Section 4.8 (2) (b))

# (b) Writing/reading device data to the standard ROM (SP.DEVST and S(P).DEVLD instructions)

Device data of the Universal model QCPU can be latched using the SP.DEVST and S (P).DEVLD instructions (instructions for writing/reading data to/from the standard ROM).

Utilizing the standard ROM allows data backup without batteries.

This method is effective for latching data that will be updated less frequently.

### (c) Specifying the latch range of internal user devices

Device data of the Universal model QCPU can be latched by specifying a latch range of internal user devices in the same way as for the Basic model QCPU and High Performance model QCPU. The ranges can be set in the Device tab of the PLC parameter dialog box. Internal user devices that can be latched are as follows:

- Latch relay (L)
- Link relay (B)
- Annunciator (F)
- Edge relay (V)
- Timer (T)
- Retentive timer (ST)
- Counter (C)
- Data register (D)
- Link register (W)

The following devices also can be set when a file register is set to be used in the PLC file.

- File register (R, ZR)
- Extended data register (D)
- Extended link register (W)

Point P

If latch ranges of internal user devices are specified in the Universal model QCPU, the processing time will be added to the scan time in proportion to the device points set to be latched.^{*1} (For example, if 8K points are latched for the latch relay (L), the scan time will be  $28.6\mu$ s.) To shorten the scan time, remove unnecessary latch device points to minimize the latch range.

*1 For file registers (including an extended data register (D) and an extended link register (W)), the scan time is not increased due to latch.

### (4) How to shorten the scan time

When data to be latched are stored in the file register the processing time is shorter than that for latching internal user device.

**Ex.** Reducing the latch points of the data register (D) from 8K points to 2K points, and using the file register (ZR) instead (when the Q06UDHCPU is used)

	Item	Before	After
Latch points of the data register (D	)	8192 (8K) points	2048 (2K) points (6K points are moved to the file register.)
Number of devices in the program	Data register (D) (Latch range)	400	100
Number of devices in the program	File register (ZR) (Standard RAM)	0	300
Additional scan time		0.41ms	0.13ms ^{*1}
Number of steps increased			300 steps

*1 Time indicates the time required additionally when the file register is stored in the standard RAM.

## Point P

The High-speed Universal model QCPU and Universal model Process CPU can choose a latch interval setting between "Each Scan" and "Time Setting" in parameter. When "Time Setting" is selected, latch data processing starts during the first END processing after a preset time has elapsed. Since the latch data processing is performed asynchronous to the sequence program, an increase in scan time is reduced.

Appendix 5 Replacing Basic Model QCPU or Qn(H)CPU with QnUCPU Appendix 5.4 Functions


### Appendix 5.4.5 File usability setting

# (1) Differences between High Performance model QCPU and Universal model QCPU

### (a) High Performance model QCPU

In the High Performance model QCPU, file usability ("Use PLC File Setting" or "Not Used") of the following files can be set for each program on the screen opened by clicking the "File Usability Setting" button on the Program tab of the PLC parameter dialog box.


- File register
- · Initial device value
- Comment
- · Local device

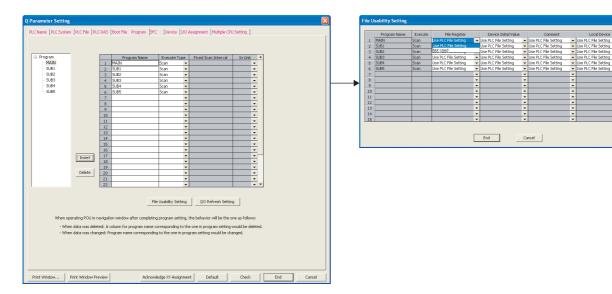

### (b) Universal model QCPU

In the Universal model QCPU, file usability of the following files^{*1} cannot be set for each program on the screen opened by clicking the "File Usability Setting" button on the Program tab of the PLC parameter dialog box.

- File register
- Initial device value
- Comment

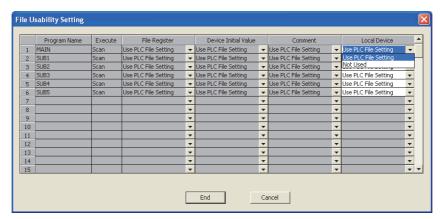

*1 Even file usability of local device file cannot be set if the serial number (first five digits) of the Q02UCPU, Q03UDCPU, Q04UDHCPU, or Q06UDHCPU is "10011" or earlier. If the local device is set to be used in the PLC file tab of the PLC parameter dialog box in the High Performance model QCPU, all the programs use the local device in the Universal model QCPU after replacement.

When the file usability setting is set in the High Performance model QCPU, change the setting as described below.

Α

# (2) Method of replacing High Performance model QCPU with Universal model QCPU

Replacement method varies depending on the settings in the PLC file tab of the PLC parameter dialog box.

"Not Used" is selected.	No change in parameter settings is required. Oper regardless of the file usability setting in the High Po When file usability is set to "Not Used" in the High corresponding program file (file register, initial dev as the program, from the target memory. The Univ using a program file if no program file that uses the	erformance model QCPU. Performance model QCPU, delete the ice value, or comment), which uses the same name
	corresponding program file (file register, initial dev as the program, from th e target memory. The Univ	ice value, or comment), which uses the same name
"Use the same file name as the program" is selected.	memory.     High Performance model QCPU       PLC parameter setting     PLC file setting       File register     Use the same file name as the program. (Target memory: Memory card (RAM))       Program setting     Program name       File     Wall       Use black     Use PLC file setting       SUB1     Not used       SUB2     Not used	
"Use the following file" is selected.	Programs do not use file registers 'SUB1' and 'SUB2' according to the "File usability setting". No change in parameter settings is required. Open regardless of the file usability setting in the High Po	

### Appendix 5.4.6 Parameter-valid drive and boot file setting

# (1) Differences between High Performance model QCPU and Universal model QCPU

#### (a) High Performance model QCPU

The parameter-valid drive is specified by the switches on the front panel of the High Performance model QCPU.

### (b) Universal model QCPU

The Universal model QCPU automatically determines the parameter-valid drive, depending on the existence of parameters in the drive (program memory, memory card, SD memory card, or standard ROM). Therefore, when replacing the High Performance model QCPU with the Universal model QCPU, changing the boot file setting for parameter and/or moving files to another drive may be required.

When replacing the High Performance model QCPU with the Universal model QCPU, change the setting as described below.

### (2) Replacing High Performance model QCPU with Universal model QCPU

# (a) When the parameter-valid drive is set to the standard ROM in the High Performance model QCPU

Setting in High Performance model QCPU	
Setting in the Boot file tab	Setting in Universal model QCPU
of the PLC parameter dialog box	
No boot file setting	<ul> <li>Change the setting so that the Universal model QCPU can refer to the parameters in the standard ROM.</li> <li>Changes in parameter settings are not required.</li> <li>Delete parameters that exist in the program memory, memory card, and/or SD memory card.^{*2}</li> </ul>
Settings in the Boot file tab           Type         Transfer from         Transfer to           Program         Standard ROM         Program memory           (No boot file setting for parameters)	<ul> <li>Change the setting so that programs are stored in the program memory in the first place, instead of booting from the standard ROM.</li> <li>Delete all settings for parameter in the Boot file tab of the PLC parameter dialog box.</li> <li>Delete parameters that exist in the program memory, memory card, and/or SD memory card.^{*2}</li> <li>Move the programs with boot setting into the program memory from the standard ROM.^{*1}</li> </ul>
Settings in the Boot file tab	Change the setting so that programs and parameters are stored in the program memory in the first place, instead of booting from the standard ROM.
Type Transfer from Transfer to	Move the programs and parameters with boot setting into the program
Program Standard ROM Program memory	memory from the standard ROM. ^{*1}
Parameter Standard ROM Program memory	• Delete all settings for parameter in the Boot file tab of the PLC parameter dialog box.

Setting in H	ligh Performa	nce model QCPU		
	ting in the Bo PLC paramete		Setting in Universal model QCPU	
Settings in the Boot file tab Type Transfer from Transfer to Program Memory card Program memory (No boot file setting for parameters)			<ul> <li>Change the setting so that the Universal model QCPU can refer to the parameters in the memory card or SD memory card, and programs are boo from the card to the program memory.</li> <li>Move the parameters in the standard ROM into the memory card or SD memory card.</li> <li>Make setting so that programs are booted from the memory card or SD memory card to the program memory in the Boot file tab of the PLC</li> </ul>	
Settings in the Bo Type Program Parameter	ot file tab Transfer from Memory card Memory card	Transfer to Program memory Program memory	<ul> <li>parameter dialog box.^{*3}</li> <li>Change the setting so that the Universal model QCPU can refer to the parameters in the memory card or SD memory card, and programs and parameters are booted from the card to the program memory.</li> <li>Move the parameters in the standard ROM into the memory card or SD memory card.</li> <li>Make setting so that programs and parameters are booted from the memory card or SD memory card to the program memory in the Boot file tab of the PLC parameter dialog box.^{*3}</li> </ul>	
Settings in the Bo	ot file tab			
Type Data other than program and parameter	Transfer from Memory card	Transfer to Program memory	Delete all settings for data other than programs and parameters in the boot file setting. Since these data can be used even not stored in the program memory, it is not	
Settings in the Bo	ot file tab		necessary to transfer them to the program memory. Or, change the setting so that they are stored in the program memory in the first place.	
Туре	Transfer from	Transfer to	Delete all settings for data other than programs and parameters in the Boot	
Data other than program and parameter	Standard ROM	Program memory	<ul><li>file tab of the PLC parameter dialog box.</li><li>Move the data other than programs and parameters into the program memory as needed.</li></ul>	
device value, devi	ice comment, an	ameter indicate initial id label program.)		

*1 Since the Universal model QCPU holds the data in the program memory even when the battery voltage drops, the boot file setting is not necessary.

*2 The Universal model QCPU searches for parameters in order of in the program memory, in the memory card or SD memory card, and in the standard ROM. Then, the module uses the parameters found first. If parameters exist in the program memory or the card, the Universal model QCPU does not use the parameters in the standard ROM.

*3 The Universal model QCPU ignores the boot file setting for parameters in the standard ROM.

# (b) When the parameter-valid drive is set to the memory card (RAM) or memory card (ROM) in the High Performance model QCPU

Set	ting in the Boo	ot file tab	Setting in Universal model QCPU	
of the PLC parameter dialog box				
No boot file setting			Change the setting so that the Universal model QCPU can refer to the parameters in the memory card or SD memory card. • Changes in parameter settings are not required. • Delete parameters that exist in the program memory. ^{*2}	
ettings in the Bo	oot file tab			
Туре	Transfer from	Transfer to	Change the setting so that the Universal model QCPU can refer to the	
Program	Memory card	Program memory	parameters in the memory card or SD memory card. <ul> <li>Changes in parameter settings are not required.</li> </ul>	
-			• Delete parameters that exist in the program memory. ^{*2}	
ettings in the Bo	ng for parameters	5)		
•		Transforto		
Type	Transfer from	Transfer to	No changes are required.	
Program Parameter	Memory card Memory card	Program memory Program memory		
Falametei	Memory caru	Flogrammemory		
ettings in the Boot file tab			Change the setting so that programs are stored in the program memory in th first place, instead of booting from the standard ROM. • Move the programs targeted for booting from the standard ROM into the	
Туре	Transfer from	Transfer to	program memory.*1	
Program Standard ROM Program memory		Program memory	Delete all settings for program in the Boot file tab of the PLC parameter	
lo boot file setting for parameters)		s)	dialog box.	
			Delete parameters that exist in the program memory.*2	
ettings in the Bo	oot file tab		Change the setting so that programs are stored in the program memory in the first place, instead of booting from the standard ROM.	
Туре	Transfer from	Transfer to	• Move the programs targeted for booting from the standard ROM into the	
Program	Standard ROM	Program memory	program memory. ^{*1}	
Parameter	Memory card	Program memory	Delete all settings for program in the Boot file tab of the PLC parameter	
		· · · · · · · · · · · · · · · · · · ·	dialog box.	
ettings in the Bo	1			
Type Data other than	Transfer from	Transfer to	Delete all settings for data other than programs and parameters in the heat file	
program and	Memory card	Program memory	Delete all settings for data other than programs and parameters in the boot file setting.	
parameter	,	J	Since these data can be used even not stored in the program memory, it is not	
Settings in the Boot file tab			necessary to transfer them to the program memory. Or, change the setting so	
Туре	Transfer from	Transfer to	<ul><li>that they are stored in the program memory in the first place.</li><li>Delete all settings for data other than programs and parameters in the Bool</li></ul>	
Data other than			file tab of the PLC parameter dialog box.	
program and	Standard ROM	Program memory	Move the data other than programs and parameters into the program	
parameter			memory as needed.	

*1 Since the Universal model QCPU holds the data in the program memory even when the battery voltage drops, the boot file setting is not necessary.

*2 The Universal model QCPU searches for parameters in order of in the program memory, in the memory card or SD memory card, and in the standard ROM. Then, the module uses the parameters found first. If parameters exist in the program memory or the card, the Universal model QCPU does not use the parameters in the standard ROM.

### Appendix 5.4.7 External input/output forced on/off function

# (1) Differences between High Performance model QCPU and Universal model QCPU

#### (a) High Performance model QCPU

External input/output can be forcibly turned on/off on the screen opened by selecting [Online]  $\rightarrow$  [Debug]  $\rightarrow$  [Forced Input Output Registration/Cancellation] in programming tool.

#### (b) Universal model QCPU

The external input/output forced on/off function is not supported in the Universal model

#### QCPU. PNote Appx.5

External input/output can be forcibly turned on/off by using the replacement program described below.

# (2) Method of replacing High Performance model QCPU with Universal model QCPU

As shown in below, add programs, "SETX" and "SETY", in the Program tab of the PLC parameter dialog box.

	Program name	Execute type	Fixed scan interval	In unit 📤			Program name	Execute type	Fixed scan interval	In unit 📤
1	MAIN	Scan 🖉 🗸		<b>•</b>		1	SETX	Scan 💌 💌		<b>•</b>
2	SUB	Scan 🖉 👻		-		2	MAIN	Scan 👻 👻		-
3		-		-	$\neg$	3	SUB	Scan 💌 💌		-
4		<b>▼</b>		-		4	SUB	Scan 🖉 👻		-
5		-		-		5		-		-
-	1							r i i i i i i i i i i i i i i i i i i i		

The following table shows the program setting of the "SETX" and "SETY".

Program name	Execution type	Position where program is added
SETX Scan		Start of Program setting (No.1)
SETY Scan		End of Program setting




Before executing this function with the Q02UCPU, Q03UDCPU, Q04UDHCPU, Q06UDHCPU, Q13UDHCPU, or Q26UDHCPU, check the versions of the CPU module and GX Developer used.

( Page 467, Appendix 2)

Ex. Forcibly turning X40, X77, and X7A on, and X41 and Y7B off

The programs, "SETX" and "SETY", turns on or off the X and Y devices, which have been registered for forced on/off using the external input/output forced on/off function, at each scan using the SET and RST instructions.

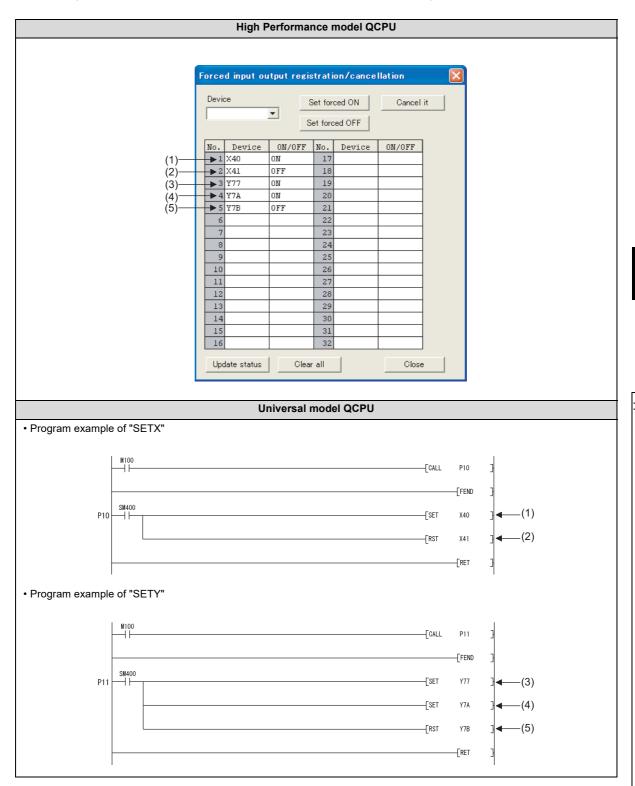


A

Appendix 5 Replacing Basic Model QCPU or Qn(H)CPU with QnUCPU Appendix 5.4 Functions

### (3) Replacing the COM instruction

If the COM instruction is used, add subroutine calls for P10 and P11 before and after the COM instruction. (P10 and P11 are pointers shown in the program examples in (2).) When SM775 is on (Executes refresh set by SD778) and also the 0 bit of SD778 is off (Do not execute I/O refresh), replacement of the instruction is not necessary.

#### (a) Program before replacement

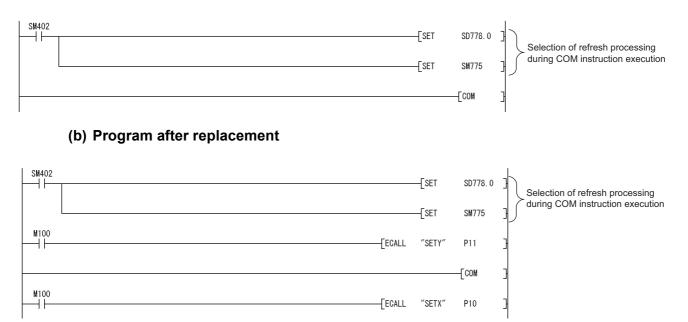

### (4) Replacing the RFS instruction

If any I/O numbers targeted for forced on/off are included in the partial refresh range specified by the RFS instruction, add subroutine calls for P10 and P11 before and after the RFS instruction. (P10 and P11 are pointers shown in the program examples in (2).)

If no I/O number targeted for forced on/off is included, addition of subroutine calls for P10 and P11 is not necessary.

### (a) When partial refresh for input (X) is executed by the RFS instruction

Add a subroutine call that executes forced input after the RFS instruction.

SM400 	[RFS	X40	H10	3
M100	[ECALL	"SETX"	P10	A subroutine call that executes forced input is added.

### (b) When partial refresh for output (Y) is executed by the RFS instruction

Add a subroutine call that executes forced output before the RFS instruction.

	[ECALL	"SETY"	P11	A subroutine call that executes forced output is added.
SM400	[RFS	Y70	H10	3

### (5) Restrictions

Replacements described in (2) to (4) do not apply in the following cases.

- Input and output targeted for forced on/off are referred to or changed using the direct input device (DX) and direct output device (DY).
- Input and output targeted for forced on/off are referred to or changed within an interrupt program.

## Appendix 5.5 Special Relay and Special Register

The Universal model QCPU does not support the use of the special relay and special register described in Page 564, Appendix 5.5.1 and Page 567, Appendix 5.5.2.

Replace them using the method described in the table or delete the corresponding sections.

### Appendix 5.5.1 Special relay list

The following table lists the special relay not supported by the Universal model QCPU and measures to be taken.

Number	er Name/Description		Measures
SM80	CHK detection		The Universal model QCPU does not support the CHK instruction. For the replacing method of the CHK instruction, refer to Page 531, Appendix 5.3.3 (4).
SM91			
SM92			
SM93	-		The Universal model QCPU does not support the step
SM94			transition monitoring timer function. For the replacing
SM95	Step transition mo	onitoring timer start	method of this function, refer to Appendix 3 "Restrictions on Basic Model QCPU, Universal Model
SM96	-		QCPU, and LCPU and Alternative Methods" in the
SM97	-		MELSEC-Q/L/QnA Programming Manual (SFC).
SM98			
SM99			
SM250	Largest mounted	I/O number read	Operation of SD250 is not necessary. The Universal model QCPU always stores the largest mounted I/O number in SD250. Delete the corresponding sections.
SM255		Indicates regular network or standby network.	
SM256	MELSECNET/H module 1	At refresh from link module to CPU, selects whether to read data from the link module.	
SM257	information	At refresh from CPU to link module, selects whether to write data to the link module.	
SM260		Indicates regular network or standby network.	
SM261	MELSECNET/H module 2	At refresh from link module to CPU, selects whether to read data from the link module.	
SM262	information	At refresh from CPU to link module, selects whether to write data to the link module.	These are special relays for the simple dual-structured network function. Since the Universal model QCPU
SM265		Indicates regular network or standby network.	does not support this function, there is no application for these special relays. Delete the corresponding
SM266	MELSECNET/H module 3	At refresh from link module to CPU, selects whether to read data from the link module.	sections.
SM267	information	At refresh from CPU to link module, selects whether to write data to the link module.	
SM270		Indicates regular network or standby network.	1
SM271	MELSECNET/H module 4	At refresh from link module to CPU, selects whether to read data from the link module.	
SM272	information	At refresh from CPU to link module, selects whether to write data to the link module.	
SM280	CC-Link error	1	Replace the relay with the I/O signals (Xn0, Xn1, and XnF) of the mounted CC-Link module.
SM315	Communication re	eserved time delay enable/disable flag	Set a service processing time value in the PLC system tab of the PLC parameter dialog box.

Number	Name/Description	Measures
SM330	Operation mode for low-speed execution type program	The Universal model QCPU does not support low- speed execution type programs. Delete the corresponding sections.
SM331	Normal SFC program execution status	The Universal model QCPU supports only normal SFC
SM332	Program execution management SFC program execution status	programs. Delete SM331 and SM332, which are used as interlocks, or replace them with SM321.
SM390	Access execution flag	Modify the program that Module ready signal (Xn) is used as an interlock, according to sample programs described in the manual for each module.
SM404	ON for only 1 scan after RUN of low-speed execution type programs	The Universal model QCPU does not support low- speed execution type programs. Delete the
SM405	Off for only 1 scan after RUN of low-speed execution type programs	corresponding sections or replace them with the special relays for scan execution type programs (SM402 and SM403).
SM430	User timing clock No.5 (for low-speed execution type programs)	The Universal model QCPU does not support low-
SM431	User timing clock No.6 (for low-speed execution type programs)	speed execution type programs. Delete the
SM432	User timing clock No.7 (for low-speed execution type programs)	corresponding sections or replace them with the special
SM433	User timing clock No.8 (for low-speed execution type programs)	relays for scan execution type programs (SM420 and
SM434	User timing clock No.9 (for low-speed execution type programs)	SM424).
SM510	Low-speed execution type program executing flag	The Universal model QCPU does not support low- speed execution type programs. Delete the corresponding sections.
SM551	Module service interval time read	The Universal model QCPU does not support the service interval measurement function. Delete the corresponding sections.
SM580	Program to program I/O refresh	Perform I/O refresh at the start or end of each program with the RFS or COM instruction.
SM660	Boot operation	Move files with a boot setting (from the standard ROM or a memory card to the program memory) to the program memory.
SM672	Memory card file register access range flag	When outside the range of the file register in the memory card is accessed, the Universal model QCPU detects "OPERATION ERROR" (error code: 4101). Programming for detecting errors using this special relay is not necessary. Delete the corresponding sections.
SM710	CHK instruction priority flag	The Universal model QCPU does not support the CHK instruction. For the replacing method of the CHK instruction, refer to Page 531, Appendix 5.3.3 (4).
SM734	XCALL instruction execution condition specification	The Universal model QCPU executes the XCALL instruction on the rising edge of execution condition as well. There is no application for this special relay. Delete the corresponding sections.
SM735	SFC comment readout instruction in-execution flag	<ul> <li>The Universal model QCPU does not support the following instructions:</li> <li>SFC step comment readout instruction (S(P).SFCSCOMR)</li> <li>SFC transition condition comment readout instruction (S(P).SFCTCOMR)</li> <li>Delete the corresponding sections.</li> </ul>

A

Number	Name/Description	Measures			
SM1780 ^{*1}	Power supply off detection flag	The Universal model QCPU does not store redundant			
SM1781 ^{*1}	Power supply failure detection flag	power supply system information in SM1780 to			
SM1782 ^{*1} Momentary power failure detection flag for power supply 1		SM1783. Delete the corresponding sections. (SM1780			
SM1783 ^{*1}	Momentary power failure detection flag for power supply 2	to SM1783 are always off.)			
	*1 The special relay can be used if the serial number (first five digits) of the Universal model QCPU is "10042" or later.				

The special relay can be used if the serial number (first five digits) of the Universal model QCPU is "10042" or later.

### Appendix 5.5.2 Special register list

The following table lists the special register not supported by the Universal model QCPU and measures to be taken.

Number	Name/Description	Measures
SD80	CHK number	The Universal model QCPU does not support the CHK instruction. For the replacing method of the CHK instruction, refer to Page 531, Appendix 5.3.3 (4).
SD90		
SD91	1	
SD92	1	
SD93	1	The Universal model QCPU does not support the step transition monitoring timer
SD94	Step transition monitoring timer	function. For the replacing method of this function, refer to Appendix 3 "Restrictions
SD95	setting value	on Basic Model QCPU, Universal Model QCPU, and LCPU and Alternative Methods"
SD96		in the MELSEC-Q/L/QnA Programming Manual (SFC).
SD97		
SD98		
SD99		
SD130 to SD137	Fuse blown module	Replace SD130 to SD137 with SD1300 to SD1307.
SD150 to SD157	I/O module verify error	Replace SD150 to SD157 with SD1400 to SD1407.
SD245 SD246	No. of base slots (Mounting status)	Replace SD245 and SD246 with SD243 and SD244, respectively.
SD280 SD281	CC-Link error	Replace these registers with the I/O signals (Xn0, Xn1, and XnF) of the mounted CC- Link module.
SD315	Time reserved for communication processing	Service processing setting is available for the Universal model QCPU on the PLC system setting tab of the PLC parameter dialog box. Select "Specify service process time." for the service processing setting parameter and set the service processing time. Other setting methods can be selected as well.
SD394	CPU mounting information	<ul> <li>Check the type and model of other CPU modules mounted on the System monitor screen of GX Developer.</li> <li>Check the mounting status of other CPU modules in SD396 to SD398.</li> </ul>
SD430	Low-speed scan counter	The Universal model QCPU does not support low-speed execution type programs. Delete the corresponding sections or replace them with the special register for scan execution type programs (SD420).
SD510	Low-speed execution type program number	The Universal model QCPU does not support low-speed execution type programs. Delete the corresponding sections or replace them with the special register for scan execution type programs (SD500).
SD528	Current scan time for low-speed	The Universal model QCPU does not support low-speed execution type programs.
SD529	execution type programs	Delete the corresponding sections or replace them with the special register for scan execution type programs (SD520 and SD521).
SD532	Minimum scan time for low-speed	
SD533	execution type programs	The Universal model QCPU does not support low-speed execution type programs. Delete the corresponding sections or replace them with the special registers for scan
SD534	Maximum scan time for low-speed	execution type programs (SD524 to SD527).
SD535	execution type programs	
SD544	Cumulative execution time for low-	The Universal model QCPU does not support low-speed execution type programs.
SD545	speed execution type programs	Delete the corresponding sections.
SD546 SD547	Execution time for low-speed execution type programs	The Universal model QCPU does not support low-speed execution type programs. Delete the corresponding sections.
-		

Α

Number	Name/Description	Measures		
SD550	Service interval measurement module	The Universal model QCPU does not support the service interval measuremen		
SD551	Service interval time	function. Delete the corresponding sections.		
SD552				
SD720	Program No. specification for PLAODP instruction	The Universal model QCPU does not support the PLAODP instruction. Delete the corresponding sections.		
SD1780 ^{*1}	Power supply off detection status			
SD1781 ^{*1}	Power supply failure detection status	The Universal model QCPU does not store redundant power supply system		
SD1782 ^{*1}	Momentary power failure detection counter for power supply 1	information in SD1780 to SD1783. Delete the corresponding sections. (SD1780 to SD1783 are always off.)		
SD1783 ^{*1}	Momentary power failure detection counter for power supply 1			

# Appendix 6 Precautions for Replacing QnUD(E)(H)CPU with QnUDVCPU/QnUDPVCPU

## Appendix 6.1 Precautions

### (1) System configuration

Item	Precautions	Replacement method	Reference
RS-232 port	There is no RS-232 port. ^{*1}	Use a USB or Ethernet port. To communicate with an RS-232 interface, use the QJ71C24N(-R2) in the system.	
Applicable products and software	<ul> <li>A programming tool that was available for the QnUD(E)(H)CPU can no longer be used or needs to be upgraded. (The use of GX Developer is not supported in the system after replacement.)</li> <li>Some GOTs and intelligent function modules that were available for the QnUD(E)(H)CPU can no longer be used or need to be upgraded.</li> </ul>	<ul> <li>Upgrade the version of GX Works2 to the one compatible with the QnUDVCPU and QnUDPVCPU.</li> <li>Replace the GOT and intelligent function modules with those compatible with the QnUDVCPU and QnUDPVCPU.</li> </ul>	Page 515, Appendix 5.2
Multiple CPU system	Scan time is shortened in the High-speed Universal model QCPU and Universal model Process CPU because operations are performed at higher speed. When used in a multiple CPU system, the High-speed Universal model QCPU and Universal model Process CPU access to the other modules frequently. As a result, the processing time in other CPU modules may increase.	Check the processing timings of other CPU modules and adjust the access frequency of the High-speed Universal model QCPU and Universal model Process CPU using timers or the constant scan function.	QCPU User's Manual (Multiple CPU System)
Current consumption	The current consumption increases.	Select a power supply module according to the total current consumption in the system.	QCPU User's Manual (Hardware Design, Maintenance and Inspection)

*1 This applies when the QnUD(H)CPU is replaced with the High-speed Universal model QCPU.

### (2) Program

ltem	Precautions	Replacement method	Reference	
Number of steps	The number of basic steps differs in some instructions. The number of steps increases by one when: Index modification is performed. ^{*1*2*3} A leading or trailing edge instruction is used. Device numbers equal to or greater than 64K words are used in a file register, extended data register, or extended link register. ^{*4*5} Bit devices are used as word data by specifying digits using K1, K2, K3, K5, K6, or K7, or by specifying a device number of other than multiples of 16.	<ul> <li>If index modifications mentioned on the left are frequently used in the program, the program size may exceed the storage capacity of the replaced CPU module. After the program controller type is changed, check the program size using the confirm memory size function. If the program size exceeds the storage capacity, take the following actions or change the CPU module to that with larger program memory.</li> <li>Move parameters and device comments to the standard ROM.</li> <li>Reduce the reserved area for online change.</li> <li>When a file register, extended data register, or extended link register with device numbers smaller then 64K words is used, there is no increase in the number of steps. Make adjustments so that device numbers smaller then 64K words are used.</li> </ul>		

*1 When device numbers equal to or greater than 64K words are used and index modification is performed, there will be no increase in the number of steps.

*2 When the OUT instruction is used with a timer and counter and index modification is performed, the number of steps will increase by three.

*3 When the following instructions are used and index modification is performed on the destination, the number of steps will increase by two.

Instruction name				
+, - (2 devices)				
D+, D (2 devices)				
E+, E- (2 devices)				
INC, DEC				
DINC, DDDEC				
NEG				
DNEG				
WAND, WOR, WXOR, WXNR (2 devices)				
DAND, DOR, DXOR, DXNR (2 devices)				
BSET, BRST				

*4 Even when index modification is specified and a device number equal to or greater than 64K words is specified, there will be no increase in the number of steps.

*5 When a device number equal to or greater than 64K words is used for the destination, the number of steps will increase by two.

### (3) Parameter size

Item	Precautions	Reference		
Parameter size	The parameter size increases because the built- in Ethernet port setting parameters are added. ^{*1}	<ul> <li>Delete unnecessary files and free some space.</li> <li>Move the parameter file to another memory area.</li> </ul>		

*1 This applies when the QnUD(H)CPU is replaced with the High-speed Universal model QCPU.

### (4) Drive and file

Item	Precautions	Replacement method	Reference		
Boot file setting	A memory card (SRAM card, ATA card, or Flash card) cannot be specified as a transfer source.	Specify an SD memory card as a transfer source.	Page 104, Section 2.11		
Device comment	A device comment file cannot be stored in an SRAM card.	Store the file in the standard RAM.			
Device comment	A device comment file cannot be stored in an ATA card nor Flash card.	Store the file in an SD memory card.			
Initial device value	An initial device value file cannot be stored in an SRAM card.	Store the file in the standard RAM or standard ROM.	Page 247, Section 3.25		
	An initial device value file cannot be stored in an ATA card nor Flash card.	Store the file in an SD memory card.			
Local device	A local device file cannot be stored in an SRAM card.	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the local device file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 422, Section 6.2		
File register	A file register file cannot be stored in an SRAM card.	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the file register file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 393, Section 4.7.1		
	A file register file cannot be stored in a Flash card. (Sequence programs only can read file register data in a Flash card.) ^{*1}	Use the initial device value file in an SD memory card or the FREAD/FWRITE instructions.	Page 247, Section 3.25, MELSEC-Q/L Programming Manual (Common Instruction)		
Sampling trace	A sampling trace file cannot be stored in an SRAM card.	<ul> <li>Store the file in the standard RAM.</li> <li>If the size of the sampling trace file exceeds the standard RAM capacity, consider the use of an extended SRAM cassette.</li> </ul>	Page 184, Section 3.14 (2)		
CPU module change function with memory card	A memory card cannot be specified as a backup destination or restoration source.	Specify an SD memory card as a backup destination or restoration source.	Page 260, Section 3.31		

Α

### (5) Built-in Ethernet port communications^{*1}

Item	Precautions	Replacement method	Reference
File transfer function (FTP server)	The security function has been enhanced from the password registration function to the file password 32 function. For this reason, the keyword-set subcommand, that sets/displays/clears the file access password, is no longer supported.	Use the FTP commands, passwd-rd and passwd-wr, that set/display/clear the read/write passwords of the file password 32 function.	QnUCPU User's Manual (Communication via Built-in Ethernet Port)

*1 This applies when the QnUDE(H)CPU is replaced with the High-speed Universal model QCPU.

### (6) Functions

ltem	Precautions	Replacement method	Reference		
Security function	The security function, that limits accesses to the files in the CPU module, has been enhanced from the password registration function to the file password 32 function.	Use the file password 32 function instead of the password registration function.	Page 207, Section 3.19		
Latch data backup to standard ROM	If an extended SRAM cassette is used and the memory capacity of the standard RAM (drive 3) is larger than that of the standard ROM, data cannot be backed up using this function.	Deselect the "Backup all files in the internal of standard RAM" checkbox in the PLC System tab of the PLC parameter dialog box.	Page 254, Section 3.29 (1)		
Battery life-prolonging function	The battery life-prolonging function is no longer supported. Without the use of the function, the battery life is as same as that of the QnUD(E)(H)CPU.	<ul> <li>The switch setting parameters are ignored and the following operations are performed.</li> <li>Data held by the battery are not cleared nor deleted.</li> <li>The bits, b0 and b1, of SD119 (Battery life- prolonging factor) are fixed to 0.</li> </ul>	Page 250, Section 3.26, QCPU User's Manual (Hardware Design, Maintenance and Inspection)		

# Appendix 7 Precautions for Replacing QnPHCPU with QnUDPVCPU

For the precautions for replacing the QnPHCPU with the QnUDPVCPU, refer to the following.

Technical bulletin: No. FA-A-0155 (Method of replacing Process CPU with Universal model Process CPU)

# Appendix 8 Precautions for Using GX Works2 and Differences with GX Developer

For the precautions for using GX Works2 and differences with GX Developer, refer to the following.

# Appendix 9 Ways to Use Different Types of the Backup/restoration Function

The following table lists the backup/restoration functions. GOT also has the backup/restoration function. Application of each function, executable operating status, and target data are described as follows.

	Executable operating status		status				
Item	Function	Application	Backup		Restoration		Target data
			RUN	STOP	RUN	STOP	
CPU module	CPU module change function with memory card	This function is used when a CPU module is replaced due to a failure or other reasons. The function backs up the data in the CPU module at a failure, and after another CPU module is mounted on, restores the data to the replaced CPU module. The operation of this function is performed while the CPU module is stopped. For the device data, recovery target is only file register files or devices that the latch range is specified. One backup data can be stored.	×	0	×*1	0	<ul> <li>Data in the CPU module</li> <li>Drive 0 (such as programs and parameters)</li> <li>Drive 3 (such as file register files)</li> <li>Drive 4 (such as files for storing device data)</li> <li>Device data (only the latch relay (L) and devices that the latch range is set)</li> </ul>
	CPU module data backup/restoration function	This function is used when the CPU module is created without using a personal computer. The data in the CPU module is backed up periodically, and the data can be restored depending on the circumstance such as recovering from an error state of programs or device data. Note that the data protected by the security functions cannot be backed up or restored. All the device data in the CPU module including file register files that the latch range is specified. Only the device data can be restored. Multiple backup data can be stored.	0	0	×*1	0	<ul> <li>Data in the CPU module</li> <li>Drive 0 (such as programs and parameters)</li> <li>Drive 3 (such as file register files)</li> <li>Drive 4 (such as files for storing device data)</li> <li>Device data (All devices)</li> </ul>
	Data backup/restoration (iQ Sensor Solution)	This function is used when the same device supporting iQ Sensor Solution is created without using a personal computer. The function backs up the setting data such as parameters of the device supporting iQ Sensor Solution, and after a changeover, restores the data to the device supporting iQ Sensor Solution. Therefore, the process of setting change can be simplified.	0	0	0	0	Setting data of the device supporting iQ Sensor Solution on the following networks. • AnyWireASLINK • CC-Link • CC-Link IE Field Network • Ethernet (only when connected by built-in Ethernet)
GOT ^{*2}	Backup/restoration function	This function is used to when the same system is created without using a personal computer. The function backs up setting data, including programs, parameters, and setting values, for a controller connected to the GOT to a Compact Flash card or USB memory in the GOT periodically. The data backed up can be restored the controller. The security function using passwords can be added to the setting information of controllers. The target device data is only file register files. Multiple backup data can be stored.	0	0	0	0	Data in the CPU module connected to GOT • Drive 0 (such as programs and parameters) • Drive 1 (Programmable controller • user data) • Drive 3 (such as file register files) • Drive 4 (such as files for storing device data)

*1 Automatic restoration is operated when the CPU module is powered off and then on or reset.

*2 For details on the backup/restoration function for GOT, refer to the corresponding manuals of GOT.

# Appendix 10 Device Point Assignment Sheet

Deniara	0h.e.l	Numeric	Number of	device points ^{*2}	Restriction check					
Device name	Symbol	notation	Points	Range	Size (words) ^{*3}	Points (bits) ^{*2}				
Input relay ^{*1}	х	Hexadecimal	8K (8192)	X0000 to X1FFF	/16 512	×1 8192				
Output relay ^{*1}	Y	Hexadecimal	8K (8192)	Y0000 to Y1FFF	/16 512	×1 8192				
Internal relay	М	Decimal	К()	M0 to	/16	×1				
Latch relay	L	Decimal	К()	L0 to	/16	×1				
Link relay	В	Hexadecimal	К()	B0000 to	/16	×1				
Annunciator	F	Decimal	К()	F0 to	/16	×1				
Link special relay	SB	Hexadecimal	К()	SB0000 to	/16	×1				
Edge relay	V	Decimal	К()	V0 to	/16	×1				
Step relay ^{*1}	S	Decimal	8K (8192)	S0 to S8191	/16 512	×1 8192				
Timer	т	Decimal	К()	T0 to	$\times \frac{18}{16}$	×2				
Retentive timer	ST	Decimal	K()	ST0 to	$\times \frac{18}{16}$	×2				
Counter	с	Decimal	K()	C0 to	$\times \frac{18}{16}$	×2				
Data register	D	Decimal	К()	D0 to	×1					
Link register	W	Hexadecimal	К()	W0000 to	×1					
Link special register	SW	Hexadecimal	К()	SW0000 to	×1					
Total					(29696 or less)	(65536 or less)				

*1 The points are determined by the system (cannot be changed). The points for the step relay can be changed to 0K for the Universal model QCPU whose serial number (first five digits) is "10042" or later. For the Universal model QCPU whose serial number (first five digits) is "12052" or later, a step relay can be set in increments of 1K point and up to the following points. (F Page 467, Appendix 2)

• Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 8192 points

• Universal model QCPU other than the Q00UJCPU, Q00UCPU, Q01UCPU, and Q02UCPU: 16384 points

*2 Up to 32K points can be set for each device. However, up to 60K points can be set for each device of the internal relay and link relay for the Universal model QCPU whose serial number (first five digits) is "10042" or later.

*3 Enter the values multiplied (or divided) by the number shown in the Size (words) column.

# INDEX

# Α

A5□B
Processing after annunciator off
Automatic backup using SD910       285         Automatic restoration using SD918       293

# В

B (Link relay)
Backup function to memory card
Base mode
Base unit
Base unit assignment setting
Batch-disabling executional conditioned device test
settings
Battery
Battery life
Battery life-prolonging function
BCD (Binary-coded decimal)
BIN (Binary code)
BL (SFC block device)
Boot file
Boot operation
Bootable files
Built-in Ethernet port QCPU
Built-in Ethernet port setting
Built-in memory40

# С

C (Counter)
(Send points expansion function)
CC-Link IE Controller Network setting
CC-Link IE Field Network
CC-Link IE Field Network setting
CC-Link setting
CC-Link system master/local module
Changing clock data
Changing the program execution type
Character string
Checking executional conditioned device test settings
Checking operation
Clearing data in the CPU module74

Clearing data in the latch relay
Clearing the error history data
Clearing the file register data
Clearing the retentive timer value
Clock data
Clock data accuracy
Clock data of 1/1000 sec
Clock function
Common pointer
Communications with intelligent function modules
Constant scan
Constants
Converting a program
Counter (C)
Counting
Resetting the counter
CPU module
CPU module change function with memory card 26
Creating a program
Creating a project
Cyclic transmission area device

# D

D (Data register). Data register (D). Data retention during power failure. Debug function from multiple GX Developers. Decimal constant (K). Detail mode. Device comment. Device comment. Device list Device memory Device point assignment sheet. Device setting Device setting Device value Direct access input . Direct access input (DX)	373 351 189 417 . 52 . 40 336 251 575 447 247 . 80 . 80
Direct access output	
Direct access output (DY)	
Disabling executional conditioned device test setting	
Double-precision floating-point dataDrive No.DUTY instructionDX (Direct access input)DY (Direct access output)	501 . 40 473 . 80

### Ε

Edge relay (V)			•		•		•	 6	1
Clearing errors Error time output mode setting									

Error cause of backup
Error history
Ethernet module
Ethernet setting
Executing a program 32
Execution time measurement 180
Executional conditioned device test
Extended data register (D) 402
Extended link register (W) 402
Extension
Extension base unit
Extension cable
External input/output forced on/off 154

### F

F (Annunciator)
FD (Function register)
File header
File name
File register
Accesses available for the file register
Block switching method
Clearing the file register data
Serial number access method
File size
File structure
File usability setting
Files
Fixed scan execution type program
Flash card
Floating-point data
Forced on/off
Formatting a memory
Function devices (FX, FY, FD)
Function list
FX (Function input)
FY (Function output)

### G

Global device	)
GOT	3
GX Developer	3
GX Works2	3

### Η

H (Hovedonimal constant)
H (Hexadecimal constant)
H/W error time PLC operation mode
H/W error time PLC operation mode setting 142
HEX (Hexadecimal)
Hexadecimal constant (H) 417
High Performance model QCPU 21
High-speed timer (T) 361
High-speed Universal model QCPU

#### I

I/O number	. 55
I/O number assignment	. 55
I/O processing and response delay	. 76
I/O refresh	. 68
I/O refresh time	472
I/O response time	139
Index register (Z)	
Restoring the index register data	390
Saving the index register data	390
Initial execution monitoring time	. 93
Initial execution type program	. 92
Initial processing	. 67
Input (X)	348
Intelligent function module	
Intelligent function module device	384
Interrupt form intelligent function module	232
Intelligent Function Module Setting	439
Internal relay (M)	351
Internal system device	377
Internal user device	345
Interrupt pointer (I)	
Interrupt Pointer Setting	439
Interrupt program	. 82
Interrupt program monitor list	180
Interrupt Program/Fixed Scan Program Setting	440

### J

J (Network No. specification device) 4
----------------------------------------

#### Κ

K (	Decimal	constant)											41	7

### L

L (Latch relay) Ladder Ladder mode Latch Latch data backup to standard ROM function Latch function	107 168 122 254
Latch relay (L)	
LED Methods for turning off the LEDs LED Indication LED indication priority Link direct device Link refresh Link register (W) Link relay (B) Link special register (SW) Link special register (SW) Link special relay (SB) List of interrupt factors Local device Local device monitor	222 223 380 383 374 358 376 359 413 422 151
Local device batch read function	
Low-speed timer (T).	

### Μ

M (Internal relay).		351
---------------------	--	-----

Macro instruction argument device (VD)416
Main base unit
Main routine program
Master control
Maximum counting speed
MC protocol
MELSECNET/H
MELSECNET/H module
MELSECNET/H setting
Memory capacity
Memory card
Memory card (RAM)40
Memory card (ROM)
Memory check function
Memory composition
Module access devices
Module error collection
Module model name read
Module refresh time
Module service interval
Momentary power failure
Monitor
Monitor condition setting
Monitor execution condition
Monitor stop condition
Motion CPU
Multiple CPU high speed main base unit
Multiple CPU high speed transmission area setting
Multiple CPU settings
Multiple CPU synchronous interrupt
Multiple programs

## Ν

N (Nesting)	7
Nesting	7
Network No. specification device (J)	5
Network parameters45	9

# 0

Online change
Online change (ladder mode)
Online change from multiple GX Developers 192
Operation for stopping boot operation
Output (Y)
Output mode at STOP to RUN
Overflow
Overhead time

## Ρ

P (Pointer)
Parameter setting method
Parameter types
Parameters
Network parameters
PLC
Parameter-valid drive42
Password
Password registration

PAUSE contact
PAUSE status71
PC CPU module
PC RAS (1) setting
PLC file setting
PLC name setting
PLC parameters
PLC system setting
PLC user data
Pointer
Common pointer
Local pointer
Points Occupied by Empty Slot
Power supply module
Priorities
Procedure
Procedure for boot run
Process CPU
Processing time
Program
Program cache memory
Program memory
Program monitor list
Program operation
Programming
Programming language
Programming tool
Progression status of backup and restoration 281
Project
Protection
Password registration
Remote password

## Q

O corico nower cupply module	22
Q series power supply module	
Q3□B	
Q3□DB	. 22
Q3□RB	. 22
Q3□SB	. 22
Q5□B	
Q6 B	
Q6□RB	
QA1S5□B	. 22
QA1S6ADP+A1S5□B/A1S6□B	. 22
QA1S6□B	. 22
QA6ADP+A5□B/A6□B	. 22
QA6 B	22
Qn(H)CPU	
QnPHCPU	
QnU(D)(H)CPU	. 21
QnUD(E)(H)CPU	. 21
QnUD(H)CPU	
QnUDE(H)CPU	
QnUDPVCPU	
QnUDVCPU	. 21

# R

R (File register)	392
Read from PLC	. 44
Reading clock data	129
Real number (E)	418
Redundant power extension base unit	. 22

Redundant power main base unit
Redundant power supply module
Refresh mode
Registering executional conditioned device test 161
Remote I/O stations
Remote latch clear
Remote operation
Remote password 219
Remote PAUSE 134
Remote RESET
Remote RUN/STOP
Response delay
Restoring
RS-232 cable
RUN contact
RUN status
RUN/STOP/RESET switch

### S

S (Step relay) 360
Sampling trace
Sampling trace file
Saving a project
SB (Link special relay) 359
Scan execution type program
Scan time
Scan time measurement
Self-diagnostic function
Serial communication
Serial communication function
Service processing
Service processing setting
SFC block device (BL)
SFC setting
Single-precision floating-point data
Slim type main base unit
Slim type power supply module
Slots
SM (Special relay) 379
Special register (SD) 379
Special relay (SM)
Special value
SRAM card
ST 107
ST (Retentive timer)
Standard device register (Z) 389
Standard RAM
Standard ROM
Stand-by type program
Step relay (S)
STOP status
Structured ladder
Subroutine programs 69
SW (Link special register)
Switch setting
Intelligent function module switch setting 143
Symbolic information 40
System memory
System Monitor
System protection

# т

T (Timer)
Timer (T) Accuracy
Processing
Timer Limit Setting
Timer Limit Setting.       439         Transmission specifications       234

### U

U (I/O No. specification device)	416
Underflow	418
Universal model Process CPU	. 21
Universal model QCPU	. 21

### V

V (Edge relay)	357
VD (Macro instruction argument device) 4	116

### W

W (Link register)	374
Watchdog timer (WDT)	
WDT (Watchdog timer)	193
Writing to the CPU module	
Writing/reading device data to/from standard ROM	
	259

### Χ

### Y

Y (Output)																												350
------------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	-----

# Ζ

Z (Index register)	387
Z (Standard device register)	389
ZR (Serial number access method of file register)	
	399

# REVISIONS

*The manual number is given on the bottom left of the back cover.

Print date	*Manual number	Revision
Dec., 2008	SH(NA)-080807ENG-A	First edition
Mar., 2009	SH(NA)-080807ENG-B	Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "11012" or later         Partial correction         SAFETY PRECAUTIONS, INTRODUCTION, MANUALS, MANUAL PAGE         ORGANIZATION, GENERIC TERMS AND ABBREVIATIONS, Section 1.3, 1.6, 2.2.2, 2.2.3, 2.3, 2.3.3, 2.3.4, 2.4, CHAPTER 3, Section 3.3, CHAPTER 4, Section 4.1.2, 4.2.2, 4.2.3, 5.1.1, 5.1.3, 5.1.6, 5.1.7, 5.1.8, 5.1.10, 6.1, 6.3, 6.4, 6.5, 6.6.1, 6.6.5, 6.11.1, 6.11.3, 6.11.4, 6.12.1, 6.13.3, 6.14, 6.15, 6.15.1, 6.15.2, 6.16, 6.17, 6.18, 6.20, 6.28, 6.30, 7.1.2, 8.2, 8.3, 9.2, 9.2.5, 9.2.11, 9.7.4, 9.11, 9.14.2, 11.5, Appendix 1, Appendix 2, Appendix 3.1, Appendix 3.3.2, Appendix 4         Addition         Appendix 3.4.2
Jul., 2009	SH(NA)-080807ENG-C	Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "11043" or later Partial correction Section 5.1.1, 5.1.5, 5.3.3, 6.1, 6.18, 6.21.2, 6.28, 8.1, 9.2.10, 9.6.1, 10.1.3, 12.2, Appendix 1, Appendix 2, Appendix 3.1.2, Appendix 3.2 Addition Section 6.31, 6.32
Nov., 2009	SH(NA)-080807ENG-D	Partial correction SAFETY PRECAUTIONS, Section 4.2.2, 9.6.1, 9.7.4, Appendix 3.1.1, Appendix 3.1.2 Addition CONDITIONS OF USE FOR THE PRODUCT
Apr., 2010	SH(NA)-080807ENG-E	Revision on the new models and new functions of the Universal model QCPU whose serial number (first 5 digits) is "12012" or later         Model addition         Q50UDEHCPU, Q100UDEHCPU         Partial correction         INTRODUCTION, MANUALS, GENERIC TERMS AND ABBREVIATIONS, Section 1.5, 2.1, 2.2.1, 2.2.3, 2.3.4, 2.4, 3.1, 3.5, 3.7, 3.8, 3.8.1, 3.8.2, 4.2.1, 5.1.1, 5.1.3, 5.3.3, 5.3.4, 6.3, 6.5, 6.6, 6.6.1, 6.6.2, 6.6.3, 6.6.4, 6.9, 6.11.2, 6.11.3, 6.12.2, 6.12.3, 6.13.1, 6.14, 6.15, 6.23, 6.24, 6.26, 6.29, 6.30, 6.30.1, 6.31, 7.1.4, 7.1.5, 8.1, 8.2, 9.1, 9.2, 9.2.1, 9.2.5, 9.2.7, 9.2.8, 9.2.12, 9.2.13, 9.2.14, 9.3.1, 9.4, 9.5.1, 9.6.1, 9.6.2, 9.7, 9.7.2, 9.7.4, 9.8, 9.9, 9.10, 9.12.1, 9.14.2, 10.1.1, 10.1.2, 10.1.3, 11.1, 11.3, 11.4, 11.5, Appendix 1, Appendix 2, Appendix 3.1.1, Appendix 3.1.2, Appendix 3.3.1, Appendix 3.5.1, Appendix 3.5.2, Appendix 4         Addition       Section 6.33
Aug., 2010	SH(NA)-080807ENG-F	Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "12052" or later Partial correction SAFETY PRECAUTIONS, Section 2.1, 2.4.4, 5.1.8, 6.1, 6.30.1, 6.30.2, 8.1, 9.1, 9.2, 9.2.1, 10.1.2, 10.1.3, Appendix 2, Appendix 4 Addition Section 6.34

Print date	*Manual number	Revision
Jan., 2011	SH(NA)-080807ENG-G	Partial correction SAFETY PRECAUTIONS, Section 5.3.3, 6.24.1, 12.1, 12.2, Appendix 2
May, 2011	SH(NA)-080807ENG-H	Partial correction GENERIC TERMS AND ABBREVIATIONS, Section 3.8.1, 3.8.2, 5.1.1, 5.2, 6.1, 6.24.1, 6.27, 9.2.10, 9.11, Appendix 2 Addition Section 6.28 Deletion Chapter 12
Jul., 2011	SH(NA)-080807ENG-I	Revision due to the layout change of the manual
Oct., 2011	SH(NA)-080807ENG-J	Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "13102" or later         Partial correction         TERMS, Section 1.7,2.3.2, 2.7, 2.8, 3.1, 3.3, 3.4, 3.7, 3.10, 3.12.3, 4.2, 4.2.10, 4.6.1, 4.7, 4.7.4, 4.8, 4.11, 5.4, Appendix 2, 3.2, 4.5, 5.1.1, 5.2, 5.3.1, 5.4.4         Addition         Section 2.14
Feb., 2012	SH(NA)-080807ENG-K	Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "14022" or later Partial correction Section 2.1.1, 3.1, 3.11.1, 3.12.3, 3.15.2, 3.27, 3.29, 4.1, 4.2, Appendix 1.1, Appendix 1.2.8, Appendix 1.3.2, Appendix 1.2.11, Appendix 2, Appendix 5.1.2
May, 2012	SH(NA)-080807ENG-L	Motion CPU model addition Revision on the new functions of the Universal model QCPU whose serial number (first 5 digits) is "14042" or later Model addition Q172DCPU-S1, Q173DCPU-S1, Q172DSCPU, Q173DSCPU Partial correction TERMS, Section 2.11, 3.27, Appendix 1.1, 1.3, 1.3.1, 1.3.2, 2, 5.2
Aug., 2012	SH(NA)-080807ENG-M	Revision on the new function of the Universal model QCPU whose serial number (first 5 digits) is "14072" or later Partial correction Section 3.1, Appendix 2, 5.1.2, 5.2
Feb., 2013	SH(NA)-080807ENG-N	Revision on the new models of the Universal model QCPU Model addition Q03UDVCPU, Q04UDVCPU, Q06UDVCPU, Q13UDVCPU, Q26UDVCPU
Sep., 2013	SH(NA)-080807ENG-O	Revision on the new function of the Universal model QCPU whose serial number (first 5 digits) is "15043" or later Partial correction Section 2.7, 3.12.3, Appendix 2, 5.1.2
Jan., 2014	SH(NA)-080807ENG-P	Revision on the new function of the Universal model QCPU whose serial number (first 5 digits) is "15103" or later Partial correction Section 2.1.1, 2.1.3, 3.1, 3.7, 3.8, 3.9, 3.10, Appendix 1.2, 2
Jul., 2014	SH(NA)-080807ENG-Q	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "16043" or later Partial correction TERMS, Section 2.3.2, 2.8, 3.1, Appendix 2, 3.2, 5.4.3, 6.1

Print date	*Manual number	Revision
Mar., 2015	SH(NA)-080807ENG-R	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "17012" or later Model addition NZ1MEM-2GBSD, NZ1MEM-4GBSD, NZ1MEM-8GBSD, NZ1MEM-16GBSD Partial correction MANUALS, TERMS, Section 2.1.1, 2.1.3, 2.3.2, 2.11, 3.1, 3.20.2, 3.29, 3.31.1, 3.31.2, Appendix 2, 3.2, 3.3, 5.1, 5.2, 7.1 Addition Section 3.36
Jun., 2015	SH(NA)-080807ENG-S	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "17052" or later         Partial correction         TERMS, Section 2.1.1, 3.29, Appendix 1.1, 1.2.11, 2, 5.1.1, 5.1.2
Dec., 2015	SH(NA)-080807ENG-T	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "17103" or later Partial correction Section 2.1.1, 2.1.3, 3.1, 3.31, 3.34, Appendix 2 Addition Section 3.32, Appendix 8
Jul., 2016	SH(NA)-080807ENG-U	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "18052" or later Partial correction MANUALS, TERMS, Section 2.5, 3.1, 3.13.3, 3.29, 3.32, 3.32.1, 3.32.2, 4.6.3, 6.2, Appendix 2, 3.2, 5, 5.2
Oct., 2016	SH(NA)-080807ENG-V	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "18072" or later Partial correction Section 2.1.1, 3.1, 3.2, 3.32.2, 3.37, Appendix 2
Jan., 2017	SH(NA)-080807ENG-W	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "18112" or later Partial correction MANUALS, Section 2.4.4, 2.5, 2.8, 2.8.1, 3.1, 3.11.3, 3.19, 3.31.1, 4.2.1, 4.8, Appendix 1.1, 1.2, 2, 3.2
Apr., 2017	SH(NA)-080807ENG-X	Partial correction Section 3.31.1, 3.32
Aug., 2017	SH(NA)-080807ENG-Y	Revision on the new function of the High-speed Universal model QCPU whose serial number (first 5 digits) is "19062" or later Partial correction Section 2.1.1, 2.1.3, 3.1, 3.23, 3.32, Appendix 1.1, 1.2.4, 1.2.8, 2 Addition Section 3.37, 3.38
Dec., 2017	SH(NA)-080807ENG-Z	Partial correction Section 3.6.1, 3.6.2, 3.6.3, 3.6.4, 3.19.2, 3.23, 3.24.1, 3.37.2, Appendix 2

Print date	*Manual number	Revision
Sep., 2018	SH(NA)-080807ENG-AA	Revision on the new function of the High-speed Universal model QCPU and Universal model Process CPU whose serial number (first 5 digits) is "19062" or later Model addition Q04UDPVCPU, Q06UDPVCPU, Q13UDPVCPU, Q26UDPVCPU Partial correction Section 2.8.1, 2.8.2, 2.4, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24, 2.24,
Dec., 2018	SH(NA)-080807ENG-AB	Section 2.8.1, 2.8.2, 3.1, 3.31.1, 3.31.2, Appendix 1.1, 1.2.11, 2           Partial correction           TERMS, Section 2.1.1, 2.1.3, Appendix 2
Apr., 2019	SH(NA)-080807ENG-AC	Partial correction TERMS
Dec., 2022	SH(NA)-080807ENG-AD	Partial correction Section 3.1, 3.38, Appendix 1.1, 1.2.11, 2
Jun., 2024	SH(NA)-080807ENG-AE	Partial correction Section 2.5

Japanese manual version SH-080802-AH

This manual confers no industrial property rights or any rights of any other kind, nor does it confer any patent licenses. Mitsubishi Electric Corporation cannot be held responsible for any problems involving industrial property rights which may occur as a result of using the contents noted in this manual.

# WARRANTY

Please confirm the following product warranty details before using this product.

#### 1. Gratis Warranty Term and Gratis Warranty Range

If any faults or defects (hereinafter "Failure") found to be the responsibility of Mitsubishi occurs during use of the product within the gratis warranty term, the product shall be repaired at no cost via the sales representative or Mitsubishi Service Company.

However, if repairs are required onsite at domestic or overseas location, expenses to send an engineer will be solely at the customer's discretion. Mitsubishi shall not be held responsible for any re-commissioning, maintenance, or testing on-site that involves replacement of the failed module.

#### [Gratis Warranty Term]

The gratis warranty term of the product shall be for one year after the date of purchase or delivery to a designated place. Note that after manufacture and shipment from Mitsubishi, the maximum distribution period shall be six (6) months, and the longest gratis warranty term after manufacturing shall be eighteen (18) months. The gratis warranty term of repair parts shall not exceed the gratis warranty term before repairs.

[Gratis Warranty Range]

- (1) The range shall be limited to normal use within the usage state, usage methods and usage environment, etc., which follow the conditions and precautions, etc., given in the instruction manual, user's manual and caution labels on the product.
- (2) Even within the gratis warranty term, repairs shall be charged for in the following cases.
  - 1. Failure occurring from inappropriate storage or handling, carelessness or negligence by the user. Failure caused by the user's hardware or software design.
  - 2. Failure caused by unapproved modifications, etc., to the product by the user.
  - 3. When the Mitsubishi product is assembled into a user's device, Failure that could have been avoided if functions or structures, judged as necessary in the legal safety measures the user's device is subject to or as necessary by industry standards, had been provided.
  - 4. Failure that could have been avoided if consumable parts (battery, backlight, fuse, etc.) designated in the instruction manual had been correctly serviced or replaced.
  - 5. Failure caused by external irresistible forces such as fires or abnormal voltages, and Failure caused by force majeure such as earthquakes, lightning, wind and water damage.
  - 6. Failure caused by reasons unpredictable by scientific technology standards at time of shipment from Mitsubishi.
  - 7. Any other failure found not to be the responsibility of Mitsubishi or that admitted not to be so by the user.

#### 2. Onerous repair term after discontinuation of production

- (1) Mitsubishi shall accept onerous product repairs for seven (7) years after production of the product is discontinued. Discontinuation of production shall be notified with Mitsubishi Technical Bulletins, etc.
- (2) Product supply (including repair parts) is not available after production is discontinued.

#### 3. Overseas service

Overseas, repairs shall be accepted by Mitsubishi's local overseas FA Center. Note that the repair conditions at each FA Center may differ.

#### 4. Exclusion of loss in opportunity and secondary loss from warranty liability

- Regardless of the gratis warranty term, Mitsubishi shall not be liable for compensation to:
- (1) Damages caused by any cause found not to be the responsibility of Mitsubishi.
- (2) Loss in opportunity, lost profits incurred to the user by Failures of Mitsubishi products.
- (3) Special damages and secondary damages whether foreseeable or not, compensation for accidents, and compensation for damages to products other than Mitsubishi products.
- (4) Replacement by the user, maintenance of on-site equipment, start-up test run and other tasks.

#### 5. Changes in product specifications

The specifications given in the catalogs, manuals or technical documents are subject to change without prior notice.

Microsoft and Windows are either registered trademarks or trademarks of Microsoft Corporation in the United States and/or other countries.

The company names, system names and product names mentioned in this manual are either registered trademarks or trademarks of their respective companies.

In some cases, trademark symbols such as '[™]' or '[®]' are not specified in this manual.

SH(NA)-080807ENG-AE(2406)MEE MODEL: QNUCPU-U-KP-E MODEL CODE: 13JZ27

# MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE : TOKYO BUILDING, 2-7-3 MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN NAGOYA WORKS : 1-14 , YADA-MINAMI 5-CHOME , HIGASHI-KU, NAGOYA , JAPAN

When exported from Japan, this manual does not require application to the Ministry of Economy, Trade and Industry for service transaction permission.

Specifications subject to change without notice.