



Programmable Controller

**MELSEC iQ-R**  
series

MELSEC iQ-R Data Analysis Function Block  
Library Reference (Basic)

---



# CONTENTS

---

<b>CHAPTER 1 OVERVIEW</b>	<b>2</b>
1.1 FB Library List .....	2
1.2 System Configuration Example .....	2
<b>CHAPTER 2 DETAILS OF THE FB LIBRARY</b>	<b>4</b>
2.1 M+DataAnalysis_FFTSpectrum_R .....	4
2.2 M+DataAnalysis_BoundCompareTest_R .....	8
2.3 M+DataAnalysis_Different_R .....	14
2.4 M+DataAnalysis_Integration_R .....	19
<b>INSTRUCTION INDEX</b>	<b>24</b>
REVISIONS .....	26

---

# 1 OVERVIEW

The FB library in this manual is for data analysis.

## 1.1 FB Library List

The following table lists the FB library in this manual.

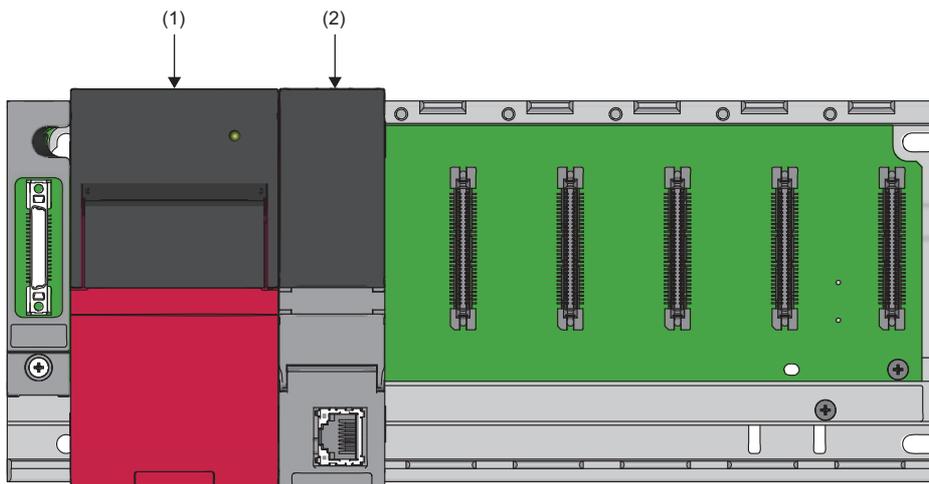
Name	Description
M+DataAnalysis_FFTSpectrum_R	Calculates the FFT spectrum of the specified wave.
M+DataAnalysis_BoundCompareTest_R	Determines if the specified wave is within the specified check value (upper/lower limit value) range.
M+DataAnalysis_Different_R	Calculates the differential operation result of the specified data.
M+DataAnalysis_Integration_R	Calculates the integral operation result of the specified data.

For the FB library, please consult your local Mitsubishi representative.

For how to register the FB library, refer to the GX Works3 Operating Manual.

## 1.2 System Configuration Example

The following figure shows a system configuration example to use the FB library in this manual.



(1) Power supply module

(2) CPU module

For the specifications of the modules, refer to the user's manual for the module used.





## Output labels

No.	Variable name	Name	Data type	Default value	Description
(7)	o_bENO	Execution status	Bit	Off	On: The execution command is on. Off: The execution command is off.
(8)	o_bOK	Normal completion	Bit	Off	The on state indicates that the FFT spectral analysis has been completed.
(9)	o_bErr	Error completion	Bit	Off	The on state indicates that an error has occurred in the FB.
(10)	o_uErrId	Error code	Word [unsigned]	0	The error code of an error occurred in the FB is returned.

## FB details

Item	Description				
Relevant devices	<table border="1"> <tr> <td>CPU module</td> <td>MELSEC iQ-R series</td> </tr> <tr> <td>Engineering tool</td> <td>GX Works3 of version 1.015R or later</td> </tr> </table>	CPU module	MELSEC iQ-R series	Engineering tool	GX Works3 of version 1.015R or later
CPU module	MELSEC iQ-R series				
Engineering tool	GX Works3 of version 1.015R or later				
Language to use	— (The internal program of this FB is not open to the public.)				
Number of steps	16415 steps The number of steps of the FB embedded in a program depends on the CPU module used, the input/output definitions, and the options setting of GX Works3. For the options setting of GX Works3, refer to the GX Works3 Operating Manual.				
FB dependence	No dependence				
Functional description	<p>(1) As i_bEN (execution command) turns on, this FB calculates the spectrum (magnitude of frequency components) with the fast Fourier transform (FFT). Use this FB to calculate the frequency components of the data (wave data) that contains sampled vibration and sound.</p> <p>(2) The analysis target input wave data of the fast Fourier transform (FFT) is read from the file register (ZR) of the address specified by i_udWaveDataAddr (wave data start address). This FB reads input wave data for the number of points set in i_uSamplingPoints (number of sampling points).</p> <p>(3) Input wave data is read as data in the word [signed] format.</p> <p>(4) Analysis results (spectra) are stored in the file register (ZR) of the address specified by i_udSpectrumDataAddr (output spectrum start address). This FB outputs analysis results (spectra) for the number of points set in i_uSamplingPoints (number of sampling points).</p> <p>(5) Analysis results (spectra) are output as data in the word [signed] format. This FB normalizes and outputs the entire analysis results by setting the maximum value of the analysis results to 32767.</p> <p>(6) Frequency resolution of analysis results (spectra) can be calculated with the following formula.</p> $\text{Frequency resolution} = \frac{1}{\text{Sampling cycle for input wave data [sec]} \times \text{Number of sampling points [point]}} \text{ [Hz]}$ <p>■Example When the sampling cycle of the input wave data is 5μs and the number of sampling points is 8192, the frequency resolution is as follows.</p> $\text{Frequency resolution} = \frac{1}{0.000005 \text{ [sec]} \times 8192 \text{ [point]}} \doteq 24.4 \text{ [Hz]}$ <p>(7) The valid components of analysis results (spectra) are the data of Nyquist frequency (sampling frequency/2) and before, and the number of valid points for analysis results (spectra) is the number of sampling points/2.</p> <p>■Example When the sampling cycle of the input wave data is 5μs and the number of sampling points is 8192, the maximum value of valid frequency components and the number of valid points are as follows.</p> <ul style="list-style-type: none"> <li>• Maximum value of valid frequency components: <math>1 \div 0.000005[\text{sec}] \div 2 = 100000[\text{Hz}]</math></li> <li>• Number of valid points: <math>8192 \div 2 = 4096[\text{point}]</math></li> </ul> <p>(8) It takes multiple scans until the fast Fourier transform (FFT) is completed. Thus, do not change the analysis target wave data until the processing is completed. When the fast Fourier transform (FFT) is completed, o_bOK (normal completion) turns on.</p> <p>(9) This FB supports window functions, Not used (do-nothing window), Hanning window, and Hamming window. Set a window function to be used in i_uWindowType (window function).</p> <p>(10)The FB supports output spectrum formats, power, half amplitude, total amplitude, and effective value. Set an output spectrum format to be used in i_uSpectrumFormat (output spectrum format).</p> <p>(11)If a value out of the range is set in i_uSamplingPoints (number of sampling points), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 100H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 7 List of error codes)</p> <p>(12)If a value out of the range is set in i_uWindowType (window function), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 101H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 7 List of error codes)</p> <p>(13)If a value out of the range is set in i_uSpectrumFormat (output spectrum format), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 102H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 7 List of error codes)</p>				

Item	Description	
FB compilation method	Subroutine type	
FB operation	Pulse execution type (multiple scan execution type)	
Timing chart of I/O signals	Normal completion	<p>The timing chart for normal completion shows the following sequence of events: <ul style="list-style-type: none"> <li><b>i_bEN</b>: Starts OFF, then turns ON, which initiates the process.</li> <li><b>o_bENO</b>: Starts OFF, then turns ON shortly after <b>i_bEN</b> turns ON.</li> <li><b>FFT spectrum analysis</b>: The state transitions from "Unexecuted" to "Executing" when <b>i_bEN</b> turns ON, and returns to "Unexecuted" when <b>i_bEN</b> turns OFF.</li> <li><b>o_bOK</b>: Starts OFF, then turns ON at the end of the execution period.</li> <li><b>o_bErr</b>: Remains OFF throughout the process.</li> <li><b>o_uErrId</b>: Remains at 0.</li> </ul> </p>
	Error completion	<p>The timing chart for error completion shows the following sequence of events: <ul style="list-style-type: none"> <li><b>i_bEN</b>: Starts OFF, then turns ON, which initiates the process.</li> <li><b>o_bENO</b>: Starts OFF, then turns ON shortly after <b>i_bEN</b> turns ON.</li> <li><b>FFT spectrum analysis</b>: Remains in the "Unexecuted" state throughout the process.</li> <li><b>o_bOK</b>: Remains OFF throughout the process.</li> <li><b>o_bErr</b>: Starts OFF, then turns ON at the end of the process.</li> <li><b>o_uErrId</b>: Starts at 0, then changes to "Error code" when the process ends, and returns to 0 when <b>i_bEN</b> turns OFF.</li> </ul> </p>
Restrictions and precautions	<p>(1) This FB does not include the error recovery processing. Prepare the error recovery processing separately to suit the user's system and the expected operation.</p> <p>(2) This FB uses the long index register LZ0. When using an interrupt program, do not use the corresponding index register.</p> <p>(3) The FB cannot be used in an interrupt program.</p> <p>(4) Using the FB in a program that is to be executed only once, such as a subroutine program or a FOR-NEXT loop, has a problem that <b>i_bEN</b> (execution command) can no longer be turned off and normal operation is not possible; Always use the FB in a program that is capable of turning off the execution command.</p> <p>(5) The FB requires the configuration of the ladder for every input label.</p> <p>(6) The FB requires label areas of up to the maximum number of sampling points (8192 points) × 3 words for the fast Fourier transform (FFT) operation. Thus, the label area capacity may be insufficient depending on the CPU module used. When the label area capacity is insufficient, refer to the following and extend the capacity.</p> <p> MELSEC iQ-R CPU Module User's Manual (Application)</p>	

## Performance value

The following table lists the performance values of this FB under the following conditions.

- CPU module: R08CPU
- File register storage location: CPU built-in memory
- FB compilation method: Subroutine type

Input label			Time required for the processing <sup>*1</sup>	Maximum scan time	Number of the scans required for the processing
Number of sampling points	Window function	Output spectrum format			
6: 64 points	0: Not used (do-nothing window)	0: Power	1.6ms	0.249ms	9 scans
		1: Half amplitude	1.73ms	0.325ms	
		2: Total amplitude	1.72ms	0.327ms	
		3: Effective value	1.72ms	0.328ms	
	1: Hamming window	0: Power	1.8ms	0.319ms	
		1: Half amplitude	1.9ms	0.32ms	
		2: Total amplitude	1.96ms	0.327ms	
		3: Effective value	1.9ms	0.326ms	
	2: Hanning window	0: Power	1.81ms	0.321ms	
		1: Half amplitude	1.9ms	0.32ms	
		2: Total amplitude	1.93ms	0.32ms	
		3: Effective value	1.91ms	0.319ms	
13: 8192 points	0: Not used (do-nothing window)	0: Power	236ms	12ms	1434 scans
		1: Half amplitude	251ms	24.8ms	
		2: Total amplitude	252ms	25.6ms	
		3: Effective value	252ms	25.6ms	
	1: Hamming window	0: Power	259ms	22.7ms	
		1: Half amplitude	273ms	24.9ms	
		2: Total amplitude	274ms	25.5ms	
		3: Effective value	274ms	25.5ms	
	2: Hanning window	0: Power	260ms	23.7ms	
		1: Half amplitude	274ms	24.8ms	
		2: Total amplitude	275ms	25.5ms	
		3: Effective value	275ms	25.5ms	

\*1 The time required from start to end of the processing

## List of error codes

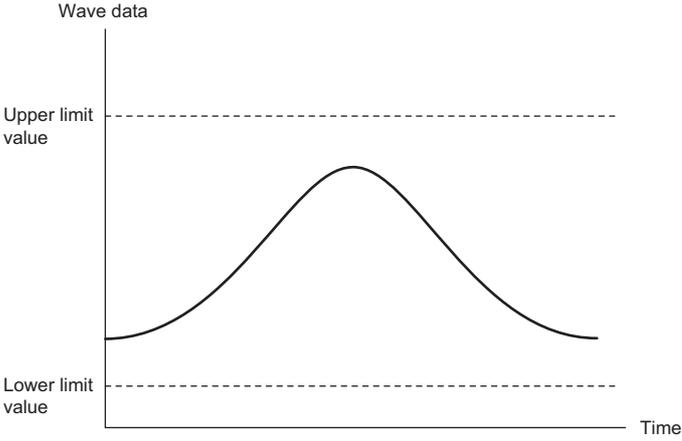
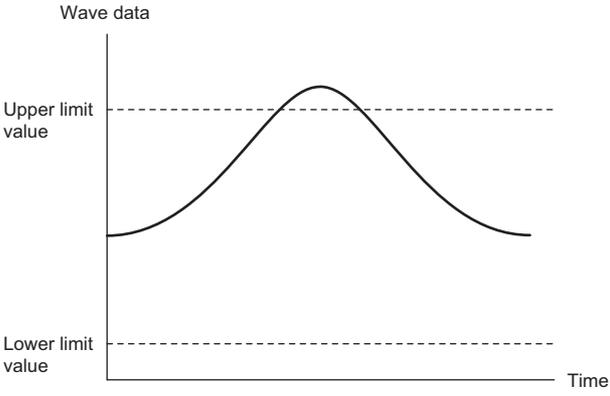
Error code	Description	Action
100H	A value out of the range is set in i_uSamplingPoints (number of sampling points).	Set a value of 6 to 13 in i_uSamplingPoints (number of sampling points). Review and correct the setting and then execute the FB again.
101H	A value out of the range is set in i_uWindowType (window function).	Set a value of 0 to 2 in i_uWindowType (window function). Review and correct the setting and then execute the FB again.
102H	A value out of the range is set in i_uSpectrumFormat (output spectrum format).	Set a value of 0 to 3 in i_uSpectrumFormat (output spectrum format). Review and correct the setting and then execute the FB again.



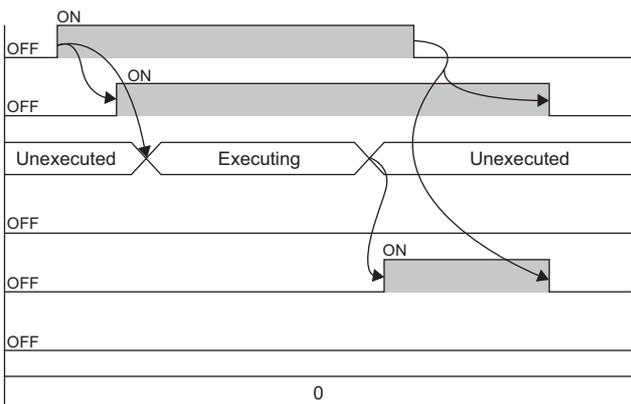
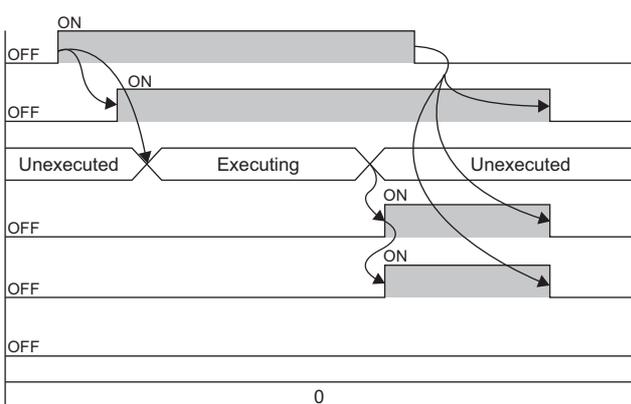
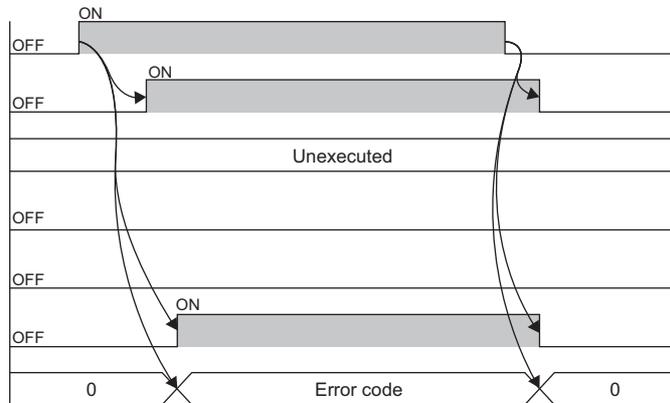
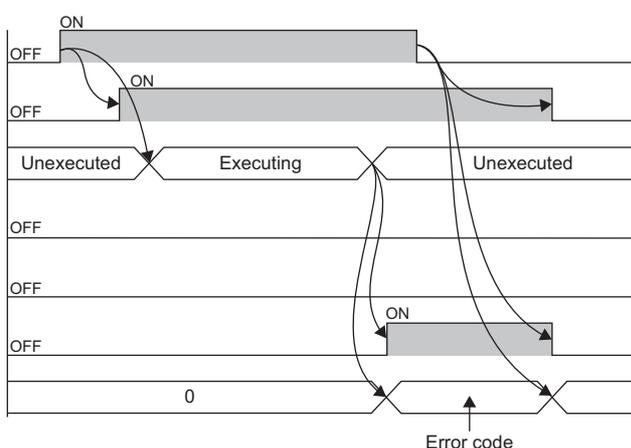
## Output labels

No.	Variable name	Name	Data type	Default value	Description
(9)	o_bENO	Execution status	Bit	Off	On: The execution command is on. Off: The execution command is off.
(10)	o_bOK	Normal completion	Bit	Off	The on state indicates that the upper/lower limit check has been completed.
(11)	o_bResult	Check result	Bit	Off	A check result is stored. Off: Passed On: Failed
(12)	o_bErr	Error completion	Bit	Off	The on state indicates that an error has occurred in the FB.
(13)	o_uErrId	Error code	Word [unsigned]	0	The error code of an error occurred in the FB is returned.

## FB details

Item	Description				
Relevant devices	<table border="1"> <tr> <td>CPU module</td> <td>MELSEC iQ-R series</td> </tr> <tr> <td>Engineering tool</td> <td>GX Works3 of version 1.015R or later</td> </tr> </table>	CPU module	MELSEC iQ-R series	Engineering tool	GX Works3 of version 1.015R or later
CPU module	MELSEC iQ-R series				
Engineering tool	GX Works3 of version 1.015R or later				
Language to use	— (The internal program of this FB is not open to the public.)				
Number of steps	1533 steps The number of steps of the FB embedded in a program depends on the CPU module used, the input/output definitions, and the options setting of GX Works3. For the options setting of GX Works3, refer to the GX Works3 Operating Manual.				
FB dependence	No dependence				
Functional description	<p>(1) As i_bEN (execution command) turns on, whether the specified wave is within the specified check value (upper/lower limit value) range is determined.</p> <ul style="list-style-type: none"> <li>• When the specified wave is within the range, o_bResult (check result) turns off (Passed).</li> </ul>  <ul style="list-style-type: none"> <li>• When the specified wave is out of the range, o_bResult (check result) turns on (Failed).</li> </ul>  <p>(2) The target wave data for upper/lower limit check is read from the file register (ZR) of the address specified by i_udWaveDataAddr (wave data start address). This FB reads wave data for the number of points set in i_udSize (number of data points).</p> <p>(3) Specify Word [signed], Double Word [signed], or Single-precision real number as the data type of wave data and check value in i_uWaveDataType (wave data type selection).</p>				

Item	Description
Functional description	<p>(4) The check values are read from the file register (ZR) of the addresses specified by <code>i_udLowerLimitAddr</code> (check value (lower limit value) address) and <code>i_udUpperLimitAddr</code> (check value (upper limit value) address). Set input labels so that the check values stored in the file register (ZR) of the addresses specified by <code>i_udLowerLimitAddr</code> (check value (lower limit value) address) and <code>i_udUpperLimitAddr</code> (check value (upper limit value) address) satisfy the condition of "check value (lower limit value) <math>\leq</math> check value (upper limit value)".</p> <p>(5) It takes multiple scans until the upper/lower limit check is completed. Thus, do not change the target wave data or check value until the processing is completed. When the upper/lower limit check is completed, <code>o_bOK</code> (normal completion) turns on.</p> <p>(6) For this FB, the number of consecutive points with which values are recognized as having exceeded or fallen below the reference value can be specified. Specify the number of consecutive points in <code>i_udConsecutivePoints</code> (number of consecutive excess points).</p> <p>■Example When 3 is set in <code>i_udConsecutivePoints</code> (number of consecutive excess points), <code>o_bResult</code> (check result) turns off (Passed) since the upper limit value is consecutively exceeded at only two points in the following figure.</p> <div data-bbox="411 566 1145 913" data-label="Figure"> </div> <p>(7) For this FB, the number of significant digits after the decimal point can be specified when 2: Single-precision real number is set in <code>i_uWaveDataType</code> (wave data type selection). Specify the number of significant digits by <code>i_uDecimalPlaces</code> (decimal places). If a value out of the range is set in <code>i_uDecimalPlaces</code> (decimal places), the number of significant decimal places is handled as four places.</p> <p>(8) If a value out of the range is set in <code>i_udSize</code> (number of data points), <code>o_bErr</code> (error completion) turns on and the processing of the FB is interrupted. In addition, 105H is stored in <code>o_uErrId</code> (error code). For the error code, refer to the list of error codes. (☞ Page 13 List of error codes)</p> <p>(9) If a value out of the range is set in <code>i_uWaveDataType</code> (wave data type selection), <code>o_bErr</code> (error completion) turns on and the processing of the FB is interrupted. In addition, 103H is stored in <code>o_uErrId</code> (error code). For the error code, refer to the list of error codes. (☞ Page 13 List of error codes)</p> <p>(10) When a single-precision real number is set in <code>i_uWaveDataType</code> (wave data type selection) and the value stored in the file register (ZR) is not a single-precision real number, <code>o_bErr</code> (error completion) turns on and the processing of the FB is interrupted. In addition, 200H is stored in <code>o_uErrId</code> (error code). For the error code, refer to the list of error codes. (☞ Page 13 List of error codes)</p> <p>(11) When the check values stored in the file register (ZR) of the addresses specified by <code>i_udLowerLimitAddr</code> (check value (lower limit value) address) and <code>i_udUpperLimitAddr</code> (check value (upper limit value) address) satisfy the condition of "check value (lower limit value) <math>&gt;</math> check value (upper limit value)", <code>o_bErr</code> (error completion) turns on and the processing of the FB is interrupted. In addition, 202H is stored in <code>o_uErrId</code> (error code). For the error code, refer to the list of error codes. (☞ Page 13 List of error codes)</p> <p>(12) If a value out of the range is set in <code>i_udConsecutivePoints</code> (number of consecutive excess points), <code>o_bErr</code> (error completion) turns on and the processing of the FB is interrupted. In addition, 108H is stored in <code>o_uErrId</code> (error code). For the error code, refer to the list of error codes. (☞ Page 13 List of error codes)</p>
FB compilation method	Subroutine type
FB operation	Pulse execution type (multiple scan execution type)

Item	Description
Timing chart of I/O signals Normal completion	<ul style="list-style-type: none"> <li>When the specified wave passes the check</li> </ul>  <ul style="list-style-type: none"> <li>When the specified wave fails the check</li> </ul> 
Error completion	<ul style="list-style-type: none"> <li>When an error occurs at startup</li> </ul>  <ul style="list-style-type: none"> <li>When an error occurs at execution</li> </ul> 

Item	Description
Restrictions and precautions	(1) This FB does not include the error recovery processing. Prepare the error recovery processing separately to suit the user's system and the expected operation. (2) This FB uses the long index register LZ0. When using an interrupt program, do not use the corresponding index register. (3) The FB cannot be used in an interrupt program. (4) Using the FB in a program that is to be executed only once, such as a subroutine program or a FOR-NEXT loop, has a problem that i_bEN (execution command) can no longer be turned off and normal operation is not possible; Always use the FB in a program that is capable of turning off the execution command. (5) The FB requires the configuration of the ladder for every input label.

## Performance value

The following table lists the performance values of this FB under the following conditions.

- CPU module: R120CPU
- File register storage location: Extended SRAM cassette
- FB compilation method: Subroutine type

Input label				Time required for the processing <sup>*1</sup>	Maximum scan time	Number of the scans required for the processing
Number of data points	Wave data type selection	Number of consecutive excess points	Number of significant decimal places			
8192: 8192 points	0: Word [signed]	1: 1 point	—	8.62ms	1.13ms	9 scans
		100: 100 points	—	8.72ms	1.17ms	
	1: Double Word [signed]	1: 1 point	—	9.23ms	1.18ms	
		100: 100 points	—	9.15ms	1.14ms	
	2: Single-precision real number	1: 1 point	0: 0 place	111ms	13.6ms	
			6: 6 places	107ms	13.2ms	
		100: 100 points	0: 0 place	109ms	13.4ms	
			6: 6 places	107ms	13.2ms	
32768: 32768 points	0: Word [signed]	1: 1 point	—	41.3ms	1.36ms	33 scans
		100: 100 points	—	40.2ms	1.34ms	
	1: Double Word [signed]	1: 1 point	—	47ms	1.57ms	
		100: 100 points	—	46.9ms	1.54ms	
	2: Single-precision real number	1: 1 point	0: 0 place	442ms	13.6ms	
			6: 6 places	434ms	13.4ms	
		100: 100 points	0: 0 place	441ms	13.6ms	
			6: 6 places	434ms	13.4ms	
1000000: 1000000 points	0: Word [signed]	1: 1 point	—	1230ms	1.31ms	1000 scans
		100: 100 points	—	1230ms	1.32ms	
	1: Double Word [signed]	1: 1 point	—	1430ms	1.53ms	
		100: 100 points	—	1430ms	1.53ms	
	2: Single-precision real number	1: 1 point	0: 0 place	13500ms	13.6ms	
			6: 6 places	13300ms	13.4ms	
		100: 100 points	0: 0 place	13500ms	13.6ms	
			6: 6 places	13300ms	13.4ms	

\*1 The time required from start to end of the processing

## List of error codes

Error code	Description	Action
103H	A value out of the range is set in i_uWaveDataType (wave data type selection).	Set a value of 0 to 2 in i_uWaveDataType (wave data type selection). Review and correct the setting and then execute the FB again.
105H	A value out of the range is set in i_udSize (number of data points).	Set a value of 1 to 1000000 in i_udSize (number of data points). Review and correct the setting and then execute the FB again.
108H	A value out of the range is set in i_udConsecutivePoints (number of consecutive excess points).	Set a value of 1 to 100 in i_udConsecutivePoints (number of consecutive excess points). Review and correct the setting and then execute the FB again.
200H	Although the value set in i_uWaveDataType (wave data type selection) is Single-precision real number, any of the following stored values is not a single-precision real number. <ul style="list-style-type: none"> <li>• Wave data</li> <li>• Check value (lower limit value)</li> <li>• Check value (upper limit value)</li> </ul>	Store the data as a single-precision real number in the file register (ZR). Review and correct the input wave data, check value (lower limit value), and check value (upper limit value), and then execute the FB again.
202H	The check value (lower limit value) is greater than the check value (upper limit value).	Set both the check values so that the check value (lower limit value) is equal to or smaller than the check value (upper limit value). Review and correct the settings and then execute the FB again.

## 2.3 M+DataAnalysis\_Different\_R

### Name

M+DataAnalysis\_Different\_R

### Overview

Item	Description																																				
Functional overview	Calculates the differential operation result of the specified data.																																				
Symbol	<div style="border: 1px solid black; padding: 10px; width: fit-content; margin: 0 auto;"> <p style="text-align: center;">M+DataAnalysis_Different_R</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 10%; vertical-align: top;">(1) —</td> <td style="width: 40%;">B : i_bEN</td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%; text-align: right;">o_bENO : B — (7)</td> </tr> <tr> <td style="vertical-align: top;">(2) —</td> <td>UD : i_udIndex</td> <td></td> <td></td> <td></td> <td style="text-align: right;">o_bOK : B — (8)</td> </tr> <tr> <td style="vertical-align: top;">(3) —</td> <td>UD : i_udSize</td> <td></td> <td></td> <td></td> <td style="text-align: right;">o_bErr : B — (9)</td> </tr> <tr> <td style="vertical-align: top;">(4) —</td> <td>UW : i_uDataType</td> <td></td> <td></td> <td></td> <td style="text-align: right;">o_uErrld : UW — (10)</td> </tr> <tr> <td style="vertical-align: top;">(5) —</td> <td>UD : i_udInputDataAddr</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td style="vertical-align: top;">(6) —</td> <td>UD : i_udDifferentDataAddr</td> <td></td> <td></td> <td></td> <td></td> </tr> </table> </div>	(1) —	B : i_bEN				o_bENO : B — (7)	(2) —	UD : i_udIndex				o_bOK : B — (8)	(3) —	UD : i_udSize				o_bErr : B — (9)	(4) —	UW : i_uDataType				o_uErrld : UW — (10)	(5) —	UD : i_udInputDataAddr					(6) —	UD : i_udDifferentDataAddr				
(1) —	B : i_bEN				o_bENO : B — (7)																																
(2) —	UD : i_udIndex				o_bOK : B — (8)																																
(3) —	UD : i_udSize				o_bErr : B — (9)																																
(4) —	UW : i_uDataType				o_uErrld : UW — (10)																																
(5) —	UD : i_udInputDataAddr																																				
(6) —	UD : i_udDifferentDataAddr																																				

### Labels to use

#### ■ Input labels

No.	Variable name	Name	Data type	Scope	Description
(1)	i_bEN	Execution command	Bit	On or off	On: The FB is activated. Off: The FB is not activated.
(2)	i_udIndex	Comparative data index	Double Word [unsigned]	0 to 89999	Specifies how far one area must be away from the other to calculate the difference of input data in these areas.
(3)	i_udSize	Number of data points	Double Word [unsigned]	1 to 90000	Specifies the number of data points (1 to 90000 points).
(4)	i_uDataType	Input data type selection	Word [unsigned]	0, 2	Specifies the data type of the input data. 0: Word [signed] 2: Single-precision real number
(5)	i_udInputDataAddr	Input data start address	Double Word [unsigned]	Valid device range <sup>*1</sup>	Specifies the start address of the file register (ZR) where the input data is stored.
(6)	i_udDifferentDataAddr	Output data start address	Double Word [unsigned]	Valid device range <sup>*1</sup>	Specifies the start address of the file register (ZR) where the differential operation result is stored. As the operation results are output as single-precision real numbers (2-word), they are stored in file register within the range of "(number of data points - comparative data index) × 2", starting from the file register (ZR) specified with the output data start address.

\*1 The valid range varies depending on "Device/Label Memory Area Setting" of "CPU Parameter".

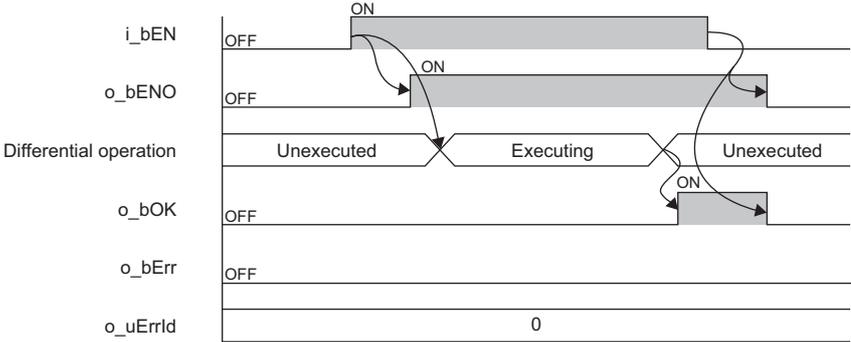
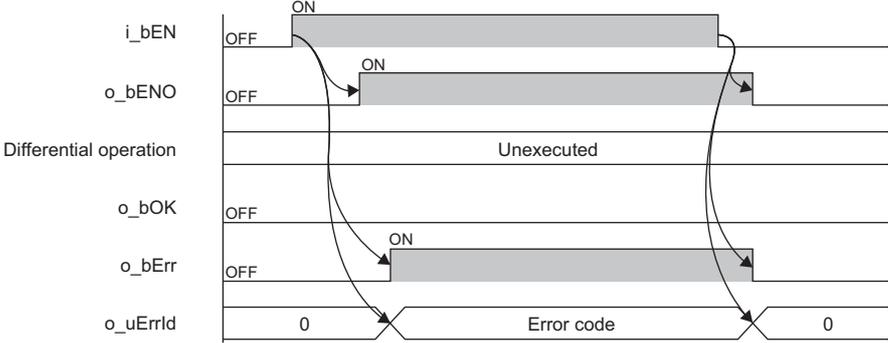
#### ■ Output labels

No.	Variable name	Name	Data type	Default value	Description
(7)	o_bENO	Execution status	Bit	Off	On: The execution command is on. Off: The execution command is off.
(8)	o_bOK	Normal completion	Bit	Off	The on state indicates that the differential operation has been completed.
(9)	o_bErr	Error completion	Bit	Off	The on state indicates that an error has occurred in the FB.
(10)	o_uErrld	Error code	Word [unsigned]	0	The error code of an error occurred in the FB is returned.

## FB details

Item	Description	
Relevant devices	CPU module	MELSEC IQ-R series
	Engineering tool	GX Works3 of version 1.015R or later
Language to use	— (The internal program of this FB is not open to the public.)	
Number of steps	444 steps The number of steps of the FB embedded in a program depends on the CPU module used, the input/output definitions, and the options setting of GX Works3. For the options setting of GX Works3, refer to the GX Works3 Operating Manual.	
FB dependence	No dependence	

Item	Description																																																																													
Functional description	<p>(1) As i_bEN (execution command) turns on, this FB calculates a differential value of the specified input data values. This FB uses data in file register areas for the number of data points starting from the one specified with the input data start address. The FB calculates the difference between input data values in two areas, one of which is away from the other by the number specified with the comparative data index. And then the FB stores the result in file register areas in order starting from the output data start address.</p> <p>This FB calculates the differential value with the following formula.</p> $\text{Differential (i)} = X_{(i+d)} - X_i$ <p>"X<sub>i</sub>" stands for i-th input data and "d" for a value of the comparative data index.</p> <p>■Example</p> <p>The following figure shows an operation example of when values of each input label are as follows.</p> <ul style="list-style-type: none"> <li>• i_udIndex (comparative data index): 3</li> <li>• i_udSize (number of data points): 10</li> <li>• i_udInputDataAddr (input data start address): 0</li> <li>• i_udDifferentDataAddr (output data start address): 20</li> </ul> <table border="1"> <thead> <tr> <th>No.</th> <th colspan="2">Input data</th> <th>No.</th> <th colspan="2">Output data</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>ZR0 (input data start address)</td> <td>945</td> <td>1</td> <td>ZR20 (output data start address)</td> <td>66</td> <td>Difference between No.4 and No.1</td> </tr> <tr> <td>2</td> <td>ZR1</td> <td>948</td> <td>2</td> <td>ZR22</td> <td>87</td> <td>Difference between No.5 and No.2</td> </tr> <tr> <td>3</td> <td>ZR2</td> <td>978</td> <td>3</td> <td>ZR24</td> <td>211</td> <td>Difference between No.6 and No.3</td> </tr> <tr> <td>4</td> <td>ZR3</td> <td>1011</td> <td>4</td> <td>ZR26</td> <td>252</td> <td>Difference between No.7 and No.4</td> </tr> <tr> <td>5</td> <td>ZR4</td> <td>1035</td> <td>5</td> <td>ZR28</td> <td>269</td> <td>Difference between No.8 and No.5</td> </tr> <tr> <td>6</td> <td>ZR5</td> <td>1189</td> <td>6</td> <td>ZR30</td> <td>212</td> <td>Difference between No.9 and No.6</td> </tr> <tr> <td>7</td> <td>ZR6</td> <td>1263</td> <td>7</td> <td>ZR32</td> <td>321</td> <td>Difference between No.10 and No.7</td> </tr> <tr> <td>8</td> <td>ZR7</td> <td>1304</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>9</td> <td>ZR8</td> <td>1401</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>10</td> <td>ZR9</td> <td>1584</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> <p>As the operation results are output as single-precision real numbers (2-word), they are stored in file register areas within the range of "(i_udSize (number of data points) - i_udIndex (comparative data index)) × 2", starting from the file register area (ZR) specified with i_udDifferentDataAddr (output data start address).</p> <p>(2) Input data targeted for differential operation is read from file register (ZR), starting from the area of the address specified with i_udInputDataAddr (input data start address), for the number of data points specified with i_udSize (number of data points).</p> <p>(3) The operation result is output as a single-precision real number, and it is stored in file register in the range of "(i_udSize (number of data points) - i_udIndex (comparative data index)) × 2", starting from the file register area (ZR) of the address specified with i_udDifferentDataAddr (output data start address).</p> <p>(4) It takes multiple scans until the differential operation is completed. Thus, do not change the input data values used for the operation until the processing is completed. When the operation is completed, o_bOK (normal completion) turns on.</p> <p>(5) If a value out of the range is set in i_udSize (number of data points), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 105H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p> <p>(6) If a value of i_udIndex (comparative data index) is equal to or larger than that of i_udSize (number of data points), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 116H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p> <p>(7) If a value out of the range is set in i_uDataType (input data type selection), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 103H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p> <p>(8) If an overflow occurs during the differential operation, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 203H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p> <p>(9) If i_bEN (execution command) is turned off before o_bOK (normal completion) or o_bErr (error completion) turns on, o_bErr (error completion) turns on in one scan. In addition, 205H is stored in o_uErrId (error code) in one scan. For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p> <p>(10) When a single-precision real number is set in i_uDataType (input data type selection) and the value stored in the file register (ZR) is not a single-precision real number, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 200H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 18 List of error codes)</p>	No.	Input data		No.	Output data		Operation	1	ZR0 (input data start address)	945	1	ZR20 (output data start address)	66	Difference between No.4 and No.1	2	ZR1	948	2	ZR22	87	Difference between No.5 and No.2	3	ZR2	978	3	ZR24	211	Difference between No.6 and No.3	4	ZR3	1011	4	ZR26	252	Difference between No.7 and No.4	5	ZR4	1035	5	ZR28	269	Difference between No.8 and No.5	6	ZR5	1189	6	ZR30	212	Difference between No.9 and No.6	7	ZR6	1263	7	ZR32	321	Difference between No.10 and No.7	8	ZR7	1304					9	ZR8	1401					10	ZR9	1584				
No.	Input data		No.	Output data		Operation																																																																								
1	ZR0 (input data start address)	945	1	ZR20 (output data start address)	66	Difference between No.4 and No.1																																																																								
2	ZR1	948	2	ZR22	87	Difference between No.5 and No.2																																																																								
3	ZR2	978	3	ZR24	211	Difference between No.6 and No.3																																																																								
4	ZR3	1011	4	ZR26	252	Difference between No.7 and No.4																																																																								
5	ZR4	1035	5	ZR28	269	Difference between No.8 and No.5																																																																								
6	ZR5	1189	6	ZR30	212	Difference between No.9 and No.6																																																																								
7	ZR6	1263	7	ZR32	321	Difference between No.10 and No.7																																																																								
8	ZR7	1304																																																																												
9	ZR8	1401																																																																												
10	ZR9	1584																																																																												
FB compilation method	Subroutine type																																																																													
FB operation	Pulse execution type (multiple scan execution type)																																																																													

Item	Description	
Timing chart of I/O signals	Normal completion	
	Error completion	
Restrictions and precautions	<p>(1) This FB does not include the error recovery processing. Prepare the error recovery processing separately to suit the user's system and the expected operation.</p> <p>(2) This FB uses the long index registers LZ0, LZ1, and LZ2. Set the long index (LZ) to three points or greater in "Index Register Setting" of "CPU Parameter". (L1 MELSEC iQ-R CPU Module User's Manual (Application)) When using interrupt programs, do not use the corresponding index registers.</p> <p>(3) The FB cannot be used in an interrupt program.</p> <p>(4) Using the FB in a program that is to be executed only once, such as a subroutine program or a FOR-NEXT loop, has a problem that i_bEN (execution command) can no longer be turned off and normal operation is not possible; Always use the FB in a program that is capable of turning off the execution command.</p> <p>(5) The FB requires the configuration of the ladder for every input label.</p> <p>(6) This FB requires input data to be stored in the file register. In addition, the FB outputs operation result data in the file register (ZR). Refer to the following examples and set the file register capacity. For how to set the file register capacity, refer to the MELSEC iQ-R CPU Module User's Manual (Application).</p> <p>■When 0 is set in i_uDataType (input data type selection) Set the capacity of "(i_udSize (number of data points) × 3) - (i_udIndex (comparative data index) × 2)" for the file register (ZR).</p> <p>■When 2 is set in i_uDataType (input data type selection) Set the capacity of "(i_udSize (number of data points) × 4) - (i_udIndex (comparative data index) × 2)" for the file register (ZR).</p> <p>(7) This FB checks the input data values before the differential operation execution to prevent an overflow from occurring during the operation. If a possibility of an overflow is detected at this check, o_bErr (error completion) turns on and 203H is stored in o_uErrId (error code). For the operation with the single-precision real number, an error may occur depending on the combination of input data values. Even after the input data values are checked, the instruction execution fault (operation error) may occur at the operation execution. In such a case, if "RAS Setting" of "CPU Parameter" is set to continue the processing even after an operation error occurs, o_bErr (error completion) turns on and 203H is stored in o_uErrId (error code).</p> <p>(8) If 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module due to an error outside FB while i_bEN (execution command) of this FB is on, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 204H is stored in o_uErrId (error code). However, if "RAS Setting" of "CPU Parameter" is set to stop the processing after an operation error occurs, 204H is not stored in o_uErrId (error code).</p>	

## Performance value

The following table lists the performance values of this FB under the following conditions.

- CPU module: R08CPU
- File register storage location: CPU built-in memory
- FB compilation method: Subroutine type

Input label			Time required for the processing*1	Maximum scan time	Number of the scans required for the processing
Number of data points	Input data type	Comparative data index			
100 points	0: Word [signed]	99	Cannot be measured	0.159ms	1 scan
		50	4.193ms	0.156ms	50 scans
		0	8.455ms	0.152ms	100 scans
	2: Single-precision real number	99	Cannot be measured	0.157ms	1 scan
		50	4.199ms	0.158ms	50 scans
		0	8.459ms	0.157ms	100 scans
32768 points	0: Word [signed]	32767	Cannot be measured	0.156ms	1 scan
		16383	1404.858ms	0.159ms	16385 scans
		0	2798.199ms	0.152ms	32768 scans
	2: Single-precision real number	32767	Cannot be measured	0.15ms	1 scan
		16383	1408.626ms	0.152ms	16385 scans
		0	2800.049ms	0.16ms	32768 scans
90000 points	0: Word [signed]	89999	Cannot be measured	0.154ms	1 scan
		45000	3845.068ms	0.153ms	45000 scans
		0	7684.673ms	0.158ms	90000 scans
	2: Single-precision real number	89999	Cannot be measured	0.156ms	1 scan
		45000	3849.393	0.157ms	45000 scans
		0	7691.146	0.159ms	90000 scans

\*1 The time required from start to end of the processing

## List of error codes

Error code	Description	Action
103H	A value out of the range is set in i_uDataType (input data type selection).	Set 0 or 2 in i_uDataType (input data type selection). Review and correct the setting and then execute the FB again.
105H	A value out of the range is set in i_udSize (number of data points).	Set a value of 1 to 90000 in i_udSize (number of data points). Review and correct the setting and then execute the FB again.
116H	A value out of the range is set in i_udIndex (comparative data index).	Set a value that satisfies the following conditions in i_udIndex (comparative data index). <ul style="list-style-type: none"> <li>• i_udIndex (comparative data index) <math>\geq</math> 0</li> <li>• i_udIndex (comparative data index) &lt; i_udSize (number of data points)</li> </ul> Review and correct the setting and then execute the FB again.
200H	Although the value set in i_uDataType (input data type selection) is Single-precision real number, the stored input data is not a single-precision real number.	Store the input data as a single-precision real number in the file register (ZR). Review and correct the input data and then execute the FB again.
203H	An overflow has occurred in the FB during the operation.	Review and correct the input data stored in the file register (ZR) and then execute the FB again. When 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module, refer to the MELSEC iQ-R CPU Module User's Manual (Application).
204H	The processing of the FB has been interrupted due to an overflow in an operation other than that of this FB.	An overflow has occurred in the operation other than that of this FB, and 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module. Refer to the MELSEC iQ-R CPU Module User's Manual (Application).
205H	i_bEN (execution command) has been turned off during the processing.	Do not turn off i_bEN (execution command) until o_bOK (normal completion) or o_bErr (error completion) turns on.

# 2.4 M+DataAnalysis\_Integration\_R

## Name

M+DataAnalysis\_Integration\_R

## Overview

Item	Description																																				
Functional overview	Calculates the integral operation result of the specified data.																																				
Symbol	<div style="border: 1px solid black; padding: 10px; width: fit-content; margin: 10px auto;"> <p style="text-align: center;">M+DataAnalysis_Integration_R</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 5%; text-align: right;">(1) —</td> <td style="width: 45%;">B : i_bEN</td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%; text-align: left;">o_bENO : B — (7)</td> </tr> <tr> <td>(2) —</td> <td>UD : i_udStartNumber</td> <td></td> <td></td> <td></td> <td>o_bOK : B — (8)</td> </tr> <tr> <td>(3) —</td> <td>UD : i_udEndNumber</td> <td></td> <td></td> <td></td> <td>o_bErr : B — (9)</td> </tr> <tr> <td>(4) —</td> <td>UD : i_udSize</td> <td></td> <td></td> <td></td> <td>o_uErrId : UW — (10)</td> </tr> <tr> <td>(5) —</td> <td>UW : i_uDataType</td> <td></td> <td></td> <td></td> <td>o_eIntegrationData : E — (11)</td> </tr> <tr> <td>(6) —</td> <td>UD : i_udInputDataAddr</td> <td></td> <td></td> <td></td> <td></td> </tr> </table> </div>	(1) —	B : i_bEN				o_bENO : B — (7)	(2) —	UD : i_udStartNumber				o_bOK : B — (8)	(3) —	UD : i_udEndNumber				o_bErr : B — (9)	(4) —	UD : i_udSize				o_uErrId : UW — (10)	(5) —	UW : i_uDataType				o_eIntegrationData : E — (11)	(6) —	UD : i_udInputDataAddr				
(1) —	B : i_bEN				o_bENO : B — (7)																																
(2) —	UD : i_udStartNumber				o_bOK : B — (8)																																
(3) —	UD : i_udEndNumber				o_bErr : B — (9)																																
(4) —	UD : i_udSize				o_uErrId : UW — (10)																																
(5) —	UW : i_uDataType				o_eIntegrationData : E — (11)																																
(6) —	UD : i_udInputDataAddr																																				

## Labels to use

### Input labels

No.	Variable name	Name	Data type	Scope	Description
(1)	i_bEN	Execution command	Bit	On or off	On: The FB is activated. Off: The FB is not activated.
(2)	i_udStartNumber	Start number	Double Word [unsigned]	0 to 89999	Specifies the start position for the integral operation. The address of the file register (ZR) for this position is determined by "input data start address + start number".
(3)	i_udEndNumber	End number	Double Word [unsigned]	0 to 89999	Specifies the end position for the integral operation. The address of the file register (ZR) for this position is determined by "input data start address + (end number - 1)".
(4)	i_udSize	Number of data points	Double Word [unsigned]	1 to 90000	Specifies the number of data points (1 to 90000 points).
(5)	i_uDataType	Input data type selection	Word [unsigned]	0, 2	Specifies the data type of the input data. 0: Word [signed] 2: Single-precision real number
(6)	i_udInputDataAddr	Input data start address	Double Word [unsigned]	Valid device range <sup>*1</sup>	Specifies the start address of the file register (ZR) where the input data is stored.

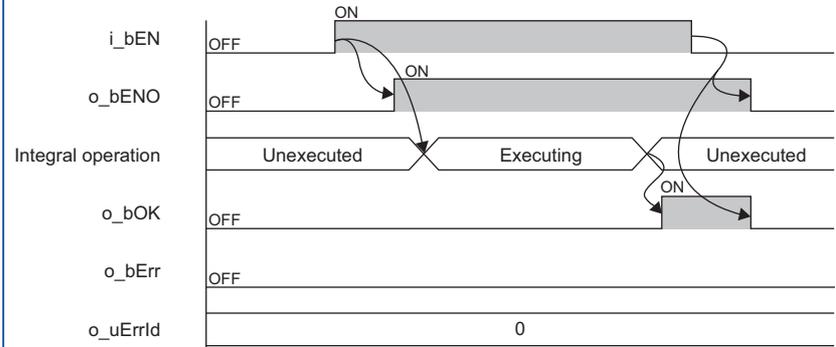
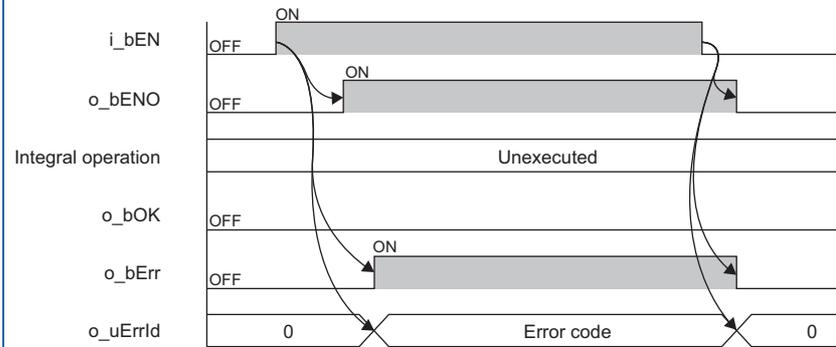
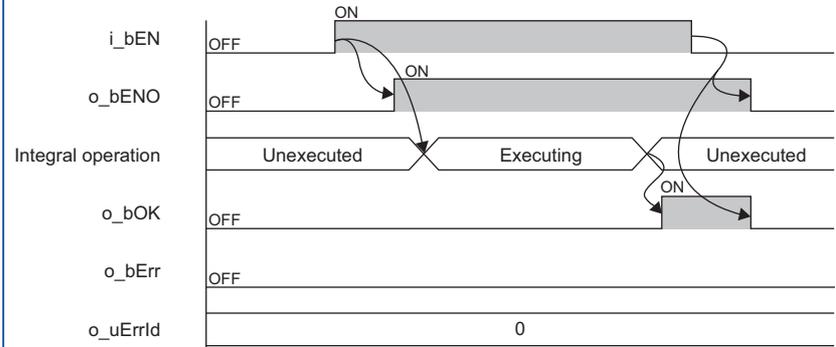
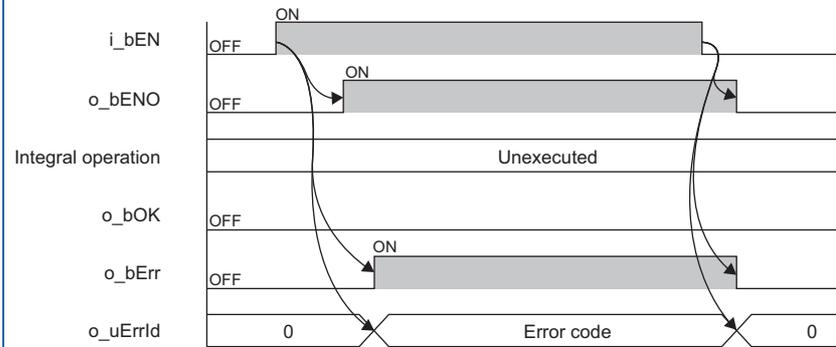
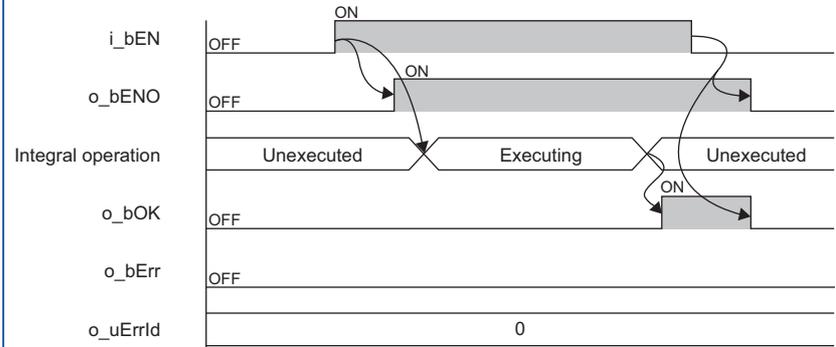
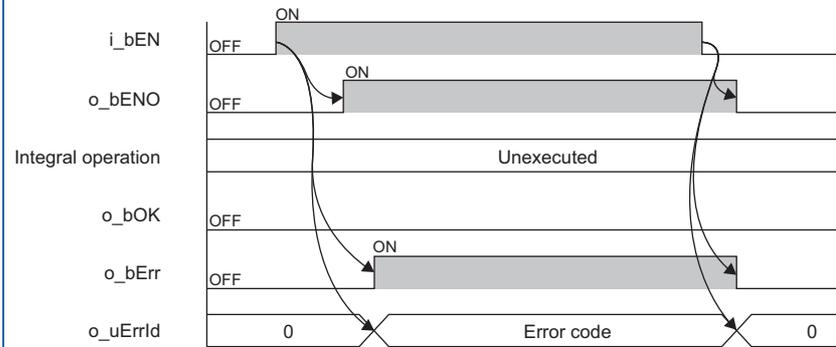
\*1 The valid range varies depending on "Device/Label Memory Area Setting" of "CPU Parameter".

### Output labels

No.	Variable name	Name	Data type	Default value	Description
(7)	o_bENO	Execution status	Bit	Off	On: The execution command is on. Off: The execution command is off.
(8)	o_bOK	Normal completion	Bit	Off	The on state indicates that an integral operation has been completed.
(9)	o_bErr	Error completion	Bit	Off	The on state indicates that an error has occurred in the FB.
(10)	o_uErrId	Error code	Word [unsigned]	0	The error code of an error occurred in the FB is returned.
(11)	o_eIntegrationData	Output data	Single-precision real number	0	The integral operation result is stored.

## FB details

Item	Description																																		
Relevant devices	CPU module	MELSEC IQ-R series																																	
	Engineering tool	GX Works3 of version 1.015R or later																																	
Language to use	— (The internal program of this FB is not open to the public.)																																		
Number of steps	367 steps The number of steps of the FB embedded in a program depends on the CPU module used, the input/output definitions, and the options setting of GX Works3. For the options setting of GX Works3, refer to the GX Works3 Operating Manual.																																		
FB dependence	No dependence																																		
Functional description	<p>(1) As i_bEN (execution command) turns on, this FB calculates an integral value of the specified input data values. This FB integrates input data values within the range of "start number" and "end number - 1", and outputs an operation result. When the start number is equal to the end number, this FB integrates all the input data values. This FB calculates the integral value with the following formula.</p> $\text{Integral} = \sum_{i=S}^{E-1} (x_i)$ <p>"X<sub>i</sub>" stands for i-th input data, "S" for the start number, and "E" for the end number.</p> <p>■Example</p> <p>The following figure shows an operation example of when values of each input label are as follows.</p> <ul style="list-style-type: none"> <li>• i_udStartNumber (start number): 0</li> <li>• i_udEndNumber (end number): 7</li> <li>• i_udSize (number of data points): 10</li> <li>• i_udInputDataAddr (input data start address): 10</li> </ul> <table border="1"> <thead> <tr> <th>No.</th> <th colspan="2">Input data</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>ZR10 (input data start address)</td> <td>10</td> </tr> <tr> <td>1</td> <td>ZR11</td> <td>20</td> </tr> <tr> <td>2</td> <td>ZR12</td> <td>30</td> </tr> <tr> <td>3</td> <td>ZR13</td> <td>40</td> </tr> <tr> <td>4</td> <td>ZR14</td> <td>50</td> </tr> <tr> <td>5</td> <td>ZR15</td> <td>60</td> </tr> <tr> <td>6</td> <td>ZR16</td> <td>70</td> </tr> <tr> <td>7</td> <td>ZR17</td> <td>80</td> </tr> <tr> <td>8</td> <td>ZR18</td> <td>90</td> </tr> <tr> <td>9</td> <td>ZR19</td> <td>100</td> </tr> </tbody> </table> <p>Start number →</p> <p>End number - 1 →</p> <p>Input data from ZR0 (start number) to ZR6 (end number - 1) are integrated. The operation result of the following formula is output in o_eIntegrationData (output data).</p> $\sum_{i=0}^{(7-1)} (x_i) = X_0 + X_1 + X_2 + X_3 + X_4 + X_5 + X_6$ $= 10 + 20 + 30 + 40 + 50 + 60 + 70$ $= 280$ <p>(2) Input data targeted for integral operation is read from file register (ZR), starting from the area of the address specified with i_udInputDataAddr (input data start address), for the number of data points specified with i_udSize (number of data points).</p> <p>(3) The operation result is output to o_eIntegrationData (output data) as a single-precision real number.</p> <p>(4) It takes multiple scans until the integral operation is completed. Thus, do not change the input data values used for the operation until the processing is completed. When the operation is completed, o_bOK (normal completion) turns on.</p> <p>(5) If a value out of the range is set in i_udSize (number of data points), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 105H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 23 List of error codes)</p> <p>(6) If a value exceeding the number of data points is set in i_udStartNumber (start number) or i_udEndNumber (end number), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 118H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (☞ Page 23 List of error codes)</p>		No.	Input data		0	ZR10 (input data start address)	10	1	ZR11	20	2	ZR12	30	3	ZR13	40	4	ZR14	50	5	ZR15	60	6	ZR16	70	7	ZR17	80	8	ZR18	90	9	ZR19	100
No.	Input data																																		
0	ZR10 (input data start address)	10																																	
1	ZR11	20																																	
2	ZR12	30																																	
3	ZR13	40																																	
4	ZR14	50																																	
5	ZR15	60																																	
6	ZR16	70																																	
7	ZR17	80																																	
8	ZR18	90																																	
9	ZR19	100																																	

Item	Description				
Functional description	<p>(7) If i_udStartNumber (start number) or i_udEndNumber (end number) is set under the following condition, o_bErr (error completion) turns on and the processing of the FB is interrupted.</p> <ul style="list-style-type: none"> <li>• i_udStartNumber (start number) &gt; i_udEndNumber (end number)</li> </ul> <p>In addition, 117H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (Page 23 List of error codes)</p> <p>(8) If a value out of the range is set in i_uDataType (input data type selection), o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 103H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (Page 23 List of error codes)</p> <p>(9) If an overflow occurs during the integral operation, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 203H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (Page 23 List of error codes)</p> <p>(10) If i_bEN (execution command) is turned off before o_bOK (normal completion) or o_bErr (error completion) turns on, o_bErr (error completion) turns on in one scan. In addition, 205H is stored in o_uErrId (error code) in one scan. For the error code, refer to the list of error codes. (Page 23 List of error codes)</p> <p>(11) When a single-precision real number is set in i_uDataType (input data type selection) and the value stored in the file register (ZR) is not a single-precision real number, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 200H is stored in o_uErrId (error code). For the error code, refer to the list of error codes. (Page 23 List of error codes)</p>				
FB compilation method	Subroutine type				
FB operation	Pulse execution type (multiple scan execution type)				
Timing chart of I/O signals	<table border="1"> <thead> <tr> <th data-bbox="287 730 400 1115">Normal completion</th> <th data-bbox="400 730 1468 1115">  </th> </tr> </thead> <tbody> <tr> <th data-bbox="287 1115 400 1496">Error completion</th> <th data-bbox="400 1115 1468 1496">  </th> </tr> </tbody> </table>	Normal completion		Error completion	
Normal completion					
Error completion					

Item	Description
Restrictions and precautions	<p>(1) This FB does not include the error recovery processing. Prepare the error recovery processing separately to suit the user's system and the expected operation.</p> <p>(2) This FB uses the long index register LZ0. When using an interrupt program, do not use the corresponding index register.</p> <p>(3) The FB cannot be used in an interrupt program.</p> <p>(4) Using the FB in a program that is to be executed only once, such as a subroutine program or a FOR-NEXT loop, has a problem that i_bEN (execution command) can no longer be turned off and normal operation is not possible; Always use the FB in a program that is capable of turning off the execution command.</p> <p>(5) The FB requires the configuration of the ladder for every input label.</p> <p>(6) This FB requires input data to be stored in the file register. Refer to the following examples and set the file register capacity. For how to set the file register capacity, refer to the MELSEC iQ-R CPU Module User's Manual (Application).</p> <p>■When 0 is set in i_uDataType (input data type selection) Set the capacity of i_udSize (number of data points) for the file register (ZR).</p> <p>■When 2 is set in i_uDataType (input data type selection) Set the capacity of "i_udSize (number of data points) × 2" for the file register (ZR).</p> <p>(7) This FB checks the input data values before the integral operation execution to prevent an overflow from occurring during the operation. If a possibility of an overflow is detected at this check, o_bErr (error completion) turns on and 203H is stored in o_uErrId (error code). For the operation with the single-precision real number, an error may occur depending on the combination of input data values. Even after the input data values are checked, the instruction execution fault (operation error) may occur at the operation execution. In such a case, if "RAS Setting" of "CPU Parameter" is set to continue the processing even after an operation error occurs, o_bErr (error completion) turns on and 203H is stored in o_uErrId (error code).</p> <p>(8) If 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module due to an error outside FB while i_bEN (execution command) of this FB is on, o_bErr (error completion) turns on and the processing of the FB is interrupted. In addition, 204H is stored in o_uErrId (error code). However, if "RAS Setting" of "CPU Parameter" is set to stop the processing after an operation error occurs, 204H is not stored in o_uErrId (error code).</p>

## Performance value

The following table lists the performance values of this FB under the following conditions.

- CPU module: R08CPU
- File register storage location: CPU built-in memory
- FB compilation method: Subroutine type

Input label				Time required for the processing*1	Maximum scan time	Number of the scans required for the processing
Number of data points	Input data type	Start number	End number			
100 points	0: Word [signed]	0	99	8.355ms	0.616ms	99 scans
	2: Single-precision real number	0	99	8.356ms	0.616ms	
45000 points	0: Word [signed]	0	44999	3837.839ms	0.616ms	44999 scans
	2: Single-precision real number	0	44999	3840.251ms	0.616ms	
90000 points	0: Word [signed]	0	89999	7676.337ms	0.616ms	89999 scans
	2: Single-precision real number	0	89999	7681.482ms	0.616ms	

\*1 The time required from start to end of the processing

## List of error codes

Error code	Description	Action
103H	A value out of the range is set in i_uDataType (input data type selection).	Set 0 or 2 in i_uDataType (input data type selection). Review and correct the setting and then execute the FB again.
105H	A value out of the range is set in i_udSize (number of data points).	Set a value of 1 to 90000 in i_udSize (number of data points). Review and correct the setting and then execute the FB again.
117H	A value exceeding i_udEndNumber (end number) is set in i_udStartNumber (start number).	Set a value that satisfies the condition of "i_udStartNumber (start number) $\leq$ i_udEndNumber (end number)". Review and correct the setting and then execute the FB again.
118H	A value exceeding i_udSize (number of data points) is set in i_udStartNumber (start number) or i_udEndNumber (end number).	Set a value that satisfies the following conditions. <ul style="list-style-type: none"> <li>• i_udStartNumber (start number) <math>\leq</math> i_udSize (number of data points)</li> <li>• i_udEndNumber (end number) <math>\leq</math> i_udSize (number of data points)</li> </ul> Review and correct the setting and then execute the FB again.
200H	Although the value set in i_uDataType (input data type selection) is Single-precision real number, the stored input data is not a single-precision real number.	Store the input data as a single-precision real number in the file register (ZR). Review and correct the input data and then execute the FB again.
203H	An overflow has occurred in the FB during the operation.	Review and correct the input data stored in the file register (ZR) and then execute the FB again. When 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module, refer to the MELSEC iQ-R CPU Module User's Manual (Application).
204H	The processing of the FB has been interrupted due to an overflow in an operation other than that of this FB.	An overflow has occurred in the operation other than that of this FB, and 3403H is stored in the special register SD0 (Latest self-diagnostic error code) of the CPU module. Refer to the MELSEC iQ-R CPU Module User's Manual (Application).
205H	i_bEN (execution command) has been turned off during the processing.	Do not turn off i_bEN (execution command) until o_bOK (normal completion) or o_bErr (error completion) turns on.

# INSTRUCTION INDEX

---

## M

---

M+DataAnalysis_BoundCompareTest_R . . . . .	8
M+DataAnalysis_Different_R . . . . .	14
M+DataAnalysis_FFTSpectrum_R . . . . .	4
M+DataAnalysis_Integration_R . . . . .	19

# MEMO

---

# REVISIONS

\*The manual number is given on the bottom left of the back cover.

Revision date	*Manual number	Description
December 2015	BCN-P5999-0623-A	First edition
June 2017	BCN-P5999-0623-B	■Additional FBs M+DataAnalysis_BoundCompareTest_R, M+DataAnalysis_Different_R, M+DataAnalysis_Integration_R ■Added or modified parts Section 1.1, 2.1, 2.2, 2.3, 2.4
June 2018	BCN-P5999-0623-C	■Added or modified parts Function block library name, Section 2.1, 2.2, 2.3, 2.4

Japanese manual number: BCN-P5999-0622-D

This manual confers no industrial property rights of any other kind, nor does it confer any patent licenses. Mitsubishi Electric Corporation cannot be held responsible for any problems involving industrial property rights which may occur as a result of using the contents noted in this manual.

© 2015 MITSUBISHI ELECTRIC CORPORATION



BCN-P5999-0623-C(1806)

## **mitsubishi electric corporation**

HEAD OFFICE : TOKYO BUILDING, 2-7-3 MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN  
NAGOYA WORKS : 1-14, YADA-MINAMI 5-CHOME, HIGASHI-KU, NAGOYA, JAPAN

When exported from Japan, this manual does not require application to the  
Ministry of Economy, Trade and Industry for service transaction permission.

Specifications subject to change without notice.