

Mitsubishi General-Purpose Programmable Logic Controller Renewal Tool Conversion Adapter

Model

ERNT-AQT68AD-GH

User's Manual



Model ERNT-AQT68AD-GH 50CM-D180033-A(0810)MEE



(Always read these precautions prior to use.)

Before using this product, please read this manual carefully and pay full attention to safety to ensure that the product is used correctly.

The precautions presented in this manual are concerned with this product only. For PLC system safety precautions, refer to the user's manual of the CPU module to be used.

In this manual, the safety precautions are ranked as "DANGER" and "CAUTION."



Indicates that incorrect handling may cause hazardous conditions, resulting in death or severe injury.



Indicates that incorrect handling may cause hazardous conditions, resulting in medium or minor injury and/or property damage.

Note that failure to observe the ^\textsuperscript{\textsuperscript{CAUTION level instructions may lead to a serious consequence according to the circumstances. Always follow the precautions of both levels because they are important to personal safety.

Please keep this manual in an easy-to-access location for future reference, and be sure to provide the manual to the end user.

[Precautions: Prior to Use]

CAUTION

When replacing the MELSEC-A series with the MELSEC-Q series, be sure to refer to the various MELSEC-Q series module manuals to check the differences in performance, functionality, CPU input/output signals, buffer memory addresses, and the like. In addition, we recommend that you also refer to the document L(NA)08045-D, "Guidelines: Replacing MELSEC-A/QnA (Large-Size) Series with Q Series (Intelligent Function Module)."

[Installation Precautions]

CAUTION

- Use the conversion adapter and conversion adapter anchor base in an environment of the general specifications defined in the CPU module user's manual. Failure to do so could lead to electric shock, fire, malfunction or product failure or deterioration.
- Do not come in direct contact with the conductive area of the conversion adapter. Doing so could lead to system malfunction or failure.
- Fully secure the conversion adapter and conversion adapter anchor base using the installation screws, and tighten the installation screws securely within the specified torque range. Failure to do so could cause the conversion adapter and anchor base to fall, resulting in conversion adapter and conversion adapter anchor base damage.
- Be sure to confirm that the MELSEC-Q series and conversion adapter combination is correct. Use
 of a different combination may result in module damage

[Wiring Precautions]

DANGER

- Be sure to shut off all phases of the external power supply before performing installation or wiring work. Failure to do so could result in electric shock or product damage.
- If you want to energize and run the unit after completing the installation and wiring work, be sure to close the terminal block cover attached to the MELSEC-A series terminal block. Failure to do so could result in electric shock.

CAUTION

- Properly wire the conversion adapter after verifying the specifications and terminal layout of the module to be used. Connecting a power supply with a different rating or improper wiring could lead to fire or product failure.
- Securely tighten the conversion adapter installation screws, conversion adapter anchor base installation screws and MELSEC-A series terminal block installation screws within the specified torque range. A loose screw may result in a short circuit, fire or malfunction. An excessively tightened screw may result in screw or conversion adapter damage, causing the conversion adapter to fall, a short circuit or product malfunction.
- Do not allow foreign matter such as cuttings or wiring shavings to enter the conversion adapter or module. Doing so could lead to fire, failure or malfunction.

[Startup and Maintenance Precautions]




- Do not touch the terminals during energization. Doing so could result in electric shock or malfunction.
- Be sure to shut off all phases of the external power supply before cleaning and retightening terminal screws. Failure to do so results in the risk of electric shock. Excessively tightened screws could result in conversion adapter and module damage, causing the conversion adapter to fall, a short circuit, or product malfunction.

CAUTION

- Do not disassemble or modify the conversion adapter. Doing so could lead to failure, malfunction, injury or fire.
- The conversion adapter case is made of resin. Do not drop or apply excessive impact to the case.
 Doing so could lead to conversion adapter damage.

[Disposal Precautions]



When disposing of the product, treat it as industrial waste.

REVISIONS

*The manual number is given on the bottom right of the front cover.

Print Date	*Manual Number	Revision
October 2008	50CM-D180033-A	First Edition

This manual confers no industrial property rights or any rights of any other kind, nor does it confer any patent licenses. Mitsubishi Electric Engineering cannot be held responsible for any problems involving industrial property rights which may occur as a result of using the contents noted in this manual.

© 2008 MITSUBISHI ELECTRIC ENGINEERING COMPANY LIMITED CONTENTS

SAF	ETY PRECAUTIONS	A-1
RE\	/ISIONS	A-3
COI	NTENTS	A-3
1.	Overview ·····	1
2.	Conversion Adapter Product Specifications	··· 2
3.	Products Required by the Conversion Adapter ······	··· 5
4.	Mounting and Installation ·····	··· 6
5.	Part Names and Installation Method·····	··· 7
6.	Conversion Adapter Anchor Base Installation Method	8
7.	External Dimensions	· 11

1. Overview

This manual describes the Mitsubishi general-purpose PLC renewal tool conversion adapter (ERNT-AQT68AD-GH) and the conversion adapter anchor base (sold separately; ERNT-AQF12/-AQF8/-AQF5/AQF3) that secures the bottom of the conversion adapter. The conversion adapter is a product that converts the differences in MELSEC-A series and MELSEC-Q series pin assignments.

When replacing the MELSEC-A series with the MELSEC-Q series, be sure to refer to the various MELSEC-Q series module manuals to check the differences in performance, functionality, CPU input/output signals, buffer memory addresses, and the like. In addition, we recommend that you also refer to the document L(NA)08045-D, "Guidelines: Replacing MELSEC-A/QnA (Large-Size) Series with Q Series (Intelligent Function Module)."

Once you have opened the packaging, verify that it contains the following products.

Product	Quantity
Conversion adapter	1
Mounting bracket	1
Mounting bracket fixing screw (M3.5 x 6)	4

2. Conversion Adapter Product Specifications

Conversion Adapter	A Series Module	No. of analog	Q Series Module	Conversion
Model	Model	input Points	Model	Adapter Weight (g)
ERNT-AQT68AD-GH	A68AD	8	Q64AD-GH x 2	280
	A68AD-S2			
	A68ADN			

This product allows you to use voltage and current inputs together.


Module Specification Comparison Chart

	Item	A68AD, A68AD-S2	Q64AD-GH					
Analog input	Voltage	-10 to 0 to 10VDC (Input resistance hardware version K or later: $1M\Omega$, hardware version J or earlier: $30k\Omega$)	-10 to 10VDC (input resistance: 1MΩ)					
	Current	4 to 20mA (input resistance: 250Ω)	0 to 20mA DC (input resistance: 250Ω)					
Digital outpu	ıt	ACPU: 16-bit signed binary (-2048 to +2047) K2ACPU: Signed +16-bit signed binary (± 2047)	16-bit signed binary (-32768 to 32767) 32-bit signed binary (-65536 to 65535)					
Input/Output characteristics		Analog Input Digital Output +10V +2000 +5V or +20mA +1000 0V or +4mA ±0 -5V or -12mA -1000 -10V -2000	Analog Input Range					
			-10 to 10V 156.3μV 312.6μV User range setting (bipolar) 47.4μV 94.8μV -64000 to 64000 -32000 to 32000					
Maximum re	esolution	Voltage 5mV(1/2000) Current 20μA(1/1000)	0 to 20mA 312.5nA 625.0nA 4 to 20mA 250.0nA 500.0nA User range setting (unipolar) 151.6nA 303.2nA 0 to 64000 0 to 32000					
Overall accuracy		±1.0%	Reference accuracy: ±0.05% Digital output value (32 bits): ±32 digits Digital output value (16 bits): ±16 digits Temperature coefficient: ±71.4ppm/°C (0.00714%/°C)					
Maximum co	onversion speed	2.5ms/channel	10ms / 4 channels					
Absolute	Voltage	±15V	±15V					
maximum	Current	±30mA	±30mA					
No. of analog	g input points	8 channels/module	4 channels/module					
Between input Isolation terminal and PLC method power supply		Photocoupler isolation	Photocoupler isolation					
Between channels		Non-isolated	Transformer isolation					
No. of occup		32 points	16 points					
Connected t	erminal block	38-point terminal block	18-point terminal block					
Current con	sumption	Hardware version K or later: 0.39A Hardware version J or earlier: 0.9A	0.89A					


	Item	A68ADN			Q64AD-GH							
	Voltage	-10 to 0 to 10VDC				-10 to 10VDC (input resistance: 1MΩ)						
Analog input	Ü	(Input resistance: 1MΩ)				500)	,					
Current -20mA to 0 to 20mA (input resistance: 250			,	0 to 20mA DC (input resistance: 250Ω) 16-bit signed binary (-32768 to 32767) 32-bit signed binary (-65536 to 65535)					67)			
Input/Output characteristics		Analog Input 10V 5V or 20mA 0V or 20mA -5V or -20mA -10V	(For 5\ 0V	al Output V/20mA G V/20mA G V/0mA Off V/0mA Off Setting 8000 4000 -4000 -8000	Sain and		Current Voltage	User range setting (bipolar)	Maximum 32 bit 156.3µV 78.2µV 62.5µV 47.4µV 156.3µV 47.4µV 312.5nA 250.0nA	Resolution 16 bit 312.6µV 156.4µV 125.0µV 94.8µV 312.6µV 94.8µV 625.0nA 500.0nA	Digital Output Value (32 bits) 0 to 64000 -64000 to 64000 0 to 64000	Digital Output Value (16 bits) 0 to 32000 -32000 to 32000 0 to 32000
Maximum re	solution	At 1/4000 At 1/8000 At 1/12000 Setting Setting Setting Voltage input 2.5mV 1.25mV 0.83mV Current input 10μΑ 5μΑ 3.33μΑ										
Overall accuracy		±1.0%			Reference accuracy: ±0.05% Digital output value (32 bits): ±32 digits Digital output value (16 bits): ±16 digits Temperature coefficient: ±71.4ppm/° C(0.00714%/°C)				gits			
	nversion speed			/channel					10r	ms / 4 ch		
Absolute	Voltage			15V			±15V					
	Current			0mA			±30mA					
No. of analog Isolation method	Between input terminal and PLC power supply Between channels		8 channels/module Photocoupler isolation Non-isolated		4 channels/module Photocoupler isolation Non-isolated							
No. of occup				points			16 points					
	erminal block	36			ock		18-point terminal block					
Current consumption		38-point terminal block 0.4A				0.89A						

Note:

 When replacing A68AD/A68AD-S2 with two Q64AD-GH modules, AG connected to terminal number TB38 on the MELSEC-A series side is no longer required.



 When replacing A68ADN with two Q64AD-GH modules, AG connected to terminal number TB37 and FG connected to terminal number TB38 on the MELSEC-A series side are no longer required.



- 3. For analog input, voltage and current inputs can be used together.
- 4. Program changes (changes to input/output signals and buffer memory addresses) are required.
- 5. For detailed and general specifications not stated in the Specification Comparison Chart, refer to the user's manual of the module used. In addition, we recommend that you also refer to the document L(NA)08045-D, "Guidelines: Replacing MELSEC-A/QnA (Large-Size) Series with Q Series (Intelligent Function Module)." For those sections in which the MELSEC-A series specifications and MELSEC-Q series specification differ, specification restrictions may apply upon replacement. Check the specifications of the connected devices.

3. Products Required by the Conversion Adapter

(1) Conversion Adapter Anchor Base (Sold Separately)

The conversion adapter anchor base secures the bottom of the conversion adapter and is required for conversion adapter use. One anchor base is required per base.

Conversion Adapter	Specifications				
Anchor Base Model	Туре	Weight (g)			
ERNT-AQF12	12-slot conversion adapter anchor base	590			
ERNT-AQF8	8-slot conversion adapter anchor base	410			
ERNT-AQF5	5-slot conversion adapter anchor base	275			
ERNT-AQF3	3-slot conversion adapter anchor base	185			

(2) Base Adapter (Sold Separately)

The base adapter enables MELSEC-Q series installation using the installation holes of the MELSEC-A series base unit. (Additional hole machining not required)


	Specifications							
Base Adapter Model	MELSEC-A Series	MELSEC-Q Series	Installable Conversion	Weight				
	Compliant Module	Compliant Module	Adapter Anchor Base	(g)				
ERNT-AQB38	A38B	Q312B	ERNT-AQF12	970				
	A38HB	Q38B	ERNT-AQF8					
ERNT-AQB68	A68B	Q612B		930				
		Q68B						
ERNT-AQB58	A58B	Q68B	ERNT-AQF8	870				
ERNT-AQB35	A35B	Q38B	ERNT-AQF8	795				
		Q35B	ERNT-AQF5					
ERNT-AQB65	A65B	Q68B		790				
		Q65B						
		Q55B						
ERNT-AQB55	A55B	Q65B	ERNT-AQF5	655				
		Q55B						
ERNT-AQB32	A32B	Q33B	ERNT-AQF3	675				
ERNT-AQB62	A62B	Q63B		650				
		Q52B						
ERNT-AQB52	A52B	Q52B		505				

4. Mounting and Installation

4.1 Handling Precautions

- (1) Do not touch the terminals during energization. Doing so could result in electric shock or malfunction.
- (2) Do not disassemble or modify the conversion adapter. Doing so could result in failure, malfunction, injury or fire.
- (3) Do not come in direct contact with the conductive area of the conversion adapter. Doing so could result in system malfunction or failure.
- (4) Fully secure the conversion adapter and conversion adapter anchor base using the installation screws, and securely tighten the screws within the specified torque range. Failure to do so could cause the conversion adapter and anchor base to fall, resulting in conversion adapter and conversion adapter anchor base damage.


4.2 Use Precautions

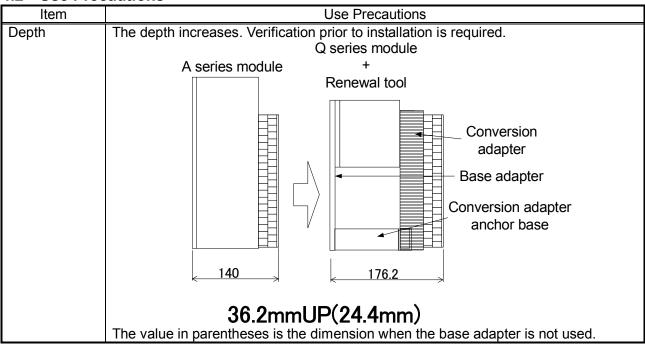

4.3 Installation Environment

For details of the installation environment, refer to the user's manual of the CPU module to be used.

5. Part Names and Installation Method

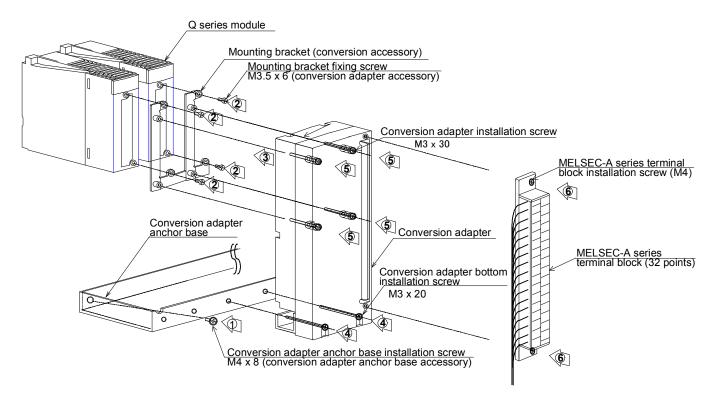

5.1 Installation Method

- [1] Secure the conversion adapter anchor base to the base adapter or control panel using the conversion adapter anchor base installation screws (M4 × 8) provided as an accessory. (Two end locations)
- [2] Secure the mounting bracket to the Q series module using the mounting bracket fixing screws [M3.5 \times 6 (conversion adapter accessory); two upper/lower locations].
- [3] Mount the conversion adapter onto the mounting bracket.
- [4] Secure the conversion adapter using the conversion adapter bottom installation screw (M3 \times 20; 2 location).
- [5] Secure the conversion adapter using the conversion adapter installation screws (M3 \times 30; 4 locations).
- [6] Secure the MELSEC-A series terminal block to the conversion adapter using the terminal block installation screws (M4; two upper/lower locations).

5.2 Tightening Torque

Tighten the module installation screws to the specified torque below. An inappropriate tightening torque could cause the product to fall or result in a short circuit, product failure or malfunction.

Screw Location	Tightening Torque Range
Conversion adapter anchor base installation screw (M4 screw)	139 to 189N·cm
Mounting bracket fixing screw (M3.5 screw)	68 to 92 N·cm
Conversion adapter bottom installation screw (M3 screw)	43 to 57 N·cm
Conversion adapter installation screw (M3 screw)	
MELSEC-A series terminal block installation screw (M4 screw)	102 to 138 N·cm

6. Conversion Adapter Anchor Base Installation Method

To use the conversion adapter, a conversion adapter anchor base (ERNT-AQF12/-AQF8/-AQF5/AQF3) is required.

Q Base Unit Conversion Adapter Anchor Base	Q312B	Q38B	Q35B	Q33B	Q612B	Q68B	Q65B	Q63B	Q55B	Q52B
ERNT-AQF12	0	×	×	×	0	×	×	×	×	×
ERNT-AQF8	0	0	×	×	0	0	×	×	×	×
ERNT-AQF5	×	0	0	×	×	0	0	×	0	×
ERNT-AQF3	×	×	×	0	×	×	×	0	×	0

©: Applicable


O: Applicable (with some restrictions*1)

×: Not applicable


*1: There are certain slots in which the conversion adapter cannot be installed. For example, the conversion adapter cannot be installed in Slots 8 to 11 (4 slots) of the Q base unit when Q132B (Q base unit) is used with ERNT-AQF8 (conversion adapter anchor base).

The machining of screw holes (M4 \times 2 locations) used to install the conversion adapter anchor base, such as described below, is required when a base adapter (sold separately) is not used.


(1) With Main Base Unit Q312B, Q38B, Q35B or Q33B

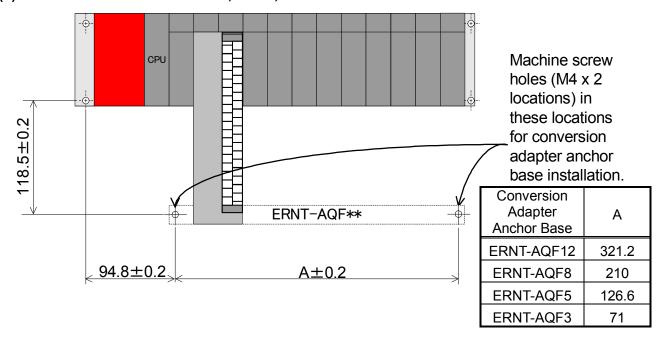


(2) With Extension Base Unit Q612B, Q68B Q65B or Q63B

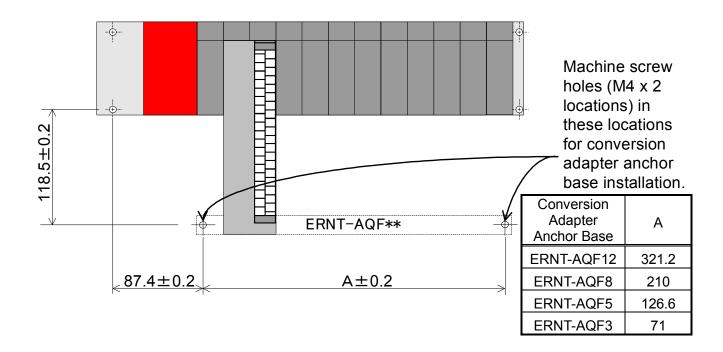

(3) With Extension Base Unit Q55B

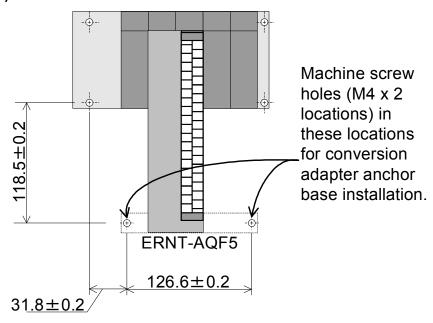

(4) With Extension Base Unit Q52B

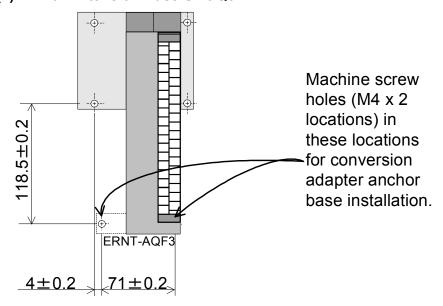


Tips


Use of a base adapter (sold separately) eliminates the need for additional screw hole machining on the control panel. (A base adapter is a product that enables MELSEC-Q series installation using the MELSEC-A series installation holes.)

7. External Dimensions

7.1 Conversion Adapter

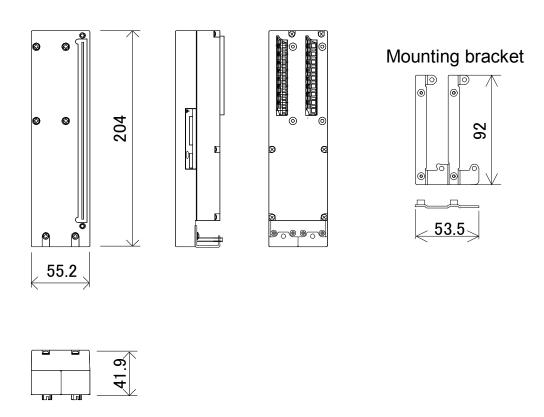

7.2 Conversion Adapter Anchor Base

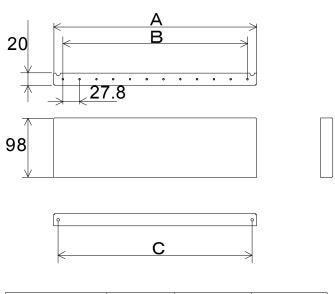

Model	Α	В	С
ERNT-AQF12	335.8	305.8	321.2
ERNT-AQF8	224.6	194.6	210
ERNT-AQF5	141.2	111.2	126.6
ERNT-AQF3	85.6	55.6	71

Product Warranty Details

Please confirm the following product warranty details prior to product use.

Gratis Warranty Terms and Gratis Warranty Range

If any fault or defect (hereinafter referred to as "Failure") attributable to Mitsubishi Electric Engineering Company Limited (hereinafter referred to as "MEE") should occur within the gratis warranty period, MEE shall repair the product free of charge via the distributor from whom you made your purchase.

Gratis Warranty Period

The gratis warranty period of this product shall be one (1) year from the date of purchase or delivery to the designated place.

Note that after manufacture and shipment from MEE, the maximum distribution period shall be six (6) months, and the gratis warranty period after manufacturing shall be limited to eighteen (18) months. In addition, the gratis warranty period for repaired products shall not exceed the gratis warranty period established prior to repair.

Gratis Warranty Range

The gratis warranty range shall be limited to normal use based on the usage conditions, methods and environment, etc., defined by the terms and precautions, etc., given in the instruction manual, user's manual and caution labels on the product.

Warranty Period after Discontinuation of Production

- (1) MEE shall offer product repair services (fee applied) for seven (7) years after production of the product has been discontinued. Discontinuation of production shall be reported via distributors.
- (2) Product supply (including spare parts) is not possible after production has been discontinued.

Exclusion of Opportunity Loss and Secondary Loss from Warranty Liability

Regardless of the gratis warranty period, MEE shall not be liable for compensation for damages arising from causes not attributable to MEE, opportunity losses or lost profits incurred by the user due to Failures of MEE products, damages or secondary damages arising from special circumstances, whether foreseen or unforeseen by MEE, compensation for accidents, compensation for damages to products other than MEE products, or compensation for other work carried out by the user.

Changes in Product Specifications

The specifications given in the catalogs, manuals and technical documents are subject to change without notice.

This document is a new publication, effective October 2008. Specifications are subject to change without notice. The standard price does not include consumption tax. Please note that consumption tax will be added at the time of purchase. This manual was printed on recycled paper.

Developed October 2008