



Energy Measuring Unit Extension for Pulse Input

Energy Measuring Unit Extension for Analog Input

Model EMU4-PX4 / EMU4-AX4

User's Manual (Digest)

- Before using this unit, please read both this manual and Details carefully and pay attention to safety to handle this unit correctly.
- Make sure that the end users read this manual and then keep the manual in a safe place for future reference.

ABOUT MANUALS

You can download User's manual (Details) of this unit from the following site.
<http://www.mitsubishielectric.com/fa/worldwide/index.html>

1. Features

- 1.1 Pulse Input Unit
- This unit is an optional device dedicated to Energy Measuring Unit (EcoMonitorPlus).
 - Adding this unit enables measurement of 4 circuits pulse.
 - Monitor upper limit of data, and indicate LED and output signal at time beyond the setting upper limit level.

- 1.2 Analog Input Unit
- This unit is an optional device dedicated to Energy Measuring Unit (EcoMonitorPlus).
 - Adding this unit enables measurement of 4 circuits analog input (0 to +5V/0 to +20mA).
 - Monitor upper/lower limit of data, and indicate LED and output signal at time beyond the setting upper/lower limit level.
- MODBUS is a trademark of Schneider Electric USA Inc.

2. Checking package contents

This following items for this device and included in package. Check that no items are missing.
(1) Energy Measuring unit x1 (2) User's Manual (Digest) x1

3. Safety Precautions

3.1 Precautions for Operating Environment and Conditions

This unit is premised on being used in pollution degree 2 ^(Note) environment. When used in higher pollution degree, protect this unit from pollution on another device side to be incorporated.

Over voltage category of measuring circuit in this unit is CAT III ^(Note), and that of auxiliary power circuit (MA, MB) is CAT III ^(Note).
Do not use this product in the places listed below. Failure to follow the instruction may cause malfunctions and a life decrease of product.

- Places the Ambient temperature exceeds the range -5 to +55°C.
- Altitude exceeds 2000m.
- Places in strong electromagnetic field or places large amounts of external noise exist.
- Places exposed to direct sunlight
- Places exposed to rain or water drop.
- Places the average daily temperature exceeds +35°C.
- Dust, corrosive gas, saline and oil smoke exist.
- Vibration and impact exceed the specifications.
- Places metal fragments or conductive substance are flying.
- Places the Relative humidity exceeds the range 30 to 85% or places with dewfall.

This unit is the open type device, which are designed to be housed within another device for prevention of electric shock. House this unit within the device such as the control panel before use. (Indoor use)

For the precautions for the compliance of the system incorporating this unit with the EMC Directives, refer to the User's Manual (Details).

(Note) For the definition of the pollution degree and the over voltage category, refer to EN61010-1/2010.

3.2 Matters concerning the precaution before use

- Use the unit in the specified usage environment and conditions.
- To use this unit, Base unit (EMU4-BM1-MB, EMU4-HM1-MB, EMU4-LG1-MB, EMU4-CNT-MB) is necessary. As for Base unit, refer to User's manual (Details) of each Base unit.
- To set this unit, dedicated small-size display unit (EMU4-D65) is necessary. For the setting method, refer to User's manual (Details) of the display unit.

3.3 Installation and Wiring Precautions


	Danger	<ul style="list-style-type: none">• Shut off the external power supply for the unit in all phases before installing or wiring. Failure to do so may cause an electric shock or damage of this unit.• Work under the electric outage condition when installing and wiring. Failure to do so may cause electric shock, a failure of the unit, a fire etc.
--	---------------	--

	Caution	<ul style="list-style-type: none">• Any person who is involved in the installation and the wiring of this unit should be fully competent to do this work.• Keep the space around this product (all directions except the back) is 30 mm or more (100 mm or more for UL standard compliance).• When tapping or wiring, take care not to entering any foreign objects such as chips and wire pieces into this unit.• Check the connection diagram when wiring. Wrong wiring may cause failure of the unit, a fire or electric shock.• This equipment is class A as per EN 55011. This equipment is not intended for use in residential environments and may not provide adequate protection to radio reception in such environments.• For protection against noise, transmission lines and input/output lines shall not be placed close to or bound together with the power lines and high-voltage lines.• Strip the wires with proper length. Overlong stripping length may cause short to next wire and electric shock. Shorter stripping length may cause contact failure.• Take care not to short to next terminal by a filament. (Do not plate the wires with solder.)• Do not connect more than two wires to one terminal screw of a terminal block for preventing loose contact and wires dropout.• Use appropriate size of electric wires. If inappropriate size of electric wire is used, it may cause a fire due to generated heat.• Tighten the screw within the specified torque. Under tightening can cause drop of the screw, short circuit or malfunction. Over tightening can damage the screw and/or unit, resulting in drop, short circuit or malfunction.• After tightening the screws, be sure to check all the screws tightened. Loose screw may cause malfunction of the unit, a fire or electric shock.• Be sure to attach the terminal cover to prevent electric shock.• Use the crimp-type terminal appropriated for the size of electric wires. If inappropriate crimp-type terminal is used, a wire breakage or a contact failure may occur, which may cause a device malfunction, a failure, a burnout or a fire.• FG terminal must be grounded according to the D-type ground (ground resistance is not exceed 100Ω).• Do not directly touch any conductive part of the unit. Doing so can cause electric shock, failure or malfunction of the unit.• The wires to be connected to this unit shall be placed in a duct or fixed together by cramping. If the electric wires are not placed in the duct or cramped together, loosen wires or their movement or careless stretch may cause a breakage of the unit or wire or a malfunction due to poor contact of electric wires.• If the wires connected to this unit are strongly pulled off, it may cause a malfunction or a breakage to the unit or the wire.• Do not exceed the specified voltage when doing an insulation resistance test and a commercial frequency withstand voltage test.• To prevent persons with little knowledge about electric equipment from electric shock, panel must be taken either following measure.• Lock the panel so that only those who get an education about electric equipment and have sufficient knowledge can unlock, or shut off power supply automatically by opening the panel.• Cover the dangerous part of this unit.
--	----------------	---

3.4 Precautions for Use

- When use Energy Measuring Unit Analog Input Model (Model : EMU4-AX4)/ Energy Measuring Unit Pulse Input Model (Model : EMU4-PX4) with CC-link communication unit(Model : EMU4-CM-C) and base unit(EMU4-BM1-MB, EMU4-HM1-MB, EMU4-LG1-MB), number of connectable show in the tables below.

① How to check the version for base unit

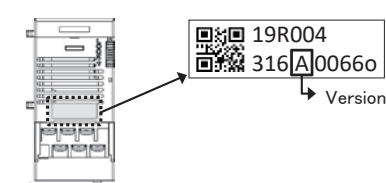

② Number of connectable Extension Unit

(i) With CC-Link Communication Unit (Model: EMU4-CM-C)

Base unit Version	Number of connectable
A	2 units
later B	3 units

(ii) Without CC-Link Communication Unit (Model: EMU4-CM-C)

Base unit Version	Number of connectable
A	3 units
later B	3 units

If you are considering using this unit for special purpose such as nuclear power plants, aerospace, medical care or passenger vehicles please refer to our sales representative.

	Caution	<ul style="list-style-type: none">• Use this unit within the ratings specified in this manual. If it is used outside the ratings, it may cause not only malfunction or failure but also fire burnout.• Do not disassemble or modify this unit. It may cause failure, malfunction, injury or fire.• Do not touch the live part such as connection terminal. It may cause electric shock, electric burn injury or burnout of the device. If any exposed conductor is found, stop the operation immediately, and take an appropriate action such as isolation protection.
--	----------------	--

3.5 Maintenance Precautions

- Use a soft dry cloth to clean off dirt of the unit surface. Do not let a chemical cloth remain on the surface for an extended period of time nor wipe the surface with thinner or benzene.
- Check for the following items to use this unit properly for long time.
 - (1) Daily maintenance
 - (a) No damage on this unit
 - (b) No abnormality with LED
 - (c) No abnormal noise, smell or heat
 - (2) Periodical maintenance (Once every 6 months to 1 year)
 - No looseness with installation and wire connection

	Caution	Do periodical maintenance under the electric outage condition. Failure to do so may cause electric shock, failure of the unit or a fire. Tighten the terminal regularly to prevent a fire. In case a display unit is attached to a sensor unit, get off the display unit during maintaining or tightening terminals.
--	----------------	--

3.6 Storage Precautions

To store this unit, turn off the power and remove wires, and put it in a plastic bag.

For long-time storage, avoid the following places. Failure to follow the instruction may cause a failure and reduced life of the unit.

- Places the Ambient temperature exceeds the range -10 to +60°C.
- Places the Relative humidity exceeds the range 30 to 85% or places with dewfall.
- Dust, corrosive gas, saline and oil smoke exist.
- Places the average daily temperature exceeds +35°C.
- Vibration and impact exceed the specifications.
- Places exposed to rain, water drop or direct sunlight.
- Places metal fragments or conductive substance are flying.

3.7 Disposal Precautions

When disposing of this unit, treat it as industrial waste.


3.8 About packaging materials and this manual

For reduction of environment load, packaging materials are produced with cardboard.


4. Name and function of each part

4.1 Name of each part


(1) EMU4-PX4

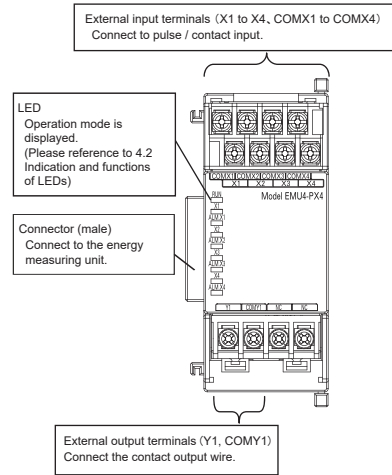

(2) EMU4-AX4

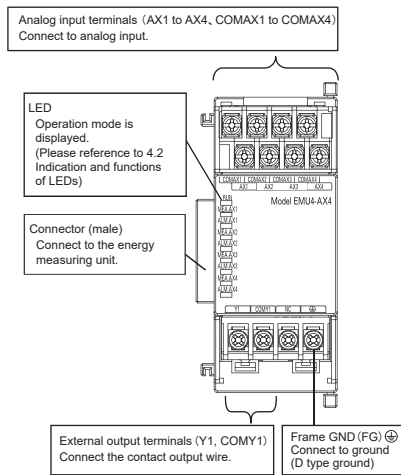

(3) Back and right side (common to EMU4-PX4 and EMU4-AX4)

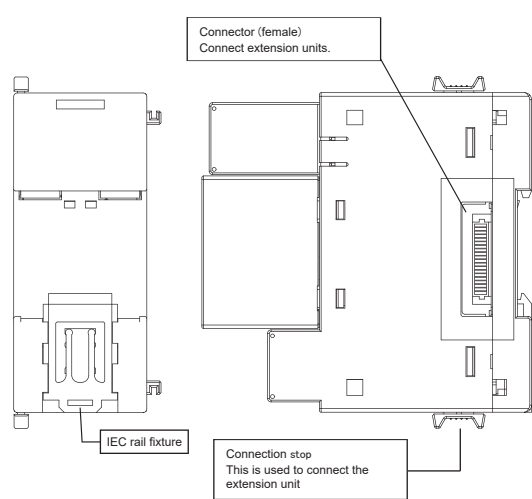

4.2 Indication and functions of LEDs

The names and operations of LEDs are as follows.

(1) EMU4-PX4

Name	Color	Function	Status
RUN LED	Red	Indicate operating status of this unit.	ON: Normal condition OFF: Power off or hardware failure (Note 1)
X1 LED	Red	Indicate measuring status of the circuit X1.	ON: Contact state is ON Blink: In the middle of measuring the pulse OFF: Other
ALM. X1 LED	Red	Indicate occurrence status of upper limit alert of the circuit X1.	ON: An error occurs (Note 1) Blink: Upper limit alert is issued OFF: No alert
X2 LED	Red	Indicate measuring status of the circuit X2.	ON: Contact state is ON Blink: In the middle of measuring the pulse OFF: Other
ALM. X2 LED	Red	Indicate occurrence status of upper limit alert of the circuit X2.	ON: An error occurs (Note 1) Blink: Upper limit alert is issued OFF: No alert
X3 LED	Red	Indicate measuring status of the circuit X3.	ON: Contact state is ON Blink: In the middle of measuring the pulse OFF: Other
ALM. X3 LED	Red	Indicate occurrence status of upper limit alert of the circuit X3.	ON: An error occurs (Note 1) Blink: Upper limit alert is issued OFF: No alert
X4 LED	Red	Indicate measuring status of the circuit X4.	ON: Contact state is ON Blink: In the middle of measuring the pulse OFF: Other
ALM. X4 LED	Red	Indicate occurrence status of upper limit alert of the circuit X4.	ON: An error occurs (Note 1) Blink: Upper limit alert is issued OFF: No alert

(Note 1) For details, refer to Chapter 14 "Error codes" of "User's Manual (Details)".

(2) EMU4-AX4


Name	Color	Function	Status
RUN LED	Red	Indicate operating status of this unit.	ON: Normal condition OFF: Power off or hardware failure (Note 1)
AX1 LED	Red	Indicate measuring status of the circuit AX1.	ON: In the middle of measuring OFF: Other
ALM. AX1 LED	Red	Indicate occurrence status of upper limit alert of the circuit AX1.	ON: An error occurs (Note 1) Blink: Upper/lower limit alert is issued OFF: No alert
AX2 LED	Red	Indicate measuring status of the circuit AX2.	ON: In the middle of measuring OFF: Other
ALM. AX2 LED	Red	Indicate occurrence status of upper limit alert of the circuit AX2.	ON: An error occurs (Note 1) Blink: Upper/lower limit alert is issued OFF: No alert
AX3 LED	Red	Indicate measuring status of the circuit AX3.	ON: In the middle of measuring OFF: Other
ALM. AX3 LED	Red	Indicate occurrence status of upper limit alert of the circuit AX3.	ON: An error occurs (Note 1) Blink: Upper/lower limit alert is issued OFF: No alert
AX4 LED	Red	Indicate measuring status of the circuit AX4.	ON: In the middle of measuring OFF: Other
ALM. AX4 LED	Red	Indicate occurrence status of upper limit alert of the circuit AX4.	ON: An error occurs (Note 1) Blink: Upper/lower limit alert is issued OFF: No alert

5. Connecting to Base unit

(1) Peel off the label pasted right part of measure unit.

(2) Plug connector (male) to connector (female) of measure unit for brought into close contact.

(3) Lock the measure unit to slide consolidated claws (green).

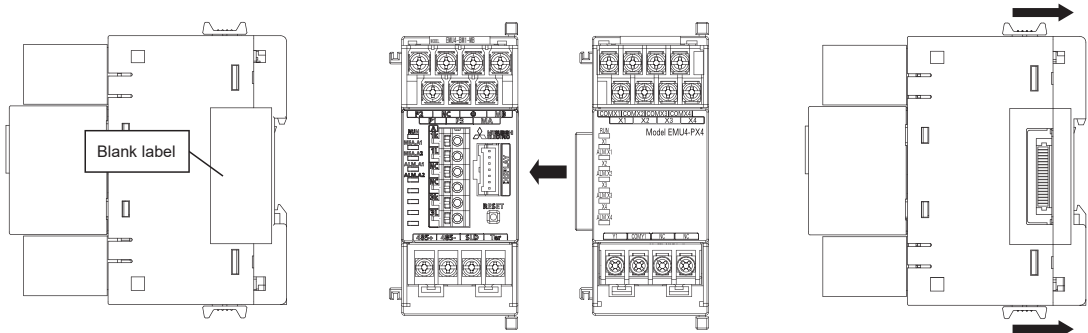

(Note 1) EMU4-BM1-MB, EMU4-HM1-MB, EMU4-LG1-MB, EMU4-CNT-MB are the connectable unit.


(Note 2) The number of extension units that can be connected to one base unit depends on the connection the product version and the CC-Link communication unit of the base unit.(3.4 Precautions for Use)

Caution


Work under the electric outage condition when connecting the Extension units. Failure to do so may cause electric shock, a failure of the unit, a fire etc.

6. Attaching and removing the unit

6.1 Mounting on IEC rail

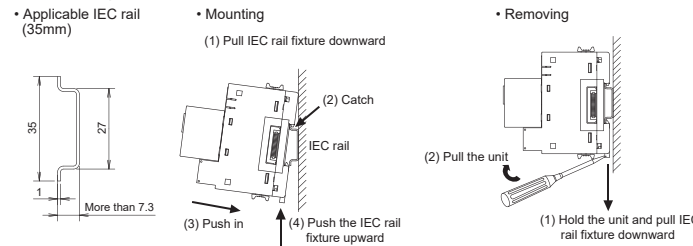

6.2 Mounting on JIS agreement type attachment

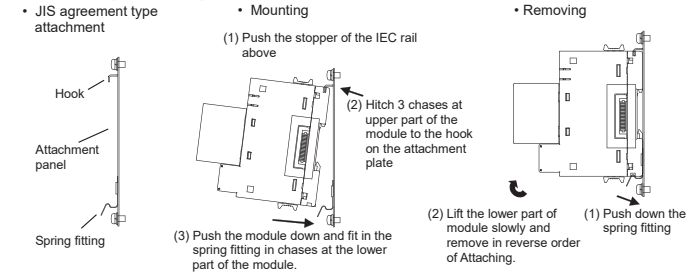

7. How to wire

7.1 Wiring

Follow the wiring diagram for external connections of this unit.


To use this unit, Base unit (EMU4-BM1-MB, EMU4-HM1-MB, EMU4-LG1-MB, EMU4-CNT-MB) is necessary.

When using this unit, current sensor (EMU-CT***, EMU-CT***-A, EMU2-CT5 or EMU2-CT5-4W) is necessary

(Note) *** indicates the rated current of the current sensor (50/100/250/400/600).


For the other examples, refer to "User's Manual (Details)".

For the pulse input system

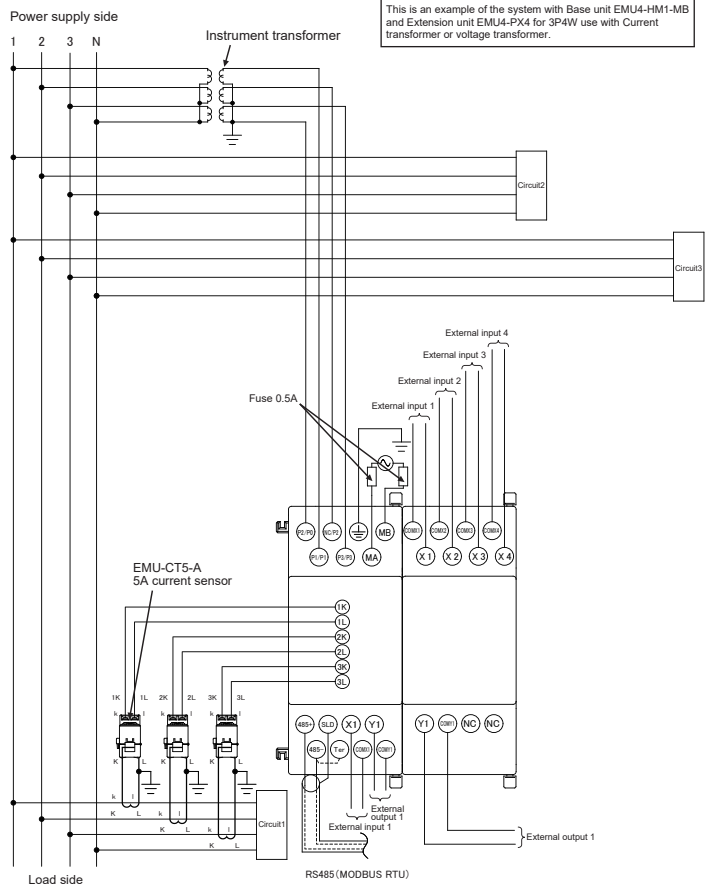


(Note 1) If UL standard/CE Marking compliant, a fuse is required. Below are the recommended fuses.
Rated current: 0.5 A, Rated breaking capacity: 250 V AC 1,500 A / 250 V DC 1,500 A (a UL certified product)

For analog input system

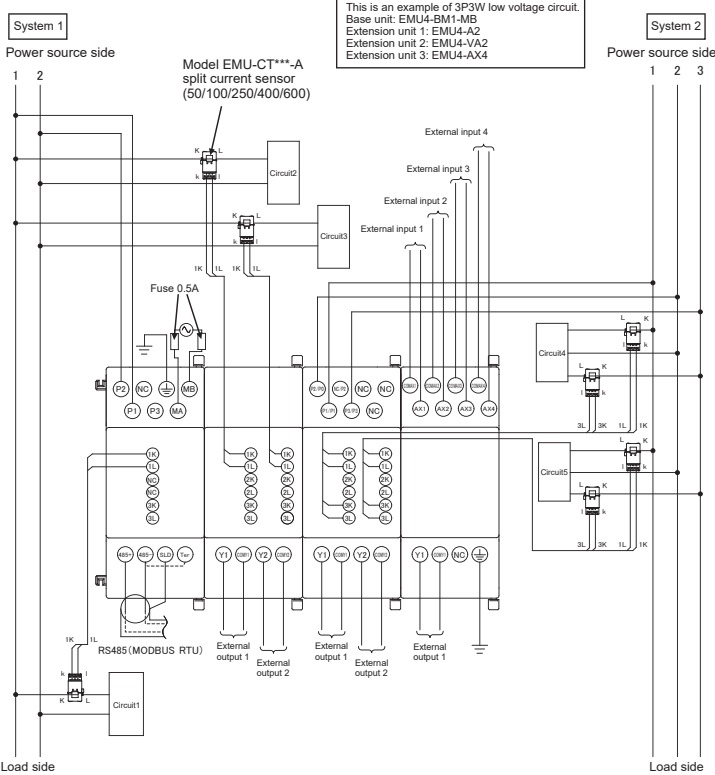

(Note) Connect the k terminal on the secondary side of the dedicated current sensor to the k terminal of the Energy Measuring Unit. Connect the l terminal on the secondary side of the current sensor to the l terminal of the Energy Measuring Unit. Perform the same processing for the 2k, 2l, 3k, and 3l terminals.

8. Dimensions

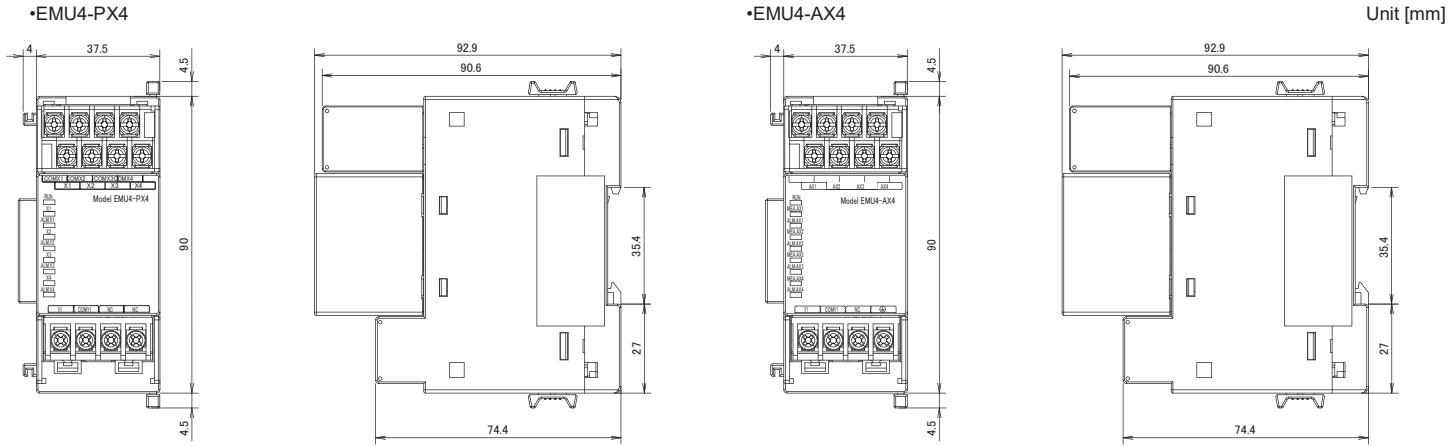

9. Specifications

Item		Specifications	
Model		EMU4-PX4	EMU4-AX4
External input	Number	4 inputs	
	Signaling system	No voltage a-contact, Open collector	
	Isolation system	Photo coupler isolation	
	Rated input	6.5V DC 10mA (Supplied from the unit)	
	voltage/current	Voltage : 0 to +5V (input resistor 1MΩ) Current : 0 to 20mA (input resistor 250Ω) *Input range (voltage / current) can be switched. (Can be switched for each channel by the setting.)	
	Input pulse conditions	Pulse ON time: more than 30ms OFF time : more than 30ms Chattering time : less than 3ms	
	Measurement item	Pulse input : pulse conversion, pulse count Contact input : operating time, contact state *External input (pulse input / contact input) can be switched. (Can be switched for each channel by the setting.)	
	Range of measured values	Pulse count : 0 to 999999 Pulse conversion : 0.000 to 999,999,000	
External output	Measurement accuracy	-	
	Output signal type	No voltage a-contact 1 output	
Operating Environment	Rated open/close voltage/current	35V DC 75mA 24V AC, 75mA (power factor = 1)	
	Operating temperature	-5 to +55°C (Under the conditions indicated in section 3.1)	
	Operating humidity	30 to 85%RH (No condensation)	
	Storage temperature	-10 to +60°C	
Standard	Operating altitude	2000m or below	
		CE marking (EMC: EN-61326-1: 2013) UL: UL61010-1	

10. Contained harmful substances

(1) 电器电子产品有害物质限制使用标识

根据《电器电子产品有害物质限制使用管理办法》，该标识适用于在中国销售的电器电子产品，其中的数字为产品的环保使用期限。只要遵守本产品在安全和使用方面的注意事项，从生产日期起的环保使用期限内不会造成环境污染或对人体、财产产生深刻的影响。
注) 产品正常使用废弃后，应按照国家 and 地方的法律法规完成该电器电子产品回收和再利用。

(2) 产品中有害物质的名称及含量

本产品中所含有的 6 种有害物质的名称、含有信息及含有部件如下表所示。

部件名称	有害物质					
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr(VI))	多溴联苯 (PBB)	多溴二苯醚 (PBDE)
基板	×	○	○	○	○	○
箱子	○	○	○	○	○	○
端子盖	○	○	○	○	○	○
螺钉	○	○	○	○	○	○
铭牌	○	○	○	○	○	○
接线	○	○	○	○	○	○
接线皮	○	○	○	○	○	○

本表格依据 SJ/T11364 的规定编制。

○：表示该有害物质在该部件所有均质材料中的含量均在 GB/T 26572 规定的限量要求以下。

×：表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T26572 规定的限量要求。

且虽然目前业界没有成熟的替代方案，但是符合欧盟 RoHS 指令要求。

11. Warranty

• The charge-free warranty is effective until the earlier of 1 year after the date of your purchase or 18 months after manufacturing. Repair shall be charged for the case failures occur due to your intent or fault even during the charge-free warranty period.

• Please check ALM A1 LED and ALM A2 LED turn off the light.
(ALM A1 LED and ALM A2 LED lighting show errors occur)

• If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

• Our company shall not be liable to compensate for any loss arising from events not attributable to our company, opportunity loss and lost earning of the customer due to failure of the product, and loss, secondary loss, accident compensation, damage to other products besides our products and other operations caused by a special reason regardless of our company's predictability.

Caution If an abnormal sound, bad-smelling smoke, fever break out from this unit, switch it off promptly and don't use it.

12. Customer Service

MITSUBISHI ELECTRIC CORPORATION
HEAD OFFICE: TOKYO BUILDING, 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, Japan

Please refer to our website for service network.
Our website address: <https://www.mitsubishielectric.com/fa/>